

Probabilistic Modeling of
Data Centers
Cooling, Capacity and Diagnosis

Ricardo Marquez

Working draft

Preface

This book is written for an engineer who knows conservation laws and linear algebra and has never met a probabilistic graphical model. It takes one idea and follows it through: that the structure of a physical system, the way conserved quantities accumulate at places and move between them and cross the system's boundary, is also the structure of every probabilistic question one can ask about that system. A model of the physics is a graph. A model of what we do not know about the physics is the same graph with probability attached to it. Inference on that graph is how a measurement in one place becomes knowledge about another, how a failure is diagnosed, how a decision is justified.

This edition takes its examples from the data center: the chassis and the rack, the row and its containment, the hall and its air, the chilled-water plant, and the campus that pays the bill. A data center is a good system to point that idea at, for a reason the book makes precise. It is a hierarchy that was drawn by engineers — device inside chassis inside rack inside row inside hall inside building inside campus — and the levels nest because the cuts nest. It conserves several quantities at once on the same graph: heat, air, water and electrical power. Its instruments are sparse relative to what an operator wants to know, so most of the questions are inference questions rather than reading questions. And the decisions it forces — where to put the next server, whether the economizer pays, which of two identical racks carries the hidden load — are decisions under uncertainty with money and uptime attached.

Every system worth modeling is a piece cut out of a larger one, trading a conserved quantity with an environment it does not model. For a data center the pieces nest: a server trades air and power with its rack, a rack with its row, a contained aisle with its hall, and the hall with the chilled-water plant and the utility feed. At each level the boundary is where one model stops and the next begins, and it is where the modeler's knowledge is thinnest. As the later chapters show, it is also where the mathematics of inference does its most useful work, and the nesting of the boundaries is why the hierarchy is also a good way to divide the computation. Chapter 1 names such a system a *boundary-exchanging system*.

Nothing in the method of Parts I to V is specific to data centers. The balances, closures and ports are the same whether the conserved quantity is heat, air, water or power, and a data center conserves all four on one graph; Table 1.3 lines them up. Three companion editions take the same method text through electric power transmission, water distribution, and district heating and cooling. Each is complete in itself, and a reader of this one needs none of them.

The Introduction says why the book exists, what it inherits from four older traditions, what it adds, and how to read it. Part I is deterministic and establishes the objects. Part II attaches probability to them and states, rather than skips, the places where that attachment needs care. Part III is inference. Part IV asks the questions an operator actually asks. Part V handles time, hierarchy and scale. Part VI is ten complete studies at every level of the hierarchy, from which of two identical racks carries the load to how much of a hall's capacity can actually be used, and

each can be reproduced from the material in the earlier parts. Each chapter ends with a short section of notes that says which of its ideas are inherited and from where, and which are the book's own.

Contents

Preface	ii
0 Introduction	1
0.1 The questions a data center operator asks	1
0.2 Where the graph comes from	2
0.3 One subject, not four	3
0.4 Probability in the structure, not around the solver	5
0.5 The boundary	6
0.6 From “what is the state” to “what can I know”	6
0.7 What is inherited and what is the book’s	7
0.8 How to read this book	7
0.9 What this book does not do	9
Notes and further reading	9
I Physical systems as graphs	10
1 Conservation, closure, and the boundary	11
1.1 Three questions about any system	11
1.2 Nodes conserve	12
1.2.1 The balance law	12
1.2.2 Node roles	12
1.2.3 Incidence	13
1.3 Edges close	13
1.3.1 Closure relations	14
1.3.2 A closure is a relation, not an assignment	14
1.3.3 Parameters	15
1.4 The boundary	15
1.4.1 Reservoirs and imposed conditions	15
1.4.2 Exactness at a cut	16
1.4.3 Why the boundary matters most	17
1.5 The residual system	17
1.5.1 Well-posedness	18
1.5.2 Sparsity	18
1.6 Three worked examples	19
1.7 In practice	26

1.8	What is missing	27
	Notes and further reading	28
	Summary	28
	Exercises	29
	Solutions to selected exercises	29
	Problems from the studies	30
2	From equations to factor graphs	31
2.1	The rows as a graph	31
2.2	Three languages	32
2.2.1	Directed graphs	32
2.2.2	The directionality problem	33
2.2.3	Undirected graphs	35
2.2.4	Factor graphs	35
2.3	The physical system as a factor graph	36
2.3.1	A bus is not a variable	37
2.3.2	Two domains on one graph	37
2.4	The factor graph is not unique	38
2.5	Vocabulary	39
2.6	In practice	40
2.7	What is missing	41
	Notes and further reading	41
	Summary	42
	Exercises	43
	Solutions to selected exercises	43
	Problems from the studies	44
II	Probability on a physical graph	45
3	Where probability enters	46
3.1	A probability on the state	46
3.2	Five kinds of factor	47
3.2.1	Priors	47
3.2.2	Closure factors	48
3.2.3	Conservation factors	48
3.2.4	Measurement factors	49
3.2.5	Failure factors	49
3.2.6	The complete list	50
3.3	The joint as an objective	50
3.3.1	Residuals in units of their widths	51
3.3.2	Conditioning a Gaussian on one reading	51
3.4	A worked example: one sensor, then two	54
3.5	A second example: the triangle with a flow meter	56
3.6	Reading the graph	59
3.7	In practice	60
3.8	What is missing	61

Notes and further reading	61
Summary	62
Exercises	62
Solutions to selected exercises	62
Problems from the studies	63
4 Hard constraints, soft constraints, and the manifold	64
4.1 The hard joint and its manifold	64
4.2 Conditioning on the manifold	65
4.3 The soft joint	66
4.4 Why soften	67
4.5 Choosing the widths	68
4.6 Worked example: the chain with soft physics	70
4.7 A second example: the triangle with an unmodeled load	72
4.8 In practice	75
4.9 What is missing	75
Notes and further reading	76
Summary	76
Exercises	77
Solutions to selected exercises	77
Problems from the studies	78
5 Factorization, separators, and treewidth	79
5.1 Factorization is not independence	79
5.2 Reading independence off the graph	80
5.3 Explaining away, precisely	81
5.4 Ports are separators	82
5.5 Elimination and fill	83
5.5.1 One elimination	83
5.5.2 Order and width	84
5.5.3 What this means for a physical graph	85
5.6 Worked examples: counting width and fill	86
5.7 Why separators matter for cost	88
5.8 In practice	90
5.9 What is missing	91
Notes and further reading	91
Summary	91
Exercises	92
Solutions to selected exercises	92
Problems from the studies	93
6 The linear-Gaussian case	94
6.1 The Gaussian in information form	94
6.2 The most probable state	95
6.2.1 Gauss–Newton against Newton	96
6.3 Elimination is Cholesky	96
6.3.1 What the factorization costs	97

6.4	The Laplace posterior	99
6.5	Worked example: the chain in matrix form	99
6.6	Second worked example: the triangle in matrix form	102
6.7	Filters, fields, and state estimators	104
6.8	In practice	105
6.9	What is missing	106
	Notes and further reading	106
	Summary	106
	Exercises	107
	Solutions to selected exercises	107
	Problems from the studies	108
7	Beyond Gaussian: hybrid states and nonlinearity	110
7.1	Four ways out of the Gaussian world	110
7.2	Hybrid states: the mixture over branches	111
7.2.1	Worked example: a feeder that may be out	112
7.2.2	Many discrete variables	113
7.3	Piecewise closures and regimes	114
7.3.1	Worked example: a thermostat	114
7.4	Strong nonlinearity	116
7.5	Bounded parameters	117
7.6	What survives	118
7.7	In practice	119
7.8	What is missing	119
	Notes and further reading	120
	Summary	120
	Exercises	121
	Solutions to selected exercises	121
	Problems from the studies	123
III	Inference	124
8	Exact inference: elimination, junction trees, Schur complements	125
8.1	What exact means	125
8.2	Messages on a tree	125
8.3	Loops: the junction tree	127
8.4	Regions and ports: the Schur complement as a message	128
8.5	Reuse	130
8.6	Worked example: two regions, one cross-tie	131
8.7	Second worked example: two halls and a wall	132
8.8	Discrete variables by region	134
8.9	In practice	135
8.10	What is missing	136
	Notes and further reading	136
	Summary	137
	Exercises	138

Solutions to selected exercises	138
Problems from the studies	140
9 Approximate inference	141
9.1 When exact is too expensive	141
9.2 Loopy belief propagation	142
9.2.1 On the book's models	142
9.3 Variational methods and expectation propagation	144
9.4 Simulation inside a region	146
9.4.1 What a mixture message loses when collapsed	147
9.4.2 Worked example: a chilled-water plant as a simulated region	147
9.5 Pruning by evidence	149
9.6 The hierarchy, and how to choose	150
9.7 In practice	151
9.8 What is missing	152
Notes and further reading	152
Summary	152
Exercises	153
Solutions to selected exercises	154
Problems from the studies	155
10 Enumeration, Monte Carlo, and factorized inference	156
10.1 The question, stated honestly	156
10.2 The problem	157
10.3 Enumeration: the product grid	157
10.4 Monte Carlo	159
10.5 Attribution: where the structural difference appears	160
10.6 The factorized route: cuts of the dependency graph	161
10.7 Second worked example: two chilled-water plants	162
10.8 Beyond three inputs	166
10.9 The claim	166
10.10 In practice	167
10.11 What is missing	168
Notes and further reading	168
Summary	168
Exercises	169
Solutions to selected exercises	169
Problems from the studies	170
11 Sequential evidence	171
11.1 Readings arrive one at a time	171
11.2 One reading, one rank-one update	171
11.3 The innovation	172
11.4 Many readings	173
11.5 Worked example: a stream of flow readings	174
11.6 The Laplace posterior and re-linearization	175
11.7 The value of a reading before it is taken	176

11.8 Cost at scale	178
11.9 Worked example: where to put the next thermometer	179
11.10 In practice	180
11.11 What is missing	181
Notes and further reading	181
Summary	182
Exercises	182
Solutions to selected exercises	183
Problems from the studies	184
 IV The operator's questions	 185
 12 Conditioning, diagnosis, and virtual sensors	 186
12.1 Everything is a readout	186
12.2 Virtual sensors	186
12.3 Is the model adequate?	187
12.4 Where is it wrong?	188
12.5 Worked example: bad data on a power network	189
12.6 Which explanation?	190
12.7 Can this parameter be recovered?	191
12.8 Worked example: can fouling be seen?	192
12.9 Which sensor next?	193
12.10 Should the Gaussian be believed?	195
12.11 In practice	197
12.12 What is missing	197
Notes and further reading	197
Summary	198
Exercises	199
Solutions to selected exercises	199
Problems from the studies	200
 13 Interventions and counterfactuals	 201
13.1 Why the graph is not enough	201
13.2 Rows are mechanisms; inputs are exogenous	201
13.3 Seeing versus doing, on the chain	202
13.4 Counterfactuals: three steps	204
13.5 Decisions as branches	207
13.6 Worked example: an afternoon heat wave	208
13.7 Worked example: holding the tie flow	210
13.8 What the semantics does not decide	211
13.9 In practice	211
13.10 What is missing	212
Notes and further reading	212
Summary	213
Exercises	213
Solutions to selected exercises	214

Problems from the studies	215
14 Attribution, sensitivity, and certificates	216
14.1 Three questions, one derivative	216
14.2 Sensitivities from the solve	216
14.3 Attribution	217
14.4 A census with gradients	219
14.4.1 What the census answers	220
14.4.2 The three-feeder problem	220
14.5 The kink	222
14.6 Worked example: convexity lost and recovered	223
14.7 Conditions	226
14.8 In practice	227
14.9 What is missing	227
Notes and further reading	227
Summary	228
Exercises	229
Solutions to selected exercises	229
Problems from the studies	230
15 Combinatorial failure	231
15.1 The question	231
15.2 The prior over failure sets	232
15.2.1 Independent failures	232
15.2.2 Failure as an intervention	233
15.3 The consequence per branch, and how to get it cheaply	233
15.4 Worked example: a six-bus distribution	234
15.5 The posterior over failure sets	236
15.6 Enumeration by regions	237
15.7 The worst k -set as a query	238
15.8 Common cause and correlated failure	239
15.8.1 A shared shock	239
15.8.2 A mixture over the rate	239
15.9 Worked example: a cooled room	240
15.10 In practice	242
15.11 What is missing	242
Notes and further reading	243
Summary	243
Exercises	244
Solutions to selected exercises	244
Problems from the studies	245
V Time, hierarchy, and scale	246
16 Dynamics and temporal factors	247
16.1 The accumulation term made live	247

16.2	Integration as a sequence of steady solves	248
16.3	The unrolled graph	249
16.4	Process noise	250
16.5	Filtering, smoothing, and prediction as eliminations	251
16.6	Worked example: tracking a drifting source	252
16.7	Detecting a change in time	253
16.8	Two hypotheses the steady state cannot separate	254
16.9	Events and cascades	255
16.10	Worked example: the conductors of the six-bus distribution	256
16.11	In practice	258
16.12	What is missing	259
	Notes and further reading	259
	Summary	259
	Exercises	260
	Solutions to selected exercises	261
	Problems from the studies	261
17	Hierarchy as physical decomposition	262
17.1	One conservation law used twice	262
17.2	Nested messages	263
17.3	What the parent needs to know	264
17.4	Worked example: a machine room in three levels	265
17.5	The cut, three times	269
17.6	Worked example: a rack row under a distribution unit	270
17.7	Hierarchy in time	271
17.8	In practice	273
17.9	What is missing	274
	Notes and further reading	274
	Summary	274
	Exercises	275
	Solutions to selected exercises	275
	Problems from the studies	276
18	Partitioning at scale	277
18.1	The cost of a cut	277
18.2	Elimination width of physical networks	278
18.3	Choosing the cut	279
18.4	Coupling the regions: messages, propagation, or iteration	281
18.5	Enumeration by region	284
18.6	The machinery is not this domain's	287
18.7	In practice	288
18.8	What is missing	288
	Notes and further reading	288
	Summary	289
	Exercises	289
	Solutions to selected exercises	290
	Problems from the studies	291

VI Case studies	292
19 Case studies	293
19.1 What a case study is here	293
19.2 The studies	294
19.3 Reading a case study	294
20 Three routes on two halls	295
20.1 The question	295
20.2 The system	296
20.3 The three routes	296
20.4 Results	297
20.5 What surprised	299
20.6 Reproducing the run	299
Notes and further reading	300
21 Which of two identical racks	301
21.1 The question	301
21.2 The system	301
21.3 Two representations of the same posterior	302
21.4 Results	302
21.5 What surprised	304
21.6 Reproducing the run	305
Notes and further reading	306
22 Where the Gaussian band stops	307
22.1 The question	307
22.2 The system	307
22.3 Three things are computed at each point	308
22.4 Results	308
22.5 What surprised	311
22.6 Reproducing the run	311
Notes and further reading	312
23 The expensive chiller nobody sees	313
23.1 The question	313
23.2 The plant	313
23.3 Method	314
23.4 Results	314
23.5 What surprised	315
23.6 Reproducing the run	317
Notes and further reading	317
24 When one explanation is not enough	318
24.1 The question	318
24.2 The hypotheses	318
24.3 Results	319
24.4 What surprised	320

24.5 Reproducing the run	321
Notes and further reading	321
25 Telemetry you should not trust	322
25.1 The question	322
25.2 Four corruptions	322
25.3 Results	323
25.4 What surprised	324
25.5 Reproducing the run	325
Notes and further reading	325
26 Which sensor to install next	326
26.1 Which reading to take now	326
26.2 Which four to install	327
26.3 What surprised	328
26.4 Reproducing the runs	329
Notes and further reading	330
27 How much capacity can we actually use	331
27.1 The question	331
27.2 The building	331
27.3 Results	332
27.4 What surprised	333
27.5 Reproducing the run	334
Notes and further reading	334
28 What the graph is worth	335
28.1 The question	335
28.2 The system	335
28.3 Results	336
28.4 What surprised	337
28.5 Reproducing the run	338
Notes and further reading	338
29 Same heatwave, four resolutions	339
29.1 The event and the facility	339
29.2 What each resolution can see	339
29.3 What each resolution does	340
29.4 What surprised	341
29.5 Reproducing the run	342
Notes and further reading	342
A Notation	343
A.1 Conventions	343
A.2 Symbols	344
A.3 Letters with more than one meaning	347

B	Gaussian identities	349
B.1	The two forms of a Gaussian	349
B.2	Block matrices	350
B.3	Marginals and conditionals	351
B.4	Products and linear-Gaussian models	352
B.5	Rank-one changes	353
B.6	Integrals, quadratic forms and divergences	353
B.7	The Laplace approximation	354
B.8	Where the book uses each identity	355
C	From the book to the engine	356
C.1	What TERRA is	356
C.2	A model in a dozen lines	357
C.3	Where each construction lives	357
C.4	The case studies	358
D	A catalogue of closures	360
D.1	How to read an entry	360
D.2	The four patterns in the engine	362
D.3	Thermal	362
D.4	Fluid	364
D.5	Moist air	366
D.6	Electrical	366
D.7	Storage and electrochemistry	368
D.8	Plant equipment	368

Chapter 0

Introduction

An inlet-temperature alarm trips on one rack in the middle of a row. Its neighbors are cool, and the cooling units report normal supply air. The list of explanations is short. Hot exhaust is finding its way back to the rack's front, over the top of the row or through a gap where a blanking panel should be. Or a cooling coil has fouled and is delivering less than its setpoint implies. Or the inlet sensor has been moved, or has drifted. Or the new deployment in that rack is drawing more than its nameplate. The facility knows its electrical load at the power distribution units and its air temperatures at a few points per row, and the decision that follows has money and uptime attached: move the load, add airflow, or accept the risk.

The engineer on shift already has the physics of that hall: an energy and an air balance at every rack, aisle and plenum, a conductance or a fan curve on every path the air can take, a coil effectiveness at every cooling unit, and the chilled-water supply temperature imposed. Given the loads, a solver turns those equations into every temperature and every airflow. What the solver cannot do is run the other way: take a row's worth of sensor readings and say which of the explanations they support, how strongly, what the inlet temperature is at the racks nobody measures, and whether the row can take the next deployment. Probabilistic graphical models supply that machinery. They are usually taught apart from conservation laws, constitutive relations and engineering solvers, and the engineer who wants both has had to learn two subjects and build the bridge alone. This book is the bridge. Its claim is that the bridge is short, because the graph the probabilistic machinery needs is already there in the equations the engineer wrote, and that once the graph is recognized, every question on the shift's list is a readout of one object. This chapter says why that claim is worth a book, what it inherits from four older traditions, what it adds, and how to read it.

0.1 The questions a data center operator asks

A model of a physical system, as engineering teaches it, is a set of equations and a solver. The equations are the balances, the closures and the boundary conditions; the solver turns known inputs into a computed state. The pipeline is

$$\text{inputs} \longrightarrow \text{solver} \longrightarrow \text{outputs}, \quad (0.1)$$

and it answers one question well: given these inputs, what is the state? Most textbooks on physical modeling stop there, and for design that is often enough.

Operation asks different questions. A data center is instrumented for billing and for alarms more than for understanding: power at the distribution units and sometimes at the outlets, air temperatures at a few heights on a few racks per row, supply and return temperatures at each cooling unit. The sensors are noisy, some are misplaced, and none reads the airflow that decides where the heat goes. Coils foul. Fans wear. Loads arrive with a nameplate rating that is a ceiling, not a measurement. The questions an operator or a capacity planner actually asks are:

- What are the temperatures and airflows across the hall now, given a few sensors per row and a model I only partly trust?
- Has that cooling unit's coil fouled, and by how much?
- What is the inlet temperature at the racks nobody measures?
- Which of two identical racks carries the hidden load, and is the hot inlet recirculation, a fouled coil, a misplaced sensor or real load?
- How uncertain is each of those answers?
- Where should the next sensor go, and what would it be worth?
- What would happen if I moved that load, raised the supply-air setpoint, or took that cooling unit out for maintenance?
- Which uncertain load or airflow drives the risk of an inlet excursion, whether the economizer pays today, and is the number I am about to report a floor, a ceiling or a guess?

None of these is a question the pipeline (0.1) can answer. Each asks the model to run in a direction other than inputs to outputs, or to weigh a reading against a law, or to compare explanations, or to say how far its own answer can be trusted. The pipeline has no place to put a reading, no notion of an explanation, and no measure of trust.

The book's starting observation is that the equations do not have to be rewritten to answer these questions. They have to be read differently. A balance says that certain flows sum to zero at a node; a closure says that a flow and two potentials satisfy a relation; a boundary condition says that a quantity has a value. Each is a statement about which combinations of the variables are admissible. Attach to each a statement of how far from admissible the system may be, attach to each uncertain input a statement of what is known about it, attach to each sensor a statement of what it read and how well, and the collection is a probability distribution over the entire state of the system, built from nothing but the physics and the instruments. Every question in the list is then a question about that distribution, and Parts II to IV of this book are about answering them.

0.2 Where the graph comes from

A textbook on probabilistic graphical models begins with random variables and their joint distributions, defines directed and undirected graphs and the factorizations they encode, develops conditional independence, and then teaches inference on the graph. The examples are alarms and burglaries, diseases and symptoms, letters and their noisy transmissions. It is a coherent subject and the machinery is powerful, but an engineer arriving from the physical side asks a question the textbook does not answer: where did the graph come from? For an alarm and a burglary the graph is a modeling decision, drawn from a story about what causes what. For a cooling coil, a rack row or a chilled-water plant it is not a decision at all.

For a physical model the graph is the sparsity pattern of the equations. Each balance reads the flows at one node. Each closure reads one flow and the potentials at its ends. Each boundary condition reads one variable. Draw a node for every variable and a node for every equation,

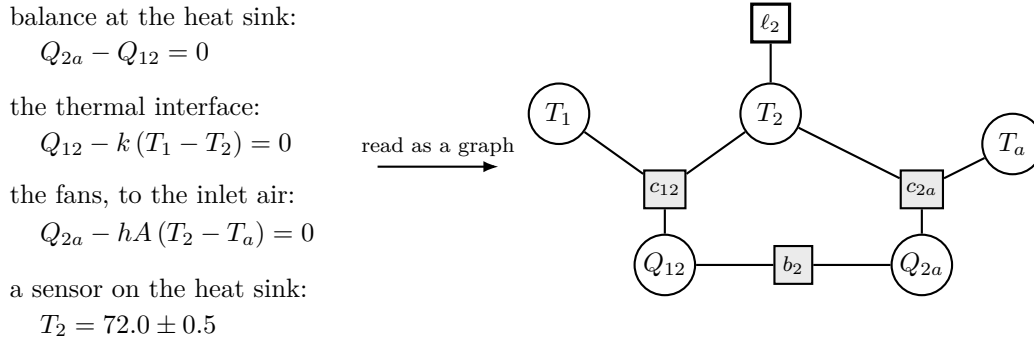


Figure 0.1: The graph comes from the equations. Left: three physics equations of the processor’s heat path of Example 1.1 and one sensor reading, as an engineer writes them. Right: the same four statements as a factor graph. Each equation is a square joined to exactly the variables it reads; the sensor is a square of degree one. Nothing was decided in drawing it.

Table 0.1: What each object of a physical model becomes when probability is attached. The graph is unchanged; only the meaning of the squares is.

In the equations	In the factor graph	With probability attached
balance at a node	a factor on the node’s flows	conservation, to within a small width
constitutive relation	a factor on a flow and two potentials	closure, to within its model error
boundary condition	a factor of degree one	a prior on the boundary value
uncertain parameter	a variable in every closure reading it	a prior on the parameter
sensor	(absent)	a likelihood of degree one on its variable
component in or out of service	(absent)	a discrete variable in its closure’s scope

join each equation to the variables it reads, and the result is a factor graph, the bipartite graph on which the probabilistic machinery operates (Figure 0.1). No modeling decision was made in drawing it, because every edge was already an entry of the Jacobian that the solver assembles. The graph is the model’s structure, seen.

Attaching probability then changes what the squares mean and not where they are. A balance equation becomes a factor that says the balance holds to within a small tolerance. A closure becomes a factor that says the constitutive law holds to within its model error. An uncertain parameter or boundary condition gets a prior, a square of degree one on its variable. A sensor becomes a likelihood, another square of degree one, on the variable it reads. A component that may be in service or out becomes a discrete variable in the scope of the closure it governs. Table 0.1 lists the correspondence, which Chapter 3 develops. The bridge from the engineer’s equations to the graphical model is this table, and it is short.

0.3 One subject, not four

Little in this construction is new in isolation, and it would be wrong to present it as if it were. Four traditions have each built part of it, and the book is written in the conviction that they are one subject that has been taught as four.

Port-based physical modeling. Bond graphs, network thermodynamics and port-Hamiltonian systems supply the domain-independent view of a physical system as

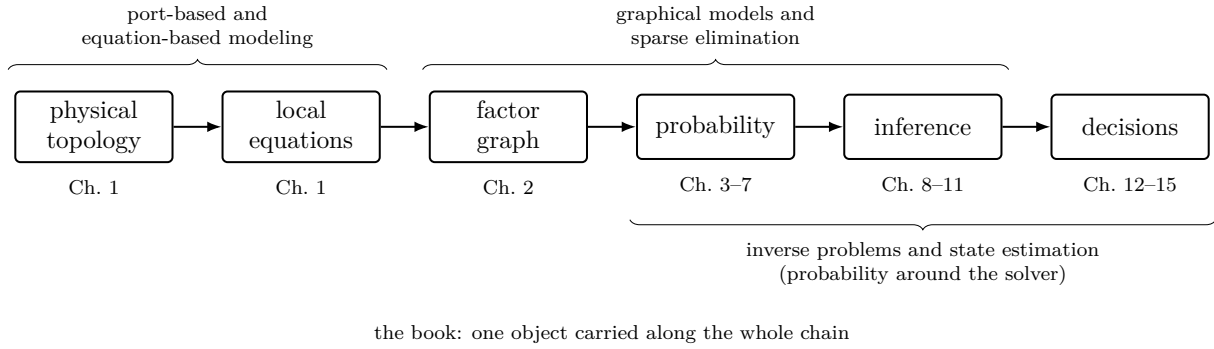


Figure 0.2: The chain of ideas the book follows, with the chapters that cover each link and the traditions that own parts of it. No one tradition carries the object from the topology to the decision.

conserved quantities at nodes, flows driven by potentials along edges, and conjugate flow-and-potential pairs at ports, the same structure whether the domain is thermal, fluid, electrical or mechanical [43, 76, 79, 104]. This tradition stops at the equations: it says how to write $\mathbf{F}(\mathbf{z}) = \mathbf{0}$ for any physical system, and then solves.

Equation-based modeling. Acausal modeling languages and the structural analysis of differential-algebraic systems establish that a physical law is a relation among variables, not an assignment of an output from inputs, and they give the bipartite equation-variable structure and its matching theory [6, 22, 72, 78]. This tradition, too, stops at the solve, and it does not attach probability.

Probabilistic graphical models and sparse elimination. Factor graphs, Markov properties, separators, elimination, fill and treewidth come from the graphical-model and sparse-matrix literatures [17, 50, 54, 56, 87]. This tradition starts from a factorized distribution and asks how to compute with it; it does not say where the factorization comes from, and its graphs are drawn, not derived.

Bayesian inverse problems and state estimation. Priors on uncertain physical inputs, sensors as likelihoods, weighted least-squares estimation under conservation constraints, and the diagnosis of bad data are established in inverse problems, in power-system state estimation, and in process data reconciliation [1, 41, 65, 73, 98], and in data centers they meet the thermal mapping of a hall from its own sensors [74]. This tradition does attach probability to physics, but usually around the solver: the physics is a black-box map from inputs to observables, and the posterior is over the inputs alone.

Put the four end to end and they make one chain,

$$\boxed{\text{physical topology} \rightarrow \text{local equations} \rightarrow \text{factorization} \rightarrow \text{probability} \rightarrow \text{inference} \rightarrow \text{engineering decisions}} \quad (0.2)$$

of which each tradition owns one or two links and none carries the whole. Figure 0.2 draws it, with the chapters of this book placed along it. The book's purpose is to make the chain feel like one subject: to start where the engineer starts, at the topology and the equations, and to arrive where the operator needs to be, at a decision with its uncertainty stated, without changing the object along the way.

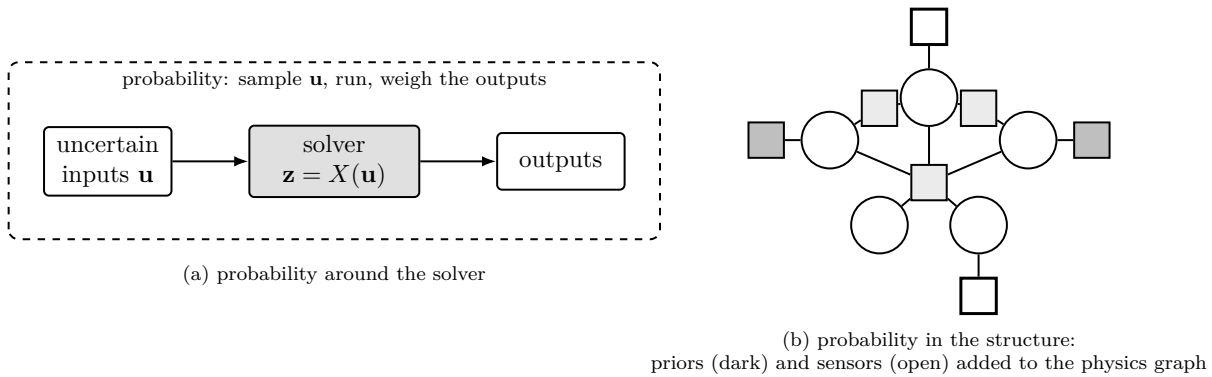


Figure 0.3: Two ways to combine physics and probability. (a) The solver is a black box; probability lives outside it, over its inputs and outputs. (b) The physics equations are the factors; priors and sensors are squares added to the same graph. The book takes the second route and says why.

0.4 Probability in the structure, not around the solver

There is an obvious way to combine a physical model with probability, and most of the fourth tradition uses it: leave the solver as it is, treat it as a function from uncertain inputs to observable outputs, draw inputs from their priors, run the solver, and reason about the outputs. The physics is a black box inside a probabilistic wrapper. Figure 0.3 draws it on the left. It is correct, it is general, and it is how a great deal of uncertainty quantification is done.

The book takes the other route, drawn on the right: the equations themselves are the factors, and probability lives inside the structure, on every variable the physics has. The thesis of the book, in one sentence, is

Do not put probability around the solver. Put it into the structure of the physical model.

(0.3)

Three consequences follow, and they are what the later chapters are about.

There is one object. The deterministic solve is the special case of the probabilistic model in which the priors and sensors are absent and the physics is exact; the two share every row and every Jacobian (Chapter 6 proves this). Adding a sensor adds a row. Adding a question adds nothing: the estimate, the diagnosis, the counterfactual and the risk are readouts of one posterior (Chapter 12).

Structure is preserved, and structure is what computation costs. The wrapper's map from inputs to outputs is dense: every output depends on every input. The physics graph is sparse: every equation reads a few variables. The posterior built in the structure has the sparsity of the physics, and every computation in Part III is affordable because of it. The wrapper's route discards the sparsity the moment it closes the box.

Violation can be seen. A wrapper enforces the physics exactly, because the solver does. When the sensors report something no state of the physics can produce, the wrapper has no answer. The structural model gives each law a width, lets it be violated at a cost, and reports the violation as a diagnosis: the recirculating exhaust, the misplaced sensor, the missing blanking panel (Chapters 4 and 12).

0.5 The boundary

Every system worth modeling is a piece cut out of a larger one. A server trades air and power with its rack, a rack with its row, a contained aisle with the hall, and the hall with the chilled-water plant and the utility feed. The piece has an inside that the modeler describes and a boundary across which conserved quantities pass to an outside the modeler does not describe. Chapter 1 calls such a piece a *boundary-exchanging system*, and the book returns to the boundary at every level for a reason that is easiest to state in the language of the third tradition.

In a graphical-model text, a *separator* is a set of variables whose knowledge makes two parts of the graph independent, and finding one is a graph-theoretic exercise whose reward is a cheaper computation. Data center designers drew their separators before any theory asked them to. A rack exchanges air with the room only through its front and back faces, and power only through its distribution units; a contained aisle exchanges air with the hall only through the racks and the cooling units that bound it. The airflows and temperatures at those faces, a flow and its conjugate potential at each port, are exactly the variables that separate a rack’s or an aisle’s interior from the rest of the hall (Chapter 5 proves it, and proves that nothing smaller does). So the instruction “find a separator” becomes “cut the hall at the rack faces and the containment”, which is where the designer has already cut it, and the mathematics then explains why that cut is also the cheap place to divide the computation. A missing blanking panel is, in this reading, a hole in the separator.

This gives one decomposition three readings at once. Physically, a subsystem is summarized to its neighbors by what crosses its ports, exactly, because conservation says the cut flows equal the net source inside. Probabilistically, the ports are a separator, so a subsystem’s message to the rest of the system is a function of the ports alone. Computationally, eliminating the interior onto the ports is the Schur complement of sparse elimination, the Kron reduction of network theory, and the region message of a junction tree, which are one operation (Chapter 8). A region can be an equivalent network with error bars, computed once and reused; a large system can be a tree of regions (Chapter 17); and a partition can be judged by its ports (Chapter 18). The three-way connection is the part of the book for which the author has found the least direct precedent, and it is the reason the boundary is in the title.

0.6 From “what is the state” to “what can I know”

The pipeline (0.1) has a direction: inputs in, outputs out. A physical law does not. The relation

$$Q - UA(T_h - T_c) = 0 \tag{0.4}$$

says that four quantities satisfy one constraint. It does not say that Q is computed from the temperatures; given Q and T_h it determines T_c , and given all three it determines UA , which is how a fouled cooling coil is found (§12.8). Which variable is unknown is a property of the question, not of the physics (Chapter 2 makes this precise, and shows that for a looped system no fixed direction exists at all). The book keeps the relations as relations, which is what the second tradition insists on and what the first tradition’s bond graphs draw, and it is why the factor graph rather than the directed graph is the book’s language.

Once uncertainty and observations enter, the absence of direction becomes the point. A reading of one temperature is evidence about everything the physics ties to it. On the processor’s heat path that runs through the book, a single thermometer on the heat sink cuts the uncertainty

in the processor's unmeasured power by a factor of three and a half, and predicts the unmeasured package temperature to within a degree and a half, before any second sensor is read (Chapter 3). That prediction is a *virtual sensor*, and its error bar is part of the answer. The question the model answers has changed from "what is the state, given the inputs" to "what can I know, given what I have", and the second question is the operator's.

0.7 What is inherited and what is the book's

A book that combines old ingredients owes its reader a clear account of which is which. Each chapter closes with a section of notes that does this for its own contents. The account for the whole is short.

Inherited: the port-based view of physics; the acausal reading of its equations; the factor graph, its Markov properties, elimination and treewidth; the Gaussian machinery of least squares, sparse Cholesky and the Laplace approximation; Bayesian inverse problems; state estimation and data reconciliation with their bad-data statistics; the causal calculus of interventions; variance-based attribution; reliability evaluation and failure-set analysis. None of these is the book's, and the notes say whose each is.

The book's: the synthesis. Taking an equation-based, conservation-structured physical model and turning its residual structure, unchanged, into the factorization on which inference, diagnosis, uncertainty propagation, attribution and decision queries are performed; the identification of physical ports with probabilistic separators and computational cuts; the intervention semantics for acausal equations; and the insistence, carried through every chapter, that the deterministic model is a corner of the probabilistic one.

The author has looked for this treatment and not found it. Pieces of it exist in several communities that have discovered the connection independently. Multibody dynamics has been written as a factor graph whose sparse structure serves both simulation and estimation, with forward and inverse dynamics as different queries on one graph [11], which is the "relations, not assignments" reading in a single domain. Bond graphs have been converted into Bayesian networks for fault diagnosis [62], which attaches probability to a port-based physical model but does so by assigning the causal directions this book declines to assign. Power systems have been estimated by message passing on a factor graph built from the power-flow equations [15], which is Chapters 6 to 12 in one domain and one query. Table 0.2 sets these beside the four traditions and beside this book. What the table shows is not that any column is empty but that no prior row fills them all, and that several communities have arrived at parts of one construction without a text that says they are parts of one construction. That is the gap the book is written to fill, and "not found" is the strongest claim the author is willing to make for it.

0.8 How to read this book

Who it is for. The reader is an engineer who knows conservation laws and linear algebra and has never met a probabilistic graphical model. Nothing about probability beyond the meaning of a density is assumed; Chapter 3 supplies what is needed in a page and Appendix B the Gaussian identities. A reader who knows graphical models and wants the physics will find Chapters 1, 2 and 5 the ones to read first, since they say what the graph is and why the ports separate. The examples are data center examples; the constructions are not, and a reader who works on water,

Table 0.2: The closest prior work, by what it covers. A check marks a substantial treatment; a word marks a partial or specialized one.

	physics graph	equations as factors	probability	general domains	ports as separators	broad inference
bond graphs, port-Hamiltonian [79, 104]	✓	—	—	✓	✓	—
multibody factor graphs [11]	✓	✓	limited	multibody	—	solve, estimate
bond-graph Bayesian networks [62]	✓	indirect	✓	general idea	—	fault diagnosis
factor-graph state estimation [15]	power grid	specialized	✓	power only	regional	state estimation
graphical-model texts [50, 56]	—	—	✓	abstract	graph-theoretic	✓
inverse-problem texts [41, 98]	equations	not generally	✓	✓	—	inverse only
this book	✓	✓	✓	✓	✓	✓

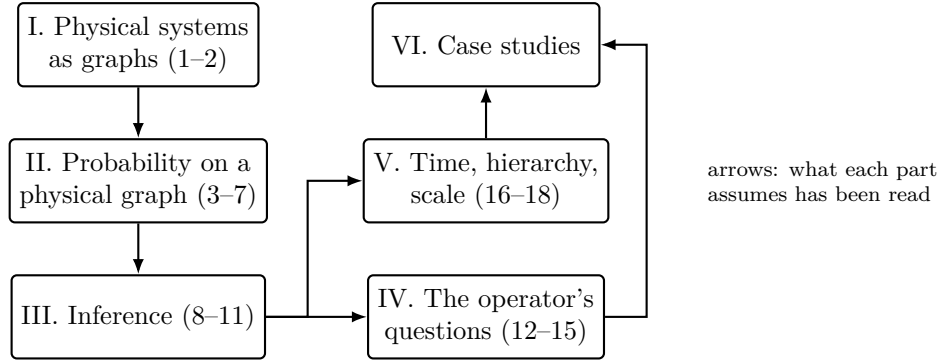


Figure 0.4: The parts of the book and their dependencies. Parts IV and V each need Part III and not each other; Part VI needs both.

district heating or any other conserved quantity will find nothing in Parts I to V that needs changing but the names.

The parts. Figure 0.4 shows the six parts and what each depends on. Part I is deterministic and builds the objects. Part II attaches probability and states, rather than skips, the places where that attachment needs care. Part III organizes the computation. Part IV asks the operator’s questions. Part V handles time, hierarchy and scale. Part VI is a set of complete studies, each reproducible from the material in the earlier parts.

The running examples. Two small systems appear in almost every chapter: the processor’s heat path of Example 1.1, from the package through the thermal interface to a heat sink that the server’s fans cool with cold-aisle air, and the facility’s own distribution, a UPS busbar feeding two units in a triangle under the DC approximation of power flow. Both are introduced in Chapter 1, both are small enough to solve by hand, and both acquire priors, sensors, a failed component, a second region, an intervention and a failure set as the chapters go on. The reader who follows them through will have seen every construction of the book on a system whose every number can be checked. Larger systems appear where the small ones cannot show the point: the facility’s six-bus distribution for decomposition and failure, a cooled room for common cause, a conducting plate for cost at scale, and the case studies of Part VI.

The numbers. Every number in every worked example is produced by a short script that accompanies the book, one per chapter, and the text says which. The scripts are a few hundred lines each and use nothing beyond a numerical library; they are meant to be read and rerun, and several exercises ask for exactly that. The case studies of Part VI read their numbers from committed result files of the studies they describe. No number in the book was typed by hand.

Conventions. Each chapter ends with a section on what is in practice, notes on what is inherited and from where, a summary, five exercises, and worked solutions to two of them. Load-bearing conclusions are set apart as numbered principles; there are about three per chapter, and a reader who remembers only those will have the book's argument. Propositions are proved where they are stated. Notation is collected in Appendix A, and the reference implementation that the author used to run every script is mapped to the book's constructions in Appendix C; nothing in the body depends on it.

0.9 What this book does not do

It does not teach physical modeling; it assumes the reader can write a balance and a closure, and it uses the simplest ones. It does not teach probability or graphical models in generality; it teaches the parts a physical model needs, and points to the texts that teach the rest. It does not develop machine learning: no factor in this book is learned from data, though Chapter 12 estimates parameters and Chapter 14 fits a surrogate, and the notes say where the learned versions of its constructions live. It does not treat airflow as a field: there is no computational fluid dynamics here, and a hall's air is a network of lumped nodes and conductances whose parameters a field model, where one exists, would supply. It does not schedule the IT workload; loads are inputs with priors, not decisions the book optimizes. It does not treat continuous space: every system here is a graph of lumped elements, and a field discretized on a mesh appears only as a large graph whose treewidth is a warning. And it does not claim that the constructions it teaches are new; it claims that they are one subject, and it tries to teach them as one.

Notes and further reading

The five gaps that §0.1 to §0.6 describe were articulated in a review of the manuscript, and the positioning of §0.7 follows a literature search made in response to it. The closest works found, Blanco-Claraco, Leanza and Reina's factor-graph multibody dynamics [11], Lo, Wong and Rad's bond-graph Bayesian networks [62], and Chavali and Nehorai's factor-graph state estimation [15], are each discussed in the chapter whose subject they touch. The four traditions of §0.3 are cited there and again in the notes of the chapters that inherit from them; the reader who wants one text per tradition is directed to Karnopp and Rosenberg [43], Benveniste, Caillaud and Malandain [6], Koller and Friedman [50], and Kaipio and Somersalo [41].

Part I

Physical systems as graphs

Chapter 1

Conservation, closure, and the boundary

Every physical system a modeler cares about is a piece cut out of a larger one. A building trades heat with the weather. An electrical room trades power with the rest of the facility. A rack trades air with the room. The piece has an inside, which the modeler describes in detail, and a boundary, across which conserved quantities pass to an outside the modeler does not describe at all.

This chapter builds the deterministic model of such a piece. It has three ingredients and no probability. The three ingredients are conservation at places, closure along paths, and exchange at the boundary. The reason to build the deterministic model first, and to build it carefully, is that the probabilistic model of Part II inherits its structure entirely: the places, paths and boundary of this chapter become the nodes, factors and separators of the graphical model. Nothing is added to the structure later. Only uncertainty is.

1.1 Three questions about any system

Take any conserved quantity: energy, mass, electric charge, a chemical species. Three questions describe how it lives in a system.

1. Where can it accumulate?
2. How does it move from one place to another?
3. What crosses the boundary?

The first question identifies the *places*. Each place has an amount of the quantity, which may change in time. The amount is an *extensive* state: the energy in a wall, the mass of water in a tank, the charge on a capacitor. Doubling the place doubles the state.

The second question identifies the *paths*. Along a path the quantity flows at some rate: watts, kilograms per second, amperes. What drives the flow is a difference in an *intensive* quantity between the two ends of the path: temperature, pressure, voltage. Doubling the place does not double the intensive quantity; it is a property of the state at a point, not of the amount.

The third question identifies the *boundary*. Some paths lead to places the model does not describe. The quantity that crosses those paths enters or leaves the system. The places on the far side are held at imposed conditions, either an imposed intensive value (the ambient temperature, the grid voltage) or an imposed flow (a heat load, a scheduled injection).

Table 1.1: Four conservation domains and their three quantities.

Domain	Extensive state	Flow	Intensive driver
Energy (thermal)	internal energy E [J]	heat rate Q [W]	temperature T [K]
Mass	mass M [kg]	mass rate $\dot{m}$ [kg/s]	pressure p [Pa]
Charge	charge q [C]	current I [A]	voltage V [V]
Power (DC network)	—	line flow F [W]	angle θ [rad]

Table 1.1 lists the four conservation domains that recur in this book with their extensive state, their flow, and the intensive quantity that drives it. The rows are physically different; the columns are the same three questions. That parallel is the foundation of everything that follows. A method that works on the columns works on every row.

The last row is worth a comment. In the DC approximation of a power network the conserved quantity is real power, the flow on a line is the power it carries, and the driver is the voltage angle difference between its ends. There is no extensive state because the approximation is steady: buses do not store power. The row still fits the three questions. The first answer is simply “nowhere”.

1.2 Nodes conserve

The three questions define a graph. The places are nodes; the paths are edges. Write $\mathcal{N}$ for the set of nodes, $\mathcal{E}$ for the set of edges, and $\mathcal{D}$ for the set of conservation domains the model tracks. A model with heat and water flowing through the same pipework has $\mathcal{D} = \{\text{energy, mass}\}$; a DC power network has $\mathcal{D} = \{\text{power}\}$.

1.2.1 The balance law

At each node n and for each domain d in which n can accumulate, the rate of change of the extensive state equals what flows in, minus what flows out, plus what is generated, minus what is lost:

$$\boxed{\frac{dX_{n,d}}{dt} = \sum_{e \in \mathcal{E}(n)} A_{n,e} P_{d,e} + G_{n,d} - L_{n,d}} \quad (1.1)$$

Here $X_{n,d}$ is the extensive state of domain d at node n , $\mathcal{E}(n)$ is the set of edges incident on n , $P_{d,e}$ is the flow of d along edge e , $G_{n,d}$ is a source at the node and $L_{n,d}$ a loss. The coefficient $A_{n,e}$ is the sign that says whether edge e delivers to or draws from node n ; it is defined in §1.2.3.

Equation (1.1) is the whole of physics that a node contributes. It is linear in the flows, always and exactly. It has no parameters. Whether the domain is energy or mass or charge, whether the node is a wall or a tank or a bus, the balance row looks the same. This is not a modeling convenience. It is the reason the graph is the right object: the graph is the conservation skeleton, and every domain that the model tracks uses that same skeleton.

1.2.2 Node roles

Not every node accumulates. Three roles cover the cases.

Balanced. The node has an extensive state that can change. Equation (1.1) holds with its left side live. A wall, a water tank, a battery.

Zero-storage. The node is a junction or a bus. It has no extensive state, so equation (1.1) holds with $dX_{n,d}/dt \equiv 0$: what comes in goes out. A pipe tee, an electrical bus, a mixing point.

Reservoir. The node is on the far side of the boundary. Its intensive state is imposed, not solved. It contributes no balance row, because the model does not claim to know its balance; it appears only as the far end of the edges that cross the boundary. The atmosphere, the utility grid, a feed line.

The first two roles are the inside of the system. The third is the outside. Which nodes are reservoirs is the modeler's first and most consequential decision, and §1.4 returns to it.

A node also declares which domains it is balanced in. A pipe carrying water may need a mass balance at each tee but no energy balance if the pipe is adiabatic; a bus needs a power balance and nothing else. The balance rows exist only where the modeler asks for them. The roles are declared per domain as well: a return manifold whose pressure is held by a pump is a reservoir for mass and yet a balanced node for energy, because the temperature of the water leaving it is the model's to determine. Example 1.3 has such a node.

1.2.3 Incidence

Give every edge a direction, from a tail node to a head node. The direction is a bookkeeping convention, not a physical claim: a flow that runs against the edge's direction is simply negative. The *incidence matrix* $\mathbf{A}$ has one row per non-reservoir node and one column per edge, with entries

$$A_{n,e} = \begin{cases} +1 & \text{edge } e \text{ enters } n \text{ (n is its head),} \\ -1 & \text{edge } e \text{ leaves } n \text{ (n is its tail),} \\ 0 & \text{otherwise.} \end{cases} \quad (1.2)$$

Every column of the full incidence matrix (with reservoir rows included) has one +1 and one −1, so the columns sum to zero. Dropping the reservoir rows breaks that property for the columns of boundary edges, and that is exactly right: the flow on a boundary edge is not balanced by any row of the model. It is what the system exchanges.

With $\mathbf{A}$ in hand, the sum in equation (1.1) is one row of a matrix product. Stack the flows of domain d into a vector $\mathbf{P}_d$ and the balances into a vector; the balance law for all nodes at once is $d\mathbf{X}_d/dt = \mathbf{A} \mathbf{P}_d + \mathbf{G}_d - \mathbf{L}_d$.

Principle 1.1. *The incidence matrix is shared by every domain. Energy and mass in the same pipework do not have two graphs. They have one graph, and each domain contributes balance rows on the nodes where it is tracked, using the same $\mathbf{A}$.*

An edge that carries one domain but not another, such as a rotating shaft that transmits energy but no mass, or a conduction path through a solid, simply has no flow variable for the absent domain. Its column contributes zero to that domain's balance rows.

1.3 Edges close

The balance law says that the flows at a node sum to the accumulation. It does not say what any flow is. That is the job of the edge.

Table 1.2: Four closure patterns. Each is written as a residual that vanishes when the relation holds.

Pattern	Residual	Typical use
Carrier flow	$P_e - q_e \varepsilon_e$	a quantity carried by another: $P = \dot{m} h$ (enthalpy carried by mass), $P = IV$ (power carried by current)
Gradient flow	$P_e - g(\phi_i, \phi_j; \theta)$	driven by a difference in intensive state: $Q = UA(T_h - T_c)$, $F = B(\theta_i - \theta_j)$
Property	$y - f(x_1, \dots, x_k)$	a property table or a device specification: $h = h(p, T)$, $Q = \text{COP} \cdot W$
Piecewise	$y - f_b(x)$	a device that changes regime: a valve that saturates, a limiter, a breaker

1.3.1 Closure relations

Along each edge, for each domain it carries, there is a flow variable and a relation that ties that flow to the states at the edge's ends and to some parameters. The relation is called a *closure* because it closes the system of equations: the balance rows alone have more unknowns than rows, and the closures supply the missing rows.

Definition 1.1 (Closure). A closure is a local relation $r(\mathbf{z}_{\text{loc}}; \theta) = 0$ among a small set of variables $\mathbf{z}_{\text{loc}}$, with parameters θ , written in *residual form*: a function that is zero exactly when the relation holds. The closure declares which variables it reads.

Four patterns cover the great majority of physical closures (Table 1.2).

The gradient pattern is the one the three questions anticipated: a flow driven by an intensive difference. Conduction, convection, DC current, DC power flow and laminar pipe flow all take this form, with different functions g and different parameters θ : a conductance, a heat transfer coefficient times an area, a susceptance. The carrier pattern appears whenever one domain rides on another, as enthalpy rides on mass flow. The property pattern is a catch-all for relations among variables at a single place. The piecewise pattern is the first hint of something the deterministic model handles awkwardly and the probabilistic model handles naturally; it returns in Chapter 7. Appendix D catalogues the closures of the domains this book touches. For each it gives the residual and its pattern, the unknowns and parameters, the Jacobian, where the relation kinks, its shape, and the parameter that usually carries the prior.

1.3.2 A closure is a relation, not an assignment

Write the conduction closure as most textbooks do:

$$Q = UA(T_h - T_c). \quad (1.3)$$

The notation suggests a computation: given the two temperatures, compute the heat rate. But nothing in the physics says which quantities are given. If the heat rate and the hot temperature are known, the same relation determines the cold temperature:

$$T_c = T_h - Q/(UA). \quad (1.4)$$

If all three are measured, the relation determines the conductance UA . The physics asserts that four quantities satisfy one constraint. It does not assert a direction.

The residual form makes this explicit:

$$r(Q, T_h, T_c; UA) = Q - UA(T_h - T_c) = 0. \quad (1.5)$$

Equation (1.5) has no left-hand side to compute. It is a surface in the space of its variables, and every point on the surface is a physically admissible state of the edge.

Principle 1.2. *A closure relates its variables. It does not compute one of them from the others. Which variable is unknown is a property of the question being asked, not of the physics.*

This principle looks like a remark about notation. It is not. It decides, in Chapter 2, which kind of graphical model a physical system should be written in, and it is the reason the arrows of a Bayesian network are not the natural representation of a closure. Hold on to it. The principle itself is old: it is the acausal view of physical laws that bond-graph modeling and equation-based modeling languages are built on [72, 79], and §1.8 says more.

1.3.3 Parameters

The parameters θ of a closure, a conductance, a susceptance, an efficiency, are ordinarily numbers the modeler supplies. Nothing forces that. A parameter the modeler does not know can be left as an unknown, added to the vector of variables, and determined by the equations if enough other things are known. A conductance inferred from a measured heat rate and two measured temperatures is the simplest case of this. The deterministic model needs one extra equation for each parameter it frees; the probabilistic model of Part II needs only a prior.

1.4 The boundary

The boundary is the set of edges with a reservoir at one end. Everything on the reservoir's side is outside the model. This section says what the model knows about the outside, why that knowledge is exact in one specific sense, and why the boundary is the most important part of the system.

1.4.1 Reservoirs and imposed conditions

A reservoir contributes no balance row. It contributes an imposed condition on the boundary edge, of one of two kinds.

Imposed potential. The reservoir's intensive state is fixed: the ambient temperature, the grid voltage angle at the point of connection. The boundary edge's closure then determines the flow across it. This is the Dirichlet condition of boundary-value problems.

Imposed flow. The flow across the boundary edge is fixed: a specified heat load, a scheduled generation injection. The balance row at the inside node then determines the inside potential. This is the Neumann condition.

Each boundary edge is thus a pair, a flow and its conjugate potential, one of which is imposed and the other of which the model determines. The pair is domain-independent (Table 1.3). Call the pair a *port*.

Table 1.3: Ports: the conjugate flow and potential pair at a boundary, by domain.

Domain	Flow across the boundary	Potential at the boundary
Thermal	heat rate Q	temperature T
Fluid	mass rate $\dot{m}$	pressure p
Electrical	current I	voltage V
DC power	line flow F	angle θ

Definition 1.2 (Boundary-exchanging system). A boundary-exchanging system is a conservation graph with at least one reservoir node. It exchanges conserved quantities with its environment through its ports. Its state is determined jointly by its internal balances and closures and by the conditions imposed at its ports.

Every model in this book is boundary-exchanging. A closed system, one with no reservoirs, is a limiting case that occurs in textbooks and almost nowhere else. The term is this book's own. Thermodynamics calls such a system *open*, and port-based modeling calls the places where it trades with its environment *ports* [104]. The definition adds only that the trade goes through reservoir nodes of a conservation graph, which is what lets Chapter 5 treat the ports as separators.

1.4.2 Exactness at a cut

Take any set S of non-reservoir nodes, and consider the edges that cross from S to its complement. Sum the steady balance rows over the nodes in S . Every edge with both ends in S appears twice in the sum, once with $+P_e$ at its head and once with $-P_e$ at its tail; it cancels. Every edge with one end in S appears once. What remains is

$$\sum_{e \text{ crossing } S} A_{n(e),e} P_{d,e} = - \sum_{n \in S} (G_{n,d} - L_{n,d}), \quad (1.6)$$

where $n(e)$ is the end of e inside S . In words: the net flow of domain d across the boundary of S equals the net source inside S , whatever happens inside. Internal detail has no effect on the cut flow.

Proposition 1.1 (Exactness at a cut). *In steady state the sum of the flows crossing the boundary of any node set S equals the net source inside S . The sum depends on S only through its sources and losses, not through its internal structure.*

This is a two-line consequence of conservation, and it is the reason a boundary can be trusted. Whoever sits outside S and sees only the port flows sees a quantity that is exact, not an approximation of the inside. A room controller that reads the total heat delivered by the racks it contains reads a number that is identically the cooling load, not an estimate of it. Chapter 17 builds an entire theory of hierarchical modeling on Proposition 1.1.

Note what the proposition does not say. It says nothing about the intensive states. The temperature at the boundary of S is not a sum of anything inside S , and no conservation law licenses aggregating it. Extensive flows aggregate by summation across a cut because a conservation law says so. Intensive states must be solved for.

1.4.3 Why the boundary matters most

Two reasons put the boundary at the center of this book.

The first is that it is unavoidable. The modeler who refuses to draw a boundary must model the universe. Every practical model draws one, and what it draws determines what the model can and cannot say. A building model with the weather as a reservoir cannot say anything about the weather; it can only say what the building does given the weather.

The second reason is that the boundary is where knowledge is thinnest. Inside the system the modeler has chosen every closure and knows every parameter, or at least knows which ones are uncertain. At the boundary the modeler has an imposed condition that summarizes an entire unmodeled world into one number per port. That number is a forecast, a schedule, a nominal value, or a measurement taken somewhere else. It is where the model's ignorance is concentrated.

When uncertainty enters in Part II it therefore enters at the boundary first. And when Part III asks how a large system can be solved as a collection of small ones, the answer is that each piece is a boundary-exchanging system in its own right, that its ports carry all that its neighbors need to know about it, and that Proposition 1.1 is what makes the ports sufficient. The machinery of separators and messages in the later chapters is the boundary of this section made probabilistic.

Principle 1.3. *A system is defined by what crosses its boundary. Everything inside is the modeler's to describe; everything outside is summarized, exactly for the flows and by assumption for the potentials, at the ports.*

1.5 The residual system

Collect the pieces. The unknowns of the model are gathered into a single vector $\mathbf{z} \in \mathbb{R}^n$: the intensive state at each inside node, the flow on each edge channel, the extensive state at each balanced node, and any parameters the modeler has freed. Conditions imposed at reservoirs either remove a variable from $\mathbf{z}$ by substituting its value, or add an explicit row $z_k - \bar{z}_k = 0$; either way they are known.

The equations are gathered into a single vector-valued residual $\mathbf{F}(\mathbf{z}) \in \mathbb{R}^m$, whose rows come in a fixed order:

1. balance rows, one per (inside node, tracked domain) pair, equation (1.1) with the accumulation term moved to the right;
2. edge-channel closures, one per edge per domain it carries;
3. storage relations, one per extensive state, tying it to the intensive state at the same node ($E = CT$ for a thermal mass, for instance);
4. freestanding closures: properties, specifications, couplings not tied to one edge;
5. explicit boundary-condition rows.

The model is the system

$$\boxed{\mathbf{F}(\mathbf{z}) = \mathbf{0}} \tag{1.7}$$

in steady state, and $\mathbf{F}(\mathbf{z}, \dot{\mathbf{z}}) = \mathbf{0}$ with the accumulation terms live in the dynamic case, which is deferred to Chapter 16.

1.5.1 Well-posedness

Before anything is solved, the system can be checked for shape. It should be square, $m = n$: as many equations as unknowns. Its Jacobian $\mathbf{J} = \partial \mathbf{F} / \partial \mathbf{z}$ should have full structural rank, which means that some assignment of equations to unknowns covers every unknown; this is a property of which variables each row reads, not of their values, and it can be checked on the graph alone. The graph should be connected. Every flow variable should be constrained by some closure, since a balance row alone cannot determine two flows. No variable should be absent from every row.

Each of these checks fails in a way that points at a node, an edge or a variable. A model that fails one is not wrong in a numerical sense. It is underspecified or overspecified, and the failure says where. Making the checks structural, and making them precede any numerical work, is the difference between a modeling error that is reported as “node 7 has no closure on its outlet flow” and one that is reported as a singular matrix somewhere inside a solver.

The first check, squareness, can be done by counting before a single row is written.

Proposition 1.2 (Squareness by counting). *Let a model have N inside nodes each balanced in every domain it touches, E edge channels (one per edge per domain the edge carries), S storage states, Θ freed parameters, C freestanding closures and R explicit boundary-condition rows, and let every inside node carry one potential per domain in which it is balanced. Then the number of unknowns exceeds the number of rows by exactly $\Theta - C - R$. The model is square if and only if every freed parameter is paid for by one freestanding closure or one explicit boundary condition.*

Proof. Count unknowns: one potential per (node, domain) pair, N_d in all; one flow per edge channel, E ; one extensive state per storage, S ; and Θ parameters. Count rows: one balance per (node, domain) pair, N_d ; one closure per edge channel, E ; one storage relation per storage, S ; then C and R . The first three pairs cancel term by term, leaving $\Theta - (C + R)$. $\square$

The proposition explains a pattern the examples below repeat. A model built from balanced nodes and closed edges is square by construction; it becomes non-square only when the modeler frees a parameter without adding a relation that pins it, or adds a relation without freeing anything. The first is the situation of a model with an unknown conductance and no measurement; the second, of a model with a measurement and nothing for it to determine. Both are exactly the situations that Chapter 3 will handle without counting, because a prior is a row that costs nothing and a measurement is a row that need not be paid for; but in the deterministic model the count must balance, and the proposition says how.

1.5.2 Sparsity

Each balance row has one nonzero entry per incident edge channel and one for its own storage state. Each closure row has one nonzero per variable it declares. The number of nonzeros in $\mathbf{J}$ is therefore of order $|\mathcal{E}|$ plus the total number of closure inputs: linear in the size of the model, not quadratic in the number of unknowns. A network with ten thousand nodes has a Jacobian with tens of thousands of nonzeros, not a hundred million.

The balance rows are exactly linear in the flows, so their entries in the flow columns are the constants $-A_{n,e}$ and never change. All of the nonlinearity, and all of the domain-specific derivative work, lives in the closure rows. The pattern of nonzeros is known before any number is computed, from the closures’ declared inputs alone.

Both facts, linear sparsity and a fixed pattern, are what make everything downstream affordable: solving equation (1.7) by Newton’s method, eliminating the inside of a subsystem to

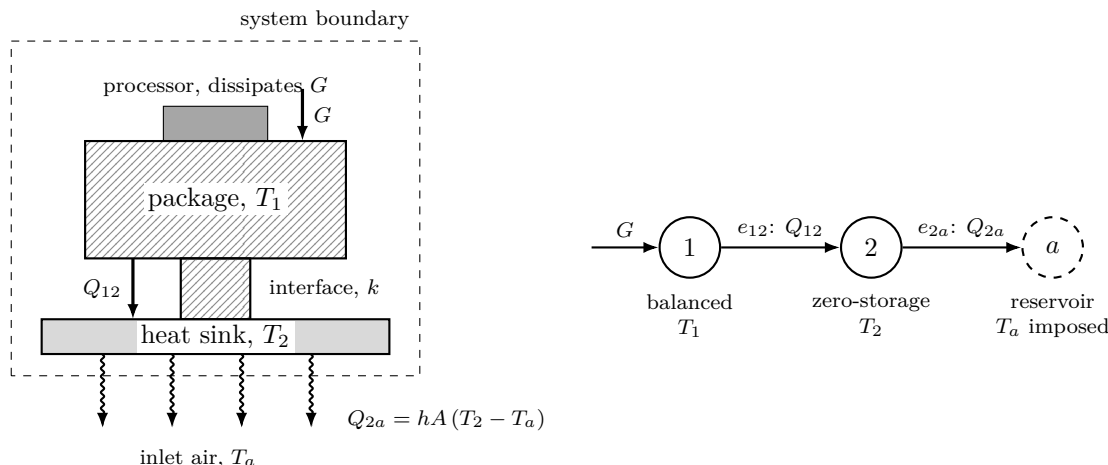


Figure 1.1: The processor heat path of Example 1.1. Left: the physical arrangement. A processor dissipates G into its package at T_1 ; the package conducts through the thermal interface and the heat-sink base, of conductance k , to the heat sink at T_2 ; the fans blow the inlet air over the fins, and the heat sink loses heat by convection to that air at T_a . The dashed box is the system boundary at the server's inlet; the cold aisle outside it is not modeled. Right: the same arrangement as a conservation graph. Node 1 is balanced (in steady state its accumulation is zero), node 2 is a junction, and node a , dashed, is the inlet-air reservoir on the far side of the boundary. Two edges, two closures; the source G is a known injection at node 1.

expose its ports, and, in Part II, forming the precision matrix of a Gaussian posterior, which turns out to be $\mathbf{J}^T \mathbf{J}$ up to weighting and inherits this sparsity exactly.

1.6 Three worked examples

Three examples, one thermal, one electrical and one fluid, show every object of this chapter in a form small enough to solve by hand or nearly so. The second is the running example of the book; it acquires a loop here, uncertainty in Chapter 3, and a failed line in Chapter 7. The third carries two domains on one graph. Every number is from `ch01_examples.py` in the book's `scripts` directory.

Example 1.1 (A processor's heat path to the inlet air). A processor in a server, a CPU or accelerator die, dissipates a known heat rate G into its package, the case and lid around the die (node 1). The package conducts to the heat sink (node 2) through the thermal interface and the heat-sink base, a path of conductance k . The heat sink loses heat to the inlet air (node a) by convection over its fins, with coefficient-area product hA ; the server's fans drive that airflow, and their speed is what sets hA . The inlet temperature T_a , the temperature of the air arriving from the cold aisle, is imposed: the cold aisle outside the server is not modeled. Figure 1.1 draws the graph.

Unknowns. Two flows, Q_{12} and Q_{2a} , and two potentials, T_1 and T_2 . The inlet temperature is imposed and substituted out.

Incidence. Rows for nodes 1 and 2, columns for edges e_{12} and e_{2a} , directions as drawn:

$$\mathbf{A} = \begin{pmatrix} -1 & 0 \\ +1 & -1 \end{pmatrix}. \quad (1.8)$$

The reservoir row $(0, +1)$ is dropped; the second column no longer sums to zero, which is the signature of a boundary edge.

Residuals. Two rows come from the balance law. At each inside node, equation (1.1) in steady state is $0 = \sum_e A_{n,e} Q_e + G_n$, written as the residual $r_n = -\sum_e A_{n,e} Q_e - G_n$, which vanishes when the node balances:

$$r_1 = -(-Q_{12}) - G = Q_{12} - G \quad (\text{balance at node 1}), \quad (1.9)$$

$$r_2 = -(Q_{12} - Q_{2a}) = Q_{2a} - Q_{12} \quad (\text{balance at node 2}). \quad (1.10)$$

Two more come from the closures, one gradient closure on each edge:

$$r_3 = Q_{12} - k(T_1 - T_2) \quad (\text{closure on } e_{12}), \quad (1.11)$$

$$r_4 = Q_{2a} - hA(T_2 - T_a) \quad (\text{closure on } e_{2a}). \quad (1.12)$$

Four rows, four unknowns, and every flow has a closure.

Vector form. Stack the unknowns, flows first, and the residuals in the order of the rows above:

$$\mathbf{z} = \begin{pmatrix} Q_{12} \\ Q_{2a} \\ T_1 \\ T_2 \end{pmatrix} = \begin{pmatrix} \mathbf{q} \\ \mathbf{T} \end{pmatrix}, \quad \mathbf{F}(\mathbf{z}) = \begin{pmatrix} r_1 \\ r_2 \\ r_3 \\ r_4 \end{pmatrix} = \begin{pmatrix} Q_{12} - G \\ Q_{2a} - Q_{12} \\ Q_{12} - k(T_1 - T_2) \\ Q_{2a} - hA(T_2 - T_a) \end{pmatrix}.$$

The model is $\mathbf{F}(\mathbf{z}) = \mathbf{0}$, equation (1.7) for this example. Its rows come in two blocks, and the incidence matrix writes each block in one line. Collect the data of the model:

$$\mathbf{s} = \begin{pmatrix} G \\ 0 \end{pmatrix}, \quad \mathbf{K} = \begin{pmatrix} k & 0 \\ 0 & hA \end{pmatrix}, \quad \mathbf{A}_b = \begin{pmatrix} 0 & +1 \end{pmatrix}.$$

The vector $\mathbf{s}$ holds the sources at the inside nodes, the diagonal matrix $\mathbf{K}$ holds one conductance per edge, and $\mathbf{A}_b$ is the dropped reservoir row, through which the imposed temperature T_a enters. The balance rows r_1, r_2 are $-\mathbf{A}\mathbf{q} - \mathbf{s}$. For the closure rows, look at the vector $\mathbf{A}^\top \mathbf{T} + \mathbf{A}_b^\top T_a$. Its first entry is $-T_1 + T_2$ and its second is $-T_2 + T_a$: it is the temperature rise along each edge, head minus tail, so its negative is the drop that drives the heat. The closure rows r_3, r_4 are therefore $\mathbf{q} + \mathbf{K}(\mathbf{A}^\top \mathbf{T} + \mathbf{A}_b^\top T_a)$, and

$$\mathbf{F}(\mathbf{z}) = \begin{pmatrix} -\mathbf{A}\mathbf{q} - \mathbf{s} \\ \mathbf{q} + \mathbf{K}(\mathbf{A}^\top \mathbf{T} + \mathbf{A}_b^\top T_a) \end{pmatrix}. \quad (1.13)$$

Jacobian. Differentiate $\mathbf{F}$ with respect to $\mathbf{z}$, one block at a time. The balance block depends on the flows alone, through $-\mathbf{A}$, and not on the temperatures. The closure block depends on the flows through the identity and on the temperatures through $\mathbf{K}\mathbf{A}^\top$. So

$$\mathbf{J} = \frac{\partial \mathbf{F}}{\partial \mathbf{z}} = \begin{pmatrix} \partial \mathbf{F}_{\text{bal}} / \partial \mathbf{q} & \partial \mathbf{F}_{\text{bal}} / \partial \mathbf{T} \\ \partial \mathbf{F}_{\text{clo}} / \partial \mathbf{q} & \partial \mathbf{F}_{\text{clo}} / \partial \mathbf{T} \end{pmatrix} = \begin{pmatrix} -\mathbf{A} & \mathbf{0} \\ \mathbf{I} & \mathbf{K}\mathbf{A}^\top \end{pmatrix} = \begin{pmatrix} 1 & 0 & 0 & 0 \\ -1 & 1 & 0 & 0 \\ 1 & 0 & -k & k \\ 0 & 1 & 0 & -hA \end{pmatrix}. \quad (1.14)$$

The balance rows are constant and the closure rows carry the parameters. The structural rank is full.

Solution. Every model in this book is solved the same way, by Newton's method on $\mathbf{F}(\mathbf{z}) = \mathbf{0}$. Each step replaces $\mathbf{z}$ by $\mathbf{z} - \mathbf{J}^{-1}\mathbf{F}(\mathbf{z})$, one linear solve with the Jacobian, and the steps repeat until the residual vanishes. Here every closure is linear, so $\mathbf{F}$ is exactly linear in $\mathbf{z}$, $\mathbf{J}$ is constant, and the first step lands on the solution from any starting point. With $G = 100$ watts, $k = 5$ and $hA = 2$ watts per kelvin, and $T_a = 20$ degrees, one step from $\mathbf{z} = \mathbf{0}$ gives $\mathbf{q} = (100, 100)^\top$ and $\mathbf{T} = (90, 70)^\top$: both flows equal the source, the package sits at 90 degrees and the heat sink at 70. The last fact holds for any numbers. Every column of the full incidence matrix sums to zero, so $\mathbf{1}^\top \mathbf{A} + \mathbf{A}_b = \mathbf{0}$; multiplying the balance rows by $\mathbf{1}^\top$ gives $\mathbf{A}_b \mathbf{q} = \mathbf{1}^\top \mathbf{s}$, which says that the flow into the reservoir, Q_{2a} , is the total source G . That is Proposition 1.1 for $S = \{1, 2\}$.

The solution is also linear in the two inputs, the source and the inlet temperature. Collect them in $\mathbf{u} = (G, T_a)^\top$; then each temperature is a fixed combination of them,

$$T_1 = \mathbf{h}_1^\top \mathbf{u}, \quad \mathbf{h}_1 = \begin{pmatrix} 1/hA + 1/k \\ 1 \end{pmatrix} = \begin{pmatrix} 0.7 \\ 1 \end{pmatrix}; \quad T_2 = \mathbf{h}_2^\top \mathbf{u}, \quad \mathbf{h}_2 = \begin{pmatrix} 1/hA \\ 1 \end{pmatrix} = \begin{pmatrix} 0.5 \\ 1 \end{pmatrix}.$$

Each temperature is the boundary temperature plus the thermal resistances between it and the boundary times the flow, exactly as an engineer would write it down. These numbers and these two vectors return in Chapter 3, where the source and the inlet temperature become uncertain and a sensor on a temperature reads $\mathbf{h}_1^\top \mathbf{u}$ or $\mathbf{h}_2^\top \mathbf{u}$. What the residual form adds is that the same four rows answer the other questions without rearrangement: if T_1 is measured and G is unknown, free G , add it to $\mathbf{z}$, and the system is again square, as Proposition 1.2 says it must be when one parameter is freed and one row is added.

Example 1.2 (The facility's distribution: a three-bus DC network). The same building has a second network inside it, carrying a second conserved quantity: electrical power. Downstream of the utility service and the uninterruptible supply, a UPS output busbar feeds two power distribution units, each over its own feeder, and a tie between the two units closes the loop so that either can be carried from the other when a feeder is out. Bus 1 is the UPS busbar, buses 2 and 3 the two distribution units. The three runs have equal susceptance B . Buses 2 and 3 carry known injections P_2 and P_3 , negative for load: the racks each unit serves. Bus 1 is the point of connection to everything upstream, whose angle is taken as the reference, $\theta_1 = 0$. Bus 1 is a reservoir: the model does not claim to know the balance of the supply beyond it. Figure 1.2 draws the graph.

Unknowns. Three flows, F_{12} , F_{13} and F_{23} , and two angles, θ_2 and θ_3 ; θ_1 is imposed and substituted out.

Incidence. Rows for buses 2 and 3, columns for the three runs in the directions drawn:

$$\mathbf{A} = \begin{pmatrix} +1 & 0 & -1 \\ 0 & +1 & +1 \end{pmatrix}. \quad (1.15)$$

Residuals. Two rows come from the balance law at buses 2 and 3, which are zero-storage, so there is no accumulation:

$$r_2 = -(F_{12} - F_{23}) - P_2 \quad (\text{balance at bus 2}), \quad (1.16)$$

$$r_3 = -(F_{13} + F_{23}) - P_3 \quad (\text{balance at bus 3}). \quad (1.17)$$

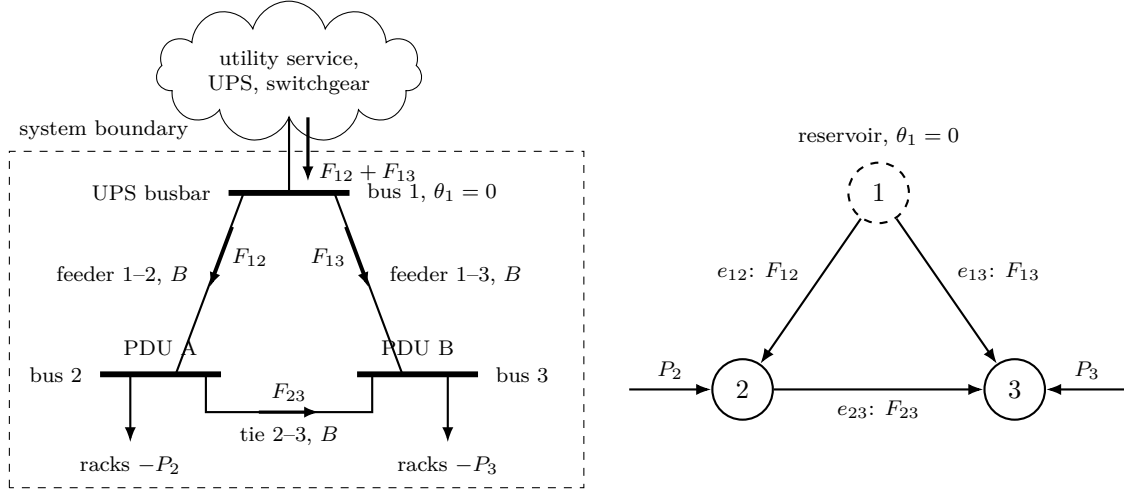


Figure 1.2: The DC triangle of Example 1.2: the facility's own distribution. Left: the one-line diagram. A UPS busbar feeds two distribution units over two feeders, and a tie between the units closes the loop; all three runs have susceptance B . Buses 2 and 3 serve racks; bus 1 is tied to everything upstream, which lies outside the dashed system boundary and supplies whatever the racks need. Arrows mark the flow directions of the example. Right: the same network as a conservation graph. Buses 2 and 3 are zero-storage; bus 1 is a reservoir at the reference angle. The three runs form a loop, the first loop in this book. Injections P_2 , P_3 are imposed.

Three more come from the closures, one gradient closure on each run:

$$r_{12} = F_{12} - B(\theta_1 - \theta_2) = F_{12} + B\theta_2 \quad (\text{closure on } e_{12}), \quad (1.18)$$

$$r_{13} = F_{13} + B\theta_3 \quad (\text{closure on } e_{13}), \quad (1.19)$$

$$r_{23} = F_{23} - B(\theta_2 - \theta_3) \quad (\text{closure on } e_{23}). \quad (1.20)$$

Five rows, five unknowns.

Vector form. As in Example 1.1, stack the unknowns flows first and the residuals in the order of the rows above:

$$\mathbf{z} = \begin{pmatrix} F_{12} \\ F_{13} \\ F_{23} \\ \theta_2 \\ \theta_3 \end{pmatrix} = \begin{pmatrix} \mathbf{F} \\ \boldsymbol{\theta} \end{pmatrix}, \quad \mathbf{F}(\mathbf{z}) = \begin{pmatrix} r_2 \\ r_3 \\ r_{12} \\ r_{13} \\ r_{23} \end{pmatrix}.$$

With the injections $\mathbf{s} = (P_2, P_3)^\top$, one susceptance per run, $\mathbf{K} = B\mathbf{I}$, and the reservoir row of bus 1, $\mathbf{A}_b = (-1, -1, 0)$, with its angle θ_1 , the residual vector has the two blocks of equation (1.13), with angles in place of temperatures: the balance rows are $-\mathbf{A}\mathbf{F} - \mathbf{s}$ and the closure rows are $\mathbf{F} + \mathbf{K}(\mathbf{A}^\top\boldsymbol{\theta} + \mathbf{A}_b^\top\theta_1)$. Differentiating block by block, as there, gives the Jacobian

$$\mathbf{J} = \frac{\partial \mathbf{F}}{\partial \mathbf{z}} = \begin{pmatrix} -\mathbf{A} & \mathbf{0} \\ \mathbf{I} & B\mathbf{A}^\top \end{pmatrix}.$$

Solution. Newton's method on $\mathbf{F}(\mathbf{z}) = \mathbf{0}$ again. The closures are linear, so from $\mathbf{z} = \mathbf{0}$ it takes one step. With $P_2 = P_3 = -1$ (two equally loaded units, in per-unit), both angles are $-1/B$

and $\mathbf{F} = (1, 1, 0)^\top$. The tie between the two units carries nothing, by symmetry: a tie is idle until the two sides it joins stop matching. The flow into the model across its boundary follows as in Example 1.1: here too $\mathbf{1}^\top \mathbf{A} + \mathbf{A}_b = \mathbf{0}$, so $\mathbf{A}_b \mathbf{F} = \mathbf{1}^\top \mathbf{s}$, which reads $-(F_{12} + F_{13}) = P_2 + P_3$. The boundary flow $F_{12} + F_{13} = 2$ is the total load: Proposition 1.1 again, with $S = \{2, 3\}$. The injection at the reference bus, which a power engineer calls the slack, is precisely the port flow of the boundary-exchanging system.

Now break the symmetry: $P_2 = -1.5$, $P_3 = -0.5$. Then $\mathbf{F} = (1.167, 0.833, -0.333)^\top$. The third entry, F_{23} , is negative: a third of a unit flows from bus 3 to bus 2, against the drawn direction. The loop matters. The heavier unit's extra load is served partly by its own feeder and partly around the tie, out of the lighter unit's. There is no way to compute F_{23} from a chain of local steps; it depends on the whole loop at once. That dependence, harmless here, is the thing that makes inference on this graph interesting in Part III.

The DC power flow. Because every closure here is linear, the flows can also be eliminated by hand, and that is how a power engineer usually solves such a network. The closure rows give $\mathbf{F} = -\mathbf{K}(\mathbf{A}^\top \boldsymbol{\theta} + \mathbf{A}_b^\top \theta_1)$. Substituting this into the balance rows, with $\theta_1 = 0$, leaves two rows in the two angles, and their solution:

$$B \begin{pmatrix} 2 & -1 \\ -1 & 2 \end{pmatrix} \begin{pmatrix} \theta_2 \\ \theta_3 \end{pmatrix} = \begin{pmatrix} P_2 \\ P_3 \end{pmatrix}, \quad \begin{pmatrix} \theta_2 \\ \theta_3 \end{pmatrix} = \frac{1}{3B} \begin{pmatrix} 2 & 1 \\ 1 & 2 \end{pmatrix} \begin{pmatrix} P_2 \\ P_3 \end{pmatrix}, \quad (1.21)$$

after which $\mathbf{F} = -B \mathbf{A}^\top \boldsymbol{\theta}$. The matrix $B \mathbf{A} \mathbf{A}^\top$ on the left is the reduced susceptance matrix of the network, and this elimination is the DC power flow. The loop is visible in it. Without the tie e_{23} the incidence matrix would be its first two columns alone, $\mathbf{A} \mathbf{A}^\top$ would be the identity, and each unit's angle would follow from its own racks alone; the off-diagonal -1 is the tie that closes the loop, and it is why F_{23} depends on both injections at once. The elimination is a shortcut that linear closures allow, not a different model. The residual form contains it but does not require it, and once the closures stop being linear the shortcut is gone: only Newton's method on the five-row system remains.

Example 1.3 (A coolant loop carrying mass and energy). A pump delivers coolant at an imposed pressure p_s and temperature T_s to a supply header (node h). From the header two branches run through cold plates a and b , which absorb heat Q_A and Q_B from the equipment mounted on them, to a return header (node r), from which the coolant returns to the pump's suction at an imposed pressure p_k . Figure 1.3 draws the arrangement and its graph. Two conserved quantities move through the same pipes, mass and energy, and the point of the example is that they share one graph.

Unknowns. Four inside nodes, each with a pressure and a temperature, and six edges, each with a mass flow $\dot{m}_e$ and an energy flow P_e : twenty unknowns in all.

Incidence. Rows h, a, b, r , columns sh, ha, hb, ar, br, rk :

$$\mathbf{A} = \begin{pmatrix} +1 & -1 & -1 & 0 & 0 & 0 \\ 0 & +1 & 0 & -1 & 0 & 0 \\ 0 & 0 & +1 & 0 & -1 & 0 \\ 0 & 0 & 0 & +1 & +1 & -1 \end{pmatrix}, \quad (1.22)$$

used twice, once for the mass balances and once for the energy balances, which is Principle 1.1 in a matrix.

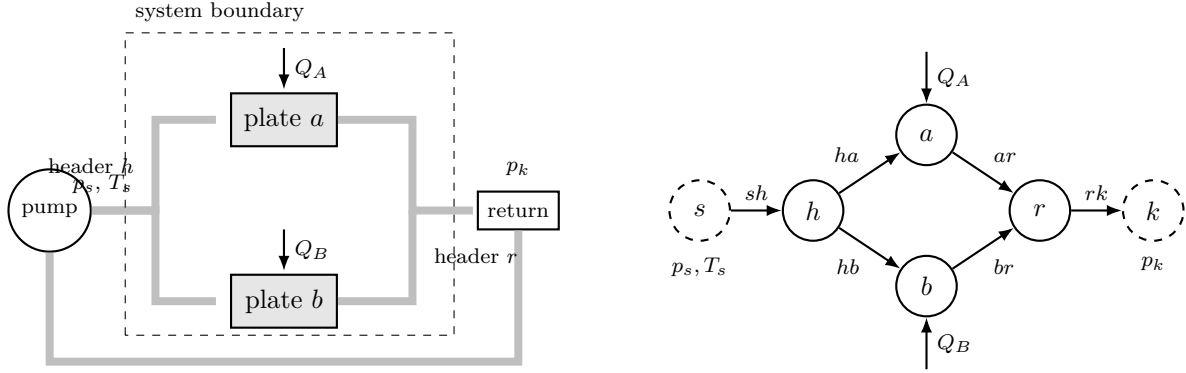


Figure 1.3: The coolant loop of Example 1.3. Left: a pump supplies two cold plates in parallel through a header; the plates absorb heat from the equipment and the coolant returns through a second header. Right: the same loop as a conservation graph, with the supply and suction sides of the pump as reservoirs. Every edge carries a mass channel and an energy channel, and the two domains use the same incidence matrix; the heat inputs are energy sources at the plate nodes.

Residuals. Eight rows come from the balance law, with the one incidence matrix serving both domains: a mass balance and an energy balance at each inside node $n \in \{h, a, b, r\}$. The energy balance carries the heat input Q_n as a source, with $Q_a = Q_A$, $Q_b = Q_B$ and zero elsewhere:

$$r_n^{\dot{m}} = - \sum_e A_{n,e} \dot{m}_e \quad (\text{mass balance}), \quad r_n^P = - \sum_e A_{n,e} P_e - Q_n \quad (\text{energy balance}).$$

Twelve more come from the closures, two on each edge e . The laminar closure is the gradient pattern of Table 1.2 in the mass domain. The carrier closure is the carrier pattern: the energy on the edge is its mass flow, times the specific heat c , times the temperature of the node it leaves.

$$r_e^g = \dot{m}_e - g_e (p_{\text{tail}} - p_{\text{head}}) \quad (\text{laminar closure}), \quad r_e^c = P_e - \dot{m}_e c T_{\text{tail}} \quad (\text{carrier closure}),$$

with the imposed values p_s , p_k and T_s wherever a tail or head is a reservoir. Twenty rows, twenty unknowns; Proposition 1.2 with $\Theta = C = R = 0$.

Vector form. As in Example 1.1, stack the unknowns flows first and the residuals balances first:

$$\mathbf{z} = \begin{pmatrix} \dot{\mathbf{m}} \\ \mathbf{P} \\ \mathbf{p} \\ \mathbf{T} \end{pmatrix},$$

with $\dot{\mathbf{m}}$ and $\mathbf{P}$ the mass and energy flows on the six edges and $\mathbf{p}$ and $\mathbf{T}$ the pressures and temperatures at h, a, b, r . The residual vector $\mathbf{F}(\mathbf{z})$ has four blocks, the two balances and then the two closures, and the model sets each to zero:

$$-\mathbf{A} \dot{\mathbf{m}} = \mathbf{0}, \quad -\mathbf{A} \mathbf{P} - \mathbf{Q} = \mathbf{0}, \quad (1.23)$$

$$\dot{\mathbf{m}} + \mathbf{G} (\mathbf{A}^T \mathbf{p} + \mathbf{A}_b^T \mathbf{p}_b) = \mathbf{0}, \quad \mathbf{P} - c \mathbf{M} (\mathbf{U} \mathbf{T} + \mathbf{u}_b T_s) = \mathbf{0}. \quad (1.24)$$

The pieces are these.

- $\mathbf{Q} = (0, Q_A, Q_B, 0)^T$ holds the heat inputs at the nodes.

- $\mathbf{G} = \text{diag}(g_{sh}, \dots, g_{rk})$ holds the laminar conductances. The left closure is $\dot{m}_e = g_e (p_{\text{tail}} - p_{\text{head}})$ on every edge, the gradient pattern of Table 1.2 in the mass domain, written exactly as the chain's.
- $\mathbf{A}_b$ holds the reservoir rows of s and k , and $\mathbf{p}_b = (p_s, p_k)^\top$ their imposed pressures:

$$\mathbf{A}_b = \begin{pmatrix} -1 & 0 & 0 & 0 & 0 & 0 \\ 0 & 0 & 0 & 0 & 0 & +1 \end{pmatrix}.$$

- The right closure is the carrier pattern: the energy on an edge is its mass flow, times the specific heat c , times the temperature of the node it leaves. $\mathbf{M} = \text{diag}(\dot{\mathbf{m}})$ puts the mass flows on a diagonal, and $\mathbf{U}$ picks each edge's tail temperature. Row e of $\mathbf{U}$ has a one in the column of e 's tail when the tail is an inside node. The one edge that leaves a reservoir, sh , takes the imposed supply temperature T_s through the vector $\mathbf{u}_b$ instead:

$$\mathbf{U} = \begin{pmatrix} 0 & 0 & 0 & 0 \\ 1 & 0 & 0 & 0 \\ 1 & 0 & 0 & 0 \\ 0 & 1 & 0 & 0 \\ 0 & 0 & 1 & 0 \\ 0 & 0 & 0 & 1 \end{pmatrix}, \quad \mathbf{u}_b = \begin{pmatrix} 1 \\ 0 \\ 0 \\ 0 \\ 0 \\ 0 \end{pmatrix}.$$

Solution. Take $p_s = 300$ and $p_k = 100$ kilopascals, conductances of 0.05, 0.02, 0.03, 0.02, 0.03 and 0.05 kilograms per second per kilopascal on the six edges in the order above, $T_s = 20$ degrees, $Q_A = 20$ and $Q_B = 40$ kilowatts, and $c = 4180$ joules per kilogram-kelvin.

The model is solved by Newton's method on $\mathbf{F}(\mathbf{z}) = \mathbf{0}$, as the other two are, from a rough guess: every pressure 200 kilopascals, every temperature 20 degrees, every mass flow 1 kilogram per second and every energy flow 100 kilowatts. It converges in three steps. The largest residual falls from 1.0×10^5 to 9.0×10^4 , then to 1.9×10^{-6} and 5.8×10^{-11} ; the Jacobian below says why so few steps are needed.

The pressures are $\mathbf{p} = (250, 200, 200, 150)^\top$ kilopascals, and every edge drops the same 50. The mass flows are $\dot{\mathbf{m}} = (2.5, 1.0, 1.5, 1.0, 1.5, 2.5)^\top$ kilograms per second: 2.5 through the loop, split 1.0 through plate a and 1.5 through plate b . The temperatures are $\mathbf{T} = (20, 24.78, 26.38, 25.74)^\top$. The supply header stays at 20, since nothing heats it; the plates sit $Q/(\dot{m}c)$ above the supply; and the return header is the flow-weighted mixture of the two plates, as its energy balance requires. The energy flows are $\mathbf{P} = (209.0, 83.6, 125.4, 103.6, 165.4, 269.0)^\top$ kilowatts. With two reservoir rows the column identity of Example 1.1 reads $\mathbf{1}^\top \mathbf{A} + \mathbf{1}^\top \mathbf{A}_b = \mathbf{0}$, and multiplying the energy balances by $\mathbf{1}^\top$ gives $P_{rk} - P_{sh} = \mathbf{1}^\top \mathbf{Q}$. Energy enters across the boundary at 209 kilowatts and leaves at 269, and the difference is the 60 kilowatts of the two heat inputs. That is Proposition 1.1 in the energy domain. The mass balances, which have no sources, give $\dot{m}_{rk} = \dot{m}_{sh}$, the same proposition in the mass domain.

The carrier closures are bilinear, $\dot{m}_e T_{\text{tail}}$, so the model is the first nonlinear one in the book. Its Jacobian, with the unknowns in the order $(\dot{\mathbf{m}}, \mathbf{P}, \mathbf{p}, \mathbf{T})$ and the rows in the order of equations (1.23)–(1.24), is

$$\mathbf{J} = \begin{pmatrix} -\mathbf{A} & \mathbf{0} & \mathbf{0} & \mathbf{0} \\ \mathbf{0} & -\mathbf{A} & \mathbf{0} & \mathbf{0} \\ \mathbf{I} & \mathbf{0} & \mathbf{G}\mathbf{A}^\top & \mathbf{0} \\ -c\mathbf{D} & \mathbf{I} & \mathbf{0} & -c\mathbf{M}\mathbf{U} \end{pmatrix}, \quad \mathbf{D} = \text{diag}(\mathbf{U}\mathbf{T} + \mathbf{u}_b T_s),$$

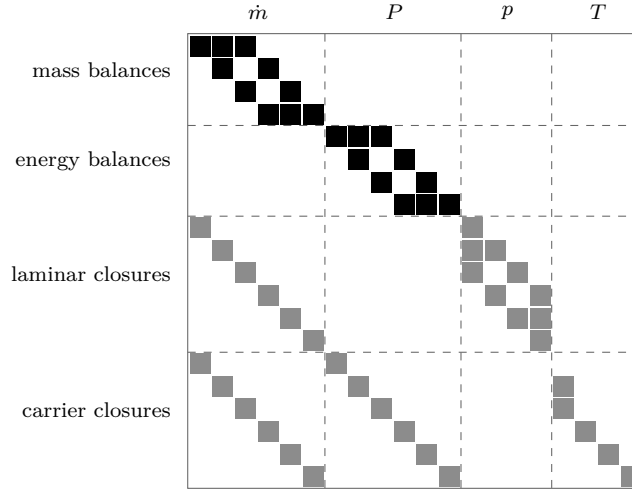


Figure 1.4: Nonzero pattern of the Jacobian of Example 1.3, rows in the fixed order of §1.5 and columns grouped by variable kind, flows first. Black entries are the constant ± 1 of the balance rows; grey entries carry parameters or the state. Thirteen percent of the matrix is nonzero, and the pattern was known before any number was.

where $\mathbf{D}$ holds the tail temperatures. The nonlinearity sits in the last row alone, in the blocks $-c\mathbf{M}\mathbf{U}$ and $-c\mathbf{D}$, which carry the state. It is also one-directional. Put the mass unknowns and rows first: no mass row reads $\mathbf{T}$ or $\mathbf{P}$, so the Jacobian is block lower triangular, and its mass block is constant. The first Newton step therefore solves the mass problem exactly, whatever the guess: after it the pressures and mass flows are right to 10^{-8} , while the temperatures are still 8.6 degrees off. With $\dot{\mathbf{m}}$ right, the energy rows are linear in $\mathbf{T}$ and $\mathbf{P}$, and the second step solves them. Figure 1.4 draws the Jacobian's pattern: 53 nonzeros in a 20×20 matrix, the balance rows constant, the carrier rows reading a flow, a temperature and an energy flow each.

Remark 1.1. All three examples have a Jacobian whose balance rows are constants and whose closure rows carry every parameter. All are square with full structural rank. All have a flow across the boundary that equals the net source inside. And in all, the unknowns could be reassigned, freeing a parameter and fixing a state, without changing a single row. The structure is the model. The numbers are an instance.

1.7 In practice

Draw the boundary first. Before any equation, decide which nodes are reservoirs. Everything the model will be unable to say follows from that decision, and so does everything it will be asked. Write the imposed condition at every port, potential or flow, and check that at least one port in every connected domain imposes a potential; a domain with only flows imposed has no level, as Exercise 1.1 shows.

One graph, several domains. Draw the nodes and edges once. Then, domain by domain, declare which nodes are balanced and which edges carry a channel. Do not draw a second graph for the second domain; the shared incidence matrix is what later lets a measurement in one domain inform the other.

Write every closure as a residual. Resist the assignment form. A closure written as $Q = UA(T_h - T_c)$ will be read as a computation, and a model that is a chain of computations cannot be run backwards, cannot absorb a measurement, and cannot free a parameter. A closure written as $Q - UA(T_h - T_c) = 0$ can.

Count before solving. Proposition 1.2 takes a minute and catches the two commonest errors: a freed parameter with nothing to pin it, and a measurement with nothing to determine. Then check structural rank, which catches the subtler error of a subsystem that is square overall but has three rows on two unknowns in one place and two rows on three in another.

Check the cut. After any solve, sum the port flows of each domain and compare with the net source inside. The identity of Proposition 1.1 costs nothing to verify and fails loudly when a sign in the incidence matrix is wrong, which is the commonest error of all.

Keep the pattern. The Jacobian's nonzero pattern is fixed by the declared inputs of the closures. Record it. Everything that follows, the solver's ordering, the elimination of a subsystem onto its ports, the sparsity of the posterior precision, is a property of that pattern, and the pattern should be inspected once, as in Figure 1.4, before any of it is trusted.

1.8 What is missing

Every number in this chapter was known. The conductance k was given; the susceptance B was given; the inlet temperature and the injections were imposed. Nothing was measured. Nothing failed.

List where a real model's ignorance actually sits.

- *Parameters.* The conductance of a real thermal interface is a nominal value from a data sheet, correct to perhaps twenty percent. The susceptance of a real line depends on its temperature.
- *Boundary conditions.* The inlet temperature is a setpoint the cooling may not hold. The load at bus 2 is a schedule that the customers have not read.
- *Model form.* The line from bus 2 to bus 3 is either in service or it is not, and the closure is different in the two cases. A valve is either open or saturated.
- *Measurements.* A real system has sensors. Some of its temperatures and flows are observed, with noise, and the deterministic model has no place to put an observation. It takes imposed values and returns solved values; it cannot take a noisy reading of a solved value and revise its other solved values in the light of it.

The last item is the decisive one. An observation of T_2 in Example 1.1 is information about k , about G , about T_a , and about T_1 . The deterministic model can use it only by choosing which one unknown it will determine. The probabilistic model uses it for all of them at once, in proportion to how much each is uncertain.

Chapter 2 rewrites $\mathbf{F}(\mathbf{z}) = \mathbf{0}$ as a graph of relations, in which each row is a node in its own right that touches only the variables it reads. Chapter 3 attaches probability to that graph: a prior on each uncertain parameter and boundary condition, a likelihood on each measurement, and a factor for each row of $\mathbf{F}$. The joint distribution over every variable in the system is then a

product,

$$p(\mathbf{z}) \propto \prod_f \varphi_f(\mathbf{z}_f), \quad (1.25)$$

in which each factor φ_f touches only a small set $\mathbf{z}_f \subset \mathbf{z}$. The set of factors is precisely the set of rows of this chapter, plus the priors and the sensors. Nothing about the structure changes. That is the claim the rest of the book makes good on.

Notes and further reading

The view of a physical system as conserved quantities at nodes, flows driven by potential differences along edges, and conjugate flow-and-potential pairs at ports, with the same structure across thermal, fluid, electrical and mechanical domains, is the bond-graph tradition begun by Paynter [79] and developed by Karnopp and Rosenberg [43]; what this chapter calls a port is their pair of effort and flow variables, and Table 1.3 is their table. Network thermodynamics [76] extended the same network structure to irreversible processes. The modern statement closest to §1.2 and §1.4, with an explicit incidence matrix, open graphs and compositional interfaces, is the port-Hamiltonian formulation on graphs of van der Schaft and Maschke [104]. The reader who knows any of these will recognize Chapter 1 as a restatement in their terms with the dynamics left for Chapter 16.

That a physical law is a relation and not an assignment (Principle 1.2) is the founding premise of acausal, equation-based modeling languages, of which Modelica [72] is the most widely used: its connectors carry potential variables that are equated and flow variables that are summed to zero at a connection, which is equation (1.1) generated automatically. The mathematical foundations of such languages, including the structural analysis that this chapter's well-posedness checks perform, are set out by Benveniste, Caillaud and Malandain [6]. Structural rank and the matching of equations to unknowns go back to Dulmage and Mendelsohn [22]; the same structural analysis applied to differential-algebraic systems is Pantelides' algorithm [78], and the numerical theory of such systems is in Brenan, Campbell and Petzold [13].

The sparsity argument of §1.5 and the claim that it is what makes everything downstream affordable are standard in the sparse-matrix literature; Davis [17] and Duff, Erisman and Reid [21] are the references, and the observation that power-network equations should be factored in an order chosen for sparsity is Tinney and Walker's [102]. The DC power flow of Example 1.2, its assumptions and its accuracy are reviewed by Stott, Jardim and Alsag [97].

What is the book's own in this chapter is the emphasis: that the boundary is where uncertainty will enter, and that the exactness of cut flows (Proposition 1.1) will become the sufficiency of ports in Chapter 5.

Summary

- Three questions describe a conserved quantity in any system: where it accumulates, how it moves, what crosses the boundary. Their answers are nodes, edges and reservoirs.
- Nodes conserve. The balance law (1.1) is linear in the flows, has no parameters, and uses one incidence matrix shared by every domain.
- Edges close. A closure is a residual relation among a few variables; it does not assign a direction. Four patterns cover most of physics.

- The boundary is the set of edges to reservoirs. Each carries a port, a conjugate flow and potential pair. Cut flows are exact by conservation; cut potentials are not aggregable.
- The model is $\mathbf{F}(\mathbf{z}) = \mathbf{0}$: square, structurally full-rank, with sparsity linear in model size and a nonzero pattern fixed before any number is computed. It is square by construction, and stays square exactly when every freed parameter is paid for by a row.
- Two domains on one graph share the incidence matrix; the coolant loop's twenty rows carry mass and energy together, and the cut identity holds in each domain separately.
- Uncertainty sits in parameters, boundary conditions, model form and measurements. The deterministic model has no place for a measurement. The probabilistic model of Part II will, on the same graph.

Exercises

Exercise 1.1. In Example 1.1, replace the imposed inlet temperature by an imposed heat rate $Q_{2a} = \bar{Q}$ at the boundary, and free the source G . Write $\mathbf{z}$ and $\mathbf{F}$. Is the system square? Compute its structural rank and identify the direction in which the Jacobian is singular. What single additional imposed condition restores a well-posed model, and why must it be a potential?

Exercise 1.2. Add a mass domain to Example 1.1 by making the path from the heat sink to the inlet air a flow of air at rate $\dot{m}$ with specific heat c , so that the convection closure becomes a carrier closure $Q_{2a} = \dot{m} c (T_2 - T_a)$. Write the incidence matrix with both domains and confirm it is the same matrix. Which nodes need a mass balance?

Exercise 1.3. In Example 1.2, remove line e_{23} . Solve for the angles and flows with $P_2 = -1.5$, $P_3 = -0.5$, and compare F_{12} with the looped case. Then remove line e_{13} instead. Which removal changes the boundary flow at bus 1, and why does Proposition 1.1 say it cannot?

Exercise 1.4. Make bus 1 of Example 1.2 an inside zero-storage node with a known injection P_1 , and make there be no reservoir at all. Show that the resulting $\mathbf{F}$ is not structurally full-rank, identify the direction in which $\mathbf{J}$ is singular, and explain in words why a closed DC network cannot fix its own reference angle.

Exercise 1.5. Prove Proposition 1.1 for the dynamic case: show that the net flow across the boundary of S equals the net source inside S minus the rate of change of the total extensive state inside S . Which quantity does a controller outside S then need to know in addition to the port flows?

Solutions to selected exercises

Exercise 1.1. The unknowns are now $\mathbf{z} = (Q_{12}, Q_{2a}, T_1, T_2, G, T_a)$, six of them, and the rows are the four of Example 1.1, with G and T_a moved into the unknowns, plus the boundary row $Q_{2a} - \bar{Q} = 0$: five rows. The system is not square, and Proposition 1.2 says why: two quantities were freed (G and T_a , so $\Theta = 2$) and one row was added ($R = 1$). Its Jacobian,

$$\mathbf{J} = \begin{pmatrix} 1 & 0 & 0 & 0 & -1 & 0 \\ -1 & 1 & 0 & 0 & 0 & 0 \\ 1 & 0 & -k & k & 0 & 0 \\ 0 & 1 & 0 & -hA & 0 & hA \\ 0 & 1 & 0 & 0 & 0 & 0 \end{pmatrix},$$

has rank five, and its null direction is $(0, 0, 1, 1, 0, 1)$: add the same constant to T_1 , T_2 and T_a and every row is unchanged, because every temperature enters only through a difference. The flows are fully determined, $Q_{12} = Q_{2a} = G = \bar{Q}$, and so are the temperature differences $T_1 - T_2 = \bar{Q}/k$ and $T_2 - T_a = \bar{Q}/hA$; what is not determined is the level. One imposed potential, any one of the three temperatures, restores a square system of full rank; an imposed flow could not, because every flow is already fixed and a sixth flow row would either repeat one or contradict it. This is the thermal form of the reference-angle problem of the next exercise but one, and the general rule: a connected domain needs at least one port with an imposed potential, or its potentials float together.

Exercise 1.3. With $P_2 = -1.5$ and $P_3 = -0.5$ the looped network of Example 1.2 has $F_{12} = 1.167$, $F_{13} = 0.833$ and $F_{23} = -0.333$. Remove e_{23} : each load is served by its own line alone, $F_{12} = 1.5$, $F_{13} = 0.5$, and the angles are $\theta_2 = -1.5/B$, $\theta_3 = -0.5/B$. Remove e_{13} instead: bus 3 is served through bus 2, $F_{12} = 2.0$ and $F_{23} = 0.5$, with $\theta_2 = -2/B$ and $\theta_3 = -2.5/B$, the far bus now the lowest. In every case the boundary flow $F_{12} + F_{13}$ is 2.0, the total load. Neither removal can change it, because Proposition 1.1 with $S = \{2, 3\}$ says the flow across the cut is the net source inside, and removing an internal line changes the internal structure and nothing else. What the removals change is how the two lines from the reservoir share the boundary flow, from 1.17 and 0.83 to 1.5 and 0.5 or to 2.0 and nothing, and that is the difference between the port flow, which conservation fixes, and the potentials and internal flows, which the closures fix and any change inside can move.

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

The cold plate, by hand *conservation at a node; the plate has no loop so the segment heats follow from balance alone; temperature as the accumulated rise*
`foundation_thermo/thermo_audit/problems/the_cold_plate_by_hand`

Chapter 2

From equations to factor graphs

Chapter 1 ended with a system of equations, $\mathbf{F}(\mathbf{z}) = \mathbf{0}$, and a promise: that its structure is also the structure of every probabilistic question about the system. This chapter makes the structure visible. It draws the equations as a graph, compares the three graphical languages in which such a graph can be drawn, and argues that one of them, the factor graph, is the right one for physics. The argument turns on Principle 1.2 of the previous chapter: a closure relates its variables and does not compute one from the others.

There is still no probability in this chapter. Every factor is a relation that either holds or does not. Chapter 3 replaces “holds or does not” by “holds to within so much”, and nothing drawn here will need to be redrawn.

2.1 The rows as a graph

Each row of $\mathbf{F}$ reads a few variables and ignores the rest. That pattern of reading is a graph.

Definition 2.1 (Factor graph of a residual system). The factor graph of $\mathbf{F}(\mathbf{z}) = \mathbf{0}$ is a bipartite graph with one *variable node* for each component of $\mathbf{z}$, one *factor node* for each row of $\mathbf{F}$, and an edge between a factor node and a variable node exactly when that row reads that variable. The set of variables a factor reads is its *scope*.

The factor graph is nothing more than the sparsity pattern of the Jacobian $\mathbf{J} = \partial\mathbf{F}/\partial\mathbf{z}$ drawn as a graph: row k is adjacent to column j when J_{kj} is structurally nonzero. It was already known at compile time in §1.5, before any number was computed. What the drawing adds is that paths and loops become visible.

Figure 2.1 draws the processor heat path of Example 1.1. Two things are worth reading off it before going further.

First, the physical graph and the factor graph are different graphs of the same system. The physical graph had three nodes and two edges. The factor graph has four variable nodes and four factor nodes. A physical node became a balance factor. A physical edge became a flow variable together with a closure factor. The correspondence is systematic and is tabulated in §2.3; the point here is only that the two drawings answer different questions. The physical graph says where things are. The factor graph says which equations constrain which unknowns.

Second, the factor graph has a cycle, although the physical graph is a chain. Follow $T_2 \rightarrow c_{12} \rightarrow Q_{12} \rightarrow b_2 \rightarrow Q_{2a} \rightarrow c_{2a} \rightarrow T_2$. Each step is an edge of the figure. The cycle exists because there are two routes by which T_2 and Q_{2a} are tied together: directly, through the

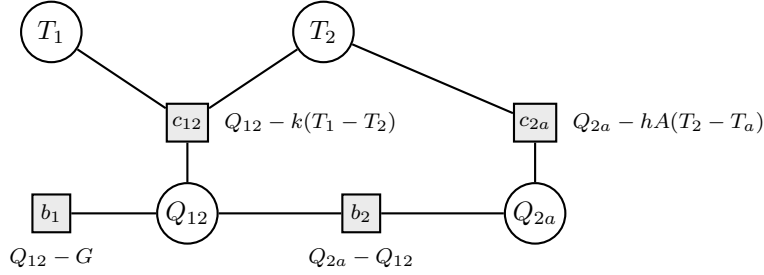


Figure 2.1: The processor heat path of Example 1.1 as a factor graph. Circles are the four unknowns; squares are the four rows of $\mathbf{F}$. The two balance rows b_1, b_2 read only flows. The two closures c_{12}, c_{2a} read a flow and the potentials at the ends of their edge. The known source G and the imposed inlet temperature T_a are constants inside their factors, not nodes.

convection closure, and indirectly, through the conduction closure and the balance at node 2. Both hold at once. This is not a defect of the drawing. It is a fact about the equations, and it has consequences for inference that Part III will have to face: the factor graph of a physically tree-shaped system is not, in general, a tree.

2.2 Three languages

A factor graph is one of three standard ways to draw a function that splits into local pieces. All three were invented for probability distributions, and Chapter 3 will use them that way. But each is defined by the shape of a factorization, not by what the factors mean, so they can be compared now, on the deterministic system, where the comparison is sharpest.

Throughout this section, a *factorization* of a function Φ of many variables is a way of writing it as a product of functions, each of which reads only a subset of the variables. For the residual system the function is the indicator “every row is satisfied”, which is the product over rows of the indicator “this row is satisfied”. Each row is a local piece. The three languages differ in what they draw and what they leave out.

2.2.1 Directed graphs

A *directed graphical model*, or Bayesian network, draws each variable as a node and each factor as a set of arrows into one variable from the variables it depends on. The factorization it encodes is

$$\Phi(X_1, \dots, X_n) = \prod_i \phi_i(X_i \mid \text{pa}(X_i)), \quad (2.1)$$

one factor per variable, each reading that variable and its *parents* $\text{pa}(X_i)$, the sources of the arrows into it. The graph must have no directed cycle. When the factors are probabilities the form is $P(A)P(B \mid A)P(C \mid B)$ for the chain $A \rightarrow B \rightarrow C$, and the arrows read as “given”.

The directed language is the natural one when the system has a generative story: something happens first, and something else depends on it. Weather drives the temperature of a conductor; the conductor’s temperature sets its rating. The chain


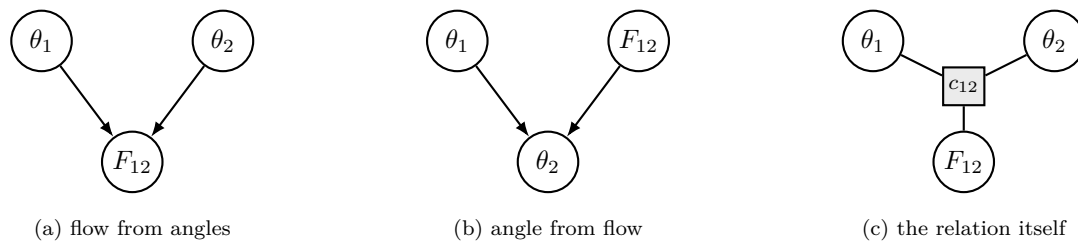


Figure 2.2: Three drawings of one closure, $F_{12} - B(\theta_1 - \theta_2) = 0$. Panels (a) and (b) are directed and each commits to a computation; they encode different factorizations of the same relation and are both correct. Panel (c) is a factor graph and commits to nothing beyond the relation.



is a faithful picture. Each arrow points from a cause to an effect, the factorization $\phi(W) \phi(T | W) \phi(R | T)$ is the story told in order, and nobody would draw it the other way.

2.2.2 The directionality problem

Now try to draw a closure in the same language. The DC line closure of Example 1.2 is

$$F_{12} = B(\theta_1 - \theta_2). \quad (2.2)$$

The directed language needs one variable to be the child and the rest to be its parents. The textbook arrangement is $\theta_1 \rightarrow F_{12} \leftarrow \theta_2$, with B as a third parent if it is uncertain. But Principle 1.2 says the physics asserts no such thing. The closure is equally $\theta_2 = \theta_1 - F_{12}/B$, which is $\theta_1 \rightarrow \theta_2 \leftarrow F_{12}$, or $B = F_{12}/(\theta_1 - \theta_2)$, which is a third orientation. Figure 2.2 draws the first two.

Each orientation is a correct picture of the same relation, and each encodes a different way of computing it. So the directed drawing is not a property of the physics. It is a property of the physics together with a choice of which quantities are known. That choice changes with the question, and the drawing changes with it.

This might be tolerable if some orientation always existed. It does not. Consider what an orientation of the whole system means: every row is assigned one output variable, no two rows share an output, and the arrows from inputs to outputs contain no directed cycle. An orientation with those properties is exactly an order in which the equations can be solved one at a time by substitution. Each row, taken in order, has all its inputs already computed and delivers its output.

For the processor heat path such an order exists. Read Figure 2.1: b_1 delivers $Q_{12} = G$; b_2 then delivers $Q_{2a} = Q_{12}$; c_{2a} then delivers T_2 ; c_{12} finally delivers T_1 . The directed drawing is $G \rightarrow Q_{12} \rightarrow Q_{2a} \rightarrow T_2 \rightarrow T_1$, and it is the order in which the example was solved by hand. But now change the boundary condition. Impose the heat rate $Q_{2a} = \bar{Q}$ instead of the inlet temperature (Exercise 1.1). Then c_{2a} must deliver T_a , b_2 must deliver Q_{12} from Q_{2a} , and b_1 must deliver G . Every arrow reverses. The same physics, the same rows, and a different directed graph, because a different quantity was imposed at the boundary.

For the DC triangle no order exists at all. Try to build one. The balance at bus 2 reads F_{12} and F_{23} and must deliver one of them; the balance at bus 3 reads F_{13} and F_{23} and must deliver one of them. Suppose bus 2 delivers F_{12} and bus 3 delivers F_{13} . Then the closure c_{12} must deliver θ_2 from F_{12} , the closure c_{13} must deliver θ_3 from F_{13} , and c_{23} must deliver F_{23} from θ_2 and θ_3 . But bus 2 needed F_{23} to deliver F_{12} , and F_{23} needs θ_2 , which needs F_{12} . That is a directed cycle. Every other assignment closes a cycle the same way; Exercise 2.2 asks for the full check. The loop in the network is an irreducible block of two equations in two unknowns, the 2×2 system of equation (1.21), and no sequence of single-equation substitutions solves it. A directed graph with one variable per node cannot represent it without first collapsing the block into one node that holds both angles, which is to say without giving up on drawing the structure at all.

The argument can be made exact, and the exact form is the one that modeling compilers use.

Proposition 2.1 (When an order of computation exists). *A square residual system admits an order of single-row substitutions if and only if there is an assignment of one distinct output variable to each row such that the dependency graph, with an arrow from every input of a row to its output, has no directed cycle. Equivalently, the system's rows decompose into irreducible blocks, sets of rows that must be solved simultaneously, and an order exists exactly when every block has one row.*

Proof. If an order exists, take each row's output to be the variable it delivers; the outputs are distinct because each variable is delivered once, and the dependency graph has no cycle because every arrow points from a variable delivered earlier to one delivered later. Conversely, given such an assignment with an acyclic dependency graph, a topological order of that graph orders the outputs, and hence the rows, so that every row's inputs have been delivered before it is reached. For the second statement, fix any assignment, which is a perfect matching of rows to variables in the bipartite factor graph, and draw an arrow from row r to row s when s reads the variable matched to r . The strongly connected components of this graph are the blocks; they do not depend on which perfect matching was chosen, a fact due to Dulmage and Mendelsohn, and a block with more than one row is a directed cycle among rows that no matching removes. An order exists exactly when every component is a single row. $\square$

The proposition turns the hand argument into a count, and the counts are in the chapter's script, `ch02_factor_graphs.py`, and in Table 2.1. The processor heat path has one assignment of outputs to rows, and its dependency graph is acyclic: the order found above is the only one. The DC triangle has three assignments, and every one has a directed cycle; its five rows form a single irreducible block. The coolant loop of Example 1.3, with twenty rows, has a block of ten, the four mass balances and six laminar closures, which is the mass network with its parallel branches; a block of three, the supply header's energy balance with the two carrier closures that leave it, which share the header temperature; and seven rows in blocks of one. Given the mass flows, the energy problem is nearly an order of substitutions, downstream node by downstream node, which is how a plant engineer computes it by hand; the mass problem is a loop and is not.

Principle 2.1. *A directed graph encodes an order of computation. Physics supplies relations, not an order. Where an order exists it is fixed by the choice of boundary conditions and changes when they change; where the physics has a loop, no order exists.*

Table 2.1: The three examples of Chapter 1 as factor graphs: rows and variables, edges of the factor graph (nonzeros of $\mathbf{J}$), its cycle rank (edges minus nodes plus one), the sizes of the irreducible blocks of Proposition 2.1, and the edges of the Markov graph (off-diagonal nonzeros of $\mathbf{J}^\top \mathbf{J}$).

system	rows	variables	edges	cycle rank	blocks	Markov edges
processor heat path	4	4	8	1	1, 1, 1, 1	5
DC triangle	5	5	11	2	5	7
coolant loop	20	20	53	14	10, 3, seven of 1	46

2.2.3 Undirected graphs

An *undirected graphical model*, or Markov random field, draws each variable as a node and joins two variables by an edge whenever they appear together in some factor. The factorization it encodes is

$$\Phi(X_1, \dots, X_n) = \prod_C \psi_C(X_C), \quad (2.3)$$

a product over *cliques* C , sets of mutually adjacent variables, of functions ψ_C that read only the variables in the clique. There are no arrows. A factor reads “these variables are jointly compatible”, not “this one is computed from those”. That is already the right reading for a closure, and it is why the undirected language is closer to physics than the directed one.

It still forgets something. The undirected graph of the DC line closure is a triangle on $\theta_1, \theta_2, F_{12}$: all three are pairwise adjacent because all three appear in one factor. But the same triangle is drawn for three separate pairwise relations, one on each pair, and for one three-way relation, and for a three-way relation together with a pairwise one. The graph records which variables interact and loses how many relations there are and which variables each one reads. For the DC triangle, where two closures both read θ_2 and two balances both read F_{23} , the undirected drawing merges relations that the physics keeps distinct. Since the relations are the physics, this is the wrong thing to forget.

2.2.4 Factor graphs

A *factor graph* is Definition 2.1 with the factors allowed to be any local functions:

$$\Phi(X_1, \dots, X_n) = \prod_f \varphi_f(X_f), \quad (2.4)$$

where X_f is the scope of factor f . Variables are circles, factors are squares, and a square is joined to exactly the circles in its scope. Nothing is oriented and nothing is merged. Panel (c) of Figure 2.2 is the DC line closure in this language: one square, three circles, and no claim about which is computed from which.

The factor graph keeps what the other two languages lose. It keeps the identity of each relation, which the undirected graph merges into cliques. It keeps the absence of direction, which the directed graph is forced to invent. And it is exactly the sparsity pattern of the Jacobian, so it costs nothing to construct: it is already there in the compiled model.

Principle 2.2. *A factor graph separates variables from the relations among them, and draws both. It is the language in which a residual system is its own picture.*

Table 2.2: What each physical object becomes in the factor graph, and what it will become when probability is attached.

Physical object	Residual system	Factor graph	Part II role
Balanced or zero-storage node	one balance row per tracked domain	a factor whose scope is the incident flows (and the node's storage state)	conservation factor
Edge channel	one flow variable and one closure row	a variable node and a factor whose scope is the flow, the end potentials, and the parameters	closure factor
Reservoir	a substituted constant, or an explicit boundary row	a constant inside the neighboring factors, or a unary factor on one variable	prior on a boundary condition
Freed parameter	a column of $\mathbf{J}$	a variable node in the scope of every closure that reads it	prior on a parameter
Sensor	none	none yet	likelihood factor

Directed and undirected graphs are not wrong, and both will return. A directed graph is the right picture for a genuinely generative piece of a model, such as the weather chain above, and Chapter 3 attaches such pieces to the factor graph as priors. An undirected graph is the right picture for asking which variables are conditionally independent of which, and Chapter 5 uses it for exactly that. But the model is built, and inference is organized, on the factor graph.

2.3 The physical system as a factor graph

The correspondence noticed in Figure 2.1 is general. Table 2.2 states it: each object of the physical graph of Chapter 1 becomes a definite set of nodes in the factor graph. The last column anticipates Part II.

Two remarks on the table.

A reservoir can be drawn either way. Substituting its value makes it vanish into the factors that read it, as T_a vanished into c_{2a} in Figure 2.1. Keeping it as a variable with an explicit row $z_k - \bar{z}_k = 0$ makes it a variable node with one unary factor. The two are equivalent now, and the second becomes the natural one the moment $\bar{z}_k$ is uncertain, because the unary factor is then simply replaced by a prior. The factor graph is drawn once, and only the meaning of one square changes.

A sensor has no row in the deterministic system, which is the gap §1.8 identified. In the factor graph it will be a unary factor on the variable it observes. That is the whole of the change Chapter 3 makes to the structure: sensors are added as squares of degree one. The rest of the graph is untouched.

Figure 2.3 draws the DC triangle. It has the cycle traced in thick lines, a second cycle through θ_3 on the right, and a long cycle that goes around the whole figure. The network's single physical loop has become several loops in the factor graph, and the processor heat path, which had no physical loop, had one. Counting physical loops does not predict the shape of the factor graph.

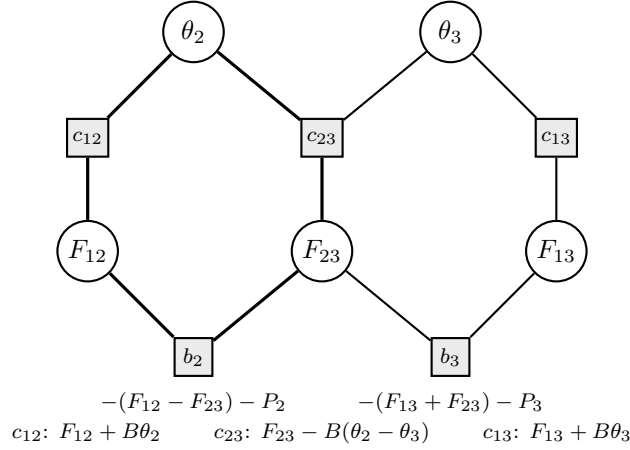


Figure 2.3: The DC triangle of Example 1.2 as a factor graph: five unknowns, five rows. The reference angle $\theta_1 = 0$ and the injections P_2, P_3 are constants inside their factors. The thick edges trace one of the graph's cycles, $\theta_2 \rightarrow c_{12} \rightarrow F_{12} \rightarrow b_2 \rightarrow F_{23} \rightarrow c_{23} \rightarrow \theta_2$; there are others.

2.3.1 A bus is not a variable

The tempting simplification is that a physical node is a variable and a physical edge is a factor. It is a useful first intuition and it is wrong in both halves.

A physical bus in the DC model has one unknown, its angle, and one balance row; that is the only case where the simplification is nearly right, and even there the balance is a factor, not a variable. In an AC model the same bus has an angle and a voltage magnitude, a real and a reactive injection, and two balance rows. A thermal node has a temperature and possibly a stored energy and a storage row. A physical node becomes several variable nodes and one or more factor nodes.

A physical line in the DC model has one flow and one closure. A line whose susceptance is uncertain adds a parameter variable. A line whose rating depends on its temperature, and whose temperature depends on the weather, adds a temperature variable, a thermal closure and a rating closure. A line that may be out of service adds a discrete availability variable, to which Chapter 7 is devoted. A physical edge becomes as many variable nodes and factor nodes as the physics of the edge requires.

Principle 2.3. *The physical topology guides the factorization; it does not dictate a one-to-one map. The closures decide which variables exist and which factors read them.*

2.3.2 Two domains on one graph

The coolant loop of Example 1.3 shows the map at its richest. Its factor graph has forty nodes, twenty variables and twenty factors, joined by fifty-three edges, one per nonzero of the Jacobian of Figure 1.4. Figure 2.4 draws the part of it that belongs to one edge of the physical graph, the branch from the supply header to plate a , together with the balances at its ends. The pattern repeats for every edge.

The figure makes two points. The two domains are two layers of one graph, joined only through the mass flows, which the carrier closures read; a temperature measurement at plate a

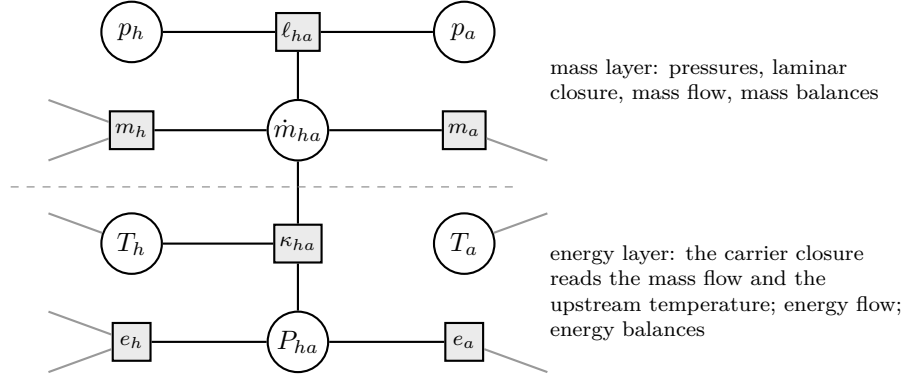


Figure 2.4: One branch of the coolant loop as a factor graph. Above the dashed line, the mass domain: the laminar closure ℓ_{ha} reads the two pressures and the mass flow, and the mass balances m_h , m_a read the flow. Below it, the energy domain: the carrier closure κ_{ha} reads the energy flow, the upstream temperature and the mass flow, and the energy balances read the energy flow. The mass flow $\dot{m}_{ha}$ is the only variable in both layers; it is where the domains couple, and it is why a temperature measurement can inform a pressure.

constrains $\dot{m}_{ha}$ through κ_{ha} , and $\dot{m}_{ha}$ constrains the pressures through ℓ_{ha} . That path exists because the incidence matrix is shared. And the graph is loopy in both layers: the mass layer has the loop of the two parallel branches, which Proposition 2.1 found as a block of ten rows, and the energy layer, even though energy given mass is nearly an order of substitutions, has cycles through every node with two outgoing carriers. The cycle rank of the whole, edges minus nodes plus one, is fourteen.

2.4 The factor graph is not unique

Definition 2.1 draws one factor per row of $\mathbf{F}$. That is the finest factorization the model offers, and it is the canonical one for constructing the model. It is not the only one, and it is not always the one to compute with.

Take the DC triangle and eliminate the flows. Substitute each closure into the balances that read its flow, as was done to reach equation (1.21). The result is two rows in two unknowns,

$$k_2(\theta_2, \theta_3) = 2B\theta_2 - B\theta_3 - P_2, \quad k_3(\theta_2, \theta_3) = -B\theta_2 + 2B\theta_3 - P_3, \quad (2.5)$$

and its factor graph has two variable nodes and two factor nodes, each factor reading both variables (Figure 2.5). The solution set is unchanged: the angles that satisfy $k_2 = k_3 = 0$ are exactly the angles of the five-row solution, and the flows are recovered from them by the closures. Three variables and three factors have disappeared from the drawing.

The same operation on the processor heat path eliminates Q_{12} and Q_{2a} and leaves two rows in T_1 , T_2 , each reading both. Both reduced graphs still have a cycle, a four-cycle through the two factors, because two factors read the same pair. Merge the two factors into one, which is always allowed since a product of two local functions with the same scope is one local function with that scope, and the chain's reduced graph is finally a tree: one factor on $\{T_1, T_2\}$. The triangle's reduced graph, merged, is a single factor on $\{\theta_2, \theta_3\}$, also a tree, and also trivial.

The coolant loop shows the same operation on a larger graph, and shows what it does to the Markov graph. Eliminate the six mass flows from the mass layer: substitute each laminar closure

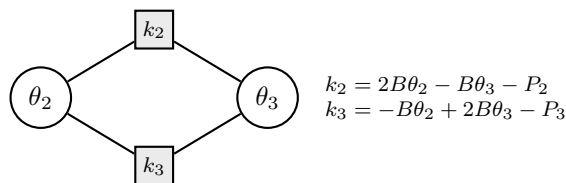


Figure 2.5: The DC triangle after eliminating its flows: the nodal form. Two variables, two factors, each reading both. It is a coarser factorization of the same solution set as Figure 2.3, and it still has a cycle, of length four, because two factors share the same scope.

into the two mass balances that read its flow. What remains is four rows on the four pressures, each row reading its own node's pressure and its neighbors', with the supply and suction pressures as constants. The Markov graph of these four variables has four edges, $h-a$, $h-b$, $a-r$, $b-r$, and is the pipe network's own graph, a four-cycle. Before elimination the twenty variables had forty-six Markov adjacencies (Table 2.1); the pressures alone had none, since no row reads two pressures without a flow between them. Elimination created the four adjacencies by joining every pair of variables that shared a factor with an eliminated one. That is fill, the subject of Chapter 5, and here it is benign: it reproduces the physical network. The same substitution in the energy layer, given the flows, leaves four rows on the four temperatures with the network's edges directed downstream, which is why energy given mass is nearly an order of substitutions.

None of these is the wrong graph. Each is a factorization of the same function, and equation (2.4) is satisfied by all of them. They differ in how many variables they expose and how finely they split the relations, and those differences will govern the cost of inference. Chapter 5 shows that the cost of exact inference depends on a property of the factor graph called its treewidth, and treewidth is a property of the drawing, not of the solution set. Choosing the factorization is choosing the treewidth.

Principle 2.4. *The row-per-factor graph is canonical for building a model. Coarser factorizations, obtained by eliminating variables and merging factors, describe the same solution set with a different graph, and the graph is what inference pays for.*

There is a physical reading of elimination that is worth stating now, because Chapter 8 builds on it. Eliminating the flows of the triangle produced the reduced susceptance matrix, which is what a power engineer writes down first. Eliminating everything inside a subsystem except its ports produces a factor on the ports alone: the subsystem as its neighbors see it. That factor is the algebraic form of Proposition 1.1, and computing it is the Schur complement of Chapter 8. The boundary of Chapter 1 is a separator in the factor graph, and eliminating the interior is how a region is summarized to the rest of the system.

2.5 Vocabulary

The rest of the book uses a small set of graph-theoretic terms about the factor graph. They are collected here.

Scope. The set of variables a factor reads. Written $\mathbf{z}_f$ for factor f .

Neighbors. The factors that read a variable, or the variables a factor reads. The two are the two ends of the bipartite edge set.

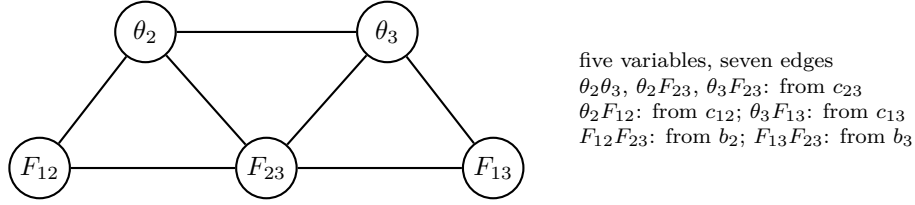


Figure 2.6: The Markov graph of the DC triangle in row-per-factor form. Each edge is a pair of variables that some factor reads together; the closure c_{23} , with scope of size three, contributes a triangle. The graph is the sparsity pattern of $\mathbf{J}^\top \mathbf{J}$ for the Jacobian of Example 1.2, and Chapter 6 will show it is the sparsity pattern of the posterior precision.

Degree. The number of neighbors. A prior or a sensor is a factor of degree one. A balance factor has degree equal to the number of incident edge channels plus one for a storage state.

Path, cycle, tree. As in any graph. A factor graph with no cycle is a tree; a factor graph with a cycle is *loopy*. All three examples of this chapter are loopy in row-per-factor form.

Cycle rank. The number of independent cycles, which for a connected graph is the number of edges minus the number of nodes plus one; zero for a tree. Table 2.1 lists it for the examples.

Markov graph. The undirected graph on the variables alone, in which two variables are adjacent when some factor reads both. It is the sparsity pattern of $\mathbf{J}^\top \mathbf{J}$, and it is the graph on which conditional independence is read in Chapter 5.

Separator. A set of variables whose removal disconnects the Markov graph. The ports of a subsystem are a separator between its interior and the rest of the system.

The Markov graph deserves more than a sentence, because the identification with $\mathbf{J}^\top \mathbf{J}$ is not a coincidence.

Proposition 2.2 (The Markov graph is the pattern of $\mathbf{J}^\top \mathbf{J}$). *Two variables are adjacent in the Markov graph of a residual system if and only if the corresponding off-diagonal entry of $\mathbf{J}^\top \mathbf{J}$ is structurally nonzero.*

Proof. The entry $(\mathbf{J}^\top \mathbf{J})_{ij} = \sum_k J_{ki} J_{kj}$ is a sum over rows. A term is structurally nonzero exactly when row k reads both variable i and variable j , that is, when both are in the scope of factor k . The sum is structurally nonzero when at least one such row exists, which is the definition of adjacency in the Markov graph. (Numerical cancellation between rows could make the entry zero by accident; the structural statement ignores that, as sparsity analysis always does.) $\square$

Figure 2.6 draws the Markov graph of the DC triangle: five variables, seven edges, one per pair that shares a factor, and the script confirms that the same seven pairs are the off-diagonal nonzeros of $\mathbf{J}^\top \mathbf{J}$. Chapter 6 shows that $\mathbf{J}^\top \mathbf{J}$, suitably weighted, is the precision matrix of the Gaussian posterior. The Markov graph of the physics is therefore the sparsity pattern of the posterior’s precision. That single fact is what makes inference on a physical system affordable at scale, and it was visible in this chapter, before any probability was introduced.

2.6 In practice

Build the row-per-factor graph and keep it. It is the Jacobian’s pattern and costs nothing. Coarser graphs are derived from it when a solver needs them; the fine one is the record of what

the model asserts.

Name every factor after its row. A factor called “balance at node 7” or “closure on line 12–13” can be pointed at when a check fails, a residual is large, or a measurement disagrees. A factor called φ_{41} cannot. The names of Table 2.2 are the vocabulary the rest of the book uses.

Keep reservoirs as unary factors. Substituting an imposed value into its neighbors is tidy and loses the place where the value will later become a prior. A variable with one square attached is the form that Chapter 3 needs, and it costs one node.

Do not let a bus be a variable. The commonest error of a reader arriving from graphical models is one circle per physical node and one square per physical edge. It is wrong for every model with more than one unknown per node, which is every model beyond the DC approximation, and it hides the closures, which are where the physics and the parameters live.

Expect loops. A physically tree-shaped system has a loopy factor graph whenever a variable is tied to another by two routes, which is always, since a flow appears in a closure and in a balance at each end. Do not build inference on the assumption of a tree; build it on separators, which Chapter 5 supplies.

Run the block decomposition. Proposition 2.1’s blocks say which parts of a model can be solved by substitution and which must be solved simultaneously, and modeling compilers compute them in linear time. A block that is unexpectedly large is usually a modeling error, a missing boundary condition or a closure written on the wrong variables, and the block names the rows involved.

2.7 What is missing

The factors of this chapter are indicators. Each is one where its row is satisfied and zero where it is not, and their product is one on the solution set and zero elsewhere. That is a legitimate factorization and the graph is a legitimate factor graph, but it is not yet a model of anything uncertain. The solution set of a square, well-posed system is a point.

Chapter 3 keeps every node and every edge of the factor graph and changes what the squares mean. A balance factor becomes “the balance holds to within a residual of this scale”. A closure factor becomes the same for its relation. A reservoir’s unary factor becomes a prior. A sensor, drawn for the first time, is a factor of degree one that says how far its reading may be from the variable it observes. The product of the squares is then a function that is large where every relation nearly holds and small elsewhere, and after normalization it is a probability distribution over the whole state of the system. Every question in Part IV is a question about that distribution, and every one is answered on this graph.

Notes and further reading

Factor graphs in the form used here, a bipartite graph of variables and local functions with the product of the functions as the object of study, were defined by Kschischang, Frey and Loeliger

[54]; Loeliger’s tutorial [63] is the gentlest introduction, and Dellaert and Kaess [19] show them used for large sparse estimation problems in robotics, which is the closest engineering use to this book’s. Directed and undirected graphical models, their factorizations and the relations between them are treated in full by Koller and Friedman [50] and Lauritzen [56]; the point of §2.2 that a directed model can represent a relation only after an orientation has been chosen, and that different orientations encode different factorizations of the same joint, is standard there.

The directionality argument of §2.2.2 is the book’s, but its ingredients are not. That a system of equations admits an order of forward substitution exactly when its bipartite equation-variable graph has a matching whose induced dependency graph is acyclic, and that a looped system decomposes into irreducible blocks, is the Dulmage–Mendelsohn decomposition [22]; equation-based modeling languages use it, together with Pantelides’ algorithm [78], to decide how to solve a model, and Benveniste, Caillaud and Malandain [6] give the theory. The chapter’s contribution is to connect that decomposition to the choice of graphical language: a directed graph is available exactly when the decomposition has no block larger than one.

The bipartite graph of a residual system as the sparsity pattern of its Jacobian, and elimination on it as a graph operation, are the standard graph view of sparse direct methods [17, 87]. The identification of the Markov graph with the pattern of $\mathbf{J}^T \mathbf{J}$ is the same observation as the graph of the normal equations in least-squares theory. The insistence that a physical bus is several variables and several factors is the book’s, and it matters because the alternative, one variable per bus and one factor per line, is the model that a reader arriving from the graphical-model side would draw first.

Water distribution networks have been drawn as factor graphs in exactly the sense of §2.3. Han, Eguchi, Mehrotra and Venkatasubramanian [36] write the mass balance at each junction and the Hazen–Williams head loss along each pipe as factors, with the heads and the pipe flows as variables, and estimate the state of a damaged network from a few pressure and flow sensors; Irofti, Romero-Ben, Stoican and Puig [39] chain two such graphs, one estimating the leak-free state over a window of readings and one placing a leak from the residuals of the first, and compare the result with interpolation and Kalman-filter baselines on published networks. Both build on the sparse nonlinear least-squares machinery that Dellaert and Kaess [19] describe for robotics. The point of §2.3 that a physical node is several variables and several factors is visible in both: a junction contributes a head, a demand and a balance factor, a pipe a flow and a closure factor, and a sensor a unary factor on one of them.

Summary

- The factor graph of a residual system is its Jacobian’s sparsity pattern drawn as a bipartite graph: variables as circles, rows as squares.
- Physical nodes become balance factors; physical edges become a flow variable and a closure factor; reservoirs become constants or unary factors; sensors will become unary factors. A bus is not a variable.
- Of the three graphical languages, the directed one encodes an order of computation that physics does not supply and that loops forbid; the undirected one merges distinct relations into cliques; the factor graph keeps both the relations and their lack of direction.
- An order of computation exists exactly when every irreducible block has one row. The chain has one order; the triangle has three candidate assignments, all cyclic; the coolant loop has a ten-row mass block and an energy problem that is nearly an order.

- Two domains are two layers of one factor graph, coupled through the variables the carrier closures read.
- A physically tree-shaped system can have a loopy factor graph. Counting physical loops does not predict the factor graph's shape.
- The factor graph is not unique. Eliminating variables and merging factors gives coarser factorizations of the same solution set, and the choice governs the cost of inference.
- The Markov graph of the physics is the sparsity pattern of $\mathbf{J}^T \mathbf{J}$, which Part II will identify as the posterior precision.

Exercises

Exercise 2.1. Draw the factor graph of the mixing junction: two inlet streams with known mass rates and enthalpies feeding one junction with one outlet, balanced in both energy and mass, with a carrier closure $P = \dot{m} h$ on each stream. Five unknowns, five rows. Identify every cycle.

Exercise 2.2. Complete the argument of §2.2.2 for the DC triangle: enumerate every assignment of an output variable to each of the five rows such that no two rows share an output, and show that every such assignment contains a directed cycle. How many assignments are there?

Exercise 2.3. A radial branch circuit is a tree of n buses fed from a distribution busbar, treated as a reservoir, with one run into each bus and a known load at each bus. Show that its DC residual system admits an order of computation, write it down, and show that it is the order in which a facility engineer computes the circuit by hand. Then add a single tie closing one loop and show that the order is destroyed.

Exercise 2.4. For the processor heat path, form the reduced two-row system in (T_1, T_2) by eliminating the flows, and confirm by direct substitution that its solutions coincide with those of the four-row system. Draw its factor graph before and after merging the two factors. Which of the three graphs, four-row, two-row, or merged, has the largest factor scope?

Exercise 2.5. Draw the Markov graph of the DC triangle in row-per-factor form, and verify that it is the sparsity pattern of $\mathbf{J}^T \mathbf{J}$ for the Jacobian of Example 1.2. Then draw the Markov graph of the nodal form (Figure 2.5). Which pairs of variables are adjacent in the first and absent from the second, and why does that not change the solution?

Solutions to selected exercises

Exercise 2.2. The rows and their scopes are b_2 on $\{F_{12}, F_{23}\}$, b_3 on $\{F_{13}, F_{23}\}$, c_{12} on $\{\theta_2, F_{12}\}$, c_{13} on $\{\theta_3, F_{13}\}$ and c_{23} on $\{\theta_2, \theta_3, F_{23}\}$. An assignment gives each row one of its variables with no repeats. Since θ_2 can be delivered only by c_{12} or c_{23} and θ_3 only by c_{13} or c_{23} , and c_{23} can deliver only one of them, at least one of c_{12} , c_{13} delivers its angle. Enumerating: (1) $c_{12} \rightarrow \theta_2$, $c_{13} \rightarrow \theta_3$, $c_{23} \rightarrow F_{23}$, $b_2 \rightarrow F_{12}$, $b_3 \rightarrow F_{13}$; (2) $c_{12} \rightarrow F_{12}$, $c_{23} \rightarrow \theta_2$, $c_{13} \rightarrow \theta_3$, $b_2 \rightarrow F_{23}$, $b_3 \rightarrow F_{13}$; (3) the mirror image of (2) with the roles of buses 2 and 3 exchanged. There are three, and no others. Each has a directed cycle. In (1), c_{12} needs F_{12} , which b_2 delivers from F_{23} , which c_{23} delivers from θ_2 , which c_{12} was to deliver: $F_{12} \rightarrow \theta_2 \rightarrow F_{23} \rightarrow F_{12}$. In (2), b_2 delivers F_{23} from F_{12} , c_{12} delivers F_{12} from θ_2 , and c_{23} delivers θ_2 from F_{23} and θ_3 : again $F_{23} \rightarrow \theta_2 \rightarrow F_{12} \rightarrow F_{23}$. Case (3) is the mirror. The five rows are one irreducible block, as Proposition 2.1 says, and the script confirms the three assignments and the absence of an acyclic one.

Exercise 2.4. Substitute $Q_{12} = k(T_1 - T_2)$ from c_{12} into b_1 and $Q_{2a} = hA(T_2 - T_a)$ from c_{2a} together with Q_{12} into b_2 :

$$k_1 = k(T_1 - T_2) - G, \quad k_2 = hA(T_2 - T_a) - k(T_1 - T_2).$$

Setting $k_1 = 0$ gives $T_1 - T_2 = G/k$; substituting into $k_2 = 0$ gives $T_2 = T_a + G/hA$; and then $T_1 = T_a + G/hA + G/k$, which is the four-row solution, 70 and 90 degrees with the numbers of Example 1.1, and the flows follow from the closures. The two-row factor graph has two variables and two factors, each reading both: a four-cycle, cycle rank one. Merging the factors into one on $\{T_1, T_2\}$ leaves a tree of three nodes, cycle rank zero. The largest scope is three in the four-row form (c_{12} reads T_1, T_2, Q_{12}), two in the two-row form, and two in the merged form; the reduced forms have smaller scopes but a denser Markov graph on the variables that remain, which is the trade that Chapter 5 will price.

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

Counting a cold plate, and what a second path costs *variables and rows; one conservation row per heated position and one closure per path; the square count is structural*
`foundation_thermo/thermo_audit/problems/rows_and_unknowns_thermal`

Part II

Probability on a physical graph

Chapter 3

Where probability enters

The factor graph of Chapter 2 was drawn with indicator factors: each square is one where its row holds and zero where it does not. This chapter keeps every circle and every square and changes what the squares mean. The change is small to state and large in consequence. A square no longer says “this relation holds”. It says “this relation holds to within so much”, and the “so much” is a number the modeler supplies. Two new kinds of square appear, priors and sensors, both of degree one. The product of all the squares is then a function over the whole state of the system, large where every relation nearly holds and small elsewhere, and after normalization it is a probability distribution. Every later chapter is about that distribution.

The reader who has not worked with probability on continuous quantities will find the necessary definitions in §3.1. They are few. The reader who has may skip to §3.2.

3.1 A probability on the state

Chapter 1 gathered every unknown of the model into a vector $\mathbf{z} \in \mathbb{R}^n$. The deterministic model picked out one point of $\mathbb{R}^n$, the solution of $\mathbf{F}(\mathbf{z}) = \mathbf{0}$. The probabilistic model instead assigns to every point of $\mathbb{R}^n$ a non-negative number, its *density* $p(\mathbf{z})$, with the density integrating to one over the whole space. The density is large at states the model considers likely and small at states it considers unlikely. A region of state space has probability equal to the integral of p over it.

Three operations on a density are used throughout the book.

Marginalization. The density of some components of $\mathbf{z}$ alone, ignoring the others, is obtained by integrating the others out: $p(z_1) = \int p(z_1, z_2) dz_2$. The marginal of the source G in a model of the processor heat path is what one would report as “the source is G , give or take”.

Conditioning. The density of some components given that others are known is the joint divided by the marginal of the known ones: $p(z_1 | z_2) = p(z_1, z_2)/p(z_2)$. Conditioning on a sensor reading is how a measurement changes what is believed about everything else.

Factorization. A density may be a product of local pieces, $p(\mathbf{z}) \propto \prod_f \varphi_f(\mathbf{z}_f)$, each reading a few components. This is the factor graph of Chapter 2 with the factors now non-negative functions instead of indicators. The proportionality sign hides a constant, the *normalizer* $Z = \int \prod_f \varphi_f d\mathbf{z}$, that makes the integral one.

The Gaussian density is used so often that its form should be recognized on sight. In one

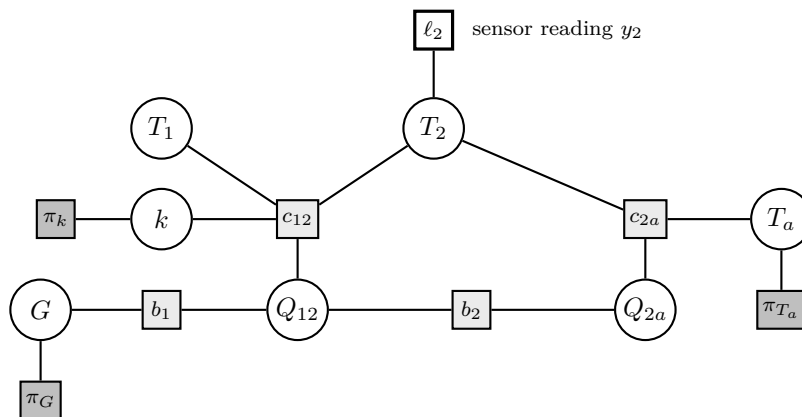


Figure 3.1: The processor heat path with probability attached. Compared with Figure 2.1 three variables have been freed, the source G , the inlet temperature T_a and the conductance k , and each has acquired a prior (dark squares π). A sensor on T_2 has been added (open square ℓ_2). The four physics factors are the same squares as before, now soft. No edge of the earlier graph has moved.

dimension,

$$p(z) = \frac{1}{\sqrt{2\pi\sigma^2}} \exp\left(-\frac{(z-\mu)^2}{2\sigma^2}\right), \quad \text{written } z \sim \mathcal{N}(\mu, \sigma^2), \quad (3.1)$$

has mean μ and standard deviation σ . About two thirds of its probability lies within σ of the mean and about 95 percent within 2σ . Its negative logarithm is a quadratic in z , which is the property that makes everything in Chapter 6 work. Appendix B collects the identities the book needs.

One remark on what the numbers mean. A density on the state of a physical system can be read as a frequency, the fraction of days on which the load at bus 2 takes each value, or as a degree of belief, how strongly the modeler expects the conductance to take each value given a data sheet. The book uses both readings without apology. The machinery is the same, and the practical question is always the same: what does the modeler know, and what does the modeler not know, about each quantity in the model? The answer is written as a factor.

3.2 Five kinds of factor

Every square in the graph is one of five kinds. Two of them, priors and sensors, are new. Three of them, conservation, closure and failure, are the rows of Chapter 1 read in a new way. Figure 3.1 draws all five on the processor heat path and the triangle; the sections that follow define each.

3.2.1 Priors

A *prior* is a unary factor on a quantity the modeler is uncertain about before any measurement is taken: a parameter, a boundary condition, a source. It is what the data sheet, the forecast, or the history says.

The conductance k of the thermal interface in Example 1.1 is quoted on a data sheet as 5 W/K with a tolerance the manufacturer does not state but that experience puts near twenty

percent. Written as a factor,

$$\pi_k(k) = \exp\left(-\frac{(k-5)^2}{2 \cdot 1^2}\right), \quad (3.2)$$

which is $k \sim \mathcal{N}(5, 1^2)$ up to the constant. The inlet temperature is a setpoint the cooling holds only roughly, $T_a \sim \mathcal{N}(20, 3^2)$. The dissipated power is a rating with a spread, $G \sim \mathcal{N}(100, 20^2)$. Each is a square of degree one attached to its variable (Figure 3.1).

Two things distinguish a prior from a boundary condition. A boundary condition is imposed exactly; a prior is imposed softly, and its width is a statement about how far the true value may be from the nominal one. And a boundary condition removes its variable from the unknowns; a prior leaves it in, so that the measurements can move it. The reservoir of Chapter 1, drawn as a unary factor in Table 2.1, is a prior with zero width. Chapter 2 promised that a reservoir becomes a prior by changing the meaning of one square, and this is the change.

Gaussian priors are the default, not the rule. A parameter that must be positive, a load that is bounded, a component whose availability is one or zero, all need other shapes, and Chapter 7 supplies them. For the present chapter everything is Gaussian.

3.2.2 Closure factors

A closure row $r_k(\mathbf{z}) = 0$ becomes the factor

$$\varphi_k(\mathbf{z}_k) = \exp\left(-\frac{r_k(\mathbf{z}_k)^2}{2\sigma_k^2}\right). \quad (3.3)$$

It is one where the relation holds exactly and falls off as the residual grows, on a scale σ_k in the units of the residual. The scope is unchanged: the factor reads exactly the variables the row read.

The scale σ_k is a statement about the closure, not about the system. A conduction law is a model of a physical path. The path has contact resistance that varies with load, a slightly nonlinear conductivity, a small radiative component the law ignores. The heat rate that actually flows differs from $k(T_1 - T_2)$ by an amount the modeler does not know but can bound, and σ_k is that bound. Setting σ_k small says the law is trusted; setting it large says the law is a rough guide. In the limit $\sigma_k \rightarrow 0$ the factor becomes the indicator of Chapter 2, and the deterministic model is recovered.

3.2.3 Conservation factors

A balance row becomes a factor of the same form,

$$\varphi_n(\mathbf{z}_n) = \exp\left(-\frac{r_n(\mathbf{z}_n)^2}{2\sigma_n^2}\right), \quad (3.4)$$

and here the reader who takes conservation seriously will object. Energy is conserved. There is no model error in a balance row. Why give it a width at all?

Two answers, one practical and one structural. The practical answer is that a balance row is exact for the system as modeled, and the system as modeled may be wrong: an unmodeled leak, a bypass, a load that is drawing from somewhere the graph does not show. A balance that cannot be satisfied by any state is the signature of exactly such a defect, and a model that forbids violation cannot report it. A balance with a small width can. The size of the violation

the posterior settles on is the measurement of the defect, and Chapter 12 makes it a diagnostic tool. The structural answer is that a product of factors with zero width is not a density on $\mathbb{R}^n$; it is concentrated on a lower-dimensional surface, and integrating it, conditioning it, marginalizing it all require more care than the general machinery provides. Chapter 4 is about that surface, and about what the width does to it. For now: every physics row, balance or closure, is given a width, the widths of balance rows are chosen small, and the deterministic solve is the limit in which all of them go to zero.

3.2.4 Measurement factors

A sensor reads a variable, or a function of several, with an error. The reading is y_i ; the variable is z_{o_i} ; the error is $\nu_i \sim \mathcal{N}(0, \sigma_i^2)$. Since $y_i = z_{o_i} + \nu_i$, the density of the reading given the state is a Gaussian centered on the variable, and read as a function of the state for the fixed reading it is the *likelihood* factor

$$\ell_i(z_{o_i}) = \exp\left(-\frac{(y_i - z_{o_i})^2}{2\sigma_i^2}\right). \quad (3.5)$$

It is a unary factor on the observed variable, drawn as the open square in Figure 3.1. The sensor scale σ_i is the sensor's accuracy, which its data sheet does state.

Three variations cover what real instrumentation does. A sensor that reads a combination, such as a meter on the total heat leaving a cabinet, has a factor whose scope is every variable in the combination. A sensor with a bias has the bias as a variable of its own, with a prior, in the scope of the factor; the bias is then estimated along with everything else. A sensor that reads a quantity not in $\mathbf{z}$, such as a surface temperature that the model relates to a node temperature by a further closure, needs that closure added as a factor and the surface temperature added as a variable. In every case the change is local: a square, and perhaps a circle, added to the graph, nothing moved.

This is the promise of §2.7 kept. The deterministic model of Chapter 1 had no place for an observation. The probabilistic model has one, and it is a square of degree one.

3.2.5 Failure factors

Some uncertainty is not about how much but about whether. A line is in service or it is not. A valve is open or stuck. A sensor is working or has failed. Such a quantity is a variable with two values, $a \in \{0, 1\}$, its prior is a probability of each, $\mathbb{P}(a = 1) = 1 - q$ with q the failure rate, and the closure that depends on it reads it in its scope:

$$r_{23}(\theta_2, \theta_3, F_{23}, a_{23}) = F_{23} - a_{23} B(\theta_2 - \theta_3). \quad (3.6)$$

With $a_{23} = 1$ this is the line closure of Example 1.2. With $a_{23} = 0$ it says the flow is zero whatever the angles: the line is gone. Figure 3.2 draws it. The variable is discrete, the closure's scope has grown by one, and the product of factors is now a density in the continuous variables times a probability mass in the discrete one. Everything in this chapter still applies; what changes in the computation is the subject of Chapter 7.

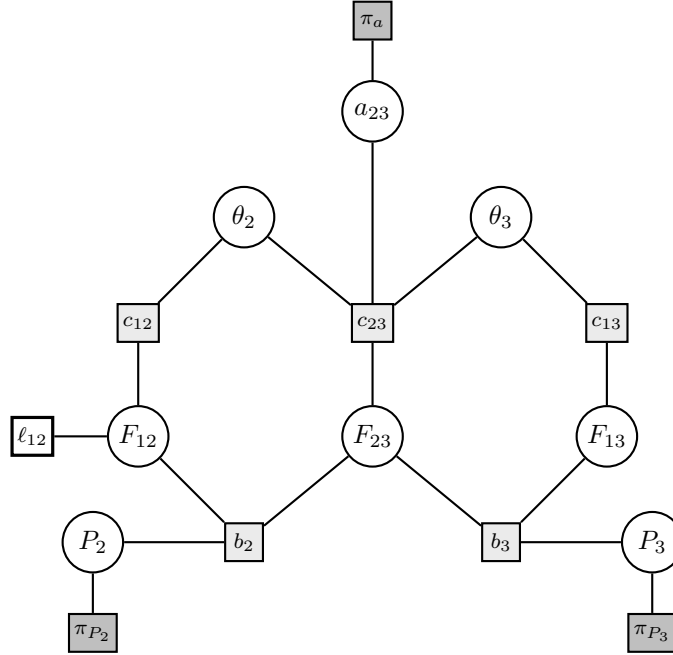


Figure 3.2: The DC triangle with probability attached. The loads P_2 , P_3 are freed and given priors; the line from bus 2 to bus 3 has an availability variable a_{23} with a failure prior, in the scope of its closure; a meter ℓ_{12} reads the flow on line 1–2. The structure of Figure 2.3 is intact inside it.

3.2.6 The complete list

Table 3.1 summarizes. The joint distribution of the whole state is their product,

$$p(\mathbf{z} \mid \mathbf{y}) \propto \prod_j \pi_j(z_j) \prod_k \varphi_k(\mathbf{z}_k) \prod_i \ell_i(z_{o_i}) \quad (3.7)$$

with the failure priors folded into the first product. It is written conditional on the readings $\mathbf{y}$ because the likelihoods depend on them; for fixed readings it is a function of $\mathbf{z}$ alone, and it is called the *posterior*. The word means “after the measurements”. The same product with the likelihoods removed is the *prior predictive* distribution, what the model believes about the state before any sensor is read.

Principle 3.1. *Probability describes uncertainty around quantities. Physics factors enforce relations between them. The joint distribution is the product of both, and its factor graph is the factor graph of the physics with unary squares added.*

3.3 The joint as an objective

Take the negative logarithm of equation (3.7). Every factor is an exponential of a negative quadratic, so the logarithm is a sum of quadratics:

$$-\log p(\mathbf{z} \mid \mathbf{y}) = \sum_j \frac{(z_j - \mu_j)^2}{2\sigma_j^2} + \sum_k \frac{r_k(\mathbf{z}_k)^2}{2\sigma_k^2} + \sum_i \frac{(y_i - z_{o_i})^2}{2\sigma_i^2} + \text{const.} \quad (3.8)$$

Table 3.1: The five kinds of factor. The three physics kinds are the rows of Chapter 1; the other two are new.

Kind	Form	Scope	Where it comes from
Prior π	$\exp(-(z - \mu)^2/2\sigma^2)$	one variable	data sheet, forecast, history
Closure φ	$\exp(-r_k(\mathbf{z}_k)^2/2\sigma_k^2)$	the row's variables	a constitutive law and its error
Conservation φ	$\exp(-r_n(\mathbf{z}_n)^2/2\sigma_n^2)$	the row's variables	a balance law; width small
Likelihood ℓ	$\exp(-(y - z)^2/2\sigma_y^2)$	the observed variable	a sensor and its accuracy
Failure π_a	$\mathbb{P}(a)$ on $\{0, 1\}$	one discrete variable	a failure rate

The most probable state is the one that minimizes this sum. Read the three terms. The first penalizes departure of each uncertain input from its nominal value, in units of that input's spread. The second penalizes violation of each physics row, in units of that row's width. The third penalizes misfit between each sensor and the variable it reads, in units of the sensor's accuracy. The most probable state is the compromise: it moves the inputs away from nominal as little as it can, violates the physics as little as it can, and misfits the sensors as little as it can, with each "as little" weighted by how much the modeler trusts that term.

Equation (3.8) is a weighted least-squares problem. When every row is linear in $\mathbf{z}$ it is a quadratic and its minimizer solves a linear system; when rows are nonlinear it is solved by the same Newton iteration that solved $\mathbf{F}(\mathbf{z}) = \mathbf{0}$, with the extra terms included. Chapter 6 develops this fully. The point to take now is that the deterministic solve of Chapter 1 is the special case of equation (3.8) in which there are no priors, no sensors, and every $\sigma_k \rightarrow 0$: the minimum is then zero, reached only where every row holds, which is the solution.

3.3.1 Residuals in units of their widths

Each term of equation (3.8) is half the square of a *standardized residual*: the departure of an input from its nominal value, the violation of a physics row, or the misfit of a sensor, each divided by its own width. Standardizing puts watts, kelvins and per-unit on one scale, the scale of "how many widths", and it is in that scale that every diagnostic of the book is read. At the most probable state the standardized residuals say where the compromise was struck. For the chain of §3.4 after its first reading, the source sits 0.18 prior widths above nominal, the inlet temperature 0.06 above, and the sensor is fitted to a hundredth of its accuracy; the sum of the squares, 0.037, is twice the objective at its minimum. After the second reading the four residuals are 0.23, -0.09 , 0.08 and -0.07 , and the sum is 0.073: two readings, both fitted to a tenth of an accuracy, at the cost of moving the source a quarter of a width. Chapter 4 names this sum the *misfit* and says what value an adequate model should give; Chapter 12 makes it a test. The point to take now is that a posterior is not only a set of estimates but a set of standardized residuals, and the residuals are where the model says whether it was comfortable.

3.3.2 Conditioning a Gaussian on one reading

The worked examples that follow use one operation over and over: a Gaussian belief about a few inputs, and a sensor that reads a linear combination of them. The operation has a closed form, and it is worth deriving once, because every later chapter uses it.

Proposition 3.1 (One linear reading). *Let $\mathbf{z} \sim \mathcal{N}(\boldsymbol{\mu}, \boldsymbol{\Sigma})$ with $\boldsymbol{\Sigma}$ positive definite, and let a sensor read $y = \mathbf{h}^\top \mathbf{z} + \nu$ with $\nu \sim \mathcal{N}(0, \sigma^2)$ independent of $\mathbf{z}$. Then the posterior of $\mathbf{z}$ given y is*

Gaussian with

$$\boldsymbol{\mu}' = \boldsymbol{\mu} + \mathbf{k}(y - \mathbf{h}^\top \boldsymbol{\mu}), \quad \boldsymbol{\Sigma}' = \boldsymbol{\Sigma} - \mathbf{k} \mathbf{h}^\top \boldsymbol{\Sigma}, \quad \mathbf{k} = \frac{\boldsymbol{\Sigma} \mathbf{h}}{\mathbf{h}^\top \boldsymbol{\Sigma} \mathbf{h} + \sigma^2}. \quad (3.9)$$

Proof. Write $e = y - \mathbf{h}^\top \boldsymbol{\mu}$ for the *innovation*, what was read less what the prior predicts, and $s = \mathbf{h}^\top \boldsymbol{\Sigma} \mathbf{h} + \sigma^2$ for its variance, so that $\mathbf{k} = \boldsymbol{\Sigma} \mathbf{h} / s$. The proof has four steps.

The negative log posterior. By Bayes' rule $p(\mathbf{z} | y) = p(\mathbf{z}) p(y | \mathbf{z}) / p(y)$, and $p(y)$ does not depend on $\mathbf{z}$. The prior density is $(2\pi)^{-n/2} |\boldsymbol{\Sigma}|^{-1/2} \exp[-\frac{1}{2}(\mathbf{z} - \boldsymbol{\mu})^\top \boldsymbol{\Sigma}^{-1}(\mathbf{z} - \boldsymbol{\mu})]$. Given $\mathbf{z}$, the number $\mathbf{h}^\top \mathbf{z}$ is fixed and ν is still $\mathcal{N}(0, \sigma^2)$, because it is independent of $\mathbf{z}$; so $y | \mathbf{z} \sim \mathcal{N}(\mathbf{h}^\top \mathbf{z}, \sigma^2)$, with density $(2\pi\sigma^2)^{-1/2} \exp[-(y - \mathbf{h}^\top \mathbf{z})^2 / 2\sigma^2]$. Multiplying the two densities and taking the negative logarithm,

$$-\log p(\mathbf{z} | y) = J(\mathbf{z}) + K, \quad J(\mathbf{z}) = \frac{1}{2}(\mathbf{z} - \boldsymbol{\mu})^\top \boldsymbol{\Sigma}^{-1}(\mathbf{z} - \boldsymbol{\mu}) + \frac{(y - \mathbf{h}^\top \mathbf{z})^2}{2\sigma^2},$$

where K collects $\frac{n}{2} \log 2\pi$, $\frac{1}{2} \log |\boldsymbol{\Sigma}|$, $\frac{1}{2} \log 2\pi\sigma^2$ and $\log p(y)$, none of which depends on $\mathbf{z}$. The posterior is proportional to $\exp[-J(\mathbf{z})]$, so its shape in $\mathbf{z}$ is fixed by J ; K only makes it integrate to one.

Completing the square. Measure $\mathbf{z}$ from the prior mean, $\mathbf{x} = \mathbf{z} - \boldsymbol{\mu}$. Then $y - \mathbf{h}^\top \mathbf{z} = e - \mathbf{h}^\top \mathbf{x}$, and expanding the square with $(\mathbf{h}^\top \mathbf{x})^2 = \mathbf{x}^\top \mathbf{h} \mathbf{h}^\top \mathbf{x}$,

$$J = \frac{1}{2} \mathbf{x}^\top \mathbf{P} \mathbf{x} - \frac{e}{\sigma^2} \mathbf{h}^\top \mathbf{x} + \frac{e^2}{2\sigma^2}, \quad \mathbf{P} = \boldsymbol{\Sigma}^{-1} + \frac{\mathbf{h} \mathbf{h}^\top}{\sigma^2}.$$

The matrix $\mathbf{P}$ is positive definite, because $\boldsymbol{\Sigma}^{-1}$ is and $\mathbf{h} \mathbf{h}^\top$ is positive semidefinite. Let $\mathbf{m}$ solve $\mathbf{P} \mathbf{m} = \mathbf{h} e / \sigma^2$. Expanding the right-hand side of

$$J = \frac{1}{2}(\mathbf{x} - \mathbf{m})^\top \mathbf{P}(\mathbf{x} - \mathbf{m}) + \text{const}$$

recovers the line above. A density proportional to $\exp[-\frac{1}{2}(\mathbf{x} - \mathbf{m})^\top \mathbf{P}(\mathbf{x} - \mathbf{m})]$ is the Gaussian with mean $\mathbf{m}$ and covariance $\mathbf{P}^{-1}$. So the posterior of $\mathbf{z} = \boldsymbol{\mu} + \mathbf{x}$ is Gaussian with covariance $\boldsymbol{\Sigma}' = \mathbf{P}^{-1}$ and mean $\boldsymbol{\mu}' = \boldsymbol{\mu} + \mathbf{P}^{-1} \mathbf{h} e / \sigma^2$.

The covariance. The claim is $\mathbf{P}^{-1} = \boldsymbol{\Sigma} - \boldsymbol{\Sigma} \mathbf{h} \mathbf{h}^\top \boldsymbol{\Sigma} / s$. Multiplying, and using that $\mathbf{h}^\top \boldsymbol{\Sigma} \mathbf{h}$ is a number,

$$\mathbf{P} \left(\boldsymbol{\Sigma} - \frac{\boldsymbol{\Sigma} \mathbf{h} \mathbf{h}^\top \boldsymbol{\Sigma}}{s} \right) = \mathbf{I} + \mathbf{h} \mathbf{h}^\top \boldsymbol{\Sigma} \left(\frac{1}{\sigma^2} - \frac{1}{s} - \frac{\mathbf{h}^\top \boldsymbol{\Sigma} \mathbf{h}}{\sigma^2 s} \right) = \mathbf{I},$$

because the bracket is $(s - \sigma^2 - \mathbf{h}^\top \boldsymbol{\Sigma} \mathbf{h}) / (\sigma^2 s) = 0$. Since $\boldsymbol{\Sigma} \mathbf{h} \mathbf{h}^\top \boldsymbol{\Sigma} / s = \mathbf{k} \mathbf{h}^\top \boldsymbol{\Sigma}$, this is $\boldsymbol{\Sigma}'$ as stated. The identity is the Sherman–Morrison formula for a rank-one change of $\boldsymbol{\Sigma}^{-1}$.

The mean. From the covariance, $\boldsymbol{\Sigma}' \mathbf{h} = \boldsymbol{\Sigma} \mathbf{h} - \boldsymbol{\Sigma} \mathbf{h} (\mathbf{h}^\top \boldsymbol{\Sigma} \mathbf{h}) / s = \boldsymbol{\Sigma} \mathbf{h} \sigma^2 / s$. Hence $\boldsymbol{\Sigma}' \mathbf{h} / \sigma^2 = \boldsymbol{\Sigma} \mathbf{h} / s = \mathbf{k}$, and $\boldsymbol{\mu}' = \boldsymbol{\mu} + \mathbf{k} e$. $\square$

In one variable, with $\mathbf{h} = 1$, the gain is $\boldsymbol{\Sigma} / (\boldsymbol{\Sigma} + \sigma^2)$ and the covariance formula reads $1 / \boldsymbol{\Sigma}' = 1 / \boldsymbol{\Sigma} + 1 / \sigma^2$: the precisions add. The formulas (3.9) never invert $\boldsymbol{\Sigma}$, and they hold for a singular $\boldsymbol{\Sigma}$ as well, for instance when one input is known exactly; the proof above needs the inverse only to write the prior's density, and Proposition B.3 in Appendix B proves the formulas without it.

What $\mathbf{h}$ is, and where the physics is. The vector $\mathbf{h}$ has one entry for each unknown in $\mathbf{z}$, and the sensor reads the weighted sum $\mathbf{h}^\top \mathbf{z} = h_1 z_1 + \cdots + h_n z_n$. A sensor attached directly to the j th unknown has $\mathbf{h}$ equal to the j th unit vector, a one in position j and zeros elsewhere. A sensor attached to a quantity that is not itself in $\mathbf{z}$ reads the combination of the unknowns that determines that quantity, and the physics is what says which combination. The proposition contains no physics. It is the conditioning of any Gaussian vector on any linear reading, and it would hold for prices or pixels. The physics enters through what the proposition is given: which quantities are the unknowns, what the prior says about them, and above all $\mathbf{h}$, the route by which each unknown reaches what the sensor sees. In the example of §3.4 the sensor sits on a temperature, an entry of $\mathbf{z}$, so its $\mathbf{h}$ is a unit vector; the physics is exact and linear, so every entry of $\mathbf{z}$ is a combination of the source and the inlet temperature, and the same sensor becomes a vector over those two inputs. Soft physics fits the same mould. A linear row $r(\mathbf{z}) = \mathbf{a}^\top \mathbf{z} - b$ of width σ_k contributes the factor $\exp[-(b - \mathbf{a}^\top \mathbf{z})^2 / 2\sigma_k^2]$, which is exactly the likelihood of a sensor with $\mathbf{h} = \mathbf{a}$ that reads the value b with accuracy σ_k . A soft physics row is a reading that always reports that the balance holds, and the proposition folds it in like any other. A nonlinear row, or a sensor on a nonlinear function of $\mathbf{z}$, is linearized at the current state, and $\mathbf{h}$ becomes a row of the Jacobian; Chapter 6 takes that step.

Three things are visible in the formula. The mean moves by the *innovation* $y - \mathbf{h}^\top \boldsymbol{\mu}$, the difference between what was read and what was predicted, times a gain $\mathbf{k}$ that is large in the directions the prior is wide and the sensor is accurate. The covariance shrinks by a rank-one amount, in the direction $\boldsymbol{\Sigma} \mathbf{h}$ and in no other: one reading narrows one combination of the inputs and leaves the orthogonal combinations exactly as they were. And the shrinkage does not depend on the reading's value, only on where the sensor sits and how accurate it is, so the posterior spread can be computed before the sensor is read, which is how a sensor's worth is judged before it is bought. Chapter 11 makes this operation the unit of sequential inference.

Several readings at once are handled by the same algebra in a form that is more convenient when there are many.

Proposition 3.2 (Information form). *Write the Gaussian prior by its precision $\boldsymbol{\Lambda} = \boldsymbol{\Sigma}^{-1}$ and information vector $\boldsymbol{\eta} = \boldsymbol{\Lambda} \boldsymbol{\mu}$. Readings $\mathbf{y} = \mathbf{H} \mathbf{z} + \boldsymbol{\nu}$ with $\boldsymbol{\nu} \sim \mathcal{N}(\mathbf{0}, \mathbf{R})$ give a posterior with precision and information*

$$\boldsymbol{\Lambda}' = \boldsymbol{\Lambda} + \mathbf{H}^\top \mathbf{R}^{-1} \mathbf{H}, \quad \boldsymbol{\eta}' = \boldsymbol{\eta} + \mathbf{H}^\top \mathbf{R}^{-1} \mathbf{y}, \quad (3.10)$$

and mean $\boldsymbol{\mu}' = \boldsymbol{\Lambda}'^{-1} \boldsymbol{\eta}'$, covariance $\boldsymbol{\Sigma}' = \boldsymbol{\Lambda}'^{-1}$.

Proof. The negative log posterior is $\frac{1}{2} \mathbf{z}^\top \boldsymbol{\Lambda} \mathbf{z} - \boldsymbol{\eta}^\top \mathbf{z} + \frac{1}{2} (\mathbf{y} - \mathbf{H} \mathbf{z})^\top \mathbf{R}^{-1} (\mathbf{y} - \mathbf{H} \mathbf{z})$ plus constants; collecting the quadratic and linear terms in $\mathbf{z}$ gives $\frac{1}{2} \mathbf{z}^\top \boldsymbol{\Lambda}' \mathbf{z} - \boldsymbol{\eta}'^\top \mathbf{z}$ with $\boldsymbol{\Lambda}'$ and $\boldsymbol{\eta}'$ as stated, and a Gaussian with that exponent has the mean and covariance claimed. $\square$

In this form a reading *adds* to the precision and the information, and the addition is a sum over readings, one rank-one term each, so readings can be folded in one at a time or all at once with the same result. Proposition 3.1 is the same update expressed in the covariance, the two being related by the matrix identity used in its proof. The information form is the one the rest of the book computes in, because the physics factors of equation (3.7) add to the precision in exactly the same way and keep it sparse; Chapter 6 builds the whole posterior this way.

3.4 A worked example: one sensor, then two

The processor heat path, with numbers, shows what the joint distribution does when a sensor is read. The model is the one of Example 1.1, with the same conductances, $k = 5$ and $hA = 2$ watts per kelvin, and two changes. The source and the inlet temperature are no longer known: they carry the priors $G \sim \mathcal{N}(100, 20^2)$ watts and $T_a \sim \mathcal{N}(20, 3^2)$ degrees, centred on the values Example 1.1 used. And a sensor on T_2 with accuracy $\sigma_y = 0.5$ K reads $y_2 = 72.0$. To keep the calculation by hand, the closures and balances are taken as exact ($\sigma_k \rightarrow 0$). Every number below is produced by a short script, `ch03_chain_posterior.py` in the book's `scripts` directory, which the reader can run.

The example in vectors. The unknown vector is the one of Example 1.1, flows first, with the two inputs appended because they are now unknown too:

$$\mathbf{z} = \begin{pmatrix} Q_{12} \\ Q_{2a} \\ T_1 \\ T_2 \\ G \\ T_a \end{pmatrix} = \begin{pmatrix} \mathbf{q} \\ \mathbf{T} \\ \mathbf{u} \end{pmatrix}, \quad \mathbf{u} = \begin{pmatrix} G \\ T_a \end{pmatrix}.$$

Exact physics leaves no freedom beyond the inputs. Example 1.1 solved $\mathbf{F}(\mathbf{z}) = \mathbf{0}$ for the flows and temperatures in terms of G and T_a : both flows equal G , and $T_1 = \mathbf{h}_1^\top \mathbf{u}$, $T_2 = \mathbf{h}_2^\top \mathbf{u}$. Every entry of $\mathbf{z}$ is therefore a fixed linear combination of the two inputs,

$$\mathbf{z} = \mathbf{S} \mathbf{u}, \quad \mathbf{S} = \begin{pmatrix} 1 & 0 \\ 1 & 0 \\ 0.7 & 1 \\ 0.5 & 1 \\ 1 & 0 \\ 0 & 1 \end{pmatrix},$$

whose third and fourth rows are $\mathbf{h}_1^\top$ and $\mathbf{h}_2^\top$. The prior sits on the inputs,

$$\boldsymbol{\mu}_u = \begin{pmatrix} 100 \\ 20 \end{pmatrix}, \quad \boldsymbol{\Sigma}_u = \begin{pmatrix} 20^2 & 0 \\ 0 & 3^2 \end{pmatrix} = \begin{pmatrix} 400 & 0 \\ 0 & 9 \end{pmatrix},$$

where the zeros off the diagonal say that the source and the inlet temperature are independent a priori. It passes to the whole vector as $\boldsymbol{\mu}_z = \mathbf{S} \boldsymbol{\mu}_u = (100, 100, 90, 70, 100, 20)^\top$ and $\boldsymbol{\Sigma}_z = \mathbf{S} \boldsymbol{\Sigma}_u \mathbf{S}^\top$. The sensor on T_2 reads the fourth entry of $\mathbf{z}$, so in Proposition 3.1 it is the simplest kind: $\mathbf{h} = \mathbf{e}_4$, a one in the position of T_2 and zeros elsewhere. Because $\mathbf{z} = \mathbf{S} \mathbf{u}$, the same reading is $\mathbf{e}_4^\top \mathbf{S} \mathbf{u} = \mathbf{h}_2^\top \mathbf{u}$, a reading of the inputs through $\mathbf{h}_2$. The entries of $\mathbf{h}_2$ are the physics. The first, $1/hA = 0.5$ kelvins per watt, is how far one watt of source raises the heat sink; the second, 1, is how far one degree of inlet temperature does. (The bold $\mathbf{h}$ is the sensor's vector; the h in hA is the convection coefficient.)

The covariance $\boldsymbol{\Sigma}_z$ has rank two, because six unknowns are driven by two inputs, so it is not positive definite. The calculation is therefore done where the freedom is. Proposition 3.1 is applied to $\mathbf{u}$, with $\mathbf{h}_2$, and $\mathbf{S}$ carries the result to all of $\mathbf{z}$: $\boldsymbol{\mu}'_z = \mathbf{S} \boldsymbol{\mu}'_u$ and $\boldsymbol{\Sigma}'_z = \mathbf{S} \boldsymbol{\Sigma}'_u \mathbf{S}^\top$. The proposition's formulas applied to $\mathbf{z}$ directly, with $\mathbf{h} = \mathbf{e}_4$ and the rank-two $\boldsymbol{\Sigma}_z$, give the same posterior to twelve digits.

Before the reading. The prior predicts T_2 at $\mathbf{e}_4^\top \boldsymbol{\mu}_z = \mathbf{h}_2^\top \boldsymbol{\mu}_u = 0.5 \cdot 100 + 1 \cdot 20 = 70.0$, with variance $\mathbf{h}_2^\top \boldsymbol{\Sigma}_u \mathbf{h}_2 = 0.5^2 \cdot 400 + 1^2 \cdot 9 = 109$, a spread of 10.44 degrees. Most of that variance comes from the source, 100 of the 109, against the inlet temperature's 9. The same two products with $\mathbf{h}_1$, the third entries of $\boldsymbol{\mu}_z$ and $\boldsymbol{\Sigma}_z$, give the prior for T_1 , 90.0 ± 14.3 .

After one reading. The reading $y_2 = 72.0$ gives the innovation $e = y_2 - \mathbf{h}_2^\top \boldsymbol{\mu}_u = 2.0$. Proposition 3.1 then takes a handful of products:

$$\boldsymbol{\Sigma}_u \mathbf{h}_2 = \begin{pmatrix} 400 \cdot 0.5 \\ 9 \cdot 1 \end{pmatrix} = \begin{pmatrix} 200 \\ 9 \end{pmatrix}, \quad s = \mathbf{h}_2^\top \boldsymbol{\Sigma}_u \mathbf{h}_2 + \sigma^2 = 109 + 0.25 = 109.25,$$

$$\mathbf{k} = \frac{\boldsymbol{\Sigma}_u \mathbf{h}_2}{s} = \begin{pmatrix} 1.8307 \\ 0.0824 \end{pmatrix}, \quad \boldsymbol{\mu}'_u = \boldsymbol{\mu}_u + \mathbf{k} e = \begin{pmatrix} 100 + 3.66 \\ 20 + 0.16 \end{pmatrix} = \begin{pmatrix} 103.66 \\ 20.16 \end{pmatrix},$$

$$\boldsymbol{\Sigma}'_u = \boldsymbol{\Sigma}_u - \mathbf{k} (\boldsymbol{\Sigma}_u \mathbf{h}_2)^\top = \begin{pmatrix} 400 & 0 \\ 0 & 9 \end{pmatrix} - \begin{pmatrix} 1.8307 \cdot 200 & 1.8307 \cdot 9 \\ 0.0824 \cdot 200 & 0.0824 \cdot 9 \end{pmatrix} = \begin{pmatrix} 33.87 & -16.48 \\ -16.48 & 8.26 \end{pmatrix},$$

where $\mathbf{k} \mathbf{h}_2^\top \boldsymbol{\Sigma}_u = \mathbf{k} (\boldsymbol{\Sigma}_u \mathbf{h}_2)^\top$ because $\boldsymbol{\Sigma}_u$ is symmetric. Read the result off the matrices. The diagonal of $\boldsymbol{\Sigma}'_u$ holds the variances: the source's falls from 400 to 33.87, a spread of 5.8 watts, and the inlet temperature's from 9 to 8.26, a spread of 2.9 degrees. The off-diagonal entry, zero before, is now -16.48 , a correlation of $-16.48 / (5.82 \cdot 2.87) = -0.985$. The posterior of the whole vector follows through $\mathbf{S}$:

$$\boldsymbol{\mu}'_z = \mathbf{S} \boldsymbol{\mu}'_u = (103.66, 103.66, 92.73, 72.00, 103.66, 20.16)^\top,$$

and the diagonal of $\mathbf{S} \boldsymbol{\Sigma}'_u \mathbf{S}^\top$ gives the spreads $(5.82, 5.82, 1.34, 0.50, 5.82, 2.87)$. Both flows sit at 103.7 ± 5.8 watts, since each equals the source, and the heat sink at 72.0 ± 0.50 degrees, the sensor's own accuracy. The posterior, in Table 3.2, is exactly this: the source up by 3.7 watts and the inlet temperature by 0.16 degrees; the source moves more because it had more room to move. The source's spread falls from 20 to 5.8 watts, a factor of three and a half, from a single temperature reading taken two nodes away. The inlet temperature's spread barely moves, from 3.0 to 2.9. And the two, independent under the prior, are now correlated at -0.985 : the posterior knows that $T_a + 0.5G$ is close to 72, so it knows that if the source is higher the inlet temperature is lower, without knowing which. Figure 3.3 draws the prior and the two posteriors as one-standard-deviation ellipses in the (G, T_a) plane; the first posterior is the thin diagonal ridge.

A virtual sensor. T_1 has not been measured, but it is the third entry of $\mathbf{z}$, and the posterior predicts it: $\mathbf{h}_1^\top \boldsymbol{\mu}'_u = 0.7 \cdot 103.66 + 20.16 = 92.7$, with variance $\mathbf{h}_1^\top \boldsymbol{\Sigma}'_u \mathbf{h}_1 = 1.79$, a spread of 1.3. Its prior spread was 14.3. The reading at node 2 has tightened the prediction at node 1 by a factor of ten, through the physics: T_1 and T_2 differ by G/k , and G is now known to ± 5.8 . This is the first virtual sensor in the book. Chapter 12 is about them. Figure 3.4 draws the three predictive densities of T_1 , before any reading, after the first, and after the second, with the second reading marked; the first reading turned a broad prior into a prediction sharp enough to be tested, and the second passed the test.

Table 3.2: The processor heat path: prior, posterior after the T_2 sensor, posterior after both sensors. Means and standard deviations; the last two rows are the temperatures predicted from each distribution.

	Prior	After $y_2 = 72.0$	After y_2 and $y_1 = 93.0$
G [W]	100.0 ± 20.0	103.7 ± 5.8	104.6 ± 2.9
T_a [°C]	20.0 ± 3.0	20.2 ± 2.9	19.7 ± 1.7
$\text{corr}(G, T_a)$	0	-0.985	-0.979
T_2 predicted	70.0 ± 10.4	72.0 ± 0.5	72.0 ± 0.4
T_1 predicted	90.0 ± 14.3	92.7 ± 1.3	93.0 ± 0.5

A second reading. Now a sensor on T_1 reads $y_1 = 93.0$. The reading falls within the virtual sensor's range, which is the first thing to check: had it read 85, six standard deviations from the prediction, the model rather than the source would be the suspect. Proposition 3.1 applies again, with the first posterior in the place of the prior. The sensor reads the third entry of $\mathbf{z}$, so on $\mathbf{z}$ it is $\mathbf{h} = \mathbf{e}_3$, and on the inputs it is $\mathbf{h}_1$. The innovation is $93.0 - \mathbf{h}_1^\top \boldsymbol{\mu}'_u = 0.27$, and

$$\boldsymbol{\Sigma}'_u \mathbf{h}_1 = \begin{pmatrix} 7.23 \\ -3.28 \end{pmatrix}, \quad s = \mathbf{h}_1^\top \boldsymbol{\Sigma}'_u \mathbf{h}_1 + \sigma^2 = 1.79 + 0.25 = 2.04, \quad \mathbf{k} = \frac{\boldsymbol{\Sigma}'_u \mathbf{h}_1}{s} = \begin{pmatrix} 3.55 \\ -1.61 \end{pmatrix},$$

$$\boldsymbol{\Sigma}''_u = \boldsymbol{\Sigma}'_u - \mathbf{k} (\boldsymbol{\Sigma}'_u \mathbf{h}_1)^\top = \begin{pmatrix} 8.20 & -4.85 \\ -4.85 & 2.99 \end{pmatrix}.$$

The gain on the inlet temperature is negative although $\mathbf{h}_1$ has a positive entry for it. The first reading left the source and the inlet temperature correlated, so a package temperature above its prediction is blamed on the source, and the correlation pulls the inlet temperature down. The mean moves by $\mathbf{k}e = (0.97, -0.44)$, and the result is the third column of Table 3.2. Proposition 3.2, which folds both readings in at once, gives the same posterior to twelve digits. The source is now 104.6 ± 2.9 , the inlet temperature 19.7 ± 1.7 . The second sensor's lever arm on the source is only the difference $T_1 - T_2 = G/k$, with a slope of 0.2 degrees per watt against two readings each accurate to 0.5 degrees, which is why the source improves by a factor of two and not by more. The correlation is still -0.979: two readings of temperature, both of which are “inlet temperature plus something times source”, cannot fully separate the two. A sensor on the flow, or on the inlet temperature itself, would. Which sensor to add next is a question the posterior can answer before the sensor is bought, and Chapter 12 returns to it.

3.5 A second example: the triangle with a flow meter

The same operation on the electrical example shows what a loop does to it. The model is the one of Example 1.2, with $B = 10$ and the physics exact, and one change: the two loads are no longer known. They carry the priors $P_2 \sim \mathcal{N}(-1.5, 0.3^2)$ and $P_3 \sim \mathcal{N}(-0.5, 0.3^2)$ per unit, independent and centred on the second set of loads Example 1.2 used. Every number is from `ch03_triangle_posterior.py`.

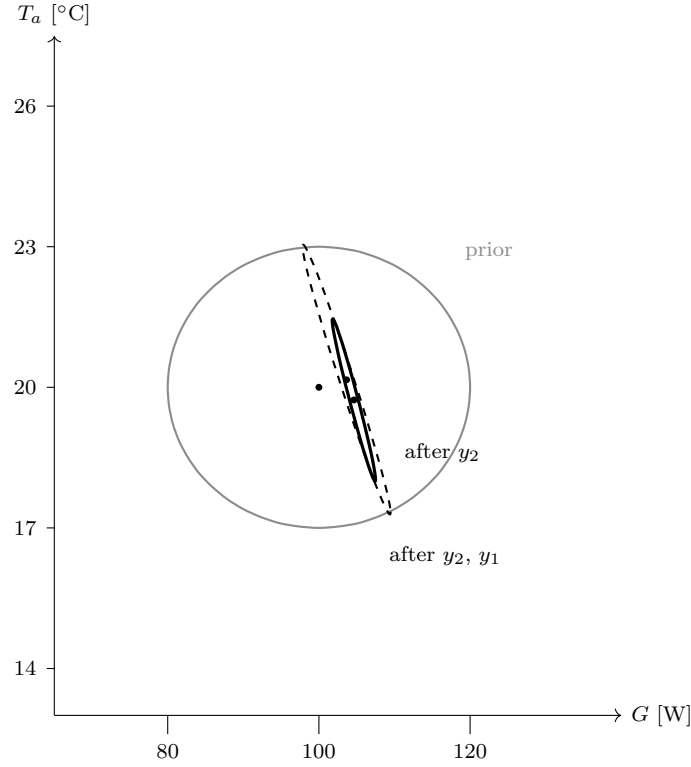


Figure 3.3: One-standard-deviation ellipses of the joint distribution of source and inlet temperature: the prior (grey, axis-aligned, because the two are independent), the posterior after the T_2 reading (dashed, a ridge along $T_a + 0.5G = 72$), and the posterior after both readings (solid, shorter along the ridge). Dots mark the means. Generated by the same script as Table 3.2.

The example in vectors. As for the chain, the unknown vector is the one of Example 1.2, flows first, with the loads appended:

$$\mathbf{z} = \begin{pmatrix} F_{12} \\ F_{13} \\ F_{23} \\ \theta_2 \\ \theta_3 \\ P_2 \\ P_3 \end{pmatrix} = \begin{pmatrix} \mathbf{F} \\ \boldsymbol{\theta} \\ \mathbf{u} \end{pmatrix}, \quad \mathbf{u} = \begin{pmatrix} P_2 \\ P_3 \end{pmatrix}.$$

The exact physics, equation (1.21) with the flows from the closures, makes every entry a linear combination of the loads,

$$\mathbf{z} = \mathbf{S} \mathbf{u}, \quad \mathbf{S} = \frac{1}{3} \begin{pmatrix} -2 & -1 \\ -1 & -2 \\ 1 & -1 \\ 2/B & 1/B \\ 1/B & 2/B \\ 3 & 0 \\ 0 & 3 \end{pmatrix},$$

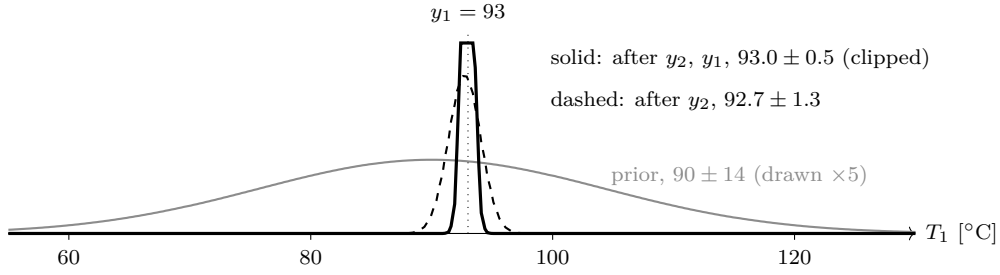


Figure 3.4: The predictive density of the unmeasured package temperature T_1 under the prior (grey), after the heat-sink reading y_2 (dashed), and after both readings (solid, clipped in height). The dotted line is the reading $y_1 = 93.0$ when it arrives: inside the dashed prediction's range, so the model is not surprised.

Table 3.3: The DC triangle: prior, posterior after the meter on line 1–2, posterior after a second meter on the boundary flow. Loads and flows in per unit, means and standard deviations.

	prior	after $F_{12} = 1.10$	after F_{12} and boundary 2.05
P_2	-1.500 ± 0.300	-1.421 ± 0.136	-1.273 ± 0.060
P_3	-0.500 ± 0.300	-0.460 ± 0.269	-0.773 ± 0.069
$\text{corr}(P_2, P_3)$	0	-0.976	-0.961
F_{12}	1.167 ± 0.224	1.101 ± 0.020	1.107 ± 0.019
F_{13}	0.833 ± 0.224	0.780 ± 0.135	0.940 ± 0.027
F_{23}	-0.333 ± 0.141	-0.320 ± 0.134	-0.167 ± 0.043
boundary flow	2.000 ± 0.424	1.881 ± 0.139	2.047 ± 0.020

and the boundary flow, $F_{12} + F_{13}$, is $-(P_2 + P_3)$. Under the prior the flows are 1.167 ± 0.224 , 0.833 ± 0.224 and -0.333 ± 0.141 , and the boundary flow 2.000 ± 0.424 . A meter on line 1–2 reads the first entry of $\mathbf{z}$: on $\mathbf{z}$ it is $\mathbf{h} = \mathbf{e}_1$, and on the loads it is the first row of $\mathbf{S}$, $(-\frac{2}{3}, -\frac{1}{3})^\top$. It reads $F_{12} = 1.10$ with accuracy 0.02, a third of a spread below its prediction. As for the chain, Proposition 3.1 is applied to $\mathbf{u}$ and $\mathbf{S}$ carries the result to $\mathbf{z}$; applied to $\mathbf{z}$ directly, with $\mathbf{h} = \mathbf{e}_1$, it gives the same posterior.

Proposition 3.1 gives the posterior of the loads, $\mathbf{S}$ carries it to the flows, Table 3.3 lists both, and Figure 3.5 draws the loads. The meter reads the direction $(-0.894, -0.447)$ of the load plane, mostly P_2 ; along it the spread falls from 0.300 to 0.027, and across it, in the direction $(0.447, -0.894)$, it stays at 0.300 exactly. The loads become $P_2 = -1.421 \pm 0.136$ and $P_3 = -0.460 \pm 0.269$, correlated at -0.976 : the meter has fixed two thirds of one plus one third of the other, so if one is lower the other must be higher. The unmetered flows move too, through the loop: F_{13} from 0.833 ± 0.224 to 0.780 ± 0.135 , F_{23} from -0.333 ± 0.141 to -0.320 ± 0.134 , and the boundary flow from 2.000 ± 0.424 to 1.881 ± 0.139 . One meter on one line has narrowed the total load by a factor of three, because the total is mostly what the meter reads.

A second meter, on the boundary flow at bus 1, reads 2.05 ± 0.02 . The boundary flow is not an entry of $\mathbf{z}$ but the sum of two, so on $\mathbf{z}$ this meter is $\mathbf{h} = \mathbf{e}_1 + \mathbf{e}_2$, and on the loads it is the sum of the first two rows of $\mathbf{S}$, the direction $(-1, -1)$. That is not the first meter's direction, and the two together pin both loads: $P_2 = -1.273 \pm 0.060$, $P_3 = -0.773 \pm 0.069$, the flow on the line between them -0.167 ± 0.043 . The prior had put P_3 at -0.5 ; the two meters have moved it by nearly a full prior spread, to -0.77 , because the boundary meter says the total is 2.05 and

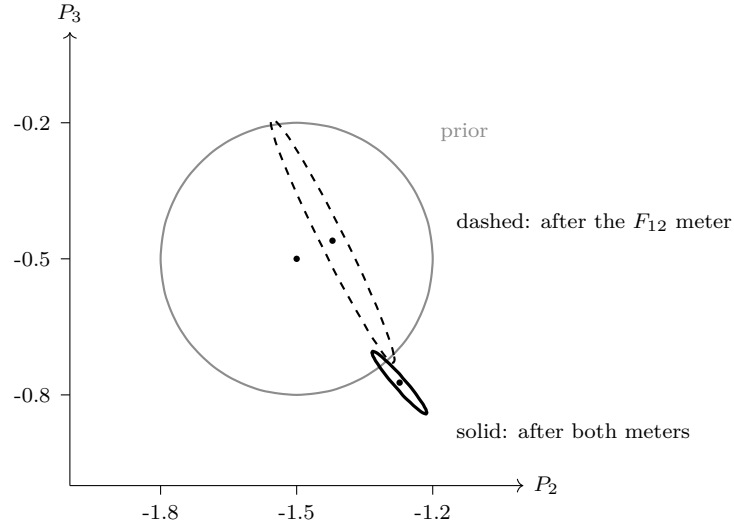


Figure 3.5: One-standard-deviation ellipses of the two loads of the DC triangle: the prior (grey), the posterior after the meter on line 1–2 (dashed), and the posterior after a second meter on the boundary flow (solid). The first meter reads one direction of the load plane and flattens the ellipse along it only; the second reads a different direction and closes it.

the line meter says most of it is not at bus 2. Neither meter reads P_3 ; both inform it through the loop. This is the electrical twin of the chain’s virtual sensor, and the loop is what makes it work: in a radial network a meter on one feeder says nothing about the load on another.

3.6 Reading the graph

The example computed numbers. The graph shows, before any number is computed, why they came out as they did.

The sensor ℓ_2 in Figure 3.1 touches only T_2 . The source G is three squares away: through c_{2a} to Q_{2a} , through b_2 to Q_{12} , through b_1 to G . Yet the reading moved G more than it moved anything else. Information travels along every path in the factor graph, and how much arrives depends on the factors along the way, not on the number of steps. A stiff closure passes information nearly unattenuated; a wide prior receives it readily. The reading reached G through three exact physics factors and found a prior twenty watts wide. It reached T_a through one exact factor and found a prior three degrees wide. It moved what was loosest.

The two priors π_G and π_{T_a} share no factor, and under the prior their variables are independent. After the reading they are correlated at -0.985 . The reading is a factor on T_2 , and T_2 is tied to both. Two variables that are independent become dependent when something they both influence is observed.

The size of the correlation has a closed form, and it is worth deriving because it says when the effect is severe. Let two independent inputs $u_1 \sim \mathcal{N}(\mu_1, s_1^2)$ and $u_2 \sim \mathcal{N}(\mu_2, s_2^2)$ be read together through $y = au_1 + bu_2 + \nu$, $\nu \sim \mathcal{N}(0, \sigma^2)$. With $\Sigma = \text{diag}(s_1^2, s_2^2)$ and $\mathbf{h} = (a, b)$, Proposition 3.1 gives $\Sigma' = \Sigma - \Sigma \mathbf{h} \mathbf{h}^T \Sigma / (a^2 s_1^2 + b^2 s_2^2 + \sigma^2)$, whose off-diagonal entry is $-abs_1^2 s_2^2 / D$ and whose diagonal entries are $s_1^2(b^2 s_2^2 + \sigma^2) / D$ and $s_2^2(a^2 s_1^2 + \sigma^2) / D$, with D the denominator. The posterior

correlation is therefore

$$\rho' = -\frac{ab s_1 s_2}{\sqrt{(a^2 s_1^2 + \sigma^2)(b^2 s_2^2 + \sigma^2)}}. \quad (3.11)$$

It tends to -1 (for $ab > 0$) as the sensor becomes accurate relative to both inputs' contributions, and to zero as the sensor becomes useless; it is large exactly when the sensor reads a combination it can resolve much better than either prior could. For the chain, $a = 0.5$ degrees per watt, $s_1 = 20$, $b = 1$, $s_2 = 3$, $\sigma = 0.5$: $\rho' = -0.5 \cdot 20 \cdot 3 / \sqrt{(100.25)(9.25)} = -0.985$, the table's value. The sensor resolves $T_a + 0.5G$ to half a degree, where the prior knew it to ten; that is a twenty-fold gain along the ridge and none across it, and the correlation is the ridge's aspect ratio. This is the same fact that Chapter 2 met as “factorization is not independence”: local factors, global dependence. It has a name in the graphical-model literature, *explaining away*, and in Chapter 5 it is stated precisely as a rule for reading conditional independence off the graph.

Principle 3.2. *A measurement anywhere is information everywhere. It travels along the factor graph, attenuated by tight factors and absorbed by loose ones, and it correlates whatever it cannot separate.*

3.7 In practice

Write down what you know about every input. A prior is not a nuisance to be set vague; it is the record of the data sheet, the forecast and the history, and its width decides how much a reading moves that input. An input given a width of a thousand will absorb every reading; one given a width of zero is a boundary condition.

Give the physics a width and say why. A closure's width is the modeler's bound on the law's error, and it should be justified in those terms: contact resistance, a neglected radiative term, a linear approximation. Balance rows get a small width so that the model can report a violation rather than refuse one; Chapter 4 says how small.

Check the innovation before believing the update. The innovation, reading minus prediction, in units of the predicted spread, is the first number to look at. A reading three spreads from its prediction is either a discovery or a defect, and the posterior will absorb it either way. Chapter 12 turns this into a test.

Ask what a sensor reads before buying it. By Proposition 3.1 the posterior spread after a reading does not depend on the reading. Compute it for every candidate sensor and buy the one that narrows the quantity you care about; a sensor that reads a direction the prior has already pinned buys nothing.

Expect correlations and report them. Two readings of the same kind leave the inputs correlated, as the chain's two temperatures left G and T_a at -0.98 and the triangle's two meters left the loads at -0.96 . A report that gives each input its own error bar and no correlation has thrown away the posterior's most useful content: the combination that is known well and the combination that is not.

Keep the deterministic limit in view. Every posterior in this chapter tends to the deterministic solve as the priors widen and the physics widths vanish. When a posterior surprises, take that limit and see whether the surprise is in the physics or in the widths.

3.8 What is missing

Three things were done in this chapter without justification, and the next three chapters supply it.

The physics rows were softened with widths σ_k , and in the worked example they were then set to zero and the physics eliminated by hand. Chapter 4 says what the product of factors is when the widths are zero, what the widths do to it, and how to choose them.

The graph was read for how information travels and where it correlates. Chapter 5 makes that reading exact: which variables, given which others, are independent, and what a separator is.

The worked example was Gaussian throughout and solved in closed form. Chapter 6 shows that when every row is linear and every factor Gaussian the posterior is Gaussian, that its precision is the weighted normal matrix of the Jacobian with the sparsity of Chapter 2, and that the whole computation is sparse linear algebra. Chapter 7 then asks what survives when a row is nonlinear or a variable is discrete, as a_{23} already is.

Notes and further reading

Attaching priors to the uncertain inputs of a physical model, reading sensors as likelihoods, and asking for the posterior over the physical state is the Bayesian formulation of inverse problems; Stuart [98] gives the mathematical framework and Kaipio and Somersalo [41] the computational one, and both treat the Gaussian case of this chapter's worked example at length. The same objective, weighted least squares over physics residuals and measurement misfits, has two older engineering homes. In power systems it is state estimation, introduced by Schweppe [92] and developed in the books of Monticelli [73] and Abur and Gómez Expósito [1]; in chemical process engineering it is data reconciliation, of which Mah, Stanley and Downing [65] is the classical statement, with conservation constraints, estimation of unmeasured flows and detection of gross errors, all of which reappear in Chapter 12. Both traditions usually take the physics as hard and carry no priors on the inputs; the soft physics and the input priors of this chapter are what let a single formulation cover estimation, diagnosis and the deterministic solve.

The closest precedent for a factor graph over a physical network with message passing on it is Chavali and Nehorai's distributed power-system state estimation [15]. Its scope is one domain and one query; the framework of this book generalizes the graph to multiple conservation domains and the queries to those of Part IV, but the reader should know that the construction of Figure 3.2 has been drawn before.

The remark in §3.1 that a density can be read as a frequency or as a degree of belief, and that the machinery is the same, is the position of MacKay [64], whose book is the best general reference for the reader who wants the probability of this chapter developed with the same practical emphasis. Explaining away, named in §3.6, is Pearl's term [80], and Chapter 5 gives it a precise form for physical graphs.

Summary

- A density on the state assigns a likelihood to every point of $\mathbb{R}^n$. Marginalization integrates out, conditioning divides, factorization multiplies local pieces.
- Five kinds of factor: priors on uncertain inputs, closure and conservation factors with widths, likelihoods from sensors, and failure priors on discrete variables. The physics factors are the rows of Chapter 1; priors and likelihoods are unary squares added to the graph.
- The posterior is the product, equation (3.7). Its negative logarithm is a weighted least-squares objective whose deterministic limit is the solve of Chapter 1.
- One linear reading moves the mean by the innovation times a gain and shrinks the covariance by a rank-one amount in one direction; the shrinkage does not depend on the reading's value.
- One temperature reading two nodes from an uncertain source cut its spread by a factor of three and a half and predicted an unmeasured temperature to ± 1.3 degrees. The second reading landed inside that prediction.
- On the triangle, one line meter narrowed the total load by a factor of three and moved an unmetered load through the loop; a second meter in a different direction pinned both.
- Information travels along the graph and is absorbed by the loosest factors; observing a shared effect correlates independent causes.

Exercises

Exercise 3.1. Repeat the worked example with the sensor on T_1 read first and the sensor on T_2 second. Show that the final posterior is the same and that the intermediate one is different. Which single sensor, on T_1 or on T_2 , tells more about G , and why?

Exercise 3.2. Add a third sensor to the worked example that reads the inlet temperature directly, first with accuracy 1.0 degree and then with 0.3. Compute the posterior in each case and show that the correlation between G and T_a falls in magnitude, to about 0.6 in the second case. Explain in terms of Figure 3.1 why this sensor breaks the ridge and the first two did not.

Exercise 3.3. In the worked example, free the conductance k with the prior $\mathcal{N}(5, 1^2)$ and keep everything else. The map from inputs to T_1 is now nonlinear in (G, k) . Write the objective of equation (3.8) for this case, find its minimizer numerically, and compare the minimizer with the second column of Table 3.2.

Exercise 3.4. Give the balance row b_2 of the chain a width σ_b and suppose the two sensors read $y_2 = 72.0$ and $y_1 = 105.0$, inconsistent with any state of the exact model. Show that as $\sigma_b \rightarrow 0$ the objective's minimum grows without bound, and that for finite σ_b the minimizer violates the balance by an amount that identifies the size of an unmodeled heat loss at node 2.

Exercise 3.5. For the triangle of Figure 3.2, write the joint distribution as a product over the two values of a_{23} : $p(\mathbf{z}) = \mathbb{P}(a_{23} = 1) p(\mathbf{z} \mid a_{23} = 1) + \mathbb{P}(a_{23} = 0) p(\mathbf{z} \mid a_{23} = 0)$. Draw the factor graph for each of the two terms and state what has happened to the loop in the second.

Solutions to selected exercises

Exercise 3.1. Reading $y_1 = 93.0$ first gives $G = 104.1 \pm 4.2$ and $T_a = 20.1 \pm 2.9$, correlated at -0.986 ; reading y_2 second gives $G = 104.6 \pm 2.9$, $T_a = 19.7 \pm 1.7$, correlated at -0.979 , which is

the third column of Table 3.2 to fourteen digits. The order cannot matter, because the posterior is the product of the prior and both likelihoods, and a product does not depend on the order of its factors; Proposition 3.1 applied twice is one way of computing that product, and the intermediate posterior is the only thing that depends on which factor went in first. The sensor on T_1 alone leaves G at ± 4.2 , the sensor on T_2 alone at ± 5.8 . The reason is the slope: $T_1 = T_a + 0.7G$ rises seven tenths of a degree per watt and $T_2 = T_a + 0.5G$ five tenths, so at equal accuracy the T_1 sensor has the larger lever arm on the source. Both sensors share the same unit slope on T_a , which is why neither separates the two.

Exercise 3.2. With the two temperature sensors read, an inlet-temperature sensor of accuracy 1.0 degree reading 19.5 gives $G = 104.9 \pm 1.5$, $T_a = 19.6 \pm 0.9$, and a correlation of -0.924 ; with accuracy 0.3 it gives $G = 105.0 \pm 0.8$, $T_a = 19.5 \pm 0.3$, and -0.636 . The first two sensors both read “inlet temperature plus a multiple of the source” and so both lie along the ridge $T_a + cG$; in Figure 3.1 they attach to T_2 and T_1 , which are tied to T_a and G through the same chain of factors, and the ridge is what that chain cannot distinguish. The inlet-temperature sensor attaches to T_a alone, reads the direction $(0, 1)$ of the (G, T_a) plane, which crosses the ridge, and Proposition 3.1 shrinks the covariance in a direction that no earlier reading had touched. The correlation does not vanish, because the ridge is only partly crossed at accuracy 1.0 and mostly crossed at 0.3; a sensor on G itself, or on a flow, would cross it at right angles.

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

Where the supply temperature’s width comes from *where probability enters a physical model; propagating a prior through a closure; linearization is exact in an input that enters linearly and biased in one that enters through a reciprocal*
`foundation_thermo/duct_heater_uq/problems/where_the_supply_width_comes_from`

Chapter 4

Hard constraints, soft constraints, and the manifold

Chapter 3 gave every physics row a width and then, in its worked example, set the widths to zero and eliminated the physics by hand. Both moves were made without justification. This chapter supplies it. It says what the product of factors is when the widths are zero, what the widths do when they are not, why a working model uses finite widths, and how to choose them. The chapter ends with the same processor heat path as before, now with all six unknowns kept and the physics rows soft, and shows the soft posterior converge to the hard one as the widths shrink, and the price paid for shrinking them.

4.1 The hard joint and its manifold

Split the unknowns into two groups. The *inputs* $\mathbf{u}$ are the quantities that carry priors: parameters, boundary conditions, sources. The *solved variables* $\mathbf{x}$ are everything else: potentials, flows, storage states. The physics rows read both, $\mathbf{F}(\mathbf{x}, \mathbf{u}) = \mathbf{0}$, and there are as many rows as solved variables, $m = n_x$, with the Jacobian in the solved variables, $\mathbf{J}_x = \partial \mathbf{F} / \partial \mathbf{x}$, invertible. That is the well-posedness of §1.5 restated: for each value of the inputs the physics determines the solved variables. Write the determined value as $\mathbf{x} = X(\mathbf{u})$. The function X is what a solver computes; it is not available in closed form except for the smallest models, but it exists, and it is smooth wherever $\mathbf{J}_x$ is invertible.

Now take the widths of Chapter 3 to zero. A physics factor $\exp(-r_k^2/2\sigma_k^2)$, divided by its normalizer $\sqrt{2\pi}\sigma_k$, becomes the delta function $\delta(r_k)$: zero away from $r_k = 0$, and with unit integral across it. The product of the m physics factors is $\delta(\mathbf{F}(\mathbf{x}, \mathbf{u}))$, which is zero except on the set

$$\mathcal{M} = \{(\mathbf{x}, \mathbf{u}) : \mathbf{F}(\mathbf{x}, \mathbf{u}) = \mathbf{0}\} = \{(X(\mathbf{u}), \mathbf{u})\}, \quad (4.1)$$

the graph of X . This set is the *constraint manifold*. It has dimension n_u , the number of inputs, inside a space of dimension $n_x + n_u$. Every physically admissible state of the system lies on it, and no state off it is admissible.

The hard joint, prior times physics, is therefore not a density on $\mathbb{R}^n$ at all. It is a density on $\mathcal{M}$: a distribution over the inputs, carried along by X to the solved variables. The natural way to write it is

$$p(\mathbf{x}, \mathbf{u}) = p(\mathbf{u}) \delta(\mathbf{x} - X(\mathbf{u})), \quad (4.2)$$

which says: draw the inputs from their prior, solve, and the solved variables are what the solve returns. Its marginal over the inputs is the prior, as it should be, since physics alone says nothing about which inputs are likely. Its marginal over any solved variable is the distribution of that variable under the prior, the *prior predictive*, which the worked example of §3.4 computed for T_2 as 70.0 ± 10.4 .

Remark 4.1 (Two delta functions). Equation (4.2) and the product of row factors $p(\mathbf{u}) \delta(\mathbf{F}(\mathbf{x}, \mathbf{u}))$ are not the same function. Integrating the second over $\mathbf{x}$ gives $p(\mathbf{u})/|\det \mathbf{J}_x(X(\mathbf{u}), \mathbf{u})|$, by the change of variables $\mathbf{r} = \mathbf{F}(\mathbf{x}, \mathbf{u})$ at fixed $\mathbf{u}$. The two agree when $\mathbf{J}_x$ is constant, which is when the physics is linear in the solved variables, and differ otherwise by a factor that weights inputs according to how compliant the physics is there. The general statement is the coarea formula of geometric measure theory [24, 25]: a product of delta functions of residuals is not invariant under a reparameterization of the residuals unless the corresponding Jacobian factor is carried along, and equation (4.2) is the parameterization-free object. Within one model the factor matters only where the physics is nonlinear, and for the models of this book it is small there. Between two models whose physics rows differ it is neither small nor common: comparing a branch in which a line is in service with one in which it is out, by the evidence of their soft row factors, weights each by $1/|\det \mathbf{J}_x|$ of its own physics, and on the DC triangle the two determinants differ by a factor of three. Chapter 7 shows the error this makes and states the correction (Proposition 7.1).

4.2 Conditioning on the manifold

A sensor reads a solved variable x_j with likelihood $\ell(x_j)$. Conditioning the hard joint on the reading multiplies equation (4.2) by $\ell(x_j)$ and, since $x_j = X_j(\mathbf{u})$ on the manifold, gives

$$p(\mathbf{u} \mid y) \propto p(\mathbf{u}) \ell(X_j(\mathbf{u})). \quad (4.3)$$

This is the *input-space* form of the posterior. It is a distribution over the inputs alone. The solved variables are recovered from it by X : their posterior is the distribution of $X(\mathbf{u})$ when $\mathbf{u}$ is drawn from equation (4.3).

The worked example of §3.4 was exactly this computation. Its inputs were $\mathbf{u} = (G, T_a)$; its X was the linear map $\mathbf{z} = \mathbf{S}\mathbf{u}$ from the inputs to the whole unknown vector; its posterior was equation (4.3) with Gaussian prior and Gaussian likelihood, which is Gaussian, and Table 3.2 tabulated it. The manifold was a plane in $\mathbb{R}^6$ parameterized by two numbers, and the whole calculation lived on that plane.

For the chain the map is explicit. With inputs $\mathbf{u} = (G, T_a)$ and solved variables $\mathbf{x} = (Q_{12}, Q_{2a}, T_1, T_2)$, flows first as in Example 1.1,

$$X(\mathbf{u}) = \begin{pmatrix} G \\ G \\ T_a + 0.7G \\ T_a + 0.5G \end{pmatrix}, \quad \frac{\partial X}{\partial \mathbf{u}} = \begin{pmatrix} 1 & 0 \\ 1 & 0 \\ 0.7 & 1 \\ 0.5 & 1 \end{pmatrix}, \quad (4.4)$$

which is the matrix $\mathbf{S}$ of §3.4 without its last two rows, the ones that return the inputs themselves. The derivative is dense: every solved variable depends on the source, and the two temperatures on both inputs, although no single physics row read more than three variables. Exercise 4.1 asks for the general statement.

The input-space form is exact, and it is always available in principle. It has two costs. The first is that every evaluation of the right-hand side of equation (4.3) at a new $\mathbf{u}$ needs $X(\mathbf{u})$,

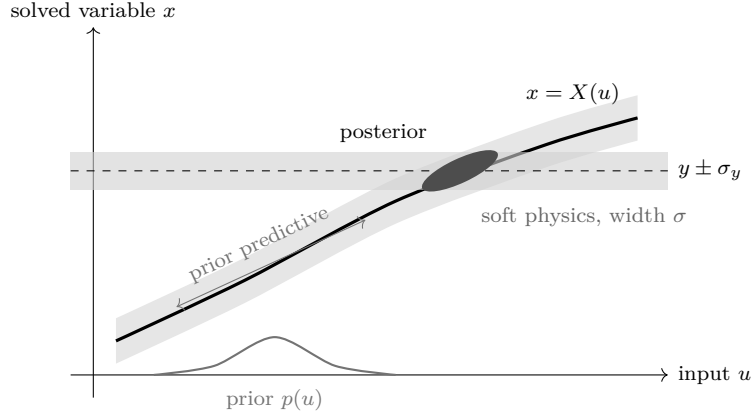


Figure 4.1: One input, one solved variable. The thick curve is the constraint manifold $x = X(u)$; the hard joint lives on it. The grey band around the curve is where the soft joint puts its mass, a distance of order σ from the curve. The prior on u sits on the horizontal axis and is carried up the curve to the prior predictive on x . A sensor reading y is a horizontal band. The posterior is the product: the dark region where the sensor band meets the curve, weighted by how much prior mass lies below it. Softening thickens the curve; it does not move the intersection.

which is a solve of the physics; and every gradient needs $\partial X / \partial \mathbf{u} = -\mathbf{J}_x^{-1} \mathbf{J}_u$, which is a solve per input or an adjoint solve per output. Chapter 14 makes much of this derivative, but it is not free. The second cost is structural. The physics of Chapter 1 was sparse: each row read a few variables. The map X is not. Every solved variable depends, in general, on every input, because information travels along the whole graph, so $\partial X / \partial \mathbf{u}$ is a dense $n_x \times n_u$ matrix and the factor graph of equation (4.3) is a single factor of scope $\mathbf{u}$. Eliminating the physics eliminates the sparsity with it.

4.3 The soft joint

Keep the widths finite. The joint is then

$$p_\sigma(\mathbf{x}, \mathbf{u} \mid y) \propto p(\mathbf{u}) \ell(x_j) \prod_{k=1}^m \exp\left(-\frac{r_k(\mathbf{x}, \mathbf{u})^2}{2\sigma_k^2}\right), \quad (4.5)$$

a density on all of $\mathbb{R}^{n_x+n_u}$, positive everywhere, largest near the manifold and falling off away from it on a scale set by the widths. Figure 4.1 draws the situation for one input and one solved variable.

Three things happen as the widths go to zero, and they are what the chapter promised to establish.

Proposition 4.1 (Zero-width limit). *Let the physics be linear in $(\mathbf{x}, \mathbf{u})$, the prior and the likelihood Gaussian, and all widths $\sigma_k = \sigma$. Then the soft posterior (4.5) is Gaussian for every $\sigma > 0$, and as $\sigma \rightarrow 0$:*

1. *its marginal over the inputs converges to the hard posterior (4.3);*
2. *its mean converges to the point of $\mathcal{M}$ that minimizes the prior and likelihood terms of equation (3.8) subject to $\mathbf{F}(\mathbf{x}, \mathbf{u}) = \mathbf{0}$;*

3. the posterior standard deviation of each physics residual r_k is at most σ , so the mass off the manifold vanishes with the width.

Proof. Write the linear physics as $\mathbf{F} = \mathbf{A}\mathbf{x} + \mathbf{B}\mathbf{u}$ with $\mathbf{A}$ square and invertible, so that $X(\mathbf{u}) = -\mathbf{A}^{-1}\mathbf{B}\mathbf{u}$. The soft joint is the exponential of a negative quadratic in $(\mathbf{x}, \mathbf{u})$, hence Gaussian for every $\sigma > 0$.

For item 1, change variables from $(\mathbf{x}, \mathbf{u})$ to $(\mathbf{r}, \mathbf{u})$ with $\mathbf{r} = \mathbf{A}\mathbf{x} + \mathbf{B}\mathbf{u}$; the map is linear with constant Jacobian $\det \mathbf{A}$, so densities transform by a constant. In the new variables $\mathbf{x} = X(\mathbf{u}) + \mathbf{A}^{-1}\mathbf{r}$ and the soft joint is $p(\mathbf{u}) \ell(X_j(\mathbf{u}) + (\mathbf{A}^{-1}\mathbf{r})_j) \exp(-\|\mathbf{r}\|^2/2\sigma^2)$. The last factor, normalized, is a Gaussian on $\mathbf{r}$ of spread σ about zero; integrating $\mathbf{r}$ out gives $p(\mathbf{u})$ times the average of $\ell(X_j(\mathbf{u}) + \epsilon)$ over $\epsilon \sim \mathcal{N}(0, \sigma^2\|(\mathbf{A}^{-1})_{j\cdot}\|^2)$, which for the Gaussian ℓ is a Gaussian in $X_j(\mathbf{u})$ whose spread is the sensor's with $\sigma^2\|(\mathbf{A}^{-1})_{j\cdot}\|^2$ added in quadrature. As $\sigma \rightarrow 0$ this tends to $\ell(X_j(\mathbf{u}))$, and the marginal to the hard posterior (4.3).

For item 2, let $\mathbf{z}_\sigma$ minimize $\Phi_\sigma(\mathbf{z}) = \Phi_0(\mathbf{z}) + \|\mathbf{F}(\mathbf{z})\|^2/2\sigma^2$, with Φ_0 the prior and likelihood terms, and let $\mathbf{z}^*$ minimize Φ_0 subject to $\mathbf{F} = \mathbf{0}$. Since $\mathbf{z}^*$ is feasible, $\Phi_\sigma(\mathbf{z}_\sigma) \leq \Phi_\sigma(\mathbf{z}^*) = \Phi_0(\mathbf{z}^*)$, so $\|\mathbf{F}(\mathbf{z}_\sigma)\|^2 \leq 2\sigma^2(\Phi_0(\mathbf{z}^*) - \Phi_0(\mathbf{z}_\sigma))$, which tends to zero because Φ_0 is bounded below. Every limit point of $\mathbf{z}_\sigma$ is therefore feasible, and has $\Phi_0 \leq \Phi_0(\mathbf{z}^*)$ by the same inequality, so it is a constrained minimizer; for a strictly convex Φ_0 the minimizer is unique and $\mathbf{z}_\sigma \rightarrow \mathbf{z}^*$.

For item 3, the posterior precision contains the term $\mathbf{h}_k\mathbf{h}_k^\top/\sigma^2$ for the residual $r_k = \mathbf{h}_k^\top\mathbf{z}$, and the remaining terms are positive semidefinite. Adding a positive semidefinite matrix to a precision cannot increase any variance, so the posterior variance of r_k is at most its variance under the precision $\mathbf{h}_k\mathbf{h}_k^\top/\sigma^2$ alone, restricted to the direction $\mathbf{h}_k$, which is σ^2 ; Exercise 4.2 asks for the one-line matrix argument. $\square$

For nonlinear physics the same statements hold locally, with the volume factor of Remark 4.1 appearing in the first.

The proposition is what licenses the two shortcuts of Chapter 3. The worked example eliminated the physics and computed on the manifold; that is the $\sigma \rightarrow 0$ limit of the soft model, and §4.6 confirms it numerically. And the objective of equation (3.8) was described as having the deterministic solve as its limit; that is item 2 with no prior and no sensor.

4.4 Why soften

If the hard model is exact and the soft model converges to it, why not use the hard model? Three reasons, in increasing order of importance.

The soft model is an unconstrained problem. Minimizing the prior and sensor terms subject to $\mathbf{F} = \mathbf{0}$ is a constrained problem, and its optimality conditions are a saddle-point system in the unknowns and m Lagrange multipliers. Minimizing equation (4.5)'s negative logarithm is an unconstrained least-squares problem whose optimality conditions are a positive definite linear system, or, for nonlinear physics, a sequence of them. The second is what the Newton iteration of Chapter 1 already solves, with more rows. The width is the reciprocal square root of a penalty weight, and the soft model is the quadratic penalty method for the constrained one. That method is old, and its limitation is known: the penalty weight cannot be made arbitrarily large, because the conditioning of the linear system degrades with it. §4.5 returns to this.

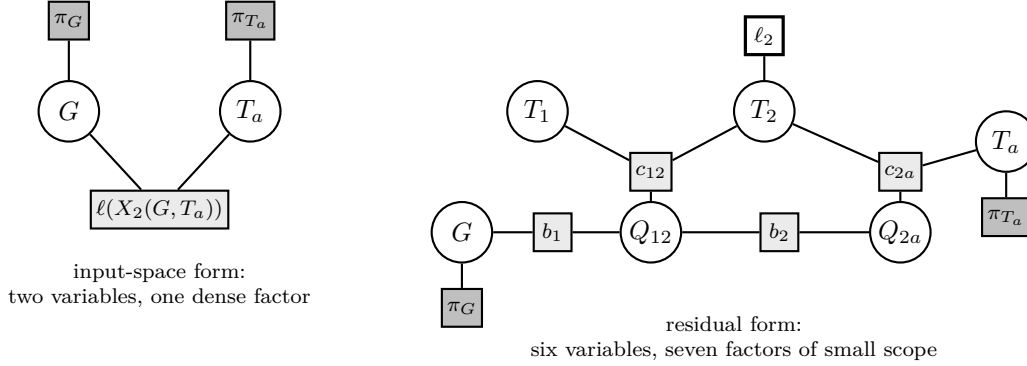


Figure 4.2: The same posterior in two forms. Left: the input-space form of §4.2, in which the physics has been solved and the likelihood is one factor reading every input. Right: the residual form of the soft joint, in which the physics rows remain as factors of small scope and the sensor reads one variable. On six variables the difference is cosmetic; on a network it is the difference between a dense matrix on the inputs and a sparse one on everything.

The soft model keeps the sparsity. This is the structural reason, and Figure 4.2 draws it. The factor graph of equation (4.5) is the factor graph of Chapter 3: physics squares of small scope, unary priors and sensors. Its precision matrix, which Chapter 6 constructs, has the sparsity of the Markov graph of §2.5, linear in the size of the model. The hard model in input-space form has thrown that away: a single dense factor on the inputs. For six unknowns the difference is nothing. For a network of ten thousand nodes it is the difference between a sparse factorization that takes a fraction of a second and a dense one that does not fit in memory. Every decomposition method of Part III, and every scaling argument of Part V, works on the soft graph.

The soft model can be wrong in a way that shows. This is the reason that matters most in practice. The hard model asserts that the state lies on $\mathcal{M}$. If the sensors report something that no point of $\mathcal{M}$ can produce, the hard model has no answer: the likelihood is zero everywhere on the manifold, and the posterior is undefined. A real system produces such readings routinely, because the model is missing something: a leak, a bypass, a load the graph does not show, a sensor that has drifted. The soft model always has an answer. It places its posterior off the manifold, by an amount that trades the physics widths against the prior and sensor widths, and the residuals r_k at that posterior say which rows were violated and by how much. Those residuals are the diagnostic. A model that forbids violation cannot report it; a model that permits it, at a cost, reports both the violation and the cost. Chapter 12 builds fault detection on exactly this, and §4.6 shows a first instance.

Principle 4.1. *Physics is softened not because it is uncertain but because the model of it is. A finite width keeps the problem unconstrained, keeps the graph sparse, and lets a violated law be seen and measured rather than forbidden.*

4.5 Choosing the widths

The widths are numbers the modeler supplies, and there are four sources of them.

Table 4.1: Where the widths come from, with the values used in the book’s examples. Relative widths are fractions of the row’s scale after the equilibration described in the text.

factor	width is		source	examples in the book
sensor	instrument	accuracy	data sheet, calibration	0.5 K thermometer; 0.02 p.u. meter
prior	spread of the input		data sheet, forecast, history	source ± 20 W; load ± 0.3 p.u.; inlet ± 3 K
closure	bound on the law’s error		neglected terms, handbook scatter	10^{-3} relative when the law is trusted
balance	admissible	violation	model completeness, numerics	10^{-3} relative; loosened to find a leak

Sensor widths come from the instrument. A thermocouple’s data sheet states its accuracy; a power meter’s states its class. These are the least negotiable numbers in the model, and the worked examples use them as given.

Prior widths come from data sheets, forecasts, and history, as §3.2 said. They are statements about the modeler’s ignorance and should be honest: a conductance known to twenty percent gets a twenty percent width, not five, and a forecast whose past errors had a spread of three degrees gets three degrees.

Closure widths come from what is known about the law’s error. A linearized law that neglects a term of known size gets a width of that size. A correlation from a handbook with a stated scatter gets that scatter. A law believed exact, such as a DC line flow at fixed susceptance, gets a small width, but not zero, for the reasons of the previous section.

Balance widths are the small ones. A balance is exact for the system as modeled; its width is there to admit violation when the model is incomplete, and to keep the problem unconstrained. It should be small compared with the flows it balances, and no smaller than the numerics allow. Table 4.1 collects the four sources with the values the book’s examples use.

That last clause has a definite content. The physics rows have units, a balance in watts, a closure in watts or kelvin or per-unit, and a width must be stated in the row’s units. It is convenient, and in a working implementation necessary, to scale each row so that its typical magnitude is of order one, and then to state widths as fractions of that scale. Call the fraction the *relative width*. With rows so scaled, the precision matrix of the soft model has entries of order one from the priors and sensors and of order $1/\rho^2$ from the physics at relative width ρ , and its condition number grows as $1/\rho^2$. The connection between condition number and lost accuracy is a standard result of numerical analysis [37]: a backward-stable solve loses about as many decimal digits as the condition number has, so in double precision a condition number near 10^{10} leaves six digits and one near 10^{14} leaves two. The widths that follow from this are implementation heuristics, not universal constants; they depend on the row scaling, the solver and the precision. With rows equilibrated as described, a relative width of 10^{-3} for the balance rows is a comfortable choice, 10^{-4} is near the edge, and 10^{-5} fails on models of moderate size. The next section shows the growth on the chain, and a reader with a different normalization should repeat the sweep on their own model.

Failure modes. A width too large lets the posterior satisfy the sensors by breaking the physics rather than by moving an input, and the estimates of the inputs stay near their priors when the data should have moved them. A width too small does the opposite: the posterior moves inputs to implausible values, and blames sensors, rather than admit a violation that the model should have allowed. Neither failure is silent. Both show in the *misfit*: the sum of squared standardized residuals at the posterior over every factor, physics, prior and sensor, which is twice the objective (3.8) there. Chapter 12 turns the misfit into a test, and the statement behind the test is worth deriving here, because it is what gives the number a scale.

Proposition 4.2 (The misfit of an adequate model). *Let a model have m linear Gaussian factors, each of the form $\mathbf{h}_k^\top \mathbf{z} - c_k \sim \mathcal{N}(0, \sigma_k^2)$ with independent errors, on $n < m$ unknowns, with the stacked standardized rows $\mathbf{W}^{1/2} \mathbf{J}$ of full column rank. If the data were generated by the model, the misfit at the posterior mean, the sum of the squared standardized residuals, is a chi-squared variable with $m - n$ degrees of freedom; its expectation is $m - n$ and its standard deviation $\sqrt{2(m - n)}$.*

Proof. Standardize every factor: let $\mathbf{a}_k = \mathbf{h}_k / \sigma_k$ and $b_k = c_k / \sigma_k$, so that the model says $\mathbf{A}\mathbf{z} = \mathbf{b} + \boldsymbol{\epsilon}$ with $\boldsymbol{\epsilon} \sim \mathcal{N}(\mathbf{0}, \mathbf{I}_m)$ and $\mathbf{A}$ the $m \times n$ matrix of rows $\mathbf{a}_k^\top$. The posterior mean minimizes $\|\mathbf{A}\mathbf{z} - \mathbf{b}\|^2$, so it is the least-squares solution $\hat{\mathbf{z}} = (\mathbf{A}^\top \mathbf{A})^{-1} \mathbf{A}^\top \mathbf{b}$, and the standardized residual vector is $\mathbf{b} - \mathbf{A}\hat{\mathbf{z}} = (\mathbf{I} - \mathbf{P})\mathbf{b}$ with $\mathbf{P} = \mathbf{A}(\mathbf{A}^\top \mathbf{A})^{-1} \mathbf{A}^\top$ the orthogonal projector onto the column space of $\mathbf{A}$. If the data came from the model, $\mathbf{b} = \mathbf{A}\mathbf{z}_{\text{true}} - \boldsymbol{\epsilon}$, and since $(\mathbf{I} - \mathbf{P})\mathbf{A} = \mathbf{0}$ the residual is $-(\mathbf{I} - \mathbf{P})\boldsymbol{\epsilon}$: the true state has dropped out. The misfit is $\boldsymbol{\epsilon}^\top (\mathbf{I} - \mathbf{P}) \boldsymbol{\epsilon}$, a standard Gaussian vector projected onto the orthogonal complement of an n -dimensional subspace, which is the sum of $m - n$ independent squared standard normals: chi-squared with $m - n$ degrees of freedom. $\square$

The proposition carries its assumptions: linear rows, Gaussian errors with the stated widths, independence. For nonlinear rows it holds locally; for widths that are wrong it fails in a way that is itself informative, since a misfit systematically below $m - n$ says the widths are too wide and one systematically above says they are too narrow or the model is missing something. A value far above $m - n$, by more than a few multiples of $\sqrt{2(m - n)}$, says the model, the widths, or the data are inconsistent. The statement is not a property of an arbitrary factor graph, and the example below shows one failure of each kind.

4.6 Worked example: the chain with soft physics

Take the processor heat path of Figure 3.1 with all six unknowns, $\mathbf{z} = (Q_{12}, Q_{2a}, T_1, T_2, G, T_a)$, the priors $G \sim \mathcal{N}(100, 20^2)$ and $T_a \sim \mathcal{N}(20, 3^2)$, the conductances $k = 5$ and $hA = 2$ known, and the four physics rows each given the same width σ in watts. Everything is linear, so the posterior is Gaussian and is computed by the script `ch04_soft_physics.py` in the book's `scripts` directory; every number below is from its output.

Convergence. With the single sensor $y_2 = 72.0$ of §3.4, Table 4.2 sweeps the width from 10 watts down to 1 milliwatt. At $\sigma = 10$, a tenth of the flow, the physics is loose: the source's posterior spread is 13.5, the correlation with the inlet temperature is only -0.25 , and the largest physics residual at the posterior mean is half a watt. The reading has been partly absorbed by bending the physics rather than by moving the inputs. At $\sigma = 1$ the estimates are within a few

Table 4.2: The chain with soft physics, one sensor $y_2 = 72.0$: posterior of the source and inlet temperature as the physics width shrinks. The last column is the condition number of the posterior precision matrix. Hard-physics reference from Table 3.2: $G = 103.66 \pm 5.82$, $T_a = \pm 2.87$, correlation -0.985 .

σ [W]	mean G	sd G	sd T_a	corr	max $ r_k $ [W]	cond
10	102.17	13.52	2.93	-0.247	5.4×10^{-1}	1.6×10^3
1	103.64	6.03	2.87	-0.944	9.1×10^{-3}	6.4×10^3
0.1	103.66	5.82	2.87	-0.985	9.2×10^{-5}	5.9×10^5
0.01	103.66	5.82	2.87	-0.985	9.2×10^{-7}	5.9×10^7
0.001	103.66	5.82	2.87	-0.985	9.2×10^{-9}	5.9×10^9

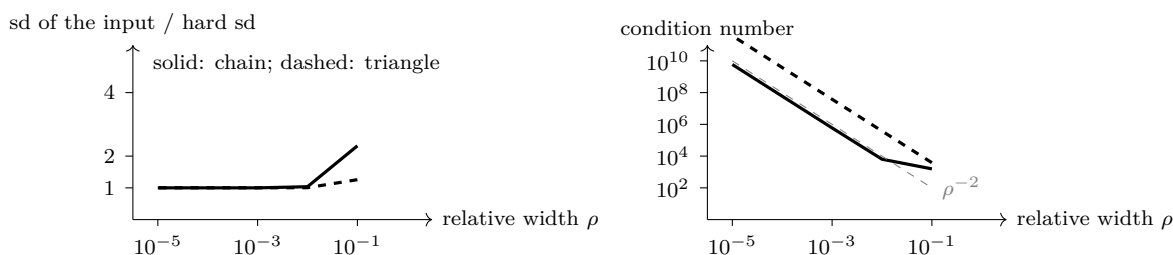


Figure 4.3: The width sweep on the chain (solid) and on the DC triangle of §4.7 (dashed), against the relative width, the physics width divided by the scale of the flows (100 watts for the chain, one per unit for the triangle). Left: the posterior spread of the uncertain input relative to its hard-physics value; both reach the hard value at a relative width of 10^{-3} . Right: the condition number of the posterior precision, which grows as the inverse square of the relative width on both models.

percent of the hard values. At $\sigma = 0.1$ and below they agree with Chapter 3's hard posterior to every digit shown, the residuals are below a tenth of a milliwatt, and the posterior spread of each residual equals the width, as Proposition 4.1 says. The soft model has become the hard one.

The last column is the price, and Figure 4.3 draws it together with the same sweep on the electrical example of §4.7. Each factor of ten in the width costs a factor of a hundred in the condition number, as §4.5 predicted. At a milliwatt, which is a relative width of 10^{-5} against flows of a hundred watts, the condition number is 6×10^9 on a six-variable model; a larger model with the same relative width would be past the edge. A width of 0.01 to 0.1 watts gives the hard answer at a condition number a solver does not notice.

An inconsistent reading. Now keep every width at 0.01 watts and read both sensors, $y_2 = 72.0$ as before and $y_1 = 105.0$. In the exact model $T_1 - T_2 = G/k$, so the two readings imply $G = 165$ watts; but then $Q_{2a} = 165$ and $T_2 = T_a + 82.5$, which with $T_2 = 72$ puts the inlet temperature near -10 degrees. No state of the exact model is consistent with both readings and both priors. The soft model with tight physics has to answer anyway, and its answer is in the first row of Table 4.3: source 147 watts, inlet temperature 0.4 degrees, the T_2 sensor missed by two degrees and the T_1 sensor by one and a half. Every physics residual is zero. The model has kept its laws and thrown away its priors and its sensors: the inlet temperature sits six and a half of its prior spreads below the setpoint, and each sensor is off by three or four of its accuracies.

Table 4.3: Inconsistent readings $y_2 = 72.0$, $y_1 = 105.0$: posterior as the width of the node-2 balance is loosened while every other row stays at 0.01 watts. The leak estimate is the violation of that balance at the posterior mean. Last column: misfit at the posterior; about 2 is expected of an adequate model.

σ_{b_2} [W]	leak [W]	G [W]	T_a [°C]	T_2, T_1 fitted	misfit
0.01	0.0 ± 0.0	147.2 ± 2.9	0.4 ± 1.7	74.05, 103.49	74.0
1	1.1 ± 1.0	147.5 ± 2.9	0.8 ± 1.8	74.02, 103.52	72.8
10	38.1 ± 5.9	157.5 ± 3.3	13.1 ± 2.6	72.85, 104.34	32.6
100	58.3 ± 7.3	162.9 ± 3.5	19.9 ± 3.0	72.21, 104.80	10.6

The misfit at this posterior, the sum of squared standardized residuals over all eight factors, is 74; for an adequate model with eight factors and six unknowns it would be about 2. The model is telling the reader, loudly, that something is wrong, and it is telling the reader the wrong thing about what.

Suppose the modeler suspects the balance at node 2: the heat sink may be losing heat somewhere the graph does not show, to the board through its retention bolts say. Loosen that one row and leave the others tight. The remaining rows of Table 4.3 show what happens. At a width of one watt nothing changes; the row is still too stiff to absorb sixty watts. At ten watts the posterior has moved: the balance is violated by 38 watts, the inlet temperature has come back to 13 degrees, the sensors are fitted to within a degree. At a hundred watts the posterior is coherent: the balance at node 2 is violated by 58 ± 7 watts, the source is 163 watts, the inlet temperature is 19.9 degrees, within a tenth of its setpoint, and both sensors are fitted to a fifth of a degree. The misfit has fallen from 74 to 10.6. It is still above 2, and the reason is visible in the table: the source is three of its prior spreads above nominal. That is either a second thing wrong or a prior that was too narrow, and the modeler now knows to ask.

Read the residual of the loosened row as a number. The balance at node 2 said heat in equals heat out. At the posterior, heat in exceeds heat out by 58 watts. That is the heat leaving the heat sink by a path the model does not contain, and the model has estimated it, with an error bar, from two temperature readings, without being told a leak exists. The row was violated, and the violation is the measurement.

For comparison, the consistent readings of §3.4, $y_2 = 72.0$ and $y_1 = 93.0$, through the same soft model with every width at 0.01 watts, give $G = 104.6 \pm 2.9$ and $T_a = 19.7 \pm 1.7$, identical to the hard result, with a misfit of 0.07. An adequate model with consistent data sits near the bottom of the misfit’s range; an inadequate one does not. Figure 4.4 draws the loosening sweep, beside the same sweep on the electrical example that follows.

4.7 A second example: the triangle with an unmodeled load

The DC triangle of §3.5 carries the same lessons into the electrical domain, where the “leak” is a load the graph does not show. Keep all seven unknowns of §3.5, flows first: the three flows, the two angles and the two loads. Give the five physics rows a common width σ in per unit, the loads their priors -1.5 ± 0.3 and -0.5 ± 0.3 , and read meters of accuracy 0.02. Every number is from `ch04_triangle_soft.py`.

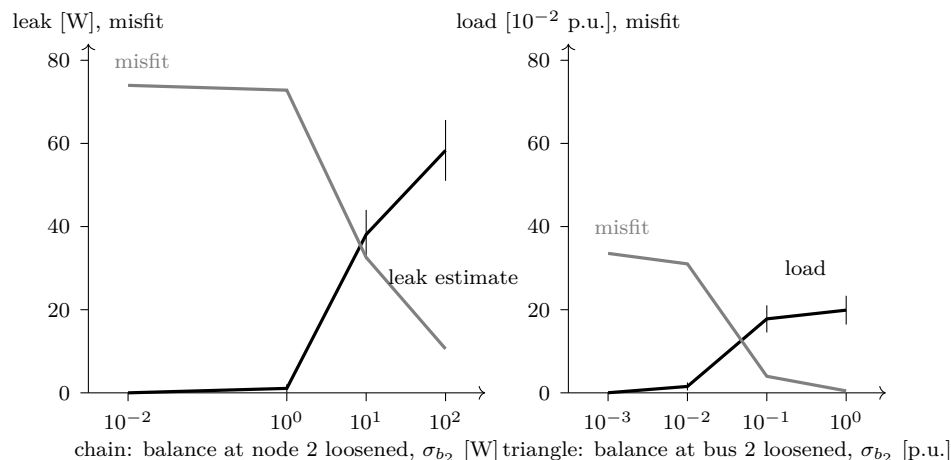


Figure 4.4: Loosening one balance row against inconsistent readings. Left: the chain, the balance at node 2 loosened; the leak estimate with its error bar (black) rises from nothing to 58 ± 7 watts as the width passes ten watts, and the misfit (grey) falls from 74 toward the value an adequate model would give. Right: the DC triangle of §4.7, the balance at bus 2 loosened; the unmodeled load rises to 0.20 per unit and the misfit falls from 34 to below one. In both, the row that is allowed to be violated is the row that reports the defect.

Table 4.4: The DC triangle with soft physics, one meter $F_{12} = 1.10$: posterior of the loads as the physics width shrinks. Hard reference from Table 3.3: $P_2 = -1.421 \pm 0.136$, $P_3 = -0.460 \pm 0.269$, correlation -0.976 .

σ [p.u.]	P_2	P_3	corr	max $ r_k $	cond
0.1	-1.433 ± 0.171	-0.466 ± 0.274	-0.649	7.5×10^{-3}	3.8×10^3
0.01	-1.421 ± 0.137	-0.460 ± 0.269	-0.971	8.8×10^{-5}	3.8×10^5
0.001	-1.421 ± 0.136	-0.460 ± 0.269	-0.976	8.8×10^{-7}	3.8×10^7
10^{-4}	-1.421 ± 0.136	-0.460 ± 0.269	-0.976	8.8×10^{-9}	3.8×10^9
10^{-5}	-1.421 ± 0.136	-0.460 ± 0.269	-0.976	8.8×10^{-11}	3.8×10^{11}

Convergence. With the single meter $F_{12} = 1.10$ of Chapter 3, Table 4.4 sweeps the width from 0.1 per unit, a tenth of the flows, down to 10^{-5} . At 0.1 the posterior is loose, the correlation between the loads only -0.65 , and the physics residuals are of order 10^{-2} : the meter has been partly absorbed by bending the loop rather than by moving the loads. At 0.01 the loads are within a thousandth of the hard values and at 0.001 they agree to every digit shown, with the correlation -0.976 of Table 3.3. The condition number grows by a hundred per decade, exactly as on the chain, and Figure 4.3 shows the two models' curves lying on top of each other once the width is expressed relative to the flows. A relative width of 10^{-3} is the comfortable choice on both.

Inconsistent readings. Now read three meters: the flow on line 1–2 at 1.10, the flow on line 2–3 at -0.20 , and the load at bus 2 itself, from a meter on the feeder it supplies, at -1.50 . The balance at bus 2 says that what arrives on the two lines is what the load draws, $F_{12} - F_{23} = -P_2$; the meters say 1.30 on the left and 1.50 on the right. No state of the exact model satisfies all

Table 4.5: Inconsistent meters on the triangle, $F_{12} = 1.10$, $F_{23} = -0.20$, $P_2 = -1.50$, each to 0.02: posterior as the width of the bus-2 balance is loosened while every other row stays at 0.001. The unmodeled load is the violation of that balance at the posterior mean. About 3 is expected of an adequate model.

σ_{b_2}	unmodeled load	P_2	P_3	F_{12}, F_{23} fitted	misfit
0.001	0.000 ± 0.001	-1.434 ± 0.016	-0.631 ± 0.043	1.166, -0.268	33.5
0.01	0.015 ± 0.010	-1.439 ± 0.017	-0.636 ± 0.043	1.161, -0.263	31.0
0.1	0.178 ± 0.033	-1.493 ± 0.020	-0.689 ± 0.044	1.106, -0.209	4.0
1	0.199 ± 0.035	-1.500 ± 0.020	-0.696 ± 0.044	1.099, -0.202	0.5

Table 4.6: The misfit at the posterior against its expectation under Proposition 4.2, for the cases of this chapter. The expectation is the number of factors minus the number of unknowns; the spread of an adequate model’s misfit is the square root of twice that.

case	factors, unknowns	expected	misfit
chain, consistent readings, tight physics	8, 6	2 ± 2	0.07
chain, inconsistent readings, tight physics	8, 6	2 ± 2	74
chain, inconsistent, node-2 balance at 100 W	8, 6	2 ± 2	10.6
triangle, inconsistent meters, tight physics	10, 7	3 ± 2.4	33.5
triangle, inconsistent, bus-2 balance at 1 p.u.	10, 7	3 ± 2.4	0.5

three to their accuracies, and the tight model of the first row of Table 4.5 answers by keeping its laws and spoiling its meters: the line flows are fitted at 1.166 and -0.268 , three accuracies from their readings, the load at -1.434 , three from its meter, and the misfit is 34 where an adequate model with ten factors and seven unknowns would give about three. Loosen the balance at bus 2 and the posterior finds the explanation: at a width of 0.1 the balance is violated by 0.18 ± 0.03 per unit and the misfit is 4; at a width of one it is violated by 0.20 ± 0.04 , every meter is fitted to within an accuracy, and the misfit is 0.5. The violation is a draw of 0.2 per unit at bus 2 that the graph does not show, a load on a feeder the meter does not cover, or a tap the operator does not know about, and the model has measured it from three meters without being told it exists. The right panel of Figure 4.4 draws the sweep beside the chain’s.

Table 4.6 sets every misfit of the chapter beside its expectation. The consistent chain and the loosened triangle sit below expectation, which says their widths are, if anything, generous; the two tight inconsistent models sit thirty and forty standard deviations above it, which is not a subtle signal; and the loosened chain, at 10.6 against 2 ± 2 , sits four deviations above, which is the residual doubt the text described.

Two differences from the chain are instructive. The triangle’s leak is found at a width of 0.1 per unit, a tenth of the flows, whereas the chain’s needed ten to a hundred watts, a tenth to a whole flow; the reason is that the triangle’s three meters pin the violation from both sides, while the chain’s two thermometers see the leak only through the source prior. And the triangle’s misfit falls all the way to 0.5, below its expected value, while the chain’s stops at 10.6; the triangle’s data are explained entirely by one unmodeled load, and the chain’s are not, which is the signal that the chain has a second thing wrong or a prior too narrow.

4.8 In practice

Scale the rows, then set relative widths. Divide every physics row by the typical size of what it balances so that its residual is of order one, and state widths as fractions of that. Relative widths of 10^{-3} reproduce the hard model on every example in this chapter at a condition number a solver does not notice; 10^{-5} is past the edge on a model of any size. Without the scaling, a width that is small for a kilowatt balance is enormous for a watt one.

Sweep the width once. Run the model at three widths a decade apart and check that the posterior has stopped moving. If it has not, the widths are too loose and the physics is being bent to fit the data; if the condition number has grown past 10^{10} , they are too tight. The sweep is cheap and it is the only way to know where a given model sits.

Read the misfit before the estimates. The sum of squared standardized residuals over every factor, compared with the number of factors minus the number of unknowns, is the first number to report. A misfit near its expectation says the model, the widths and the data are consistent; a misfit far above it says they are not, and no estimate from that posterior should be believed until the reason is found.

Loosen the row you suspect, not every row. An inconsistency is explained by violating some row. Loosening all of them lets the posterior spread the violation wherever it is cheapest, which is usually wrong and always uninformative. Loosening one row asks a question, “is it this?”, and the misfit answers it: the chain’s data were explained by a leak at node 2 and not by anything at node 1.

Report the violation as a measurement. The residual of a loosened row at the posterior, with its posterior spread, is an estimate of the unmodeled flow, and it should be reported in the row’s units with its error bar, exactly as a measured quantity would be.

Keep the hard limit as a check. When the soft model surprises, tighten the widths and compare with the input-space form. If the two disagree, the widths were doing work the modeler did not intend.

4.9 What is missing

The chapter has said what the widths mean and shown what they do on a six-variable model where every posterior was computed by inverting a six-by-six matrix. It has not said how the same computation is organized when the matrix is a million by a million and sparse, which is Chapter 6, nor which variables can be computed without the others, which is Chapter 5. And it has assumed that every row is linear, so that the soft joint is Gaussian and the manifold is a plane. A nonlinear closure makes the manifold curved, the soft joint non-Gaussian, and Proposition 4.1 local rather than global; a discrete availability variable makes the manifold a union of pieces, one per value. Chapter 7 takes those up.

Notes and further reading

The soft model is the quadratic penalty method for equality-constrained least squares, and §4.4 and §4.5 restate what Nocedal and Wright [75] say about it: the penalized problem converges to the constrained one as the penalty weight grows, and its conditioning degrades as the weight grows, which is why the weight is chosen finite and why augmented-Lagrangian methods exist. The book keeps the plain penalty form because its normal equations are the same sparse system as the deterministic solve (Proposition 6.2 in Chapter 6) and because a finite width is wanted for its own sake, to admit violation. The relation between condition number and lost digits is in Higham [37].

Treating physics as a soft constraint with a modeler-chosen width, and letting the size of the violation at the posterior carry diagnostic meaning, is the practice of power-system state estimation, where zero-injection buses are handled either as hard constraints or as pseudo-measurements of very high weight [1, 73], and of process data reconciliation, where the residual of a balance is the signature of a leak or a bad meter [65]. The leak example of §4.6 is the data-reconciliation argument on the smallest possible flowsheet. The chi-squared test named in §4.5 is the standard adequacy test of both fields and of least-squares theory generally; its assumptions are stated there because they are often omitted.

The input-space form of §4.2, with the physics eliminated and the posterior written over the inputs alone, is how Bayesian inverse problems are usually posed [41, 98]: the forward map is $X(\mathbf{u})$, and its derivative is the sensitivity that adjoint methods compute. The observation that this form is dense while the residual form is sparse, and that the choice between them is the choice between Chapter 14's gradients and Chapter 8's elimination, is the book's framing.

Summary

- With zero widths the joint lives on the constraint manifold $\mathbf{x} = X(\mathbf{u})$, of dimension equal to the number of inputs. Its natural form is the prior on the inputs carried along by the solve.
- Conditioning on the manifold gives the input-space posterior $p(\mathbf{u}) \ell(X(\mathbf{u}))$: exact, dense, and one solve per evaluation. The worked example of Chapter 3 was this.
- With finite widths the joint is a density on the full space, concentrated within about a width of the manifold. As the widths go to zero it converges to the hard posterior; the soft model is the quadratic penalty form of the constrained one.
- Soften because it keeps the problem unconstrained, keeps the graph sparse, and makes a violated law visible and measurable.
- Widths come from instruments, data sheets, forecasts, and known model error; balance widths are small relative to their flows, and the condition number grows as the inverse square of the relative width.
- On the chain, widths of 0.1 to 0.01 watts reproduce the hard posterior exactly; inconsistent readings through tight physics produce an absurd state with a misfit of 74; loosening one balance turns the inconsistency into a 58 ± 7 watt leak estimate and a misfit of 10.6.
- On the triangle the same sweep converges at a relative width of 10^{-3} , and three inconsistent meters become an unmodeled load of 0.20 ± 0.04 per unit at bus 2 with the misfit falling from 34 to 0.5. Loosening the wrong row explains nothing, and the misfit says so.

Exercises

Exercise 4.1. For the linear physics $\mathbf{F} = \mathbf{A}\mathbf{x} + \mathbf{B}\mathbf{u}$ with $\mathbf{A}$ square and invertible, write $X(\mathbf{u})$ explicitly, verify that $\partial X/\partial \mathbf{u} = -\mathbf{A}^{-1}\mathbf{B}$, and show that this matrix is dense for the processor heat path even though $\mathbf{A}$ and $\mathbf{B}$ are sparse.

Exercise 4.2. Prove item 3 of Proposition 4.1: in a Gaussian posterior whose precision includes the term $\mathbf{h}\mathbf{h}^\top/\sigma^2$ for a linear residual $r = \mathbf{h}^\top\mathbf{z}$, the posterior variance of r is at most σ^2 . Use the fact that adding a positive semidefinite matrix to a precision cannot increase any variance.

Exercise 4.3. Re-run the sweep of Table 4.2 with the two closure rows at width 1 watt and only the two balance rows swept. Explain, in terms of Figure 4.1, why the estimate of G converges to a different limit than in the table, and compute that limit by treating the closure widths as model error in the input-space form.

Exercise 4.4. In the leak example, loosen the balance at node 1 instead of node 2. Show that the posterior finds a different explanation of the same readings, state what physical defect it corresponds to, and compare the two misfits. Which explanation should the modeler prefer, and can the data alone decide?

Exercise 4.5. Derive the volume factor of Remark 4.1 for one solved variable and one input, $r(x, u) = 0$, by substituting r for x in the integral $\int \delta(r(x, u)) dx$. Then evaluate it for the closure $Q - k(T_1 - T_2)$ solved for T_1 with k as the input, and state when it is constant.

Solutions to selected exercises

Exercise 4.2. Write the posterior precision as $\mathbf{\Lambda} = \mathbf{h}\mathbf{h}^\top/\sigma^2 + \mathbf{M}$ with $\mathbf{M}$ positive semidefinite, the sum of every other factor's contribution. The posterior variance of $r = \mathbf{h}^\top\mathbf{z}$ is $\mathbf{h}^\top\mathbf{\Lambda}^{-1}\mathbf{h}$. For any positive definite $\mathbf{\Lambda}_1$ and positive semidefinite $\mathbf{M}$, $\mathbf{\Lambda}_1 + \mathbf{M} \succeq \mathbf{\Lambda}_1$ implies $(\mathbf{\Lambda}_1 + \mathbf{M})^{-1} \preceq \mathbf{\Lambda}_1^{-1}$, so adding $\mathbf{M}$ to a precision cannot increase any variance. But $\mathbf{h}\mathbf{h}^\top/\sigma^2$ alone is singular, so take $\mathbf{\Lambda}_1 = \mathbf{h}\mathbf{h}^\top/\sigma^2 + \epsilon\mathbf{I}$ with $\epsilon > 0$ small and $\mathbf{M} - \epsilon\mathbf{I} \succeq 0$ for ϵ below the smallest eigenvalue of $\mathbf{M}$ restricted to the directions where it is positive; then $\mathbf{h}^\top\mathbf{\Lambda}^{-1}\mathbf{h} \leq \mathbf{h}^\top\mathbf{\Lambda}_1^{-1}\mathbf{h}$, and by the Sherman–Morrison identity $\mathbf{h}^\top\mathbf{\Lambda}_1^{-1}\mathbf{h} = \|\mathbf{h}\|^2/\epsilon \cdot (1 - \|\mathbf{h}\|^2/(\epsilon\sigma^2 + \|\mathbf{h}\|^2)) = \sigma^2\|\mathbf{h}\|^2/(\epsilon\sigma^2 + \|\mathbf{h}\|^2) < \sigma^2$. When $\mathbf{M}$ is singular in the direction $\mathbf{h}$ the bound is attained in the limit, which is why the posterior spread of every residual in Table 4.2 equals the width: the physics row is the only factor that constrains its own residual.

Exercise 4.4. Loosening the balance at node 1 to 100 watts, with every other row at 0.01, gives a violation of -46 ± 20 watts, a source of 102 ± 20 , an inlet temperature of -0.1 ± 1.7 degrees, and a misfit of 68.5; at ten watts the violation is -10 , and at one watt nothing has moved from the tight solution. The violation's sign says that 46 watts more than the source is entering the package's conduction path: a second, hidden source at node 1. But the posterior has not been helped: the inlet temperature is still twenty degrees below its setpoint, the sensors are still off by three or four accuracies, and the misfit has fallen from 74 only to 68. The reason is in the physics. The two readings fix $T_1 - T_2 = 31$ degrees and hence $Q_{12} = 155$ watts whatever balance is loosened; a leak at node 2 lets Q_{2a} be less than Q_{12} , so that $T_2 - T_a$ can be 52 degrees instead of 77 and the inlet temperature can return to its setpoint, while a defect at node 1 changes only where Q_{12} came from and leaves $Q_{2a} = Q_{12} = 155$, so the inlet temperature must still sit at -5 .

The data decide: the node-2 explanation reaches a misfit of 10.6 and the node-1 explanation does not leave 68, and the modeler should prefer the first by a margin of nearly sixty units of misfit, which Chapter 12 will turn into a likelihood ratio. What the data cannot decide is whether the node-2 leak is the whole story, since 10.6 is still above the expected 2; that residual doubt is about the source prior, and only a meter on the source or a better data sheet can remove it.

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

A closure you do not trust *soft physics rows; a width on a closure is a claim about the model; not about the instrument*

`foundation_hvac/model_adequacy_audit/problems/a_closure_you_do_not_trust`

Chapter 5

Factorization, separators, and treewidth

Chapter 3 read the factor graph informally: a measurement travels along every path, and two inputs that share an observed effect become correlated. This chapter makes the reading exact. It states what a factorization does and does not say about independence, gives the rule for reading conditional independence off the graph, shows that the ports of Chapter 1 are exactly the sets that rule singles out, and then turns to cost: what it takes to compute a marginal on a factor graph, why the answer is governed by a number called treewidth, and why a physical cut with few ports is a cheap place to divide a computation. Nothing in the chapter requires Gaussians; everything in it holds for any positive factorized density.

5.1 Factorization is not independence

Two variables are *independent* if their joint density is the product of their marginals, $p(x_1, x_3) = p(x_1)p(x_3)$; knowing one says nothing about the other. They are *conditionally independent given* a third if the same holds for every fixed value of the third:

$$p(x_1, x_3 \mid x_2) = p(x_1 \mid x_2) p(x_3 \mid x_2), \quad \text{written } x_1 \perp x_3 \mid x_2. \quad (5.1)$$

Neither implies the other.

Take the simplest factor graph with three variables, the chain of Figure 5.1:

$$p(x_1, x_2, x_3) \propto \varphi_A(x_1, x_2) \varphi_B(x_2, x_3). \quad (5.2)$$

Are x_1 and x_3 independent? In general, no. Integrate out x_2 :

$$p(x_1, x_3) \propto \int \varphi_A(x_1, x_2) \varphi_B(x_2, x_3) dx_2, \quad (5.3)$$

which is a function of x_1 and x_3 together that does not split into a product unless the factors are very special. Information passes from x_1 through x_2 to x_3 , and the chain of Chapter 3 showed it passing: a reading two nodes away moved the source.

Are they independent *given* x_2 ? Yes, always. Fix x_2 . The right side of equation (5.2) is then a function of x_1 alone times a function of x_3 alone, and a joint density that splits that way is a product of its marginals. That is equation (5.1), with one line of proof.




Figure 5.1: The three-variable chain. Left, as a factor graph. Right, its Markov graph: variables adjacent when they share a factor. Removing x_2 disconnects x_1 from x_3 , so $x_1 \perp x_3 \mid x_2$. Nothing disconnects them otherwise, so in general $x_1 \not\perp x_3$.

So a factorization into local pieces does two opposite things at once. It creates global dependence, because every variable is reachable from every other along the factors. And it creates conditional independence, because fixing the variables on a path blocks it. The first is what makes a measurement anywhere informative everywhere. The second is what makes inference tractable, because it says which variables can be dealt with separately once a few others are known.

Principle 5.1. *Local factors create global dependence and, at the same time, conditional independence. Which variables are independent given which others is a property of the graph alone, and can be read before any number is computed.*

5.2 Reading independence off the graph

The reading uses the Markov graph of §2.5: one node per variable, an edge between two variables when some factor reads both.

Definition 5.1 (Separator). A set of variables S *separates* two disjoint sets A and B in the Markov graph if every path from a variable in A to a variable in B passes through some variable in S . Equivalently, removing the nodes of S leaves A and B in different connected components.

Proposition 5.1 (Separation implies conditional independence). *Let $p(\mathbf{z}) \propto \prod_f \varphi_f(\mathbf{z}_f)$ be a factorized density and let S separate A from B in its Markov graph. Then $A \perp B \mid S$.*

Proof. Every factor’s scope is a set of mutually adjacent variables in the Markov graph, by construction. A set of mutually adjacent variables cannot contain one variable from A and one from B , since those two would then be adjacent and the path of length one between them would avoid S . So every factor reads variables from $A \cup S$ only, or from $B \cup S$ only (or from S only, which is both). Group the factors: $p(\mathbf{z}) \propto f(\mathbf{z}_A, \mathbf{z}_S) g(\mathbf{z}_B, \mathbf{z}_S)$. For fixed $\mathbf{z}_S$ this is a product of a function of $\mathbf{z}_A$ and a function of $\mathbf{z}_B$, which is conditional independence. $\square$

The proof is the chain argument of the previous section, with “the middle variable” replaced by “a set that every path must cross”. The proposition is the useful direction of a two-way result; the other direction, that every conditional independence a positive density has is visible as a separation in some factorization of it, is the Hammersley–Clifford theorem and is not needed here. Two things about it matter for physical models.

First, the proposition asks nothing of the factors except that they exist. They may be Gaussian, discrete, nonlinear, or indicator functions. So the independence structure of a model is settled by its factor graph, which is settled by its physics, before any width, prior or sensor is chosen.

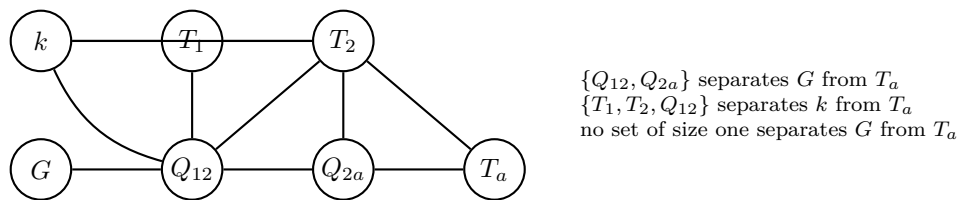


Figure 5.2: The Markov graph of the soft processor heat path with its three freed inputs (Figure 3.1), before any sensor is attached. Every edge is a pair read by one factor: the balances join the flows to each other and to the source, the closures join each flow to the potentials at its ends and, for c_{12} , to the conductance. The path from G to T_a carries no marginal dependence, and every path from either to the other crosses the two flows.

Second, the converse direction needs the density to be positive everywhere, and a model with hard physics is not: the delta factors of Chapter 4 put zero density off the manifold. Hard physics can therefore carry independencies that no separation shows. The soft model is positive, and the correspondence between graph and independence is then as clean as the proposition makes it. This is one more reason, after the three of §4.4, to compute on the soft graph.

5.3 Explaining away, precisely

Chapter 3 found that the source G and the inlet temperature T_a , independent under the prior, were correlated at -0.985 after the reading of T_2 . Proposition 5.1 says when two variables *are* independent given a set; it does not say when they are not, and it says nothing about marginal independence, which is independence given the empty set. Both are needed to make the observation exact.

Look at the Markov graph of Figure 3.1, drawn in Figure 5.2. The source is adjacent to Q_{12} through the balance b_1 ; the inlet temperature is adjacent to Q_{2a} and T_2 through the closure c_{2a} ; and Q_{12} , Q_{2a} , T_2 are all adjacent to one another through b_2 and c_{12} . There is a path from G to T_a , so the empty set does not separate them, and the proposition is silent about their marginal independence.

Yet under the prior they are independent, by construction: their priors are separate unary factors, and Chapter 4 showed that for linear physics the physics factors integrate out to a constant, leaving the product of the priors. The Markov graph draws an edge path that carries no marginal dependence.

The reason is that the physics between them is, in the hard limit, a deterministic map from inputs to solved variables. Marginalizing a deterministic map's outputs returns its inputs untouched. The undirected graph cannot express "this path carries dependence only when something on it is observed", because it has no notion of input and output. The directed language of §2.2 can: the pattern $G \rightarrow T_2 \leftarrow T_a$, two arrows meeting head to head at a common effect, is called a *collider*, and the rule for directed graphs is that a path through a collider is blocked when the collider is *not* observed and opened when it is, or when anything downstream of it is. That is the opposite of the rule for a chain, and it is the whole of explaining away: two independent causes of a common effect become dependent once the effect is seen, because having seen the effect, the more one cause explains it the less the other needs to.

For the models of this book the statement can be made without the directed formalism, because the physics has the input-output structure of Chapter 4 built in.

Proposition 5.2 (Explaining away on a physical graph). *Let the physics be linear with widths $\sigma > 0$, and let two inputs u_1, u_2 carry independent priors. Then $u_1 \perp u_2$ under the prior predictive; and if a solved variable x_j that depends on both, $\partial X_j / \partial u_1 \neq 0 \neq \partial X_j / \partial u_2$, is observed, then in general $u_1 \not\perp u_2 \mid y_j$.*

Proof. For the first half, write the physics as $\mathbf{F} = \mathbf{A}\mathbf{x} + \mathbf{B}\mathbf{u}$ with $\mathbf{A}$ square and invertible, as in Chapter 4. The prior predictive of the inputs is the joint with the solved variables integrated out, $p(\mathbf{u}) \int \exp(-\|\mathbf{A}\mathbf{x} + \mathbf{B}\mathbf{u}\|^2 / 2\sigma^2) d\mathbf{x}$. Substitute $\mathbf{x} = -\mathbf{A}^{-1}\mathbf{B}\mathbf{u} + \mathbf{A}^{-1}\mathbf{r}$; the Jacobian of the substitution is $1/|\det \mathbf{A}|$, a constant, and the integral becomes $|\det \mathbf{A}|^{-1} \int \exp(-\|\mathbf{r}\|^2 / 2\sigma^2) d\mathbf{r}$, which does not depend on $\mathbf{u}$. So the prior predictive of the inputs is the prior, $p(u_1)p(u_2)$, a product, and $u_1 \perp u_2$. For the second half, condition the same joint on a reading of x_j ; by equation (4.3) the posterior of the inputs is $p(u_1)p(u_2)\ell(X_j(u_1, u_2))$ in the hard limit, and for finite σ the same with ℓ smoothed as in the proof of Proposition 4.1. A product of a function of u_1 , a function of u_2 , and a function of both factorizes into a function of u_1 times a function of u_2 only if the third factor does, which for a Gaussian ℓ of a linear X_j with both derivatives nonzero it does not: $\ell(au_1 + bu_2)$ with $ab \neq 0$ contains the cross term $-abu_1u_2/\sigma_y^2$ in its exponent, and a joint Gaussian with a nonzero cross term is not a product. Hence $u_1 \not\perp u_2 \mid y_j$. $\square$

The second half is read from the input-space posterior, and the cross term is the correlation of equation (3.11). In the worked example X_j was $T_a + 0.5G$, the likelihood was a Gaussian in that combination, and the posterior was a ridge along it. The ridge is the picture of explaining away: along the ridge, a higher source is paid for by a lower inlet temperature.

Principle 5.2. *Independent inputs stay independent while nothing downstream of them is observed, and become dependent the moment a shared consequence is. The undirected graph over-connects them; the input-output structure of the physics is what says which is which.*

5.4 Ports are separators

Now return to the boundary. Chapter 1 cut a physical graph into a set S of nodes and its complement, and found that the flows across the cut sum to the net source inside, whatever the inside does (Proposition 1.1). The probabilistic version of that statement is that the cut carries everything one side needs to know about the other.

Take a physical cut through a set of edges $\mathcal{C}$. For each cut edge e with inside end i and outside end j , the closure factor c_e reads the flow F_e , both potentials ϕ_i and ϕ_j , and the edge's parameters. Every other factor reads variables from one side only, together with the cut flows: the balance at i reads F_e and the inside flows at i ; the balance at j reads F_e and the outside flows at j . Figure 5.3 draws the Markov graph near one cut edge.

Remove the pair $\{F_e, \phi_j\}$. The closure's remaining scope is $\{\phi_i\}$ and the edge's parameters, all inside; the outside balance at j has lost its only inside-facing variable. No path remains from inside to outside through edge e . Do the same for every cut edge and the two sides are disconnected.

Proposition 5.3 (Ports separate). *For a physical cut $\mathcal{C}$, the set of port pairs $\{(F_e, \phi_{j(e)}) : e \in \mathcal{C}\}$, one flow and one potential per cut edge, separates the inside variables from the outside variables in the Markov graph of the physics. Hence, given the ports, the inside and the outside are conditionally independent.*

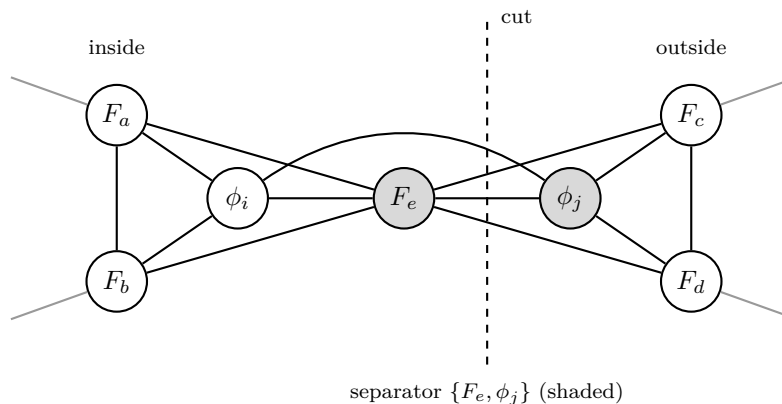


Figure 5.3: The Markov graph around one cut edge e from inside node i to outside node j . The closure c_e makes $\{F_e, \phi_i, \phi_j\}$ a clique; the balance at i joins F_e to the other inside flows F_a, F_b ; the balance at j joins it to the outside flows F_c, F_d . Removing the shaded pair $\{F_e, \phi_j\}$ leaves no path from the inside cluster to the outside one. The pair is the port of the edge.

Two remarks. The separator is not unique; $\{F_e, \phi_i\}$ works as well, and so does $\{F_e, \phi_i, \phi_j\}$, and which potential is included is the choice of which side owns the cut's potential. But one flow and one potential per edge is the smallest set that works, and neither alone suffices: the potentials without the flow leave the balances at i and j joined through F_e , and the flow without a potential leaves the closure joining ϕ_i to ϕ_j . The pair that Chapter 1 called a port, on physical grounds, is the pair that separation requires on graphical grounds.

And the proposition is the probabilistic reading of Proposition 1.1. That proposition said the cut flows are exact: the inside's detail cancels, and the outside sees only what crosses. This one says the cut variables are *sufficient*: given them, the inside's detail is irrelevant to the outside, and vice versa. A region can be summarized to its neighbors by a function of its ports alone, with nothing lost. What that function is, and how it is computed, is the subject of Chapter 8.

Principle 5.3. *The ports of a physical cut are a separator of the factor graph. Given the ports, each side of the cut is conditionally independent of the other, so each side can be summarized to the other by a function of the ports alone.*

5.5 Elimination and fill

Independence says what can be computed separately. Cost says what it takes. The basic operation of exact inference is to remove one variable from the factor graph by integrating it out, and the cost of inference is the cost of doing that repeatedly in some order.

5.5.1 One elimination

Suppose x_1 appears in two factors, $\varphi_A(x_1, x_2)$ and $\varphi_C(x_1, x_3)$, and nowhere else. Integrating it out of the joint replaces the two factors by one,

$$g(x_2, x_3) = \int \varphi_A(x_1, x_2) \varphi_C(x_1, x_3) dx_1, \quad (5.4)$$

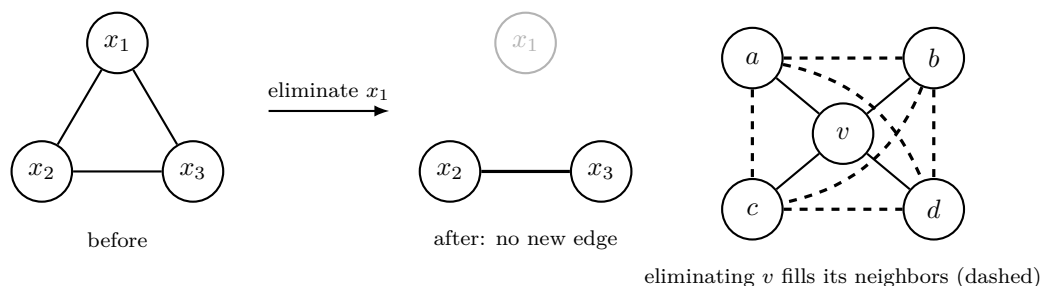


Figure 5.4: Elimination and fill. Left: eliminating x_1 from the triangle creates a factor on $\{x_2, x_3\}$, but they were already adjacent, so the graph gains no edge. Right: eliminating a variable with four neighbors that were not adjacent to each other creates six fill edges; the neighbors become a clique of four, and the factor on that clique is the largest object the computation must hold.

which reads every variable the eliminated factors read except x_1 . Nothing else in the joint changes, since no other factor read x_1 . The result is a factor graph on one fewer variable that has exactly the marginal of the original over the remaining ones.

The new factor is the point. Before elimination, x_2 and x_3 shared no factor; after it, they share g . In the Markov graph an edge has appeared between x_2 and x_3 . Such an edge is called *fill*, and eliminating a variable always fills in every pair of its neighbors that was not already adjacent: the neighbors of the eliminated variable become a clique. Figure 5.4 shows it on the triangle and on a variable with four neighbors.

5.5.2 Order and width

Eliminate all the variables but one, in some order, and what remains is the marginal of that one. The cost is dominated by the largest factor created along the way. For discrete variables with K states, a factor on $w + 1$ variables is a table of K^{w+1} numbers, and creating it costs that many operations. For Gaussian variables a factor on $w + 1$ variables is a $(w + 1) \times (w + 1)$ block, and eliminating a variable from it costs of order w^2 ; the total for the whole graph is what a sparse Cholesky factorization costs, and the fill edges are the nonzeros of the factor that were not in the original matrix.

The largest factor depends on the order. Eliminate the middle of a chain first and the two ends become adjacent; eliminate from one end and no fill ever appears. For the chain the best order creates factors on two variables at most; for the four-neighbor star of Figure 5.4, eliminating the center first creates a factor on four, while eliminating the leaves first creates factors on two. The number that measures how well the best order can do is:

Definition 5.2 (Treewidth). The *width* of an elimination order is one less than the size of the largest factor scope it creates. The *treewidth* of a graph is the minimum width over all elimination orders.

A tree has treewidth one: eliminate leaves inward and every factor created has two variables. A single cycle has treewidth two. A $\sqrt{n} \times \sqrt{n}$ grid has treewidth $\sqrt{n}$. A complete graph on n variables has treewidth $n - 1$. Finding the optimal order is hard in general, but good orders are found in practice by heuristics that eliminate low-degree variables first, or that recursively cut the graph at small separators and eliminate the pieces before the separator.

Two bounds fix the number without a search.

Lemma 5.1 (Bounds on the width). *The treewidth of a graph is at least the size of its largest clique minus one, and at most the width of any elimination order. A graph is a tree if and only if its treewidth is one.*

Proof. Consider a largest clique Q and the first of its vertices to be eliminated in any order. Every other vertex of Q is still present and adjacent to it, since elimination never removes an edge, so its front has at least $|Q| - 1$ vertices; the width of the order, and hence the minimum over orders, is at least $|Q| - 1$. The upper bound is the definition. For the last statement, a tree has an order of width one, leaves inward, and a graph with a cycle contains, after eliminating everything off the cycle, a cycle whose first eliminated vertex has two neighbors, so its width is at least two. $\square$

The lower bound is often tight on physical graphs. The DC triangle's row-per-factor Markov graph has a clique of three, the scope of the feeder closure c_{23} , so its treewidth is at least two, and an order of width two exists (Exercise 5.3); every closure that reads a flow and two potentials plants such a triangle, which is why no row-per-factor physical graph is a tree.

Principle 5.4. *Exact inference costs what the largest factor created by elimination costs, and that is governed by the treewidth of the factorization, not by the number of variables. Sparse is not enough; a sparse graph with large treewidth is expensive.*

5.5.3 What this means for a physical graph

Return to the two examples. The processor heat path in its row-per-factor form has a six-cycle (§2.1), so its treewidth is two; in nodal form, with the flows eliminated first, it is a path and its treewidth is one. Eliminating the flows is what the nodal form of §2.4 did by hand. A flow appears in one closure and two balances, and eliminating it joins everything those three factors read: the potentials at its ends and the other flows at both its nodes. That fill among flows is temporary. Once every flow is gone, what remains joins two potentials exactly when their nodes share an edge, which is the network's own graph, and no fill survives. That is why power engineers write the nodal equations first: the reduced susceptance matrix has the sparsity of the network itself. Whether to eliminate flows first or last in a numerical factorization is a different question, answered by counting the fill, and Chapter 6 counts it.

A radial branch circuit is a tree, so in nodal form its treewidth is one and exact inference on it is linear in its size. A distribution meshed by its ties has treewidth larger than one, but it is a sparse, nearly planar graph, and planar graphs have separators of size $O(\sqrt{n})$ [60], so their treewidth grows no faster than the square root of the number of buses and in practice much more slowly; the measured values for the standard test networks are reported in Chapter 18. Exact inference on them is affordable. A finite-element discretization of a three-dimensional solid, a hall's air among them, is harder: its separators, hence its treewidth, grow as $n^{2/3}$ [70], so sparse direct factorization becomes expensive at scale, which is one motivation for iterative and domain-decomposition solvers.

The physical cut of §5.4 is the elimination strategy the last paragraph hinted at. Cut the network at a set of ports; eliminate everything inside each region, which creates fill only within the region and among its ports; then what remains is a factor graph on the ports alone. The largest factor created inside a region is bounded by the region's own treewidth, and the factor left on the ports has scope equal to the number of ports. The cost of the whole is set by the

Table 5.1: Elimination orders on the DC triangle in row-per-factor form, five variables: the width distribution over all 120 orders, and the widths and fill of the orders that eliminate the flows first or the angles first.

orders	count	width	fill edges
all orders	120	2: 24 orders; 3: 72; 4: 24	–
flows first	12	2 to 4	0 to 3
angles first	12	3	2
F_{23} first	24	4	3 or more

region sizes and the port counts, and a cut with few ports is a cheap cut. Chapter 8 carries this out for Gaussian models, where it is the Schur complement, and Chapter 18 asks how to choose the cut.

5.6 Worked examples: counting width and fill

The claims of the last section can be counted on the book’s examples, and the counts are in `ch05_separators.py`.

The triangle, every order. The DC triangle in row-per-factor form has five variables and seven Markov edges (Figure 2.6); Table 5.1 counts its orders. Of its 120 elimination orders, 24 have width two, 72 width three, and 24 width four; none has width one, because the graph contains the triangle $\theta_2\theta_3F_{23}$ and a graph with a triangle is not a tree. The twelve orders that eliminate the three flows first have widths from two to four depending on the order among the flows, and create between none and three fill edges, all among the flows themselves; what remains is the nodal form, two angles joined by the edge that c_{23} had already drawn. The twelve orders that eliminate the two angles first all have width three and create two fill edges, F_{12} to θ_3 and then F_{12} to F_{13} , joining flows that no factor read together. Flows first is the better family, but not uniformly: within it, eliminating F_{23} first, the flow on the loop, costs width four.

The six-bus distribution. Table 5.2 counts the same things on the two-room distribution of two triangles and a tie that Chapters 8 and 15 use, drawn in Figure 5.5. Its nodal Markov graph, the five angles with the network’s own edges, has treewidth two. Its row-per-factor graph, twelve variables and twenty-six edges, has treewidth at most four by the minimum-fill heuristic, which found an order of width four with three fill edges. Eliminating all seven flows first has width six and creates fourteen fill edges before the flows are gone, because a flow’s elimination joins every other flow at both its buses; eliminating the angles first has width eight and twenty-six fill edges. The lesson of §5.5 stands corrected in one respect: the nodal form is the right *result*, with the network’s own sparsity, but reaching it by eliminating every flow before any angle is not the cheapest *route*, and a heuristic that interleaves them is. The same table checks Proposition 5.3: removing the tie flow F_{34} and the angle θ_4 disconnects the left triangle from the right, and removing either alone, or the two angles at the tie’s ends without the flow, does not.

Lemma 5.1 brackets these numbers. The six-bus graph’s largest clique is the scope of a feeder closure, three variables, so its treewidth is at least two, and the minimum-fill order shows it is at most four; the true value lies between, and finding it exactly is the hard problem the Notes cite. On graphs of this size the gap is harmless, since a width of four is as cheap as a width of two;

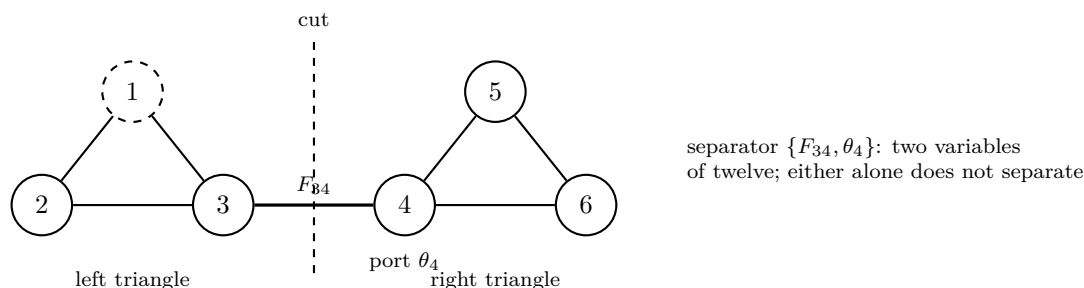


Figure 5.5: The six-bus distribution cut at its tie. The port pair of the cut edge, the tie flow and the angle on the far side, separates the two triangles in the row-per-factor Markov graph; the script confirms that neither variable alone does, nor the two end angles without the flow.

Table 5.2: Elimination on the six-bus distribution in row-per-factor form (twelve variables): width and fill under three orders, and which variable sets separate the two triangles.

order	width	fill edges
all flows first, then angles	6	14
all angles first, then flows	8	26
minimum fill (interleaved)	4	3
removed	left and right triangles	
$\{F_{34}, \theta_4\}$	separated	
$\{F_{34}\}$ or $\{\theta_4\}$ alone	connected	
$\{\theta_3, \theta_4\}$	connected	

on a network of a thousand buses the heuristics' orders are what a solver uses, and Chapter 18 reports what they find.

The coolant loop. The two-domain model of Example 1.3 has a Markov graph of twenty variables and forty-six edges with treewidth at most six by the heuristics and at least two by its largest clique, the scope of a carrier closure. Its interesting separator is not a physical cut but a domain cut: remove the six mass flows and the four pressures are disconnected from the four temperatures and six energy flows. Given the mass flows, the pressure layer and the temperature layer are conditionally independent, which is the probabilistic statement of what Chapter 2's Figure 2.4 showed structurally: the domains couple only through the flows the carrier closures read. A pressure measurement informs a temperature only by way of what it says about a mass flow. The minimum separator between one particular pressure and one particular temperature is smaller, two variables, the mass flow and energy flow of the return edge, which is the physical statement that the return header's temperature depends on the supply pressure only through what returns.

The ring, around and across. A ring of twelve buses, each tied to its two neighbors, has treewidth two: eliminate the buses in order around the ring and every elimination joins the two neighbors of the eliminated bus, a front of two, creating nine fill edges in all (the last two eliminations find their neighbors already adjacent). Figure 5.6 shows the alternative. Cut the ring at two opposite buses, which are then the ports of two chains of five buses each; eliminate

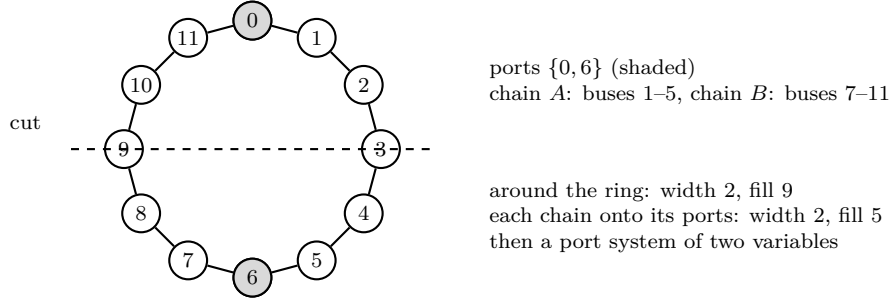


Figure 5.6: A ring of twelve buses cut at two opposite buses into two chains. Eliminating each chain’s interior onto the shaded ports costs the same width as going around the ring, and leaves a two-variable port system that the chains share; the gain is independence and reuse, not width.

each chain’s interior onto its ports, five fill edges and a front of two per chain; and what remains is a port system on two variables. Nothing has been gained in width, which was already two, but the two chains can be eliminated independently, each holds only its own factors, and the port system is what the chains need to exchange. This is the structure of Chapter 8’s region messages in the smallest possible case, and the reason to prefer it is not the width but the reuse: a change in one chain recomputes that chain’s five eliminations and the two-variable port solve, not the ring.

Grids against networks. Figure 5.7 plots the elimination width of square grids, the graph of a conducting plate discretized on $s \times s$ nodes, from 4×4 to 16×16 , against the number of nodes, with $\sqrt{n}$ for comparison. The width grows as $\sqrt{n}$ and a little faster, 22 at 256 nodes, as the separator theorem for planar graphs says it must. The six-bus distribution and the coolant loop sit far below the curve at their sizes. A plate is the hardest two-dimensional physics there is for elimination, because every node has four neighbors and no cut is thin; a network built by engineers has long thin regions joined at few ports, and Chapter 18 measures how far below the curve real networks of a thousand buses sit.

5.7 Why separators matter for cost

The chapter closes with the count that motivates Part III.

Take a system that divides into three regions, each containing twenty binary uncertain quantities (component availabilities, say), and suppose the physics makes the regions conditionally independent given a separator S of k variables between them. The joint has 2^{60} states, about 10^{18} . A method that must visit each state cannot be run.

Proposition 5.1 says the joint factorizes across the separator,

$$p(R_A, R_B, R_C, S) \propto f_A(R_A, S) f_B(R_B, S) f_C(R_C, S), \quad (5.5)$$

for suitable factors, where R_A denotes region A ’s variables. Then any marginal of interest can be found by eliminating each region into a message on the separator,

$$m_A(S) = \sum_{R_A} f_A(R_A, S), \quad m_B(S) = \sum_{R_B} f_B(R_B, S), \quad m_C(S) = \sum_{R_C} f_C(R_C, S), \quad (5.6)$$

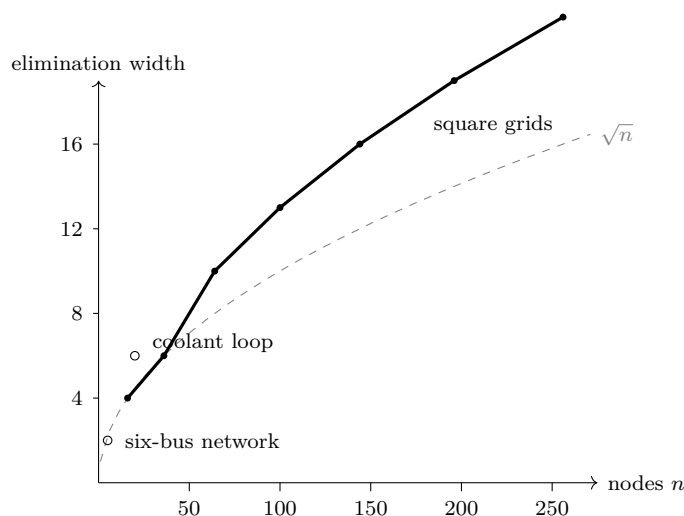


Figure 5.7: Elimination width of square grids of n nodes (filled points, minimum-fill ordering) against $\sqrt{n}$ (dashed). The six-bus network and the coolant loop are marked at their sizes. A grid's width grows with the square root of its size; the networks' widths are set by their ports.

Table 5.3: Operations to marginalize three regions of n binary variables exactly: joined at one separator of k variables (star), or in a chain with two separators of k each, against enumeration of the joint.

n	k	star	chain	ratio	enumeration 2^{3n}
20	5	1.0×10^8	1.1×10^9	11	1.2×10^{18}
20	3	2.5×10^7	8.4×10^7	3.3	1.2×10^{18}
30	5	1.0×10^{11}	1.2×10^{12}	11	1.2×10^{27}

and combining them, $p(S) \propto m_A(S) m_B(S) m_C(S)$. Each message costs $2^{20} \cdot 2^k$ operations at most, about $10^6 \cdot 2^k$, and the combination costs 2^k . For a separator of five variables the whole computation is a few times 10^7 operations, against the 10^{18} of enumeration. The exponent that matters is k , the size of the separator, not 60, the number of uncertain quantities.

Table 5.3 tabulates the count for three sizes, beside the chain arrangement of Exercise 5.5 in which the middle region touches two separators and pays for both; Figure 5.8 draws the two arrangements.

This is the central fact about factorized inference, and it is worth stating what it does and does not claim. It claims that the cost of *exact* inference scales with the separator, and that a physical system with a natural cut of few ports has a small separator for free. It does not claim that a method which samples states instead of enumerating them is defeated by 2^{60} ; a sampler draws a hundred thousand states from a space of 10^{18} without difficulty, and the count above is not an argument against it. The argument that does bear on samplers is about what each state costs to evaluate, and about how much of that evaluation the messages (5.6) let one reuse across related questions. Chapter 10 makes that argument with numbers.

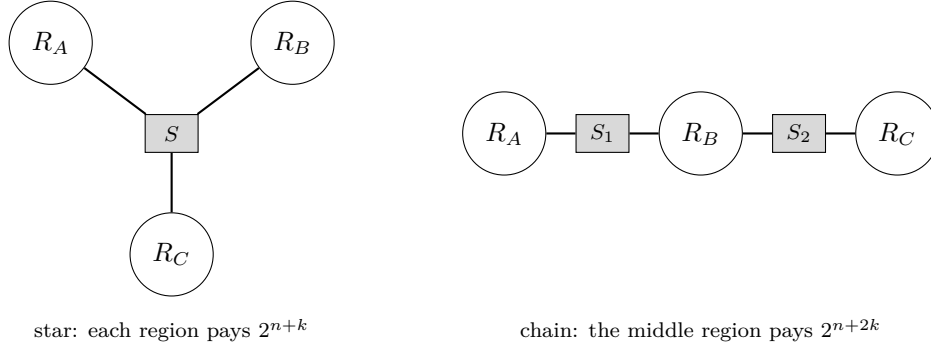


Figure 5.8: Three regions joined at one separator (left) and in a chain through two (right). In the chain the middle region’s message must be computed jointly over both separators it touches, and its cost is exponential in their total size.

5.8 In practice

Read independence before computing. The Markov graph is free, and Proposition 5.1 answers, without a number, which quantities a proposed sensor can and cannot inform. If every path from the sensor to the quantity of interest crosses a set of variables that are already known, the sensor is wasted.

Remember which paths are open. Two independent inputs of a physical model are correlated only after something downstream of both is observed. A report that lists the sources as independent after the readings are in has misread the graph.

Cut at the ports. A physical cut’s port pairs are the minimal separator; the potentials alone or the flows alone are not. A region summarized on anything less than its ports leaks information, and on anything more wastes it.

Do not trust “flows first”. The nodal form is the right final graph; the cheapest route to it interleaves flows and potentials. Let a fill-reducing heuristic choose the order, and check the width it reports against the network’s own sparsity.

Measure the width of your graph. A minimum-degree ordering gives it in milliseconds. A physical network of any size has a small width; a discretized continuum does not; and a model whose width is unexpectedly large usually contains a closure that reads more variables than the physics requires.

Count the separator, not the state space. For an exact computation the cost is exponential in the separator’s size and linear in the number of regions. Before declaring a problem intractable at 2^{60} states, find the cut, count its ports, and count again.

5.9 What is missing

The chapter has read independence off the graph and counted the cost of elimination without saying what a factor is or how one is integrated out. For the Gaussian model both are matrices, elimination is Gaussian elimination, fill is fill, and the treewidth argument becomes a statement about sparse Cholesky. That is Chapter 6. Chapter 7 asks what elimination means when a factor is not Gaussian, and Chapter 8 organizes elimination by regions and ports, as §5.4 promised.

Notes and further reading

Markov properties of undirected graphs, the global Markov property that Proposition 5.1 states, the positivity condition and the Hammersley–Clifford theorem that supplies the converse are treated in Lauritzen [56] and Koller and Friedman [50]; the theorem’s first published proof is Besag’s [8]. Explaining away, colliders and the d-separation rule that §5.3 paraphrases are Pearl’s [80]. Proposition 5.2 is the book’s specialization of those rules to a physical graph whose input-output structure is supplied by the physics rather than by declared arrows.

Vertex elimination, fill, and the correspondence between elimination orders and chordal completions are due to Rose, Tarjan and Lueker [87]; that minimizing fill is NP-complete is Yannakakis’s result [111], and that deciding treewidth is NP-complete is Arnborg, Corneil and Proskurowski’s [3]. Elimination as the basis of exact inference on graphical models, and the junction tree that Chapter 8 uses, are from Lauritzen and Spiegelhalter [57]. Nested dissection, the strategy of §5.5’s last paragraph, is George’s [27]; the separator theorems that bound treewidth for planar and finite-element graphs are Lipton and Tarjan’s [60] and Miller, Teng, Thurston and Vavasis’s [70]. Davis [17] is the reference for all of this from the sparse-matrix side.

Proposition 5.3 is the book’s. Its two halves are inherited: the port as a conjugate flow-potential pair is the bond-graph notion [43, 79, 104], and separation as sufficiency is the graphical-model notion. Their combination, that the physical port is the minimal probabilistic separator of the physics, is the construction on which Part III and Part V rest. The three-region count of §5.7 is the standard argument for the sum-product algorithm [54]; the caveat about samplers is the book’s, and Chapter 10 is its development.

Proposition 5.3 has a concrete consequence in water networks. Han, Eguchi, Mehrotra and Venkatasubramanian [36] partition a network at its articulation junctions and estimate the biconnected components separately. An articulation junction’s head is a separator of the network graph, but by itself it is not a separator of the factor graph: the balance factor at that junction contains the flows of every incident pipe, so the two sides stay coupled through the flow of the bridge until that flow joins the head in the separator, which is the head-flow port of §5.4. On EPANET’s Net3 example, eliminating the 31 articulation heads alone leaves one connected interior block; eliminating the 31 heads and the 32 bridge flows splits it into 18. The elimination orderings and fill heuristics of §5.5 are used in the same way, and with the same sparse-matrix vocabulary, by Dellaert and Kaess [19], whose Bayes tree is the junction tree of an elimination order read as a directed structure.

Summary

- A factorization creates global dependence and conditional independence together. Fixing a separator blocks every path.

- Separation in the Markov graph implies conditional independence, for any factors. Hard physics breaks the converse; soft physics restores it.
- Independent inputs stay independent while nothing downstream is observed and become dependent once a shared consequence is. The undirected graph over-connects; the physics' input-output structure decides.
- The port pairs of a physical cut, one flow and one potential per cut edge, are a separator: the probabilistic form of exactness at a cut.
- Elimination fills the neighbors of the eliminated variable. Cost is set by the largest factor created, hence by treewidth, hence by the factorization and the order. Nodal form is the right result; an interleaved order is the cheap route to it: on the six-bus distribution, width four and three fill edges against width six and fourteen for flows-first.
- A grid's width grows as $\sqrt{n}$; a physical network's is set by its ports. The coolant loop's two domains are separated by its six mass flows.
- Three regions of twenty binary variables joined at a five-variable separator cost a few times 10^7 operations to marginalize exactly, not 10^{18} . The exponent is the separator, not the state count.

Exercises

Exercise 5.1. Draw the Markov graph of the soft chain of Figure 3.1 with all six variables and the sensor on T_2 . Find the smallest separator between G and T_a , and the smallest between k and T_a . Verify by Proposition 5.1 that $G \perp T_a \mid \{Q_{12}, Q_{2a}\}$, and explain physically why knowing both flows makes the source and the inlet temperature irrelevant to each other.

Exercise 5.2. Prove the first half of Proposition 5.2: for $\mathbf{F} = \mathbf{A}\mathbf{x} + \mathbf{B}\mathbf{u}$ with $\mathbf{A}$ square and invertible, show $\int \exp(-\|\mathbf{A}\mathbf{x} + \mathbf{B}\mathbf{u}\|^2/2\sigma^2) d\mathbf{x}$ does not depend on $\mathbf{u}$. Then give an example of a nonlinear physics for which it does, and say what that means for the prior predictive of the inputs.

Exercise 5.3. For the DC triangle in row-per-factor form (Figure 2.3), find an elimination order of width two and prove no order of width one exists. Then show that eliminating the three flows first produces the nodal form of Figure 2.5, and find the order among the flows that creates no fill and the one that creates the most.

Exercise 5.4. A ring of n buses, each connected to its two neighbors, has treewidth two. Give an elimination order that achieves it and the fill it creates. Now cut the ring at two opposite buses into two chains and eliminate each chain onto its ports. What is the largest factor created, and how does it compare with eliminating the ring in the naive order around it?

Exercise 5.5. Repeat the count of §5.7 for regions of n binary variables each joined at a separator of k , and for regions joined in a chain $A - S_1 - B - S_2 - C$ rather than at a single separator. Which arrangement is cheaper, and by what factor, when $k = 5$ and $n = 20$?

Solutions to selected exercises

Exercise 5.3. An order of width two: $F_{12}, F_{13}, F_{23}, \theta_2, \theta_3$. Eliminating F_{12} joins its neighbors θ_2 (from c_{12}) and F_{23} (from b_2); they were not adjacent, so one fill edge appears and the front had two variables. Eliminating F_{13} likewise joins θ_3 to F_{23} , a second fill edge, front of two.

Eliminating F_{23} now has neighbors θ_2 and θ_3 , already adjacent through c_{23} : front of two, no fill. The two angles remain, joined, and the order's width is two. No order of width one exists because the Markov graph contains the triangle $\theta_2, \theta_3, F_{23}$: whichever of its three vertices is eliminated first has the other two as neighbors, a front of at least two. Among flows-first orders the script finds widths two, three and four: eliminating F_{23} first is worst, since its four neighbors $\theta_2, \theta_3, F_{12}, F_{13}$ become a clique with three fill edges and a front of four; eliminating it last, after F_{12} and F_{13} have each been joined to it, is the order above, and its two fill edges are the ones that the nodal form needs and no more. The claim in §5.5 that flows-first creates no lasting fill is right about what survives, the angle-to-angle edges of the network, and silent about the temporary fill among flows, which the order among the flows controls.

Exercise 5.5. With three regions of n binary variables meeting at one separator of k , each message costs $2^n \cdot 2^k$ and the combination 2^k : about $3 \cdot 2^{n+k}$. For $n = 20$, $k = 5$ that is 1.0×10^8 operations. In the chain $A - S_1 - B - S_2 - C$, the end regions send messages on one separator each, 2^{n+k} , but the middle region's message must carry both separators, since B 's factor reads S_1 and S_2 together: $2^n \cdot 2^{2k}$. The total is $2^{n+k} \cdot 2 + 2^{n+2k} + 2^{2k}$, about 1.1×10^9 for the same n and k : the chain costs eleven times more, and the factor is $2^k/3$ in general, because the middle region pays for two separators at once. Both are negligible beside enumeration's $2^{60} = 1.2 \times 10^{18}$. The lesson for a partition is that what a region pays for is the total size of the separators it touches, so a region in the middle of a chain is charged twice, and a star of regions around one separator is cheaper than a chain of the same regions.

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

The cut between two halls *separators and the Markov graph; a physical cut gives a separator; the port pair is the cut path's flow and the potential on its far side*
`foundation_hvac/thermal_local_to_global/problems/the_cut_between_two_halls`

Chapter 6

The linear-Gaussian case

Everything so far has been about structure: which variables share a factor, which are independent given which, what elimination costs. This chapter is about numbers. When every row is linear and every factor is Gaussian, the posterior is Gaussian, and a Gaussian is two objects: a matrix and a vector. The factor graph becomes the sparsity pattern of the matrix. Elimination becomes Gaussian elimination. Fill becomes fill. The most probable state is the solution of one sparse linear system, and the uncertainty of every variable is read from the same factorization that produced it. When a row is mildly nonlinear the same machinery runs a few times instead of once and returns a Gaussian approximation whose quality can be measured. The chapter ends with the processor heat path in matrix form, the fill of three elimination orders counted, and a nonlinear closure checked against exact quadrature.

6.1 The Gaussian in information form

A Gaussian density on $\mathbf{z} \in \mathbb{R}^n$ is usually written by its mean and covariance, $\mathcal{N}(\boldsymbol{\mu}, \boldsymbol{\Sigma})$. For a factor graph the other parameterization is the natural one:

$$p(\mathbf{z}) \propto \exp\left(-\frac{1}{2}\mathbf{z}^T \boldsymbol{\Lambda} \mathbf{z} + \boldsymbol{\eta}^T \mathbf{z}\right), \quad \boldsymbol{\Lambda} = \boldsymbol{\Sigma}^{-1}, \quad \boldsymbol{\eta} = \boldsymbol{\Lambda} \boldsymbol{\mu}. \quad (6.1)$$

$\boldsymbol{\Lambda}$ is the *precision* or *information matrix* and $\boldsymbol{\eta}$ the *information vector*. The reason to prefer them is one line: the product of two Gaussians in information form is the Gaussian whose precision is the sum of the precisions and whose information vector is the sum of the information vectors. Multiplying factors is adding matrices.

Every factor of Chapter 3 is a Gaussian in a linear function of $\mathbf{z}$. Write a generic linear row as $r(\mathbf{z}) = \mathbf{h}^T \mathbf{z} - c$ with width σ and weight $w = 1/\sigma^2$. Its factor $\exp(-w r^2/2)$ expands to

$$\exp\left(-\frac{1}{2} w \mathbf{z}^T \mathbf{h} \mathbf{h}^T \mathbf{z} + w c \mathbf{h}^T \mathbf{z}\right) \times \text{const}, \quad (6.2)$$

which is equation (6.1) with $\boldsymbol{\Lambda} = w \mathbf{h} \mathbf{h}^T$ and $\boldsymbol{\eta} = w c \mathbf{h}$: a rank-one matrix on the row's scope and a vector supported there. A prior on z_j is the case $\mathbf{h} = \mathbf{e}_j$, $c = \mu_j$: it adds w_j to one diagonal entry and $w_j \mu_j$ to one component. A sensor on z_o is the same with $c = y$. A physics row is $\mathbf{h}$ equal to the row's gradient.

Sum over all factors. Stack every residual, physics, prior and sensor, into one vector $\mathbf{g}(\mathbf{z})$ of length m_g , let $\mathbf{J}_g = \partial \mathbf{g} / \partial \mathbf{z}$ be its Jacobian and $\boldsymbol{\Omega} = \text{diag}(w)$ its weights. Then

$$\boxed{\boldsymbol{\Lambda} = \mathbf{J}_g^T \boldsymbol{\Omega} \mathbf{J}_g} \quad (6.3)$$

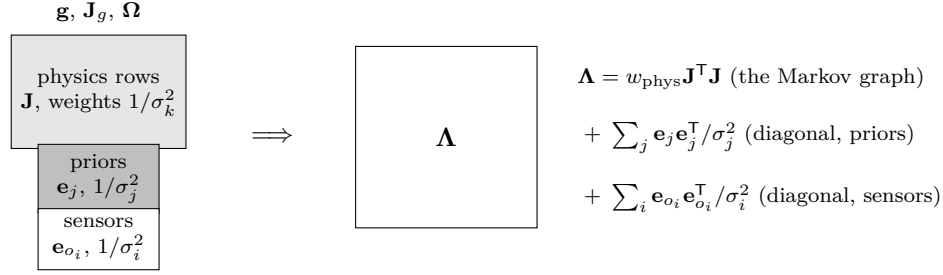


Figure 6.1: Assembling the precision. The three blocks of the stacked residual contribute three terms to Λ : the physics rows give the sparse matrix whose pattern is the Markov graph, and priors and sensors add to the diagonal only. Removing the last two blocks and letting the physics weights grow recovers the deterministic solve (Proposition 6.2).

is the precision of the posterior, and the physics part of it is $w_{\text{phys}} \mathbf{J}^T \mathbf{J}$ with $\mathbf{J}$ the Jacobian of Chapter 1, exactly the matrix that §2.5 said would appear. Figure 6.1 draws the assembly: the stacked residual has a block of physics rows, a block of priors and a block of sensors, and each block adds its own rank- m term to the same matrix.

Proposition 6.1 (Sparsity of the precision). $\Lambda_{ij} \neq 0$ only if some row of $\mathbf{g}$ reads both z_i and z_j . The off-diagonal sparsity pattern of Λ is the Markov graph of the factor graph.

The proof is that $(\mathbf{J}_g^T \Omega \mathbf{J}_g)_{ij} = \sum_k w_k (\mathbf{J}_g)_{ki} (\mathbf{J}_g)_{kj}$, and a term is nonzero only when row k has nonzeros in both columns. Two consequences follow at once. The number of nonzeros of Λ is linear in the size of the model, by the sparsity argument of §1.5. And every structural statement of Chapter 5, separation, fill, treewidth, applies to Λ verbatim, because the Markov graph is Λ 's graph.

6.2 The most probable state

The negative log posterior, equation (3.8), in the stacked notation is

$$C(\mathbf{z}) = \frac{1}{2} \mathbf{g}(\mathbf{z})^T \Omega \mathbf{g}(\mathbf{z}), \quad (6.4)$$

and the most probable state, the *maximum a posteriori* or MAP estimate $\mathbf{z}^*$, minimizes it. When $\mathbf{g}$ is linear, $\mathbf{g}(\mathbf{z}) = \mathbf{J}_g \mathbf{z} - \mathbf{c}$, the minimizer solves the normal equations

$$\Lambda \mathbf{z}^* = \mathbf{J}_g^T \Omega \mathbf{c} = \boldsymbol{\eta}, \quad (6.5)$$

one sparse symmetric positive-definite system. This is weighted least squares, and $\mathbf{z}^*$ is also the posterior mean, since for a Gaussian the mode and the mean coincide.

When some rows are nonlinear, linearize at the current iterate, $\mathbf{g}(\mathbf{z} + \boldsymbol{\delta}) \approx \mathbf{g}(\mathbf{z}) + \mathbf{J}_g(\mathbf{z}) \boldsymbol{\delta}$, and minimize the resulting quadratic:

$$\Lambda(\mathbf{z}) \boldsymbol{\delta} = -\mathbf{J}_g(\mathbf{z})^T \Omega \mathbf{g}(\mathbf{z}), \quad \mathbf{z} \leftarrow \mathbf{z} + t \boldsymbol{\delta}. \quad (6.6)$$

This is the Gauss–Newton iteration. Because Λ is positive definite at a well-posed problem, $\boldsymbol{\delta}$ is a descent direction for C , and a step length $t \leq 1$ chosen by backtracking until C decreases makes the iteration converge from a poor start. Near the solution $t = 1$ and convergence is quadratic when the residuals are small, which for a physical model with tight physics they are.

Proposition 6.2 (Determinism is a corner of inference). *Let the model carry no prior and no sensor, let the physics be square ($m = n$) with $\mathbf{J}$ nonsingular, and let all physics weights be equal. Then the Gauss–Newton step (6.6) is the Newton step for $\mathbf{F}(\mathbf{z}) = \mathbf{0}$, and any stationary point of C with $C = 0$ is a solution of the physics.*

Proof. With no other factors, $\mathbf{g} = \sqrt{w} \mathbf{F}$ and $\mathbf{J}_g = \sqrt{w} \mathbf{J}$. Equation (6.6) reads $w \mathbf{J}^\top \mathbf{J} \boldsymbol{\delta} = -w \mathbf{J}^\top \mathbf{F}$; cancel w and multiply by $\mathbf{J}^{-\top}$ to get $\mathbf{J} \boldsymbol{\delta} = -\mathbf{F}$, which is Newton’s step. And $C = \frac{1}{2} w \|\mathbf{F}\|^2$ vanishes only where $\mathbf{F}$ does. $\square$

The proposition is the precise form of a claim made twice already: the deterministic solve of Chapter 1 and the probabilistic estimate of Chapter 3 are one computation. There is one set of rows, one Jacobian, one iteration. Adding a sensor adds a row; adding a prior adds a row; softening the physics changes a weight. The deterministic model is the corner of the probabilistic one in which the extra rows are absent, and the two can never disagree about the physics because they share it.

6.2.1 Gauss–Newton against Newton

The Gauss–Newton matrix $\mathbf{J}_g^\top \boldsymbol{\Omega} \mathbf{J}_g$ is not the Hessian of C . Differentiating equation (6.4) twice gives

$$\nabla^2 C = \mathbf{J}_g^\top \boldsymbol{\Omega} \mathbf{J}_g + \sum_k w_k g_k(\mathbf{z}) \nabla^2 g_k(\mathbf{z}), \quad (6.7)$$

the Gauss–Newton term plus a sum, over every row, of that row’s residual times its own curvature. The second term vanishes when the rows are linear, since then $\nabla^2 g_k = \mathbf{0}$, and it is small when the residuals at the solution are small, whatever the curvature, which is the case for a physical model whose physics rows are tight and whose sensors are fitted to their accuracies. Dropping it costs nothing in the linear case, keeps the matrix positive definite in every case, since a sum of weighted outer products cannot be indefinite while $\nabla^2 g_k$ can, and makes the iteration a sequence of least-squares solves that never needs a second derivative. What it costs is the rate: with the second term present Newton’s method converges quadratically regardless of the residuals, and without it Gauss–Newton converges quadratically only when they vanish and linearly otherwise, at a rate set by the size of the dropped term relative to the kept one. On the models of this book the residuals at the mode are the physics widths and the sensor accuracies, both small, and the examples of §6.5 and §6.6 show the quadratic tail; a model with a badly fitted sensor, one whose residual at the mode is many accuracies, is the case where the dropped term matters, and it is also the case where Chapter 12 says something is wrong with the model.

A singular $\boldsymbol{\Lambda}$ is not a numerical accident but a statement: some direction in $\mathbf{z}$ is constrained by no physics row, no prior and no sensor, and the posterior is flat along it. The remedy is a prior on a variable in that direction, and the factorization that fails names the variable; §6.6 shows it on the triangle. Chapter 12 treats this as identifiability.

6.3 Elimination is Cholesky

Chapter 5 eliminated a variable by integrating it out and found that the neighbors fill in. For a Gaussian the integral is a formula. Partition $\mathbf{z}$ into a block $\mathbf{x}$ to eliminate and a block $\mathbf{u}$ to keep, and partition $\boldsymbol{\Lambda}$ and $\boldsymbol{\eta}$ accordingly. Then

$$p(\mathbf{u}) \propto \int p(\mathbf{x}, \mathbf{u}) d\mathbf{x} = \mathcal{N}(\cdot; \boldsymbol{\Lambda}_{uu} - \boldsymbol{\Lambda}_{ux} \boldsymbol{\Lambda}_{xx}^{-1} \boldsymbol{\Lambda}_{xu}, \boldsymbol{\eta}_u - \boldsymbol{\Lambda}_{ux} \boldsymbol{\Lambda}_{xx}^{-1} \boldsymbol{\eta}_x) \quad (6.8)$$

in information form. The matrix $\Lambda_{uu} - \Lambda_{ux}\Lambda_{xx}^{-1}\Lambda_{xu}$ is the *Schur complement* of Λ_{xx} . Its sparsity is that of Λ_{uu} plus every pair of kept variables that are both adjacent to the eliminated block, which is the fill of §5.5 written as a matrix.

Proposition 6.3 (Marginalization is the Schur complement). *Equation (6.8) holds: the marginal of a Gaussian in information form over a block of variables is Gaussian with the Schur complement as precision and $\eta_u - \Lambda_{ux}\Lambda_{xx}^{-1}\eta_x$ as information vector. The Schur complement is positive definite when Λ is.*

Proof. Write the exponent of the joint as $-\frac{1}{2}(\mathbf{x}^\top \Lambda_{xx} \mathbf{x} + 2\mathbf{x}^\top \Lambda_{xu} \mathbf{u} + \mathbf{u}^\top \Lambda_{uu} \mathbf{u}) + \eta_x^\top \mathbf{x} + \eta_u^\top \mathbf{u}$. For fixed $\mathbf{u}$ it is a quadratic in $\mathbf{x}$; complete the square with $\mathbf{m} = \Lambda_{xx}^{-1}(\eta_x - \Lambda_{xu} \mathbf{u})$:

$$-\frac{1}{2}(\mathbf{x} - \mathbf{m})^\top \Lambda_{xx} (\mathbf{x} - \mathbf{m}) + \frac{1}{2}\mathbf{m}^\top \Lambda_{xx} \mathbf{m} - \frac{1}{2}\mathbf{u}^\top \Lambda_{uu} \mathbf{u} + \eta_u^\top \mathbf{u}.$$

Integrating over $\mathbf{x}$ removes the first term and contributes a constant, $\sqrt{(2\pi)^{n_x} / \det \Lambda_{xx}}$, that does not depend on $\mathbf{u}$. Expanding $\frac{1}{2}\mathbf{m}^\top \Lambda_{xx} \mathbf{m} = \frac{1}{2}(\eta_x - \Lambda_{xu} \mathbf{u})^\top \Lambda_{xx}^{-1}(\eta_x - \Lambda_{xu} \mathbf{u})$ and collecting the terms in $\mathbf{u}$ gives the quadratic $-\frac{1}{2}\mathbf{u}^\top (\Lambda_{uu} - \Lambda_{ux}\Lambda_{xx}^{-1}\Lambda_{xu}) \mathbf{u} + (\eta_u - \Lambda_{ux}\Lambda_{xx}^{-1}\eta_x)^\top \mathbf{u}$, which is the claim. For positive definiteness, take any $\mathbf{u} \neq \mathbf{0}$ and set $\mathbf{x} = -\Lambda_{xx}^{-1}\Lambda_{xu} \mathbf{u}$; then $(\mathbf{x}, \mathbf{u})^\top \Lambda (\mathbf{x}, \mathbf{u}) = \mathbf{u}^\top (\Lambda_{uu} - \Lambda_{ux}\Lambda_{xx}^{-1}\Lambda_{xu}) \mathbf{u}$, and the left side is positive because Λ is. $\square$

Eliminating one variable at a time, in some order, is exactly what the Cholesky factorization $\Lambda = \mathbf{L}\mathbf{L}^\top$ does: each step pivots on one diagonal entry and updates the trailing submatrix by the rank-one Schur complement. The nonzeros of $\mathbf{L}$ that are not nonzeros of Λ are the fill edges, the order of elimination is the order of the pivots, and the treewidth of Λ 's graph is what bounds the largest dense block that $\mathbf{L}$ contains. Chapter 5's statements about cost are statements about the size of $\mathbf{L}$.

6.3.1 What the factorization costs

A column-oriented Cholesky factorization that finds c_j nonzeros below the diagonal in column j of $\mathbf{L}$ spends about $c_j(c_j + 3)/2$ multiply-adds on that column: one square root, c_j divisions, and a rank-one update of the $c_j \times c_j$ trailing block that the column touches. The total is a sum over columns of a quadratic in the column counts, and the column counts are the fronts of Chapter 5's elimination. So the cost is set by the order, through the fill it creates, and Table 6.1 counts it on the book's two small models and on square grids, the graph of a conducting plate, where the difference between orders is large enough to see.

On the 1 600-node grid the minimum-degree order factors in 2.9×10^5 multiply-adds, four and a half times fewer than the natural order and more than two thousand times fewer than a dense factorization, and its factor holds 1.7 percent of the entries a dense one would. The ratio to dense grows with the size, since the dense cost grows as n^3 and the sparse one, for a plate, as $n^{3/2}$. The physical networks of Chapter 18, with their smaller elimination widths, do better still. This is the arithmetic behind Principle 5.4.

With $\mathbf{L}$ in hand:

- the MAP is two triangular solves, $\mathbf{L}\mathbf{v} = \boldsymbol{\eta}$ then $\mathbf{L}^\top \mathbf{z}^* = \mathbf{v}$;
- the marginal variance of z_k is $(\Lambda^{-1})_{kk}$, and it is obtained by solving $\Lambda \mathbf{x} = \mathbf{e}_k$ with the same two triangular solves and reading x_k , never by forming Λ^{-1} , which is dense. This is *selected inversion*, and it costs one solve per variable asked about;

Table 6.1: Nonzeros of the Cholesky factor and multiply-adds of the factorization, for the chain and the triangle under the orders of this chapter and for square grids of n nodes under the natural (row by row) order and a minimum-degree order, against a dense factorization of the same size.

model	order	nonzeros of $\mathbf{L}$	multiply-adds
chain, 6 variables	inputs first	14	25
	flows first	20	50
triangle, 7 variables	minimum degree	20	42
	flows first	23	55
grid 10×10 , $n = 100$	natural	1 009	5.9×10^3
	minimum degree	656	2.9×10^3
	dense	5 050	1.7×10^5
grid 40×40 , $n = 1\,600$	natural	63 895	1.3×10^6
	minimum degree	21 508	2.9×10^5
	dense	1 280 800	6.8×10^8

- the marginal of any subset $\mathbf{u}$ is the Schur complement (6.8), and when $\mathbf{u}$ is the set of ports of a region, that Schur complement is the region summarized to its neighbors. Chapter 8 is about that.

Two of the three items deserve their own statements, because later chapters lean on them.

Proposition 6.4 (Selected inversion and sampling). *Let $\mathbf{\Lambda} = \mathbf{L}\mathbf{L}^\top$. Then the marginal variance of z_k is $\|\mathbf{L}^{-1}\mathbf{e}_k\|^2$, obtained by one forward triangular solve; and if $\boldsymbol{\xi}$ is a vector of independent standard normals, then $\mathbf{z} = \boldsymbol{\mu} + \mathbf{L}^{-\top}\boldsymbol{\xi}$ is a sample from $\mathcal{N}(\boldsymbol{\mu}, \mathbf{\Lambda}^{-1})$, obtained by one backward triangular solve.*

Proof. $(\mathbf{\Lambda}^{-1})_{kk} = \mathbf{e}_k^\top (\mathbf{L}\mathbf{L}^\top)^{-1} \mathbf{e}_k = (\mathbf{L}^{-1}\mathbf{e}_k)^\top (\mathbf{L}^{-1}\mathbf{e}_k)$, the squared norm of the solution of $\mathbf{L}\mathbf{v} = \mathbf{e}_k$. For the sample, $\mathbf{z} - \boldsymbol{\mu} = \mathbf{L}^{-\top}\boldsymbol{\xi}$ is Gaussian with mean zero and covariance $\mathbf{L}^{-\top}\mathbf{I}\mathbf{L}^{-1} = (\mathbf{L}\mathbf{L}^\top)^{-1} = \mathbf{\Lambda}^{-1}$. $\square$

Both cost a triangular solve, which for a sparse factor is linear in the factor's nonzeros. So every marginal variance of a model with a million variables costs a million sparse solves, which is affordable, and a posterior sample costs one, which is how Chapter 10 draws samples from a Gaussian region without ever forming a covariance.

Proposition 6.5 (Conditioning is the other Schur complement). *In information form, conditioning on the block $\mathbf{x} = \mathbf{x}_0$ leaves $\mathbf{u}$ Gaussian with precision $\mathbf{\Lambda}_{uu}$, unchanged, and information vector $\boldsymbol{\eta}_u - \mathbf{\Lambda}_{ux}\mathbf{x}_0$.*

Proof. Fix $\mathbf{x} = \mathbf{x}_0$ in the exponent of equation (6.1) and keep the terms in $\mathbf{u}$: $-\frac{1}{2}\mathbf{u}^\top \mathbf{\Lambda}_{uu}\mathbf{u} + (\boldsymbol{\eta}_u - \mathbf{\Lambda}_{ux}\mathbf{x}_0)^\top \mathbf{u}$ plus a constant. $\square$

Marginalizing and conditioning are thus the two halves of one block elimination. Marginalizing $\mathbf{x}$ changes the precision on $\mathbf{u}$ by the Schur complement and needs a solve; conditioning on $\mathbf{x}$ leaves the precision alone and needs only a product. The asymmetry is the information form's whole convenience: the questions that Part IV asks most, “given these readings” and “given this intervention”, are conditionings, and they are cheap.

Principle 6.1. *For a linear-Gaussian model the whole of inference is one sparse factorization. The mode, every marginal variance, every conditional and every region summary are solves against it.*

6.4 The Laplace posterior

When some rows are nonlinear the posterior is not Gaussian, and its exact marginals are integrals with no closed form. But the Gauss–Newton iteration (6.6) still converges to the mode $\mathbf{z}^*$, and the matrix assembled to take the last step, $\mathbf{\Lambda}(\mathbf{z}^*) = \mathbf{J}_g(\mathbf{z}^*)^\top \mathbf{\Omega} \mathbf{J}_g(\mathbf{z}^*)$, is the curvature of C at the mode. The *Laplace approximation* replaces the posterior by the Gaussian with that mode and that curvature,

$$p(\mathbf{z} \mid \mathbf{y}) \approx \mathcal{N}(\mathbf{z}^*, \mathbf{\Lambda}(\mathbf{z}^*)^{-1}). \quad (6.9)$$

It is exact when every row is linear, since then $\mathbf{\Lambda}$ does not depend on $\mathbf{z}$ and the posterior is the Gaussian it describes. Otherwise it is the second-order expansion of $\log p$ about its maximum, and it is accurate when the posterior is concentrated enough that the rows are nearly linear across its width. A closure that curves by a small fraction of its slope over one posterior standard deviation is nearly linear in that sense; a closure that saturates or switches regime inside the posterior’s width is not, and Chapter 7 is about those.

The Laplace posterior costs nothing beyond the MAP: the matrix is already assembled. What it does not provide is a guarantee, and Chapter 12 supplies tests that probe its validity from the model itself. The worked example below supplies the simplest test, comparison with exact quadrature, in the one case where quadrature is affordable.

6.5 Worked example: the chain in matrix form

Take the soft processor heat path of Chapter 4 with both sensors: six unknowns, four physics rows at width 0.01 watts, two priors, two sensors, eight rows of $\mathbf{g}$ in all. Every number here is from the script `ch06_gaussian_chain.py` in the book’s `scripts` directory.

The Jacobian and the precision. Table 6.2 shows which variables each row of $\mathbf{g}$ reads. Form $\mathbf{\Lambda} = \mathbf{J}_g^\top \mathbf{\Omega} \mathbf{J}_g$ and mark its nonzeros:

$$\mathbf{\Lambda} \sim \begin{pmatrix} \bullet & \bullet & \bullet & \bullet & \bullet & \cdot \\ \bullet & \bullet & \cdot & \bullet & \cdot & \bullet \\ \bullet & \cdot & \bullet & \bullet & \cdot & \cdot \\ \bullet & \bullet & \bullet & \bullet & \cdot & \bullet \\ \bullet & \cdot & \cdot & \cdot & \bullet & \cdot \\ \cdot & \bullet & \cdot & \bullet & \cdot & \bullet \end{pmatrix} \quad (Q_{12}, Q_{2a}, T_1, T_2, G, T_a). \quad (6.10)$$

The off-diagonal nonzeros are the eight edges $T_1 T_2$, $T_1 Q_{12}$, $T_2 Q_{12}$, $T_2 Q_{2a}$, $T_2 T_a$, $Q_{12} Q_{2a}$, $Q_{12} G$, $Q_{2a} T_a$, which is the Markov graph of Figure 3.1 read off Table 6.2: two variables are adjacent when some row has a mark in both columns. Proposition 6.1, by inspection.

Table 6.2: Rows of the stacked residual $\mathbf{g}$ for the chain with two sensors, and the variables each reads. The pattern of $\mathbf{J}_g$.

Row	Residual	Q_{12}	Q_{2a}	T_1	T_2	G	T_a
b_1	$Q_{12} - G$	•				•	
b_2	$Q_{2a} - Q_{12}$	•	•				
c_{12}	$Q_{12} - k(T_1 - T_2)$	•		•	•		
c_{2a}	$Q_{2a} - hA(T_2 - T_a)$		•		•		•
π_G	$G - 100$					•	
π_{T_a}	$T_a - 20$						•
ℓ_2	$T_2 - 72.0$				•		
ℓ_1	$T_1 - 93.0$			•			

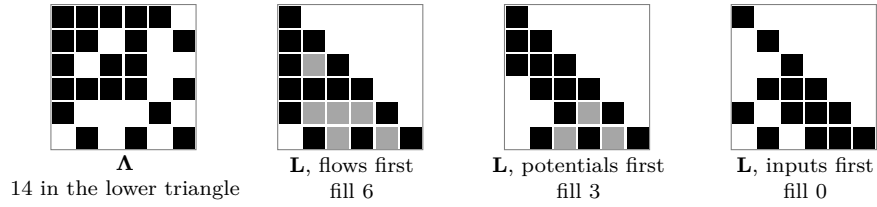


Figure 6.2: The chain’s precision $\mathbf{A}$ and its Cholesky factor $\mathbf{L}$ under three orderings, as nonzero patterns. Black entries of $\mathbf{L}$ are nonzeros of the lower triangle of the permuted $\mathbf{A}$; grey entries are fill. Inputs first has none; potentials first has three; flows first, the order in which the unknowns are listed, has six.

The MAP and the marginals. One solve of equation (6.5) gives the MAP: $Q_{12} = Q_{2a} = 104.63$, $T_1 = 92.97$, $T_2 = 72.04$, $G = 104.63$, $T_a = 19.73$. The two flows and the source agree to every digit because the physics rows are tight. The marginal standard deviations, by selected inversion against the Cholesky factor, are 2.86, 2.86, 0.47, 0.44, 2.86, 1.73 in the same order, and they agree with the diagonal of the dense inverse to four decimals, as they must. The Schur complement of $\mathbf{A}$ onto the two inputs (G, T_a) gives standard deviations 2.86 and 1.73 with correlation -0.979 , which is the third column of Table 3.2. Chapter 3’s hand calculation on the manifold and this chapter’s sparse factorization of the soft model are, as Proposition 4.1 said, the same answer.

Fill under three orderings. The lower triangle of $\mathbf{A}$ has 14 nonzeros. Factor it in three orders and count the nonzeros of $\mathbf{L}$:

Elimination order	nonzeros of $\mathbf{L}$	fill
$Q_{12}, Q_{2a}, T_1, T_2, G, T_a$ (flows first, as listed)	20	6
$T_1, T_2, Q_{12}, Q_{2a}, G, T_a$ (potentials first)	17	3
$G, T_a, T_1, T_2, Q_{12}, Q_{2a}$ (inputs first)	14	0

Figure 6.2 draws the three factors. Inputs first creates no fill at all: G has one neighbor, T_a has two that are already adjacent, and so on down the list, each variable’s neighbors already a clique when its turn comes. That is a perfect elimination order, and it exists because the Markov

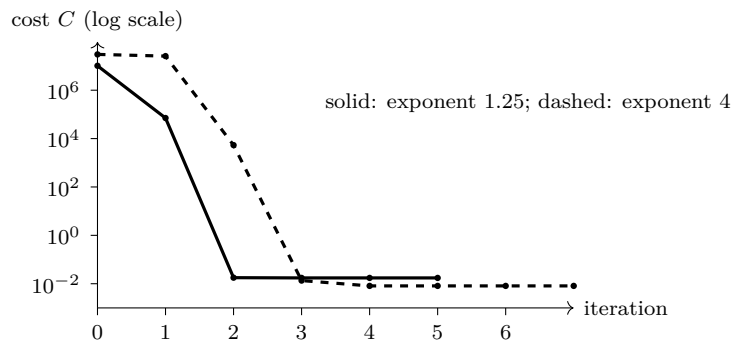


Figure 6.3: Gauss–Newton on the chain with the nonlinear convection closure, from the cold start, one sensor: the cost at each iteration on a logarithmic scale, for the exponent 1.25 of the text (solid) and for exponent 4 (dashed). The first step removes seven orders of magnitude; the convergence is quadratic once the iterate is close.

graph of the chain is chordal. Flows first is the worst of the three: Q_{12} has four neighbors, T_1 , T_2 , Q_{2a} , G , of which only some pairs are adjacent, and eliminating it fills the rest. The fill is temporary in the sense of §5.5, since after every flow is gone the graph on the potentials is the network’s, but $\mathbf{L}$ remembers it.

Flows first is also the order in which this book lists the unknowns, from Chapter 1 on, and there is no contradiction in that. The order in which variables are listed is for reading a model: the flows, then the potentials they connect, then the inputs. The order in which they are eliminated is for computing with it, and a sparse solver chooses that order separately, from the graph, before it does any arithmetic. On six variables none of this matters. On a million it decides whether the factorization fits in memory, and it is why a sparse solver spends effort choosing the order before it spends any on arithmetic.

A nonlinear closure. Replace the heat sink’s convection closure by natural convection, $Q_{2a} = C(T_2 - T_a)^{1.25}$, with C chosen so that the two closures agree at the nominal operating point (104 watts at 52 degrees). The row is now nonlinear in T_2 and T_a . Start Gauss–Newton from a deliberately poor guess, flows of 80, $T_1 = 60$, $T_2 = 50$, inputs at their prior means. With one sensor the cost falls from 1.0×10^7 to 7.1×10^4 to 0.018 in three iterations, with full steps throughout, and the step length is below 10^{-9} by the fifth. With two sensors it is the same story, one half-step near the end. Convergence is quadratic once the iterate is close, as the theory said. Figure 6.3 plots the cost per iteration for this closure and for a much harsher one, exponent 4, which takes seven iterations from the same start; the second script, `ch06_triangle_gaussian.py`, produces the figures of this section and the electrical example that follows.

Table 6.3 compares the Laplace posterior at the mode with the exact posterior, computed by quadrature on an 801×801 grid over the two inputs in the input-space form of Chapter 4. With one sensor the Laplace mean of G is 0.12 watts below the exact mean, and the standard deviations agree to two decimals; the exact posterior is very slightly skewed, its mode sitting at the Laplace mean and its mean a little above. With two sensors the two agree to every digit shown. This is what a mildly nonlinear closure looks like: the row curves, but not enough across three watts of posterior width to matter.

Table 6.3: Natural-convection closure: Laplace posterior at the Gauss–Newton mode against exact quadrature over (G, T_a) .

Sensors		G [W]	T_a [°C]
y_2 only	Laplace	103.50 ± 7.10	20.20 ± 2.81
	exact	103.62 ± 7.09	20.17 ± 2.81
y_2, y_1	Laplace	104.69 ± 3.02	19.76 ± 1.53
	exact	104.69 ± 3.02	19.76 ± 1.53

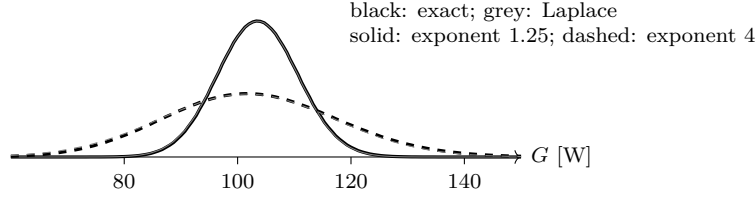


Figure 6.4: The marginal posterior density of the source with one sensor, exact by quadrature (black) and Laplace (grey), for the natural-convection exponent 1.25 (solid) and for exponent 4 (dashed). At 1.25 the two are indistinguishable; at 4 the exact density is visibly skewed and its mean sits one watt above the Laplace mode, while the spreads still agree to one percent.

Figure 6.4 draws the two densities, and adds the case of exponent 4: the Laplace spread is still within one percent of the exact one, 15.3 against 15.2 watts, but the exact density is skewed and its mean is a watt above the mode. The spread of a posterior is the first thing Laplace gets right and the skew the first thing it misses; Chapter 12 gives a probe that detects the skew from the model itself.

One number in the table deserves a physical reading. With one sensor the source’s spread is 7.1 watts here against 5.8 in the linear model. The nonlinear closure has a smaller slope at the operating point: with $Q \propto \Delta T^{1.25}$, a watt of source moves T_2 by $\Delta T/(1.25 G) \approx 0.4$ degrees rather than 0.5. The sensor’s lever arm on the source is shorter, so the same reading constrains it less. The Laplace posterior reports that correctly because $\mathbf{\Lambda}$ at the mode carries the local slope.

6.6 Second worked example: the triangle in matrix form

The DC triangle with uncertain loads and one flow meter, the model of §3.5, in the same matrix form: seven unknowns, the two angles, three flows and two loads; eight rows of $\mathbf{g}$, five physics rows at width 0.001 per unit, two load priors and the meter. Table 6.4 gives the pattern of $\mathbf{J}_g$. The precision has eleven off-diagonal nonzeros, the eleven edges of the Markov graph: the seven of Figure 2.6 plus the four that the balances draw between the loads and the flows they balance. One solve gives the MAP, $P_2 = -1.421$, $P_3 = -0.460$, $F_{12} = 1.101$, $F_{13} = 0.780$, $F_{23} = -0.320$, which is the second column of Table 3.3, and selected inversion against the Cholesky factor gives the spreads 0.136, 0.269, 0.020, 0.135, 0.134, agreeing with the dense inverse to 10^{-12} . The condition number is 3.8×10^7 , the value the sweep of Chapter 4 found at this width.

Fill. The lower triangle of $\mathbf{\Lambda}$ has 18 nonzeros. Angles first gives a factor with 22, four fill entries; flows first 23, five; the loads first, then the angles, then the flows, 20, two, which is what

Table 6.4: Rows of $\mathbf{g}$ for the DC triangle with uncertain loads and a meter on line 1–2, and the variables each reads. The pattern of $\mathbf{J}_g$.

Row	Residual	θ_2	θ_3	F_{12}	F_{13}	F_{23}	P_2	P_3
b_2	$F_{12} - F_{23} + P_2$			•		•	•	
b_3	$F_{13} + F_{23} + P_3$				•	•		•
c_{12}	$F_{12} + B\theta_2$	•		•				
c_{13}	$F_{13} + B\theta_3$		•		•			
c_{23}	$F_{23} - B(\theta_2 - \theta_3)$	•	•			•		
π_{P_2}	$P_2 + 1.5$						•	
π_{P_3}	$P_3 + 0.5$							•
ℓ_{12}	$F_{12} - 1.10$			•				

Table 6.5: Observability of the triangle’s loads: the ratio of the smallest to the largest eigenvalue of the precision, and the posterior of the loads, with and without load priors, for one and two meters.

priors and meters	eigenvalue ratio	P_2	P_3
no priors; F_{12}	8.7×10^{-19}	unobservable	unobservable
no priors; F_{12}, F_{13}	6.9×10^{-7}	-1.260 ± 0.045	-0.780 ± 0.045
no priors; F_{12}, F_{23}	1.0×10^{-6}	-1.270 ± 0.028	-0.760 ± 0.045
load priors; F_{12}	2.6×10^{-8}	-1.421 ± 0.136	-0.460 ± 0.269

the minimum-degree heuristic also finds. The loads are the leaves of this graph, each read by one balance and its prior, and eliminating leaves first never fills; the angles then have two or three neighbors that are nearly cliques already. Flows first is again not the cheapest route, for the reason Chapter 5 counted: a flow’s neighbors are the potentials at its ends and the other flows at both its buses, and they are not adjacent to one another until the flow joins them.

Observability. Remove the load priors and keep the one meter. The precision is then singular: its smallest eigenvalue is 10^{-18} of its largest, and the eigenvector belonging to it is the direction $\Delta P_2 = -0.5$, $\Delta P_3 = 1$, with the flows on lines 1–3 and 2–3 each moving by -0.5 and F_{12} not at all. That is the shift of load from bus 2 to bus 3 that leaves the metered flow unchanged, since $F_{12} = -(2P_2 + P_3)/3$; the meter cannot see it, no prior pins it, and the posterior is flat along it. The factorization fails, and the vector that makes it fail names the unobservable combination. Table 6.5 lists the cures. A second meter on line 1–3 or on line 2–3 reads a different combination of the loads and restores a condition number near 10^6 , with the loads known to 0.03 to 0.05 per unit from the meters alone; the load priors restore it too, at the price of a condition number of 4×10^7 and of loads known only to 0.14 and 0.27, because a prior pins the unseen direction with its own width and no more. Observability in the power engineer’s sense is the nonsingularity of this matrix with the priors removed.

Sampling from the factor. Proposition 6.4 turns the Cholesky factor into a sampler: 20 000 draws of $\boldsymbol{\mu} + \mathbf{L}^{-\top} \boldsymbol{\xi}$, one backward solve each, have sample spreads 0.137 and 0.270 for the loads against the exact 0.136 and 0.269, and a sample correlation of -0.976 , the exact value. Figure 6.5 draws four hundred of them with the exact ellipses. The samples answer questions that the mean and covariance answer only with more algebra, and any question, including a nonlinear one: the

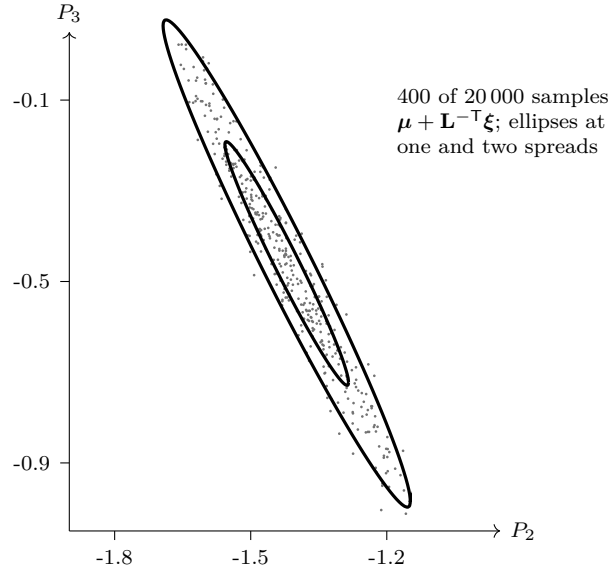


Figure 6.5: Four hundred posterior samples of the triangle’s two loads, drawn from the Cholesky factor of the precision, with the exact one- and two-standard-deviation ellipses. The samples fill the ellipses in the proportions a Gaussian gives, because a triangular solve against the factor turns independent standard normals into draws with exactly the posterior covariance.

probability that the boundary flow exceeds 2.1 per unit is 0.0570 from the samples and 0.0574 exactly, and the probability that line 2–3 carries more than half a per unit toward bus 2 is 0.089. Chapter 10 uses exactly this sampler inside a region.

A nonlinear line closure. Replace the DC closure by the angle form of the power flow, $F = B \sin(\theta_i - \theta_j)$, and load the network heavily, with $B = 2.5$ so that the angles are large enough for the sine to matter. Gauss–Newton from a flat start, angles zero and loads at their priors, reduces the cost from 1.3×10^6 to 700 to 0.04 in three iterations, full steps throughout, and converges by the fifth. The mode has $\theta_2 = -0.456$ radians, where $\sin \theta_2 = -0.440$, a difference of four percent between the DC and the AC closures at this loading. The Laplace posterior of the loads is $P_2 = -1.431 \pm 0.139$ and $P_3 = -0.464 \pm 0.267$; the exact posterior, by quadrature over the two loads with the hard sine physics solved by Newton’s method at each grid point, is -1.430 ± 0.138 and -0.463 ± 0.266 . The linear model at the same susceptance gives -1.421 ± 0.136 and -0.460 ± 0.269 . Four percent of nonlinearity in the closure moves the loads’ posterior by a hundredth of a per unit and their spreads by two percent, and the Laplace posterior tracks the exact one to the same precision.

6.7 Filters, fields, and state estimators

Three things the reader may already know are this chapter under other names.

The *Kalman filter* is the case in which the variables are the state of a system at successive times, the physics rows are the transition from each time to the next, and the sensors read each time’s state. The precision $\mathbf{A}$ is block-tridiagonal in time. Eliminating the blocks forward in

time is the filter’s prediction and update; eliminating backward is the smoother. Chapter 16 unrolls the graph and says so at length.

A *Gaussian Markov random field* is a Gaussian whose precision is sparse, with the sparsity read as a graph. That is equation (6.3) with Proposition 6.1. The literature on such fields is the literature on this chapter’s objects.

Power-system state estimation is this chapter with the AC power flow equations as the physics rows, the bus voltages and angles as the unknowns, meters as the sensors, and, in its classical form, no priors and hard physics. The weighted least-squares iteration it uses is equation (6.6), and its bad-data detection is the objective test that §4.5 previewed and Chapter 12 develops. The framework of this book adds soft physics, priors on the inputs, and the multi-domain graph; the linear algebra is the same.

6.8 In practice

Assemble in information form and never invert. Build $\mathbf{A}$ by adding one rank-one term per factor, factor it once, and answer every question by a solve against the factor: the mode, the variance of any variable by selected inversion, the summary of any region by a Schur complement. A dense inverse of a sparse precision is dense, and forming it is the commonest way to turn a fast model into a slow one.

Let the solver choose the order. A fill-reducing ordering found by a minimum-degree or nested-dissection heuristic is nearly always better than any order a modeler writes by hand, and the chapter’s counts show why: on the chain, inputs first has no fill and flows first has six; on the triangle, the heuristic finds the least. The exception is when the order is chosen for reuse, region interiors before ports, which Chapter 8 explains.

Scale the rows. A precision assembled from rows in mixed units, watts and kelvins and per-unit, has a condition number set by the ratio of the largest weight to the smallest, and the tight physics rows dominate. Equilibrate the rows as Chapter 4 described, and check the condition number after assembly; a value near 10^{10} means the physics widths are too tight for the arithmetic.

Start Gauss–Newton from the physics. A cold start converges in the examples of this chapter, but a start from the deterministic solve at the prior means costs one solve and removes the backtracking. Watch the step length: a run of half-steps means the linearization is poor across the current iterate’s neighborhood, and the Laplace posterior at the end deserves the checks of Chapter 12.

Report the Laplace posterior with its slope. The posterior spread of an input under a nonlinear closure is set by the closure’s slope at the mode, as the natural-convection example showed. When the spread differs from a linear model’s, the difference should be explained by that slope, and if it cannot be, the mode or the linearization is suspect.

Test Laplace where you can. On any model with two or three uncertain inputs, quadrature over the inputs in input-space form is cheap and exact. Run it once on a representative case

before trusting the Laplace posterior on the full model; the exponents 1.25 and 4 of Figure 6.4 show what a mild and a severe nonlinearity look like.

6.9 What is missing

The chapter assumed every variable continuous and every row at worst mildly nonlinear. A discrete availability, a closure that switches regime, a bounded parameter, or a strongly curved law breaks one of the two, and Chapter 7 says which of the machinery survives each. And it took the elimination order as given; organizing it by physical regions and ports, so that each region's Schur complement is computed once and reused, is Chapter 8.

Notes and further reading

A Gaussian with a sparse precision matrix whose pattern is read as a graph is a Gaussian Markov random field, and Rue and Held [88] develop everything in §6.1 and §6.3, including the information form, the Schur complement as marginalization, and the use of a sparse Cholesky factor for sampling and for marginal variances. Selected inversion, computing chosen entries of the inverse from the factor without forming the inverse, is Erisman and Tinney's [23], and it was invented for power networks. Sparse Cholesky, fill-reducing orderings and their graph theory are in Davis [17] and Duff, Erisman and Reid [21]; the first fill-reducing ordering for network equations is Tinney and Walker's [102].

Gauss–Newton with backtracking for nonlinear least squares, its descent property, and its quadratic convergence under small residuals are in Nocedal and Wright [75]. The Laplace approximation is classical; MacKay [64] and Bishop [10] present it in the form used here, as the Gaussian at the mode with the Hessian's curvature, and discuss when it is trusted. Proposition 6.2 is the book's statement of a fact that every implementation of weighted least squares over physics residuals relies on implicitly.

The three instances of §6.7 have their own literatures. The Kalman filter is Kalman's [42]; Särkkä and Svensson [91] give the modern treatment, including the view of filtering and smoothing as Gaussian inference on a chain, which is how Chapter 16 presents it. Power-system state estimation as weighted least squares over the power-flow equations is Schweppe's [92]; Monticelli [73] and Abur and Gómez Expósito [1] cover the Gauss–Newton iteration, sparse factorization, observability (the singular $\mathbf{\Lambda}$ of §6.2) and bad-data detection. Chavali and Nehorai [15] run the same estimation as message passing on a factor graph. Factor graphs for large sparse Gaussian and nearly-Gaussian estimation, with the same emphasis on the elimination order and the Cholesky factor, are the subject of Dellaert and Kaess [19].

Summary

- In information form, multiplying Gaussian factors is adding matrices. Every factor is a rank-one term on its scope; the posterior precision is $\mathbf{\Lambda} = \mathbf{J}_g^T \mathbf{\Omega} \mathbf{J}_g$, and its sparsity is the Markov graph.
- The MAP solves $\mathbf{\Lambda} \mathbf{z}^* = \boldsymbol{\eta}$; for nonlinear rows, Gauss–Newton with backtracking. With no priors and no sensors the step is Newton's step for the physics: determinism is a corner of inference.

- Elimination is Cholesky; fill is fill; the Schur complement is the marginal. Marginal variances come from solves against the factor, never from a dense inverse.
- The Laplace posterior is the Gaussian at the mode with the assembled curvature: exact for linear rows, accurate when rows are nearly linear across the posterior's width.
- On the chain: the precision pattern is the Markov graph by inspection; inputs-first elimination has zero fill, flows-first six; a natural-convection closure converges in three Gauss-Newton steps from a cold start and its Laplace posterior matches quadrature to two decimals, and still to one percent in spread at exponent 4.
- On the triangle: eleven Markov edges, the MAP of Chapter 3 in one solve, selected inversion to 10^{-12} , leaves-first the cheapest order; a sine closure at heavy loading converges in five iterations and its Laplace posterior matches quadrature to a thousandth.

Exercises

Exercise 6.1. Show that the product of $\mathcal{N}(\boldsymbol{\mu}_1, \boldsymbol{\Sigma}_1)$ and $\mathcal{N}(\boldsymbol{\mu}_2, \boldsymbol{\Sigma}_2)$, as functions of $\mathbf{z}$, is proportional to a Gaussian with precision $\boldsymbol{\Sigma}_1^{-1} + \boldsymbol{\Sigma}_2^{-1}$ and information vector $\boldsymbol{\Sigma}_1^{-1}\boldsymbol{\mu}_1 + \boldsymbol{\Sigma}_2^{-1}\boldsymbol{\mu}_2$. Then derive the posterior of the worked example of §3.4 in one line from this rule.

Exercise 6.2. Proposition 6.3 gives the marginal in information form. Show that in covariance form the marginal of $\mathbf{u}$ is simply the block $\boldsymbol{\Sigma}_{uu}$ of the joint covariance, and hence that $(\boldsymbol{\Lambda}_{uu} - \boldsymbol{\Lambda}_{ux}\boldsymbol{\Lambda}_{xx}^{-1}\boldsymbol{\Lambda}_{xu})^{-1} = \boldsymbol{\Sigma}_{uu}$: the Schur complement of the precision is the inverse of a block of the covariance. Which form is cheaper to compute when $\mathbf{u}$ is small and $\mathbf{x}$ is large and sparse?

Exercise 6.3. For the chain's $\boldsymbol{\Lambda}$ in equation (6.10), carry out the inputs-first elimination symbolically, one variable at a time, and verify at each step that the eliminated variable's neighbors are already mutually adjacent. Then do the same for flows first and list the six fill entries.

Exercise 6.4. The DC triangle with uncertain loads (Figure 3.2, $a_{23} = 1$ fixed) and one flow meter is linear-Gaussian. Write its $\mathbf{g}$, its $\mathbf{J}_g$, and its $\boldsymbol{\Lambda}$, and find an elimination order with the least fill. Compare with the nodal form of Figure 2.5.

Exercise 6.5. Replace the natural-convection exponent 1.25 by 2 and by 4 in the script and rerun the Laplace-versus-quadrature comparison with one sensor. The spreads agree to within one percent even at exponent 4; what does change, and why does a single coarse sensor keep Laplace honest where Chapter 12 will find a precise one does not? Relate the answer to the curvature of the closure across the posterior width.

Solutions to selected exercises

Exercise 6.2. In covariance form the joint is $\mathcal{N}(\boldsymbol{\mu}, \boldsymbol{\Sigma})$ and the marginal of a block is obtained by dropping the other coordinates: $\mathbf{u} \sim \mathcal{N}(\boldsymbol{\mu}_u, \boldsymbol{\Sigma}_{uu})$, because a marginal of a Gaussian is Gaussian with the corresponding sub-vector and sub-block. Proposition 6.3 gives the same marginal with precision $\boldsymbol{\Lambda}_{uu} - \boldsymbol{\Lambda}_{ux}\boldsymbol{\Lambda}_{xx}^{-1}\boldsymbol{\Lambda}_{xu}$, so that precision is $\boldsymbol{\Sigma}_{uu}^{-1}$: the Schur complement of the precision is the inverse of the covariance's block, which is the block-inverse identity read as a statement about marginals. When $\mathbf{u}$ is small and $\mathbf{x}$ is large and sparse, the Schur complement is the cheaper route: it needs one sparse factorization of $\boldsymbol{\Lambda}_{xx}$ and $|\mathbf{u}|$ solves against it, whereas $\boldsymbol{\Sigma}_{uu}$ by way of the full covariance needs the dense inverse of $\boldsymbol{\Lambda}$. For a region of a thousand interior variables and

six ports that is six sparse solves against a dense million-entry inverse, and it is why Chapter 8 computes region messages as Schur complements.

Exercise 6.3. Inputs first: eliminate G , whose only neighbor is Q_{12} , trivially a clique; then T_a , whose neighbors T_2 and Q_{2a} are adjacent through c_{2a} ; then T_1 , neighbors T_2 and Q_{12} , adjacent through c_{12} ; then T_2 , neighbors Q_{12} and Q_{2a} , adjacent through b_2 ; then Q_{12} , neighbor Q_{2a} ; then Q_{2a} . At every step the neighbors were already a clique, so no fill: a perfect elimination order, and the factor has the fourteen nonzeros of the lower triangle and no more. Flows first: eliminating Q_{12} , with neighbors T_1, T_2, Q_{2a}, G , fills T_1Q_{2a}, T_1G, T_2G and $Q_{2a}G$; eliminating Q_{2a} , now with neighbors T_1, T_2, G, T_a , fills T_1T_a and GT_a ; the remaining four are then a clique and nothing more fills. Six fill entries, the number the script counts, and every one of them joins a pair that the physics never related directly: a flow's neighbors on both sides of it, tied together only because the flow between them was removed.

Exercise 6.1. As a function of $\mathbf{z}$, the logarithm of $\mathcal{N}(\boldsymbol{\mu}_i, \boldsymbol{\Sigma}_i)$ is $-\frac{1}{2}\mathbf{z}^\top \boldsymbol{\Sigma}_i^{-1} \mathbf{z} + \mathbf{z}^\top \boldsymbol{\Sigma}_i^{-1} \boldsymbol{\mu}_i$ plus a constant. The logarithm of the product is the sum, $-\frac{1}{2}\mathbf{z}^\top (\boldsymbol{\Sigma}_1^{-1} + \boldsymbol{\Sigma}_2^{-1}) \mathbf{z} + \mathbf{z}^\top (\boldsymbol{\Sigma}_1^{-1} \boldsymbol{\mu}_1 + \boldsymbol{\Sigma}_2^{-1} \boldsymbol{\mu}_2)$ plus a constant, which is the logarithm of a Gaussian with precision $\boldsymbol{\Sigma}_1^{-1} + \boldsymbol{\Sigma}_2^{-1}$ and information vector $\boldsymbol{\Sigma}_1^{-1} \boldsymbol{\mu}_1 + \boldsymbol{\Sigma}_2^{-1} \boldsymbol{\mu}_2$: in information form, multiplying Gaussians adds their parameters. For the worked example of §3.4, work in the plane of the two inputs. The prior has precision $\text{diag}(1/400, 1/9)$ and information $(100/400, 20/9)$. The reading $T_2 = 72$ with accuracy 0.5 reads $T_2 = T_a + G/2$, the linear function $\mathbf{h}^\top(G, T_a)$ with $\mathbf{h} = (\frac{1}{2}, 1)$, so it contributes precision $4\mathbf{h}\mathbf{h}^\top$ and information $4 \cdot 72\mathbf{h}$. In one line, the posterior has precision $\begin{pmatrix} 1.0025 & 2 \\ 2 & 4.1111 \end{pmatrix}$ and information $(144.25, 290.22)$, whose solution is $G = 103.7 \pm 5.82$ and $T_a = 20.16 \pm 2.87$, the second column of Table 3.2.

Exercise 6.4. In row form the variables are the two angles, the three flows and the two loads. The rows are the two balances, $F_{12} - F_{23} + P_2$ and $F_{13} + F_{23} + P_3$; the three closures, $F_{12} + B\theta_2$, $F_{13} + B\theta_3$ and $F_{23} - B(\theta_2 - \theta_3)$; the two load priors; and the meter on F_{12} . Each row's variables form a clique of Λ 's pattern: $\{F_{12}, F_{23}, P_2\}$, $\{F_{13}, F_{23}, P_3\}$, $\{F_{12}, \theta_2\}$, $\{F_{13}, \theta_3\}$ and $\{F_{23}, \theta_2, \theta_3\}$, the priors and the meter adding only diagonal entries. Eliminate the loads first: each has two neighbours already joined by its balance row. Then eliminate F_{12} , whose neighbours θ_2 and F_{23} are joined by the closure of line 2–3, and then F_{13} likewise. What remains, θ_2, θ_3 and F_{23} , is one clique. No step creates a fill entry, so the order is perfect, and the largest clique has three variables. In the nodal form of Figure 2.5 the flows are gone. The variables are θ_2, θ_3, P_2 and P_3 ; the balances read $P_2 = B(2\theta_2 - \theta_3)$ and $P_3 = B(2\theta_3 - \theta_2)$, each touching its load and both angles; and the meter reads $F_{12} = -B\theta_2$, touching θ_2 alone. Eliminating the loads first is again perfect, and what remains is the pair of angles. The nodal form has four variables instead of seven and the same largest clique. The row form costs more variables for the same width, and buys a model in which every physical statement is a row that can be loosened or replaced on its own.

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

The band that is not symmetric *the Laplace approximation as a transferred width; a monotone closure transfers an interval exactly; a symmetric band cannot represent a reciprocal map*

`level2_room_hall/when_laplace_lies/problems/the_band_that_is_not_symmetric`

Chapter 7

Beyond Gaussian: hybrid states and nonlinearity

Chapter 6 assumed that every variable is continuous and every row is linear, or nearly so. Real systems break both assumptions, and they break them in a small number of ways: a component is in service or it is not; a device saturates or switches regime; a law curves strongly; a parameter has a bound. This chapter takes the four in turn, says what each does to the posterior, and says which parts of the machinery survive. The short answer is that the graph survives entirely, the Gaussian machinery survives conditionally on the discrete part, and what is lost is the single Gaussian: the posterior becomes a mixture, and the question of how many components it has is the question that Part III is organized around. The chapter's worked example is the smallest possible instance, a feeder that may be out of service, detected from one flow meter.

7.1 Four ways out of the Gaussian world

- A discrete variable.** The availability $a_{23} \in \{0, 1\}$ of Figure 3.2. Its prior is a probability mass, not a density; the closure that reads it is linear in the continuous variables for each fixed value of a_{23} and is not a single linear row across both values.
- A piecewise closure.** A valve that is proportional until it saturates, a limiter, a diode, a breaker: $y = f_b(x)$ with the regime b selected by the state itself. The closure is linear or smooth within each regime and has a kink at the boundary between regimes.
- A strongly nonlinear closure.** Radiation as the fourth power of temperature, AC power flow with its sines and cosines, a pump curve. The row is smooth but curves enough across the posterior's width that the Laplace posterior of §6.4 is in question.
- A bounded parameter.** A conductance or an efficiency that must be positive, an availability that must lie in $[0, 1]$, a load that cannot be negative. A Gaussian prior puts mass where the parameter cannot be.

Nothing in this list changes the factor graph. A discrete variable is a circle; a piecewise closure is a square; a bound is a unary factor of a non-Gaussian shape. The scopes, the Markov graph, the separators and the treewidth are exactly as Chapters 2 and 5 described them. What changes is the arithmetic inside the squares, and therefore what the posterior looks like.

7.2 Hybrid states: the mixture over branches

Take a model with one discrete variable a and continuous variables $\mathbf{z}$. Write the joint as a sum over the values of a :

$$p(\mathbf{z}, a \mid \mathbf{y}) \propto \mathbb{P}(a) p(\mathbf{z} \mid a, \mathbf{y}) Z_a, \quad Z_a = \int p(\mathbf{y}, \mathbf{z} \mid a) d\mathbf{z}. \quad (7.1)$$

For each fixed a the model is one of Chapter 6's: every row is linear in $\mathbf{z}$, so $p(\mathbf{z} \mid a, \mathbf{y})$ is Gaussian with a precision $\mathbf{\Lambda}_a$ and a mode $\mathbf{z}_a^*$ obtained by one sparse solve. Call this the *branch* a . The number Z_a is the *evidence* of the branch: the probability of the readings under it, integrated over everything uncertain. For a linear-Gaussian branch it has a closed form,

$$\log Z_a = -C_a(\mathbf{z}_a^*) - \frac{1}{2} \log \det \mathbf{\Lambda}_a + \text{const}, \quad (7.2)$$

where C_a is the branch's objective (6.4) and the constant collects the factors' normalizers, which are the same for every branch with the same rows and widths. The first term rewards a branch that fits the data and the priors closely; the second penalizes a branch whose posterior is sharply concentrated, since a sharp posterior means the branch predicted a narrow range of readings and was lucky to be right. Together they are the Gaussian form of the trade-off between fit and flexibility.

The log-determinant hides one more term, and it is the one that decides whether branches can be compared at all.

Proposition 7.1 (The evidence of a branch). *Let a branch have inputs $\mathbf{u}$ with prior $p(\mathbf{u})$, solved variables $\mathbf{x}$ determined by m linear physics rows $\mathbf{F}_a(\mathbf{x}, \mathbf{u})$ with square Jacobian $\mathbf{J}_{x,a}$ with respect to $\mathbf{x}$, every physics width σ , and readings $\mathbf{y}$ with likelihood $p(\mathbf{y} \mid \mathbf{x}, \mathbf{u})$. As $\sigma \rightarrow 0$ the evidence Z_a of the branch's soft factors satisfies*

$$\frac{Z_a}{(\sqrt{2\pi}\sigma)^m} \longrightarrow \frac{1}{|\det \mathbf{J}_{x,a}|} \int p(\mathbf{u}) p(\mathbf{y} \mid X_a(\mathbf{u}), \mathbf{u}) d\mathbf{u}. \quad (7.3)$$

The integral is the predictive density of the readings under the branch, and it does not depend on how the physics rows are written. Branches whose physics rows differ must therefore be weighted by $|\det \mathbf{J}_{x,a}| Z_a$, or equivalently by the predictive density; weighting them by Z_a alone weights each by the reciprocal of its own physics determinant.

Proof. Fix $\mathbf{u}$ and integrate the product of the physics factors and the likelihood over $\mathbf{x}$. Substitute $\mathbf{r} = \mathbf{F}_a(\mathbf{x}, \mathbf{u})$; for linear physics $d\mathbf{x} = d\mathbf{r}/|\det \mathbf{J}_{x,a}|$ with a constant Jacobian, and $\mathbf{x} = X_a(\mathbf{u}) + \mathbf{J}_{x,a}^{-1}\mathbf{r}$. The physics factors are $\prod_k \exp(-r_k^2/2\sigma^2)$, whose integral over $\mathbf{r}$ is $(\sqrt{2\pi}\sigma)^m$ and which, divided by that, tends to $\delta(\mathbf{r})$. So the inner integral tends to $(\sqrt{2\pi}\sigma)^m p(\mathbf{y} \mid X_a(\mathbf{u}), \mathbf{u})/|\det \mathbf{J}_{x,a}|$, and integrating over $\mathbf{u}$ against the prior gives the claim. For nonlinear physics $\mathbf{J}_{x,a}$ depends on $\mathbf{u}$ and stays inside the integral, which is Remark 4.1. $\square$

The determinant is not a nuisance constant. Scaling one closure row by a factor, writing $F_{23}/B - (\theta_2 - \theta_3)$ instead of $F_{23} - B(\theta_2 - \theta_3)$, changes $|\det \mathbf{J}_x|$ and hence Z_a by that factor and changes nothing physical; the predictive density is unchanged. And a branch that changes a closure, as an outage does, changes the determinant with it. On the DC triangle the physics determinant with feeder 2–3 in service is three times its value with the feeder out, because the nodal matrices are $B \begin{pmatrix} 2 & -1 \\ -1 & 2 \end{pmatrix}$ and $B \mathbf{I}$, with determinants $3B^2$ and B^2 . The soft-row evidence

understates the in-service branch threefold, and the worked example below shows what that does to an alarm.

The posterior over the discrete variable follows by Bayes' rule,

$$\mathbb{P}(a \mid \mathbf{y}) \propto \mathbb{P}(a) Z_a, \quad (7.4)$$

and the posterior of any continuous variable is the *mixture*

$$p(z_j \mid \mathbf{y}) = \sum_a \mathbb{P}(a \mid \mathbf{y}) \mathcal{N}(z_j; (\mathbf{z}_a^*)_j, (\mathbf{\Lambda}_a^{-1})_{jj}), \quad (7.5)$$

one Gaussian per branch, weighted by the branch's posterior probability. Its mean and variance are those of a mixture: the mean is the weighted mean of the branch means, and the variance is the weighted variance within branches plus the variance of the branch means between them.

Principle 7.1. *A discrete variable splits the model into branches. Within a branch the model is linear-Gaussian and everything in Chapter 6 applies; across branches the posterior is a mixture weighted by prior times evidence. The evidence is one number per branch, and it comes from the same factorization that gives the branch's mode.*

7.2.1 Worked example: a feeder that may be out

Return to the DC triangle of Figure 3.2. The loads are uncertain, $P_2 \sim \mathcal{N}(-1.5, 0.2^2)$ and $P_3 \sim \mathcal{N}(-0.5, 0.2^2)$ per unit, negative for load; the feeder susceptances are $B = 10$; the physics rows have width 0.01; the feeder from bus 2 to bus 3 is out of service with prior probability 0.05; and one meter reads the flow on feeder 1–2 with accuracy 0.02. Every number is from the script `ch07_hybrid_triangle.py` in the book's `scripts` directory.

Before the reading. With the feeder in service the metered flow is $F_{12} = -(2P_2 + P_3)/3$, which under the load priors is 1.167 ± 0.149 ; the loop shares bus 2's load with feeder 1–3 by way of feeder 2–3, which carries -0.333 ± 0.095 . With the feeder out, bus 2 is served by feeder 1–2 alone, $F_{12} = -P_2 = 1.500 \pm 0.200$, and feeder 2–3 carries nothing. Panel (a) of Figure 7.1 draws the prior predictive of the metered flow: the two branch Gaussians, weighted 0.95 and 0.05, and their sum. The outage branch is a small shoulder on the right of the main peak.

After the reading. Table 7.1 sweeps the reading from 1.10 to 1.60. Two things happen at once. Within each branch the posterior is Gaussian and the meter pins the flow to ± 0.02 ; the branch's estimate of P_2 is then whatever load explains that flow under the branch's physics, -1.50 under the outage branch when the reading is 1.50, and -1.89 under the in-service branch, which needs a heavier load at bus 2 to push that much flow down feeder 1–2 when part of it is being shared around the loop. Across branches the posterior probability of the outage rises from 0.006 at a reading of 1.10, where the reading sits on the in-service peak, to 0.31 at 1.50 and 0.68 at 1.60, where it sits on the outage branch's. Panel (b) draws the whole curve; it crosses one half at a reading of 1.55.

The weights come from Proposition 7.1, and the script checks them against the predictive density of the reading computed directly. Had the soft-row evidence been used without the determinant, the in-service branch would have been understated threefold: the outage probability at 1.50 would have been reported as 0.58 instead of 0.31, at 1.60 as 0.87 instead of 0.68, and the crossover placed at 1.48 instead of 1.55. An alarm set at one half would have fired on readings between 1.48 and 1.55, which the correct posterior considers more likely normal than not.

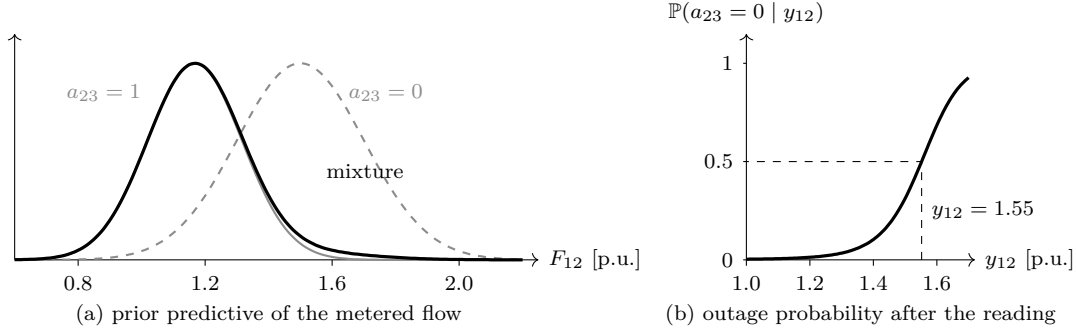


Figure 7.1: Feeder-outage detection from one meter. (a) The prior predictive of the metered flow F_{12} : the in-service branch (solid grey) and the outage branch (dashed grey), each drawn at unit peak so that both are visible, and the weighted mixture (black), scaled to its own peak; in the mixture the outage branch is a shoulder of height about a twentieth of the main peak. (b) The posterior probability that the feeder is out, as a function of the meter reading, with the branch evidence corrected by the physics determinant (Proposition 7.1); it crosses one half at $y_{12} = 1.55$.

Table 7.1: The triangle with an uncertain feeder and one meter: the outage posterior and the per-branch and mixture posteriors of the load at bus 2 as the meter reading is swept.

y_{12}	$\mathbb{P}(a_{23} = 0 y)$	$P_2 a_{23} = 1$	$P_2 a_{23} = 0$	$\mathbb{E}[P_2 y]$	$\text{sd}[P_2 y]$
1.10	0.006	-1.42 ± 0.09	-1.11 ± 0.02	-1.42	0.10
1.17	0.010	-1.50 ± 0.09	-1.18 ± 0.02	-1.50	0.10
1.30	0.034	-1.66 ± 0.09	-1.30 ± 0.02	-1.64	0.11
1.40	0.104	-1.77 ± 0.09	-1.40 ± 0.02	-1.74	0.14
1.50	0.312	-1.89 ± 0.09	-1.50 ± 0.02	-1.77	0.20
1.60	0.685	-2.01 ± 0.09	-1.60 ± 0.02	-1.73	0.20

What a single Gaussian would miss. Look at the last two columns at a reading of 1.50. The mixture’s mean load is -1.77 with a spread of 0.20. No branch believes that. The in-service branch says -1.89 ± 0.09 and the outage branch says -1.50 ± 0.02 ; the mixture mean lies between two modes, in a region of low posterior density, and its spread is mostly the distance between the modes, not uncertainty within either. An operator told “the load is 1.67 give or take 0.2” would be told something that is not true under any hypothesis. The correct report is “either the feeder is out and the load is 1.50, or the feeder is in and the load is 1.89, with odds of about 69 to 31 that it is in”. This is what a Laplace posterior, which fits one Gaussian at one mode, cannot say, and it is the first of the ways it fails.

7.2.2 Many discrete variables

With k discrete variables there are 2^k branches, each a sparse Gaussian solve. For k up to ten or so that is affordable and exact. Beyond that, three things help, and Part III develops each: most branches have negligible posterior weight and can be pruned by their evidence; discrete variables that are separated in the graph can be summed out independently, which is the region argument of §5.7 with discrete separators; and the sum over branches can be sampled rather than enumerated. Chapter 15 applies all three to the question of which k feeders, out of hundreds, are

most likely to be out together.

7.3 Piecewise closures and regimes

A piecewise closure is a discrete variable in disguise. Write the regime as b and the closure as $r_b(\mathbf{z}) = 0$; then the model is a mixture over b exactly as in §7.2, with one difference. The regime is not free: it is determined by the state. A valve is in its saturated regime when the demanded opening exceeds one, and in its proportional regime otherwise. So a branch b is *consistent* only if its own posterior mode puts the state in regime b , and inconsistent branches have no weight.

The deterministic version of this is the *active-set loop*: guess the regimes, solve, check each closure’s regime against the solved state, switch the inconsistent ones, and repeat until no regime changes. It usually converges in a few passes, and when it does the solution is on a single branch. The probabilistic version does the same with posteriors: for each candidate assignment of regimes, solve the branch, check consistency at its mode, and keep the branches whose modes are consistent, weighted by evidence. Usually one survives. Two survive when the posterior straddles a regime boundary, and the posterior is then a mixture whose components sit on either side of a kink.

The kink matters for one thing more than any other. A gradient computed across it is wrong: the sensitivity of the state to an input jumps at the boundary, and a finite difference that spans the boundary averages two slopes that belong to different physics. Chapter 14 returns to this when it computes sensitivities, and it is the reason that chapter insists on differentiating within the active regime.

When the regimes join continuously, as a valve’s do at saturation, the weight of a regime has an exact form that the active-set picture only approximates.

Proposition 7.2 (The weight of a regime). *Let the physics be piecewise linear in the inputs $\mathbf{u}$: on region $\mathcal{R}_b$ of input space the solved variables are $X_b(\mathbf{u})$, the map of the linear branch b . Then the posterior probability of regime b is*

$$\mathbb{P}(b \mid \mathbf{y}) \propto p_b(\mathbf{y}) \mathbb{P}_b(\mathbf{u} \in \mathcal{R}_b \mid \mathbf{y}), \quad (7.6)$$

where $p_b(\mathbf{y})$ is branch b ’s predictive density of the readings and $\mathbb{P}_b(\cdot \mid \mathbf{y})$ is branch b ’s Gaussian posterior over the inputs. The posterior of any quantity within regime b is branch b ’s posterior restricted to $\mathcal{R}_b$.

Proof. The posterior over the inputs is $p(\mathbf{u})p(\mathbf{y} \mid X(\mathbf{u}))/p(\mathbf{y})$, and on $\mathcal{R}_b$ the true map X equals X_b . So the mass of regime b is $\int_{\mathcal{R}_b} p(\mathbf{u})p(\mathbf{y} \mid X_b(\mathbf{u}))d\mathbf{u}$ divided by $p(\mathbf{y})$. Branch b ’s posterior is $p(\mathbf{u})p(\mathbf{y} \mid X_b(\mathbf{u}))/p_b(\mathbf{y})$ over all of input space, so the integral is $p_b(\mathbf{y})$ times that posterior’s mass on $\mathcal{R}_b$. $\square$

The proposition replaces the active-set test “is the branch’s mode in its region” by a mass, “how much of the branch’s posterior is in its region”. The two agree when the posterior is far from every boundary and disagree near one, and the worked example below shows by how much.

7.3.1 Worked example: a thermostat

Put a thermostat on the processor heat path. The heat sink is cooled by the server’s fan, whose speed a controller sets to hold the heat sink at 70 degrees, and the fan’s conductance to the inlet

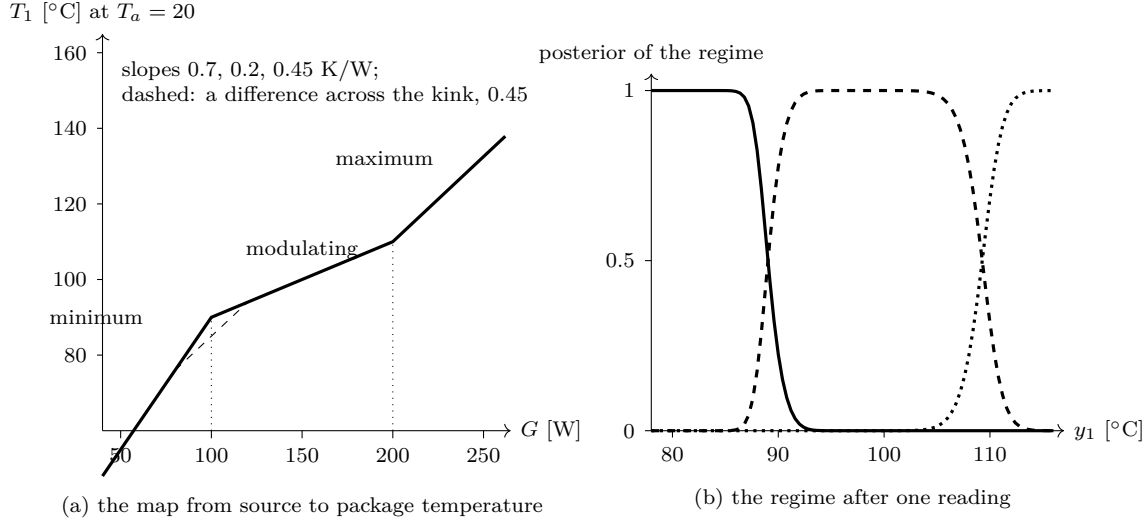


Figure 7.2: The thermostat. (a) The package temperature as a function of the source at an inlet temperature of 20 degrees: continuous, with kinks where the fan reaches its minimum and its maximum; the dashed chord is a central difference across the first kink. (b) The exact posterior probability of each regime as a function of the package-temperature reading: fan at minimum (solid), modulating (dashed), fan at maximum (dotted).

air can range from 2 to 4 watts per kelvin. The convection closure then has three regimes. With the fan at its minimum, $Q_{2a} = 2(T_2 - T_a)$ and the heat sink is below the set point. With the fan modulating, $T_2 = 70$ and the conductance is whatever the controller needs, between the limits. With the fan at its maximum, $Q_{2a} = 4(T_2 - T_a)$ and the heat sink is above the set point. The first boundary is where the minimum fan just holds the heat sink at 70, $G = 2(70 - T_a)$; the second is where the maximum fan does, $G = 4(70 - T_a)$. The priors of Chapter 3, $G \sim \mathcal{N}(100, 20^2)$ and $T_a \sim \mathcal{N}(20, 3^2)$, put the first boundary through the prior mean: the prior gives 0.501 to the fan at minimum, 0.499 to modulating, and nothing measurable to the fan at maximum, which needs 200 watts. A temperature sensor on the package reads T_1 with accuracy 0.5 degrees. Every number is from `ch07_regimes.py`.

The map and its kinks. In the three regimes the package temperature is $T_a + 0.7G$, $70 + 0.2G$ and $T_a + 0.45G$. Panel (a) of Figure 7.2 draws the map at $T_a = 20$: continuous, with slopes 0.7, 0.2 and 0.45 kelvin per watt and kinks at 100 and 200 watts. A central difference across the first kink gives 0.45 kelvin per watt for steps of 20, 5 and 0.5 watts. It converges as the step shrinks, but to the average of the two slopes, not to either, and nothing in the number says that it belongs to no physics.

The weights. Table 7.2 sweeps the reading and computes the regime probabilities three ways: exactly, by quadrature over the two inputs with the piecewise physics; by Proposition 7.2, with each branch's in-region mass estimated from 400 000 samples of its Gaussian posterior; and by the active-set shortcut, which keeps a branch only if its mode lies in its region. The proposition matches quadrature to 0.004 in every regime probability and to a tenth of a watt in the source's mean and spread. The shortcut is right away from the boundaries and wrong near them. At a

Table 7.2: The thermostat after one reading of the package temperature: regime probabilities and the posterior of the source, exact by quadrature and by Proposition 7.2, and the modulating probability under the active-set shortcut.

y_1	exact			G [W]	proposition		shortcut
	min	mod	max		mod	G [W]	mod
85	1.000	0.000	0.000	93.2 ± 4.2	0.000	93.2 ± 4.2	0.000
88	0.824	0.176	0.000	96.7 ± 4.3	0.179	96.7 ± 4.3	0.000
90	0.224	0.776	0.000	101.2 ± 2.7	0.780	101.2 ± 2.7	0.000
92	0.020	0.980	0.000	110.0 ± 2.4	0.981	110.0 ± 2.4	1.000
100	0.000	1.000	0.000	149.2 ± 2.5	1.000	149.2 ± 2.5	1.000
105	0.000	0.987	0.013	173.8 ± 2.5	0.987	173.8 ± 2.5	1.000
110	0.000	0.317	0.683	191.8 ± 6.5	0.319	191.8 ± 6.5	0.442
114	0.000	0.002	0.998	197.8 ± 6.4	0.002	197.8 ± 6.4	0.000

Table 7.3: The chain with $Q_{2a} = C(T_2 - T_a)^p$ and one sensor $y_2 = 72.0$: Laplace posterior against exact quadrature as the exponent grows. Skewness of the exact posterior of G in the last column.

p	Laplace G	exact G	Laplace T_a	exact T_a	skew
1.25	103.5 ± 7.1	103.6 ± 7.1	20.2 ± 2.8	20.2 ± 2.8	+0.04
2	102.9 ± 10.3	103.5 ± 10.3	20.3 ± 2.6	20.2 ± 2.6	+0.11
4	101.6 ± 15.3	102.7 ± 15.2	20.3 ± 2.0	20.3 ± 2.0	+0.14

reading of 90, where the exact posterior gives 0.22 to the fan at minimum and 0.78 to modulating, the shortcut reports the fan at minimum with certainty: the modulating branch's mode sits on the edge of its region and is discarded, though most of that branch's posterior lies inside. At 110 it reports 0.44 modulating where the exact value is 0.32.

What the regime does to the sensor. In the modulating regime the package temperature is $70 + 0.2G$ whatever the inlet temperature: the controller has absorbed the inlet temperature, and the reading says nothing about it. At readings of 95 and 105 the posterior of the inlet temperature is its prior, 20.0 ± 3.0 . The source is known to 2.5 watts there, which is the sensor's accuracy divided by the slope 0.2, while with the fan at its minimum the inlet temperature's spread adds to the reading's and the source is known only to 4.2. What a sensor tells is a property of the regime, and the regime is a property of the state.

7.4 Strong nonlinearity: when the Laplace posterior holds and when it does not

Chapter 6 showed that a closure with exponent 1.25 left the Laplace posterior accurate to two decimals. Raise the exponent. Table 7.3 repeats the one-sensor comparison of Table 6.3 with the convection closure $Q_{2a} = C(T_2 - T_a)^p$ at $p = 1.25, 2$ and 4 , the constant C rescaled each time so that the closure passes through the nominal operating point.

The result is not what a reader expecting nonlinearity to break the approximation would

predict. At $p = 4$, a fourth-power law, the Laplace standard deviation of the source is within one percent of the exact one and its mean is one watt low on a spread of fifteen. The reason is physical. A stiffer closure moves T_2 less per watt of source: the slope $\partial T_2 / \partial G = \Delta T / (pG)$ falls from 0.4 degrees per watt at $p = 1.25$ to 0.125 at $p = 4$. The sensor's lever arm on the source shortens, the posterior on G widens from ± 7 toward the prior's ± 20 , and a posterior that is mostly prior is mostly Gaussian. The nonlinearity that might have distorted the posterior has instead removed the information that would have made the distortion visible. Curvature matters in proportion to how far the posterior extends across it, and here the extension and the curvature moved in opposite directions.

So strong nonlinearity by itself is a weaker enemy of the Laplace posterior than folklore suggests, at least for closures of this kind. The approximation fails in three recognizable situations, and a modeler should look for these rather than for large exponents.

Multiple modes. The outage example of §7.2.1: two branches, two modes, and a single Gaussian at either one misreports both the mean and the spread. Discrete structure is the usual cause; a closure that is symmetric in a variable, so that a sensor cannot distinguish a value from its negative, is another. Chapter 15's failure sets and the phase-angle ambiguities of AC power flow are the cases that matter in practice.

A mode at a bound. When the posterior mode sits on a constraint, §7.5 below, the curvature at the mode describes a Gaussian half of which lies where the variable cannot go.

Curvature that survives concentration. When the data are informative enough to concentrate the posterior and the closure still curves within that concentrated width. Periodic closures with wide priors on angles are the standard example; so is a posterior that straddles a regime boundary. Here the mode is right and the curvature is not, and the marginal computed from Λ^{-1} can be wrong by a factor.

The tests that detect these from the model itself, without exact quadrature, are in Chapter 12: a comparison of the Laplace posterior's predicted spread of each residual with the actual residuals, and a probe that evaluates the objective at a few points along each posterior axis and checks that it is quadratic. The remedies, in increasing cost, are to reparameterize so that the closure is nearer to linear in the new variable, to integrate exactly in the one or two dimensions that are nonlinear and use Laplace for the rest, and to sample. Chapter 9 takes them up.

7.5 Bounded parameters

A Gaussian prior on a conductance $k \sim \mathcal{N}(5, 1^2)$ puts a probability of about 3×10^{-7} on $k < 0$, which is harmless. A prior $\mathcal{N}(1, 1^2)$ on an efficiency puts 0.16 on $\eta < 0$ and 0.5 on $\eta > 1$, which is not. Two remedies are standard.

Truncation. Multiply the Gaussian prior by the indicator of the admissible interval. The factor graph gains nothing; the prior's unary factor changes shape. The posterior mode is found by the same Gauss–Newton iteration with the step clipped at the bound, and if the unconstrained mode lies inside the interval nothing else changes. If the mode lies on the bound, the Laplace posterior is a Gaussian centered on the bound, half of it inadmissible; the honest report is the truncated Gaussian, whose mean is inside the interval and whose spread is smaller than Λ^{-1} says.

Reparameterization. Write the positive conductance as $k = e^\kappa$ and put the prior on κ ; write the efficiency as $\eta = 1/(1 + e^{-\lambda})$ and put the prior on λ . The closure that read k now reads e^κ , which is one more nonlinearity in a row that is already treated by Gauss–Newton, and the

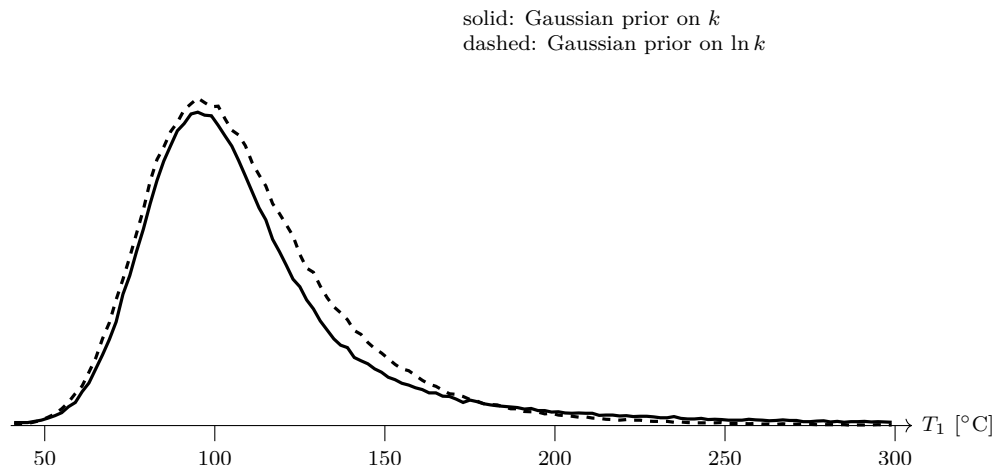


Figure 7.3: The prior predictive density of the package temperature under a Gaussian prior on the conductance (solid) and a Gaussian prior on its logarithm (dashed), both with median 3 watts per kelvin. The solid curve’s heavy right tail comes from conductances near zero; its 6.6 percent of draws with negative conductance, all with the package colder than the heat sink, lie off the left of the figure.

bound has disappeared. This is usually the better choice: it keeps the machinery unchanged, and a Gaussian on κ is often a more honest prior for a quantity known to within a factor than a Gaussian on k . Its cost is that κ ’s posterior, mapped back to k , is skewed, and the Laplace posterior in κ must be transformed rather than read off.

The two remedies differ where the data are thin, and the chain shows where. Give the conductance a Gaussian prior $\mathcal{N}(3, 2^2)$, a contact conductance known only to lie somewhere between one and five, or a Gaussian prior on $\ln k$ with the same median and a spread of 0.6. With the two thermometers of Chapter 3 the posterior of k is 4.92 ± 0.33 under the first and 4.92 ± 0.34 under the second: the data decide, and the bound never bites. Before the data the two priors differ sharply. Draw the prior predictive of the package temperature, $T_1 = T_2 + G/k$, by sampling the three inputs. Under the Gaussian prior 6.6 percent of the draws have $k \leq 0$, and in every one of them heat flows uphill from the heat sink into the package; the fifth percentile of T_1 is -7 degrees, and 3.4 percent of the draws put the package above 300 degrees because k is near zero. Under the log-normal prior no draw is unphysical, and the fifth to ninety-fifth percentiles are 71 to 169 degrees. Figure 7.3 draws both. A prior predictive is exactly what a Monte Carlo study of uncertain inputs computes, and a Gaussian prior on a positive parameter hands that study samples that are not physics.

7.6 What survives

It is worth listing what the four departures leave standing, because it is most of the book.

The factor graph, its Markov graph, its separators and its treewidth are untouched. Proposition 5.1 holds for any factors, and Proposition 5.3 is about the physics rows’ scopes, which the departures do not change. Elimination and fill are the same graph operations; what changes is that eliminating a discrete variable is a sum and eliminating a continuous one is an integral, and a factor that has both kinds of variable in its scope must be represented as a table of Gaussians,

one per discrete configuration. Such *conditional Gaussian* factors have their own algebra, and junction-tree inference with them is exact when the discrete variables are eliminated after the continuous ones in each clique; the rule and its limits are in the notes.

The Gaussian machinery survives per branch. Every branch is a sparse solve, every branch's evidence is its objective plus a log-determinant from the same factorization, and every branch's marginals are selected inversions. The Laplace posterior survives within a branch under the conditions of §7.4.

What does not survive is the single Gaussian. The posterior is a mixture over branches and over regimes, and the honest summary of a mixture is its components and their weights, not its mean and variance. Where the number of branches is small the mixture is enumerated exactly; where it is large, Part III is about how to avoid enumerating it.

7.7 In practice

Compare branches by their predictive densities. When the branches differ in their physics, as an outage or a regime does, weight each by the predictive density of the readings, or by its soft-row evidence times its physics determinant. Never compare soft-row evidences alone; Proposition 7.1 says what that does, and the outage example shows it raising an alarm on a normal reading.

Report the components. A mixture's mean and variance are a summary that no branch believes when the weights are comparable. Report each branch's estimate and its weight, and collapse to one Gaussian only when one weight is near one.

Weight regimes by mass, not by mode. For a piecewise closure, Proposition 7.2 weights a regime by the part of its branch's posterior that lies in the regime's region. Keeping a branch because its mode is in its region is exact far from the boundaries and wrong near them, which is where the operator's questions usually are.

Differentiate within the regime. A finite difference across a kink converges to the average of two slopes. Take derivatives of the active regime's closure at the operating point, and if the operating point is near a boundary, report both slopes.

Parameterize positive quantities by their logarithms. A Gaussian prior on a conductance, an efficiency or a load is harmless once the data are in and wrong before they are, and the prior predictive is what a Monte Carlo study and a planning study compute. Put the prior on the logarithm, or the logit for a quantity in an interval.

Test Laplace where it can fail. Multiple modes, a mode on a bound, and curvature that survives concentration are the three failures; a large exponent is not one of them. Look for the three, and use the probes of Chapter 12 to check.

7.8 What is missing

Part II is complete. The model is a factor graph whose squares are soft physics, priors, sensors and failure factors; its posterior is a mixture of sparse Gaussians; its structure decides what is

independent of what and what elimination costs. What has not been said is how to organize the computation when the graph is large: how to eliminate by regions and reuse the result (Chapter 8), what to do when exact elimination is too expensive (Chapter 9), how the factorized computation compares with sampling when both are costed in physics solves (Chapter 10), and how to fold in evidence as it arrives (Chapter 11). That is Part III.

Notes and further reading

Graphical models with both discrete and continuous variables, in which the continuous ones are Gaussian conditional on the discrete ones, are the conditional Gaussian models of Lauritzen and Wermuth [58]; exact propagation of probabilities, means and variances on a junction tree for such models, with the constraint on the elimination order mentioned in §7.6, is Lauritzen's [55]. The evidence of a branch as the integrated likelihood, its closed form for Gaussian models, and its use to compare hypotheses are treated by Kass and Raftery [45] under the name of Bayes factors, and by MacKay [64], whose account of the trade-off between fit and flexibility in equation (7.2) is the one followed here. That the soft-row evidences of branches with different physics must be corrected by the physics determinant, Proposition 7.1, is the coarea factor of Remark 4.1 appearing in model comparison; it is stated here because the soft formulation makes the uncorrected comparison easy to compute and wrong.

The accuracy of the Laplace approximation to posterior moments, with the error terms that explain why a nearly-Gaussian posterior is approximated well, is Tierney and Kadane's [101]; Bishop [10] gives the textbook account. The observation of §7.4, that a stiffer physical closure can make the posterior more Gaussian rather than less by weakening the sensor's lever arm, is the book's, and the exponent sweep is its evidence.

Feeder-outage detection from measurements is a standard problem in power-system operation, usually posed as a hypothesis test over a list of candidate outages; the treatment in §7.2.1 as a posterior over a discrete variable in the same graph as the state is the framework's, and Chapter 15 scales it up. The active-set loop of §7.3 is the standard treatment of piecewise constitutive laws in circuit and network simulators. Reparameterization of positive and bounded parameters by logarithms and logits is the common practice of Bayesian modeling [64].

Summary

- Four departures from the Gaussian world: a discrete variable, a piecewise closure, a strongly nonlinear closure, a bounded parameter. None changes the factor graph.
- A discrete variable splits the model into linear-Gaussian branches. Each has a mode, a precision and an evidence from one sparse factorization; the discrete posterior is prior times evidence; the continuous posterior is a mixture.
- Branches whose physics differ are compared by their predictive densities, which is the soft-row evidence times the physics determinant. On the triangle the uncorrected evidence understates the in-service branch threefold and would raise an outage alarm too early.
- One flow meter on the triangle detects a feeder outage: the outage probability rises from 0.006 to 0.68 across a reading sweep, and at the crossover the load posterior is bimodal, which no single Gaussian can report.
- A piecewise closure is a discrete variable determined by the state. A regime's weight is its branch's predictive density times the branch posterior's mass in the regime's region,

which matches quadrature on the thermostat to 0.004; keeping branches whose modes are in their regions fails near the boundaries. A finite difference across a kink converges to the average of two slopes.

- In the thermostat's modulating regime the sensor says nothing about the inlet temperature: what a reading tells depends on the regime.
- Raising a closure's exponent to four did not break the Laplace posterior, because the stiffer law shortened the sensor's lever arm and returned the posterior toward its Gaussian prior. Laplace fails at multiple modes, at a mode on a bound, and when curvature survives concentration.
- Bounded parameters: truncate, or reparameterize by a logarithm or a logit. Reparameterization is usually better: with data both give the same posterior, but a Gaussian prior on a positive conductance sends 6.6 percent of prior-predictive draws uphill.

Exercises

Exercise 7.1. Derive equation (7.2) by completing the square in the branch's objective and integrating the Gaussian, and identify the constant. Then show that for two branches with the same rows and widths but different row coefficients the constant cancels and the log-determinant does not: it contains $\log |\det \mathbf{J}_{x,a}|$, which Proposition 7.1 says must be added back.

Exercise 7.2. In the outage example, move the meter to feeder 2–3 instead of feeder 1–2. Compute the prior predictive of its reading under both branches and explain why this meter detects the outage from a single reading with near certainty, whatever the loads. Then move it to feeder 1–3 and explain why it is exactly as informative as the meter on feeder 1–2.

Exercise 7.3. Add a second uncertain feeder to the triangle, feeder 1–3, so that there are four branches. Compute the prior probability of each, the predictive density of each at a reading $y_{12} = 1.50$, and the posterior. Which two branches can this meter not tell apart, and what does their posterior ratio equal?

Exercise 7.4. A valve closure is $Q = cu\Delta p$ for opening $u \in [0, 1]$ and $Q = c\Delta p$ for $u \geq 1$. Write the two regimes as rows, state the consistency condition for each, and construct a prior on u and a sensor on Q for which both regimes are consistent at their modes. Draw the resulting posterior of u and mark the kink.

Exercise 7.5. Repeat the exponent sweep of Table 7.3 with the sensor accuracy improved from 0.5 to 0.05 degrees, so that the posterior on G is concentrated. Find the exponent at which the Laplace standard deviation first errs by more than ten percent, and relate the answer to the third failure mode of §7.4.

Solutions to selected exercises

Exercise 7.1. For a fixed branch every factor is Gaussian in $\mathbf{z}$ with weight w_k , so the integrand of Z_a is $\prod_k (w_k/2\pi)^{1/2} \exp(-C_a(\mathbf{z}))$, with C_a the branch's quadratic objective. A quadratic equals its value at its minimum plus half its Hessian form about the minimum: $C_a(\mathbf{z}) = C_a(\mathbf{z}_a^*) + \frac{1}{2}(\mathbf{z} - \mathbf{z}_a^*)^\top \mathbf{\Lambda}_a(\mathbf{z} - \mathbf{z}_a^*)$. The Gaussian integral over d dimensions is $(2\pi)^{d/2}(\det \mathbf{\Lambda}_a)^{-1/2}$, so

$$\log Z_a = -C_a(\mathbf{z}_a^*) - \frac{1}{2} \log \det \mathbf{\Lambda}_a + \frac{d}{2} \log 2\pi + \frac{1}{2} \sum_k \log \frac{w_k}{2\pi},$$

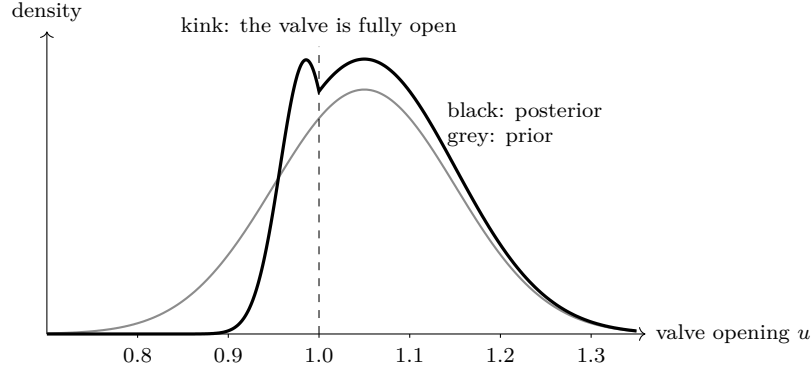


Figure 7.4: The posterior of the valve opening after a flow reading of 9.8 kilograms per second with accuracy 0.3 (black), against the prior (grey). Below $u = 1$ the valve throttles and the reading pins the opening; above it the valve is wide open and the reading says nothing about the opening. The posterior is continuous with a kink at $u = 1$, a notch between the two regimes' modes.

which is equation (7.2), the constant being the last two terms. Two branches with the same rows and widths share d and every w_k , so the constant cancels. The log-determinant does not. With m physics rows of width σ , $\mathbf{\Lambda}_a$ is dominated by $\sigma^{-2} \mathbf{J}_{g,a}^\top \mathbf{J}_{g,a}$ on the solved variables. As $\sigma \rightarrow 0$, $\log \det \mathbf{\Lambda}_a$ is $-2m \log \sigma + 2 \log |\det \mathbf{J}_{x,a}|$, plus a term from the inputs' posterior, which the proof of Proposition 7.1 identifies with the predictive density. The first piece is common to the branches; the second is not whenever the branches' physics coefficients differ. So $\log Z_a$ carries $-\log |\det \mathbf{J}_{x,a}|$, which is exactly what the proposition adds back.

Exercise 7.4. The two regimes are two rows for the same closure, each with its consistency condition: throttling, $Q - cu \Delta p = 0$ with $u \leq 1$, and wide open, $Q - c \Delta p = 0$ with $u \geq 1$. The script `ch07_valve.py` takes $c \Delta p = 10$ kilograms per second, a prior $u \sim \mathcal{N}(1.05, 0.1^2)$ for a valve usually driven slightly past fully open, and a meter reading $Q = 9.8$ with accuracy 0.3. Each regime is a linear-Gaussian branch. The throttling branch reads u through the meter: its posterior is 0.986 ± 0.029 , inside its region, and the predictive density of the reading under it is 0.305. The wide-open branch does not read u at all, since the flow no longer depends on it. Its posterior is the prior, with mode 1.05, inside its region, and its predictive density is 1.065. Both regimes are consistent at their modes. By Proposition 7.2 each weight is the predictive density times the mass the branch's posterior puts in its own region, 0.690 for throttling and 0.692 for wide open, so the probabilities are 0.222 and 0.778; direct integration of the exact posterior gives the same to four digits. Figure 7.4 draws that posterior. It is continuous, since both rows give $Q = c \Delta p$ at $u = 1$, but its logarithm's slope jumps there from -17.2 just below to $+5.0$ just above. The kink is a notch between two local modes, one per regime, and a single Gaussian placed at either mode would miss the other regime entirely.

Exercise 7.5. The script `ch07_exponent.py` integrates the inlet temperature out in closed form, since for fixed G the objective is quadratic in T_a , and computes the exact marginal of G by a one-dimensional quadrature. With the sensor at 0.05 degrees, the Laplace standard deviation of G is within 0.6 percent of the exact one at every exponent from 1 to 4, and so is that of T_a : at $p = 4$, 15.20 against 15.11 and 1.933 against 1.924. No exponent in the range makes either

spread err by ten percent. What does move is the mean of G , 1.1 watts low at $p = 4$, a fourteenth of its spread. The exercise's premise, that a concentrated posterior would make the marginal spreads fail, is wrong here, and the reason is the third failure mode of §7.4. The precise sensor confines the posterior to a thin curved band about $T_a + (G/C)^{1/p} = 72$, and a Gaussian cannot follow a curved band. It can still match the band's two marginal spreads, which average over the curvature. Chapter 12's probes see what the spreads do not: at $p = 4$ with this sensor the objective at two spreads along the widest axis is 29 times its quadratic prediction, and only 7 percent of reweighted draws are effective. A check of marginal spreads is not a check of the Gaussian.

Exercise 7.2. With the feeder in service the flow on feeder 2–3 is $F_{23} = (P_2 - P_3)/3$, so under the load priors its prediction is -0.333 ± 0.096 with the meter's accuracy added; with the feeder out it is exactly zero, 0.000 ± 0.020 . The two predictions are separated by more than three of the wider spread, and a reading near either is decisive. A reading of zero gives $\mathbb{P}(\text{out}) = 0.990$ despite the prior of 0.05, and a reading of -0.167 , halfway between the two, gives less than 10^{-4} : the out-of-service branch says the reading must be zero to within 0.02, so anything eight of its spreads away rules it out. The meter reads the quantity the outage changes most, the flow on the feeder itself. The meter on feeder 1–3 reads $F_{13} = -(P_2 + 2P_3)/3$, predicted 0.833 ± 0.150 in service and $-P_3 = 0.500 \pm 0.201$ out: the same separation and the same spreads as the meter on feeder 1–2, mirrored. At its out-branch prediction it gives $\mathbb{P}(\text{out}) = 0.315$, exactly what the feeder 1–2 meter gives at its own. It is as informative because the outage moves bus 2's load onto feeder 1–2 and bus 3's onto feeder 1–3, by amounts that the loads' symmetric priors make equal.

Exercise 7.3. Under each branch F_{12} is a linear combination of the loads: $-(2P_2 + P_3)/3$ with both feeders in, $-P_2$ with feeder 2–3 out, $-(P_2 + P_3)$ with feeder 1–3 out, since bus 3 is then fed through bus 2, and $-P_2$ with both out, since bus 3 is de-energized and its load shed. The predictive densities at 1.50 are 0.228, 1.985, 0.297 and 1.985; the priors are 0.9025, 0.0475, 0.0475 and 0.0025; the posterior is 0.644, 0.296, 0.044 and 0.016. The meter cannot tell “feeder 2–3 out” from “both out”: in both, bus 2 is fed by feeder 1–2 alone and $F_{12} = -P_2$. Their predictive densities are identical, so their posterior ratio is their prior ratio, 19 to 1, whatever the reading. The second outage is invisible to this meter because it happens on the far side of the first; a meter on feeder 1–3 would see it at once. Pruning by weight alone would discard “both out” at a threshold of 0.02, and that is safe only because its consequence, bus 3 dark, is one an operator would see by other means.

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

The cooling unit that may be out *a hybrid state: one discrete branch over Gaussian continuous states; the predictive is a mixture; a branch's width and not only its mean decides what a reading favours*

`level2_room_hall/airflow_redistribution/problems/the_unit_that_may_be_out`

Part III

Inference

Chapter 8

Exact inference: elimination, junction trees, Schur complements

Part II built the model and said what its posterior is. Part III is about computing it, and this chapter is about computing it exactly. The tools are the ones Chapter 5 introduced, elimination and separators, and Chapter 6 made concrete, the Schur complement. What is new is organization. Elimination can be arranged as messages passed along a tree, which gives every marginal from two sweeps; a loopy graph can be made into a tree of clusters; and, most usefully for a physical system, elimination can be organized by regions and ports, so that each region is summarized to its neighbors once and the summary is reused for every question that does not change the region. The chapter ends with two rooms of the facility's distribution cut at their cross-tie, each eliminated onto the port pair of the cut, and the exactness and the reuse checked to machine precision.

8.1 What exact means

A query is exact when its answer is the marginal, the mode, or the conditional of the posterior, computed without approximation beyond floating-point arithmetic. For the Gaussian branches of Chapter 7 that means the mode from a sparse solve, the marginal variances from selected inversion, and the marginal over any subset from a Schur complement. For the discrete part it means summing over every branch, or over every branch that the graph does not let one sum separately. Both are elimination: integrate or sum out the variables one does not want, in some order, and what remains is the marginal of the ones one does. This chapter takes the arithmetic of elimination as settled and asks only how to organize it.

8.2 Messages on a tree

Take a factor graph that is a tree and pick any variable as the root. Every other node has a unique path to the root, so every node has a parent and some children. Elimination from the leaves inward is then a local operation at each node, and the local objects it passes are called *messages*.

A variable x sends to a neighboring factor f the product of the messages it has received from

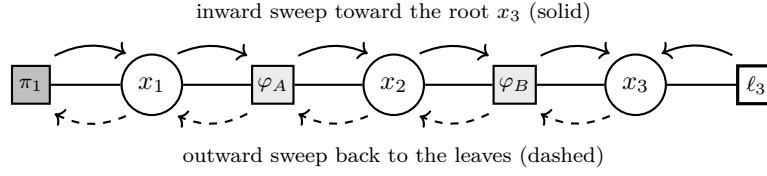


Figure 8.1: Sum-product on the three-variable chain with a prior on x_1 and a sensor on x_3 . The inward sweep carries one message along each edge toward the root; the outward sweep carries one back. After both, every variable has received a message from every neighbor, and its marginal is their product (Proposition 8.1). Twelve messages, one per edge in each direction, give all three marginals.

its other neighboring factors:

$$m_{x \rightarrow f}(x) = \prod_{g \neq f} m_{g \rightarrow x}(x). \quad (8.1)$$

A factor f with scope $\{x, y_1, \dots, y_k\}$ sends to x its own function times the messages from its other variables, integrated over those variables:

$$m_{f \rightarrow x}(x) = \int \varphi_f(x, y_1, \dots, y_k) \prod_i m_{y_i \rightarrow f}(y_i) dy_1 \cdots dy_k. \quad (8.2)$$

Equation (8.2) is one elimination step: it removes $y_1, \dots, y_k$ and leaves a function of x . A leaf factor, a prior or a sensor, has no other variables and sends itself. Run the messages from the leaves to the root, and the root's marginal is the product of what arrives. Run them back from the root to the leaves, and every variable's marginal is the product of what it has received from all sides:

$$p(x) \propto \prod_{f \ni x} m_{f \rightarrow x}(x). \quad (8.3)$$

Two sweeps, every marginal, no approximation. On a tree this is exact, and it is called the *sum-product* algorithm.

Proposition 8.1 (Sum-product is exact on a tree). *If the factor graph is a tree, the messages (8.1) and (8.2), computed from the leaves inward and then back outward, give every variable's marginal by equation (8.3), exactly.*

Proof. Fix a variable x . Removing x from a tree splits it into one subtree per neighboring factor f , and because the graph is a tree no factor in one subtree reads a variable of another. So the joint is $\prod_{f \ni x} \Phi_f(x, V_f)$, where Φ_f is the product of the factors in f 's subtree and V_f its variables other than x , and the marginal is $p(x) \propto \prod_{f \ni x} \int \Phi_f dV_f$. It remains to show that $\int \Phi_f dV_f = m_{f \rightarrow x}(x)$, which is an induction on the depth of the subtree. If f is a leaf, $\Phi_f = \varphi_f(x)$ and the message is φ_f itself. Otherwise f 's subtree is f together with, for each of its other variables y_i , the subtrees hanging from y_i through its other factors g ; these share no variables, so $\int \Phi_f dV_f = \int \varphi_f(x, \mathbf{y}) \prod_i [\prod_{g \ni y_i, g \neq f} \int \Phi_g dV_g] d\mathbf{y}$. By the induction hypothesis each inner integral is $m_{g \rightarrow y_i}$, their product is $m_{y_i \rightarrow f}$ by equation (8.1), and the outer integral is equation (8.2). The inward sweep computes these messages for the root; the outward sweep computes, for every other variable, the messages from the side of the tree that the inward sweep did not visit. $\square$

Figure 8.1 draws the two sweeps on the chain. The count is worth noticing: two messages per edge give every marginal, where computing each marginal separately by elimination would repeat most of the work once per variable. That saving is what the organization buys, and it is the same saving that selected inversion buys against a factorization in Chapter 6.

For Gaussian factors every message is a Gaussian in one variable, hence two numbers in information form, a precision λ and an information η . Equation (8.1) adds them. Equation (8.2) is a Schur complement: form the factor's precision on its scope, add the incoming precisions to the diagonal entries of $y_1, \dots, y_k$, and eliminate those variables. The whole computation is a sequence of small dense eliminations, one per factor, in an order fixed by the tree.

The chain of Figure 5.1 is the smallest instance. Root it at x_3 . The message from φ_A to x_2 integrates x_1 out of φ_A times any prior on x_1 ; x_2 passes it to φ_B ; φ_B integrates x_2 out and delivers a function of x_3 . That is the reading of Chapter 3's worked example as a computation: the sensor's message enters at T_2 , passes through the closures and balances, and arrives at G three factors away, attenuated by each.

8.3 Loops: the junction tree

Every factor graph in this book has loops, and on a loopy graph the messages (8.1)–(8.2) do not terminate and do not give exact marginals. Chapter 9 says what happens if one runs them anyway. The exact route is to make a tree.

Group the variables into overlapping *clusters* such that every factor's scope lies within some cluster, and arrange the clusters in a tree such that any variable shared by two clusters is contained in every cluster on the path between them. The second condition is the *running intersection property*, and a cluster tree with it is a *junction tree*. The intersection of two adjacent clusters is their separator. Assign each factor to a cluster containing its scope, and run the sum-product messages between clusters instead of between variables and factors: a cluster sends to its neighbor the product of its factors and its other incoming messages, integrated over everything not in the separator. Two sweeps give the marginal of every cluster, hence of every variable, exactly.

A junction tree is an elimination order in disguise, and the correspondence is the one Chapter 5 set up. Take any elimination order; each eliminated variable together with its neighbors at the time of elimination is a clique of the filled graph; the maximal cliques, arranged by the order, form a junction tree; and the largest cluster has one more variable than the order's width. The DC triangle in nodal form is a single cluster of two variables. The chain in row form, with its six-cycle, has a junction tree whose largest cluster is three variables, and the inputs-first order of §6.5, which created no fill, is the order that builds it. For Gaussian factors, the junction tree's messages are the block Schur complements that a sparse Cholesky factorization performs in that order; the elimination tree of the factorization is the junction tree, and Chapter 6's statement that inference is one factorization is this section's statement with the clusters made explicit.

Figure 8.2 draws the junction tree of the DC triangle in row-per-factor form, built from the order $F_{12}, F_{13}, F_{23}, \theta_2, \theta_3$ that Chapter 5 found to have width two. Eliminating F_{12} forms the clique $\{F_{12}, \theta_2, F_{23}\}$; eliminating F_{13} forms $\{F_{13}, \theta_3, F_{23}\}$; eliminating F_{23} forms $\{F_{23}, \theta_2, \theta_3\}$; the rest are contained in these. Three clusters of three variables, joined through the third by two separators of two, and each of the five rows lies in a cluster that contains its scope: the balance b_2 and the closure c_{12} in the first, b_3 and c_{13} in the second, c_{23} in the third. The variable F_{23} is in all three clusters and on every path between them, which is the running intersection property.




Figure 8.2: A junction tree for the DC triangle in row-per-factor form. Clusters (rounded) are the cliques of the elimination order $F_{12}, F_{13}, F_{23}, \theta_2, \theta_3$; separators (shaded) are their intersections. Every row is assigned to a cluster containing its scope, and the loop of the network has become a chain of clusters.

Principle 8.1. *Exact inference on a loopy graph is exact inference on a tree of clusters. The clusters are the cliques of an elimination order, the largest cluster costs what treewidth says it costs, and for Gaussian models the cluster messages are the Schur complements of a sparse factorization.*

8.4 Regions and ports: the Schur complement as a message

For a physical system there is a natural coarse junction tree: the regions of a physical partition, with the ports of each cut as separators. Proposition 5.3 says the ports do separate, so the clusters are the regions' interiors together with their ports, and the tree is the tree of regions. This section writes out what the messages are.

Partition the variables into region interiors $I_1, \dots, I_m$ and the port set S , and partition the factors accordingly: those reading only $I_r \cup S$ belong to region r , and those reading only S , such as the cut closures once one potential per cut edge has been assigned to a side, belong to the cut. The precision matrix of the whole model, ordered with the interiors first and the ports last, is then bordered block-diagonal:

$$\Lambda = \begin{pmatrix} \Lambda_{11} & & \Lambda_{1S} \\ & \Lambda_{22} & \Lambda_{2S} \\ & & \ddots & \vdots \\ \Lambda_{S1} & \Lambda_{S2} & \cdots & \Lambda_{SS} \end{pmatrix}, \quad \Lambda_{SS} = \sum_r \Lambda_{SS}^{(r)} + \Lambda_{SS}^{\text{cut}}, \quad (8.4)$$

with no coupling between different interiors, because no factor reads two. Figure 8.4 draws the structure for the example below.

Proposition 8.2 (The region message). *Let region r 's factors have precision $\Lambda^{(r)}$ and information $\eta^{(r)}$ on $I_r \cup S$. Their product, marginalized over I_r , is a Gaussian on S with*

$$\mathbf{S}_r = \Lambda_{SS}^{(r)} - \Lambda_{SI}^{(r)} (\Lambda_{II}^{(r)})^{-1} \Lambda_{IS}^{(r)}, \quad \mathbf{h}_r = \eta_S^{(r)} - \Lambda_{SI}^{(r)} (\Lambda_{II}^{(r)})^{-1} \eta_I^{(r)}. \quad (8.5)$$

This is the region's message to the rest of the system, and it is the Schur complement of the region's interior in the region's own precision.

Proposition 8.3 (Exactness of the reduced system). *The posterior marginal on the ports is the Gaussian with precision $\sum_r \mathbf{S}_r + \Lambda_{SS}^{\text{cut}}$ and information $\sum_r \mathbf{h}_r + \eta_S^{\text{cut}}$. Given the port posterior (μ_S, Σ_S) , the posterior of region r 's interior is Gaussian with*

$$\mu_I = (\Lambda_{II}^{(r)})^{-1} (\eta_I^{(r)} - \Lambda_{IS}^{(r)} \mu_S), \quad \Sigma_I = (\Lambda_{II}^{(r)})^{-1} + \mathbf{X} \Sigma_S \mathbf{X}^\top, \quad \mathbf{X} = (\Lambda_{II}^{(r)})^{-1} \Lambda_{IS}^{(r)}. \quad (8.6)$$

Both are exact.

Proof. Proposition 8.2 is Proposition 6.3 applied to the product of region r 's factors, which is a Gaussian on $I_r \cup S$. For Proposition 8.3, eliminate every interior from the whole precision at once. By the bordered structure (8.4), $\mathbf{\Lambda}_{I_r I_s} = \mathbf{0}$ for $r \neq s$, so the interior block is block diagonal, its inverse is block diagonal, and the Schur complement $\mathbf{\Lambda}_{SS} - \sum_r \mathbf{\Lambda}_{SI_r} \mathbf{\Lambda}_{I_r I_r}^{-1} \mathbf{\Lambda}_{I_r S}$ splits into one term per region. The only factors that read I_r are region r 's, so $\mathbf{\Lambda}_{I_r I_r} = \mathbf{\Lambda}_{II}^{(r)}$ and $\mathbf{\Lambda}_{SI_r} = \mathbf{\Lambda}_{SI}^{(r)}$; with $\mathbf{\Lambda}_{SS} = \sum_r \mathbf{\Lambda}_{SS}^{(r)} + \mathbf{\Lambda}_{SS}^{\text{cut}}$ the Schur complement is $\sum_r \mathbf{S}_r + \mathbf{\Lambda}_{SS}^{\text{cut}}$, and the same bookkeeping gives the information vector. For the interior, the conditional of I_r given the ports involves only the factors that read I_r , and by Proposition 6.5 it is Gaussian with precision $\mathbf{\Lambda}_{II}^{(r)}$ and information $\boldsymbol{\eta}_I^{(r)} - \mathbf{\Lambda}_{IS}^{(r)} \mathbf{x}_S$. Averaging its mean over the port posterior gives the first formula of equation (8.6), and the law of total covariance, the conditional covariance plus the covariance of the conditional mean $-\mathbf{X} \mathbf{x}_S + \text{const}$, gives the second. $\square$

Nothing is approximated. The interior covariance in equation (8.6) has two terms: the region's own conditional uncertainty given its ports, and the port uncertainty carried into the interior by the sensitivity $\mathbf{X}$ of the interior to the ports. A region whose ports are known exactly has only the first term; a region cut off from all sensors has mostly the second.

This organization has three names in three literatures. In sparse direct methods it is *nested dissection* or *substructuring*: eliminate the interiors, solve the reduced system on the separators, back-substitute. In electrical networks it is *Kron reduction*: eliminating the interior buses of a network leaves an equivalent network among the boundary buses, with equivalent feeders and equivalent injections, and the reduced susceptance matrix is exactly the Schur complement. In graphical models it is the junction tree with regions as clusters. They are one computation, and the physical reading is the most useful: the region's message is the region as its neighbors see it, an equivalent network with error bars.

Principle 8.2. *A region's Schur complement onto its ports is the region summarized to its neighbors, exactly. It is an equivalent network on the ports with uncertainty, and the rest of the system needs nothing else about the region.*

Proposition 8.4 (Messages compose). *Split the interior variables into sets $I_1, \dots, I_R$, and call the rest S . The reduced system on S obtained by eliminating every interior at once equals the one obtained by eliminating them one set at a time, in any order. If, in addition, no factor involves variables of two different interiors, it equals the sum of the regions' messages, each computed from that region's factors alone, plus the factors that involve only S .*

Proof. The reduced system is the information form of the marginal of S , by Proposition 6.3. Marginalizing a density over $I_1 \cup I_2$ at once, or over I_1 and then over I_2 , gives the same marginal, since the integrals can be taken in either order; so the reduced systems agree, and by induction they agree for any number of sets in any order. When no factor involves two interiors, the joint density is a product of one group of factors per region, each group involving only that region's interior and S , times the factors on S alone. Integrating over I_r touches only region r 's group, which becomes its message on S . The product of the messages and the S -only factors is the marginal, and in information form a product is a sum. $\square$

The script `ch08_compose.py` checks both parts on the two-region network of §8.6. Eliminating region A first, region B first, or both together gives the same 2×2 port system to fourteen digits relative to its entries, and adding the two regions' separately computed messages gives it too.




Figure 8.3: What a change costs on the two-region network, by the table of §8.5. The circle is the port system. Dark: recomputed. Light: a back-substitution against a factorization already held. White: reused as it was. (a) A sensor inside region B changes B 's message and the port solve. (b) A factor on the cut changes only the port solve. (c) A query about region A 's interior is a back-substitution in A alone.

Now add one factor that joins an angle of region A to an angle of region B directly, a comparison of θ_3 with θ_5 , say, that does not pass through the port. Sequential elimination is still exact. The sum of separately computed messages is not. The new factor belongs to neither region's group and touches no port, so neither message sees it, and the posterior mean of the tie flow comes out at 2.1496 instead of 2.1444, a quarter of its posterior spread. A factor across the cut that bypasses the ports makes a different partition, with a larger separator, and the regions have to be redrawn before their messages can be added.

Composition is what makes hierarchy possible. A region can itself be a union of subregions whose messages were computed separately and eliminated in any order, and Chapter 17 builds a building, a campus and a grid out of exactly this.

8.5 Reuse

The region message depends only on the region's own factors. That single fact decides what must be recomputed when something changes, and it is the structural basis for every claim of reuse in this book.

Change	Recompute	Reuse
sensor or prior inside region r	$\mathbf{S}_r, \mathbf{h}_r$; port solve; back-sub in r	every other region's message
factor on the cut	port solve; back-sub where asked	every region's message
query about region r 's interior	back-substitution in r	everything else
region r replaced or re-modeled	$\mathbf{S}_r, \mathbf{h}_r$; port solve	every other region's message

Two things in the table deserve emphasis. A sensor inside region r changes $\mathbf{h}_r$ and, in general, $\mathbf{S}_r$; but it may change neither, if what it reads is a combination of interior variables that the ports do not depend on. The worked example has such a sensor: a meter inside a region that moves the region's interior estimates and leaves its message to the rest of the system untouched, because the region's total draw through its port is fixed by its loads whatever their split. And a query about one region's interior costs a back-substitution in that region alone, which is a solve against a factorization already held. Neither the port solve nor any other region is touched.

Figure 8.3 draws the three most frequent rows of the table on the two-region network. In operation the third case dominates. Most questions are about one region's interior given everything else, and each costs a solve. The first case is the one that makes distributed estimation practical: a region's own sensors change its own message and nothing else, so a region can fold in its readings and publish a new message without any other region repeating its work.

The cost model that follows is the one Chapter 10 uses to count. Let region r have n_r interior variables and k_r ports. Computing its message costs one sparse factorization of $\mathbf{\Lambda}_{II}^{(r)}$ plus k_r

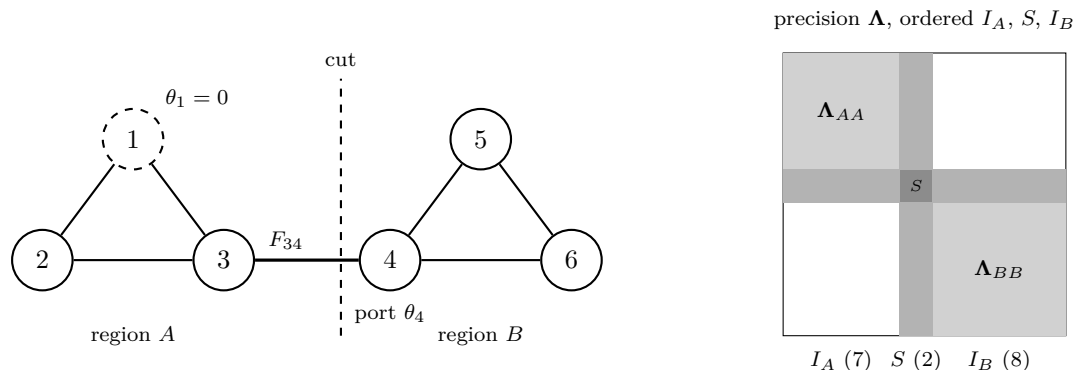


Figure 8.4: Two regions joined by one cross-tie. Left: the network; the dashed line is the cut, whose port pair is the tie flow F_{34} and the angle θ_4 on the B side. Right: the precision matrix with region A 's seven interior variables first, the two ports in the middle, and region B 's eight interior variables last. The white blocks are structurally zero: no factor reads variables from both interiors.

solves against it, once. The port solve costs a dense factorization of a $|S| \times |S|$ matrix, where $|S| = \sum_r k_r$. A query answered by back-substitution in one region costs a solve. A change confined to one region costs that region's message again and the port solve again, and nothing else. Whether this beats re-solving the whole model depends on how many regions there are, how many ports, and how many questions are asked of one model; Chapter 10 puts numbers to it, and Chapter 18 asks how to cut so that the ports are few.

8.6 Worked example: two regions, one cross-tie

Two electrical rooms, each a copy of the DC triangle, are joined by a cross-tie. Region A is the first room, buses 1, 2, 3, with bus 1 its UPS busbar and the reference; region B is the second, buses 4, 5, 6, with bus 4 the unit the cross-tie lands on. Every feeder has susceptance $B = 10$. The five loads $P_2, \dots, P_6$ are uncertain with Gaussian priors of spread 0.2 about $-1.2, -0.8, -0.5, -1.0, -0.6$ per unit. Physics rows have width 0.01. Three meters read F_{12} , F_{56} and the tie flow F_{34} , with accuracy 0.02, at 1.75, -0.15 and 2.15, values a little off the flows the nominal loads would produce. Figure 8.4 draws the network and the block structure of its precision. Every number is from the script `ch08_regions_schur.py` in the book's `scripts` directory.

The separator. In row-per-factor form the cut edge's port pair is $\{F_{34}, \theta_4\}$, with θ_4 assigned to region B and the cut closure c_{34} , which also reads θ_3 , assigned to region A . The script confirms on the Markov graph of the assembled precision that no edge joins a variable of A 's interior to one of B 's. In nodal form, with the flows eliminated, the balance at bus 4 would read $\theta_3, \theta_4, \theta_5, \theta_6$ and P_4 together, making them a clique, and the smallest separator at the same cut would have three or four variables. The flow variable is worth keeping: it is the cheaper place to cut.

Exactness. The full model has 17 unknowns and 20 factors. Its posterior on the ports is $F_{34} = 2.1496 \pm 0.0199$ and $\theta_4 = -0.4490 \pm 0.0096$. Now eliminate each region separately. Region A 's factors, including the cut closure, give a 2×2 message on the ports; region B 's give another;

their sum is the reduced port system. Solving it gives the same two numbers to fourteen decimal places, and back-substituting into region A by equation (8.6) reproduces every interior marginal of the full model to thirteen: the load at bus 3, for instance, is -0.7805 ± 0.1794 either way. Proposition 8.3, checked.

The messages, read physically. Region A 's message has precision

$$\mathbf{S}_A \approx \begin{pmatrix} 2738 & 1661 \\ 1661 & 11822 \end{pmatrix} \quad \text{on } (F_{34}, \theta_4) : \quad (8.7)$$

it constrains both the tie flow and the angle at bus 4, because bus 4 is tied through feeder 3–4 and the triangle to the reference, and because the tie meter sits on the cut side of the split and was assigned to A . Region B 's message is

$$\mathbf{S}_B \approx \begin{pmatrix} 8.31 & 0 \\ 0 & 0 \end{pmatrix}, \quad \mathbb{E}[F_{34} \mid \theta_4] = 2.100 + 0 \cdot \theta_4, \quad \text{sd } 0.347. \quad (8.8)$$

Region B says nothing about the angle at its own port, because nothing in B reaches the reference except the tie itself: its angles are defined only relative to θ_4 . What it says about the flow is that the tie must carry 2.10 per unit into B with a spread of 0.347, which is the sum of its three load priors, $0.5 + 1.0 + 0.6$, with their spreads added in quadrature, $0.2\sqrt{3}$. That is Proposition 1.1, exactness at a cut, delivered as a message with an error bar: the flow across the boundary equals the net load inside, whatever the inside does, and the message is the inside's ignorance of its own total. Had B a second tie to the reference network, the message would acquire a slope in θ_4 , the equivalent susceptance seen from bus 4, and the intercept would become an equivalent injection: the classical Ward equivalent, with the zero spread that classical equivalents assume replaced by the spread the priors imply.

Reuse, two ways. Move the meter on F_{56} from -0.15 to 0.00 . Inside B the estimates shift: P_5 from -1.040 to -0.826 and P_6 from -0.593 to -0.807 , the meter redistributing load between the two buses. Region B 's message does not change at all, to twelve decimals: the meter reads a difference of loads, and the message carries only their sum. Nothing outside B needs to be told. Now instead change the prior mean of P_5 from -1.0 to -1.3 . Region B 's intercept moves from 2.100 to 2.400 ; region A 's message is unchanged, to machine precision; and solving the 2×2 port system with A 's old message and B 's new one gives $F_{34} = 2.1506$, $\theta_4 = -0.4491$, which is what a full re-solve gives. Region A 's seven-variable elimination was done once and not again.

On seventeen variables none of this is worth the bookkeeping. The point is the structure: what changed inside B was paid for inside B and at the two ports, and the whole of A was reused unread. That structure is what scales.

8.7 Second worked example: two halls and a wall

Region B of the electrical example said nothing about the angle at its own port, because nothing in it reached the reference except the tie. A thermal region usually has a reservoir of its own, and its message is then richer. Two data halls stand side by side and share a wall. Each is the network of Figure 8.5: supply air enters a cold aisle from a supply reservoir, passes two racks whose exhausts are heated by the racks' loads, collects in a hot aisle, and returns through a

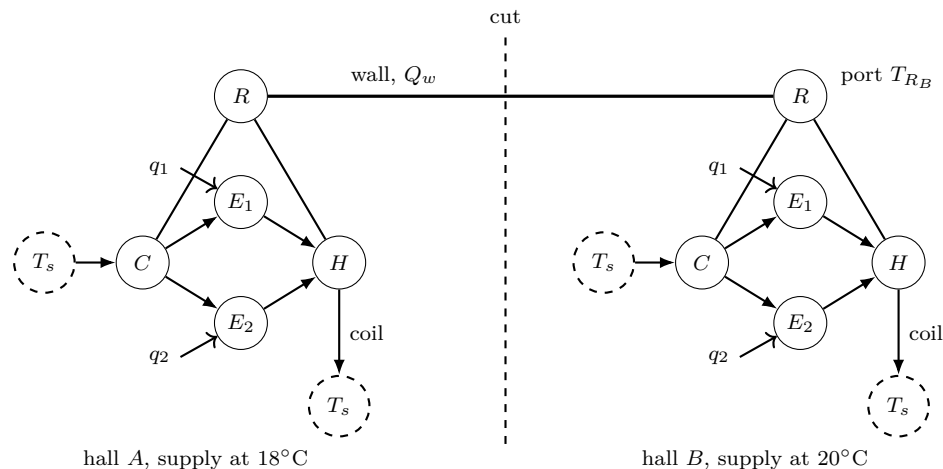


Figure 8.5: Two data halls sharing a wall. In each, supply air (reservoir T_s) enters the cold aisle C , is heated by the racks' loads at the exhausts E_1 , E_2 , collects in the hot aisle H and returns through the cooling coil; the room air R exchanges with both aisles. The wall joins the two room-air nodes and is the cut; its port pair is the wall heat Q_w and hall B 's room-air temperature.

cooling coil to the supply; a room-air node exchanges with both aisles. The two room-air nodes are joined through the wall, of conductance 0.06 kilowatts per kelvin, and the wall is the cut edge. Hall A 's supply is at 18 degrees and its racks draw 20 ± 3 kilowatts each; hall B 's supply is at 20 and its racks draw 25 ± 4 . Physics rows have width ten watts. Thermometers of accuracy half a degree read hall A 's first exhaust and hot aisle and hall B 's hot aisle, at 36.2, 26.1 and 29.0 degrees, a little off the nominal 35.4, 25.7 and 29.6. The model has thirty-one unknowns and thirty-four factors. Every number is from `ch08_halls.py`.

Exactness. The port pair is the wall heat Q_w and hall B 's room-air temperature T_{RB} , with the wall closure assigned to hall A , which it reads through T_{RA} . The Markov graph has no edge between the halls' interiors. The full posterior has $Q_w = -0.157 \pm 0.029$ kilowatts, a sixth of a kilowatt flowing from the warmer hall B into A , and $T_{RB} = 28.39 \pm 0.40$ degrees. The reduced port system, the sum of the two halls' messages, gives the same two numbers to 6×10^{-11} and their covariance to 5×10^{-14} , and back-substitution into hall B reproduces its fourteen interior marginals to 3×10^{-10} . Table 8.1 collects the numbers.

The message is a Thevenin equivalent. Hall B has its own supply air, so its temperatures are defined without the wall, and its message constrains the port temperature as well as the port heat. Read as the conditional of the port temperature given the wall heat, it is $\mathbb{E}[T_{RB} \mid Q_w] = 28.59 + 1.298 Q_w$ with a conditional spread of 0.43 degrees: an equivalent temperature and an equivalent resistance, with an error bar on the first. The resistance is not quite the network's. Kron reduction of hall B 's conductance matrix at the room-air node, with the supply grounded, gives 0.698 kilowatts per kelvin, a resistance of 1.433 kelvin per kilowatt, and removing hall B 's thermometer from its message recovers that slope exactly, 1.4326, with the equivalent temperature 29.04 known only to 1.02 degrees. The thermometer has done two things to the message. It has narrowed the equivalent temperature from 1.02 to 0.43 degrees,

Table 8.1: The two halls: the port posterior from the full model and from the reduced port system, and hall B ’s message read as a Thevenin equivalent, $\mathbb{E}[T_{R_B} | Q_w] = T_{\text{eq}} + r_{\text{eq}}Q_w$, with and without the thermometer in hall B , against the Kron reduction of hall B ’s conductance matrix.

	full model	reduced port system
Q_w [kW]	-0.1571 ± 0.0288	-0.1571 ± 0.0288
T_{R_B} [°C]	28.386 ± 0.401	28.386 ± 0.401
hall B ’s message	T_{eq} [°C]	r_{eq} [K/kW]
with its thermometer	28.59 ± 0.43	1.298
without its thermometer	29.04 ± 1.02	1.4326
Kron reduction at R_B	–	1.4326

and it has stiffened the apparent resistance to 1.30, because a hot aisle held near its reading pushes back against a change in the wall heat more than the bare network would. The message is the equivalent network with the region’s readings folded in, which is more than Kron reduction gives and different from it; Chapter 17 finds the same in a machine room.

Reuse. Raise hall A ’s exhaust reading by two degrees, to 38.2. Hall A ’s racks move, from 21.04 to 23.92 and from 20.67 to 19.65 kilowatts; hall B ’s message does not change at all; and solving the two-variable port system with B ’s old message gives $Q_w = -0.1396$ and $T_{R_B} = 28.408$, the full re-solve’s values.

8.8 Discrete variables by region

A region with d_r discrete variables has 2^{d_r} branches, and its message is a mixture of 2^{d_r} Gaussians on its ports, each with a weight from its branch’s predictive density (Proposition 7.1). Regions combine by multiplying mixtures, and the product of mixtures with c_1 and c_2 components has c_1c_2 ; across m regions with $d = \sum_r d_r$ discrete variables in all, the port posterior has $\prod_r 2^{d_r} = 2^d$ components, which is the full enumeration again. Region structure has not reduced the count. What it has done is localize the expensive part: each region’s 2^{d_r} branches are eliminated on the region’s own interior, once, and only the small mixtures on the ports are multiplied. When d_r is a handful per region that is exact and affordable; when it is not, pruning components by weight and sampling the remainder are the subject of Chapter 9, and Chapter 15 applies them to feeder outages by the hundred.

The two-region network shows the count at a size small enough to list. Make three feeders uncertain, each out with probability 0.05: feeder 2–3 in region A , and feeders 4–5 and 5–6 in region B . Region A has two branches, region B four, the network eight. Each branch is linear in the loads, so its weight is its prior times the predictive density of the three meters (Proposition 7.1), and Table 8.2 lists them, from `ch08_messages.py`. Before the meters the prior needs four components to reach ninety-nine percent of the weight: all feeders in, at 0.857, and each single outage, at 0.045. The prior mixture on the port angle, drawn in Figure 8.6, is visibly spread: the outage of feeder 2–3 moves θ_4 from -0.443 to -0.500 , and the loss of both feeders at bus 5, which de-energizes it and drops its load, moves it to -0.277 .

After the meters one component carries 0.99904 of the weight. The meter on feeder 5–6

Table 8.2: The two-region network with three uncertain feeders: the eight branches, their prior probabilities, the predictive density of the three meter readings under each, the posterior, and the port angle θ_4 before and after the readings. The two branches that island bus 5 shed its load.

feeders out	prior	predictive density	posterior	θ_4 prior	θ_4 posterior
none	0.857	1.2×10^1	0.99904	-0.443 ± 0.060	-0.4490 ± 0.0095
2–3	0.045	2.2×10^{-1}	0.00096	-0.500 ± 0.072	-0.5100 ± 0.0204
4–5	0.045	6.9×10^{-6}	$< 10^{-8}$	-0.443 ± 0.060	-0.4484 ± 0.0095
5–6	0.045	3.6×10^{-11}	$< 10^{-8}$	-0.443 ± 0.060	-0.4490 ± 0.0095
2–3, 4–5	0.0024	1.3×10^{-7}	$< 10^{-8}$	-0.500 ± 0.072	-0.5091 ± 0.0204
2–3, 5–6	0.0024	6.5×10^{-13}	$< 10^{-8}$	-0.500 ± 0.072	-0.5100 ± 0.0204
4–5, 5–6	0.0024	4.7×10^{-14}	$< 10^{-8}$	-0.277 ± 0.049	-0.4483 ± 0.0095
all three	0.0001	8.5×10^{-16}	$< 10^{-8}$	-0.300 ± 0.060	-0.5090 ± 0.0204

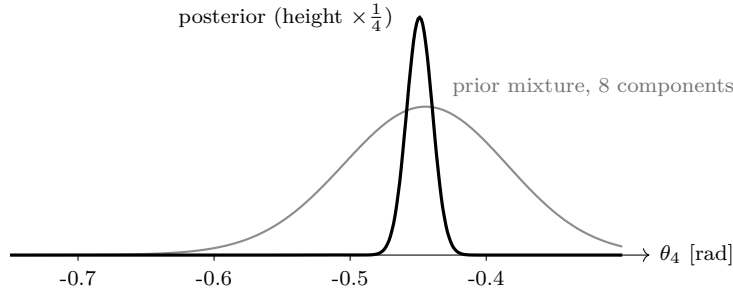


Figure 8.6: The port angle θ_4 of the two-region network with three uncertain feeders. Grey: the prior mixture over the eight branches, with four components carrying ninety-nine percent of the weight. Black: the posterior after the three meters, one component, drawn at a quarter of its height.

reads -0.15 , and a branch with that feeder out predicts a reading of zero to within the meter's accuracy; its predictive density is 10^{-11} , and every branch with feeder 5–6 out is gone. The outage of feeder 2–3 keeps 0.00096, which is the 0.001 that Chapter 9 finds for region A 's mixture message on its own: the global enumeration and the region's message agree. The work divides as the text above said. Region A 's interior is eliminated once for each of its two branches and region B 's once for each of its four, six interior eliminations, and then eight two-variable port systems are combined; the global route solves eight full models. With m regions of b branches each that is mb interior eliminations against b^m full solves, while the port combinations remain b^m unless the weights prune them, which here they do to one.

8.9 In practice

Cut at a port pair, and assign each cut closure to one side. A region's factors are those that read only its interior and its ports. The closure of a cut edge reads potentials on both sides; give it to the side that owns the near potential, and keep the far potential as the port. Getting this wrong puts a factor in both regions or in neither, and the reduced system is then wrong without any error being raised.

Check exactness once. On a representative case, solve the full model and the reduced port system and compare to machine precision, as both examples of this chapter do. A discrepancy at the eighth digit is a factor assigned to the wrong region, not rounding.

Hold the factorizations. The value of the region message is reuse, and reuse needs each region's interior factorization kept between questions. A back-substitution is then one solve against a factor already held; a change in one region is that region's elimination and the port solve.

Read the message physically. A region without a reservoir sends a message on its port flow alone, its total with an error bar. A region with a reservoir sends a Thevenin equivalent: an equivalent potential with an error bar and an equivalent resistance. If the message has neither form, a factor is missing or misassigned.

Do not replace the message by a Kron reduction. The Kron reduction of the region's conductance matrix is the message with the region's sensors and priors removed. It is right for planning with no data and wrong for estimation with data; the halls' thermometer changed the equivalent resistance by ten percent and the equivalent temperature's spread by more than half.

Keep discrete branches inside their regions. A region's branches are eliminated on its own interior, once; only the small mixtures on the ports are combined. Weight each branch by its predictive density, not by its soft-row evidence.

8.10 What is missing

Everything in this chapter was exact and everything was Gaussian per branch. Chapter 9 asks what to do when the exact route is too expensive: when the treewidth is large, when the branch count is large, or when a factor is not Gaussian and its message has no closed form. Chapter 10 then puts the exact route, the approximate route and plain sampling on one problem and counts what each costs in physics solves. And the reuse of §8.5 was stated for a change in one region; Chapter 11 treats the change that matters most in operation, one new sensor reading at a time, and shows it costs even less than a region message.

Notes and further reading

The sum-product algorithm on factor graphs, with the message equations (8.1)–(8.2) and the proof of exactness on trees, is Kschischang, Frey and Loeliger's [54]. The junction tree, the running intersection property and exact local propagation on loopy graphs are Lauritzen and Spiegelhalter's [57]; Koller and Friedman [50] give the correspondence between junction trees and elimination orders in full. For Gaussian models, Rue and Held [88] treat the same computation as sparse Cholesky, and the identification of the elimination tree with the junction tree is standard in both literatures.

Eliminating the interior of a subsystem onto its boundary is substructuring in structural mechanics and nested dissection in sparse direct methods [17, 27]; its iterative descendants are the domain decomposition methods of Toselli and Widlund [103]. In electrical networks the same

Schur complement is Kron reduction [53], given its modern graph-theoretic treatment by Dörfler and Bullo [20], and the reduced network with equivalent injections is Ward's equivalent [107], still the standard external-system model in power-system analysis. Proposition 8.2 is Kron reduction of the posterior precision rather than of the susceptance matrix; the book's contribution is to read it as a message on the port separator of Proposition 5.3 and to carry the priors' and sensors' information along with it, so that the equivalent has error bars. Distributed power-system state estimation by message passing between areas [15] is the closest published instance of §8.4 in a power-system setting.

In water networks, Han, Eguchi, Mehrotra and Venkatasubramanian [36] estimate a damaged network component by component, which is the elimination of each biconnected component onto its articulation interface, and the block-Schur marginal of Proposition 8.2 is exact there whichever interface is chosen; what the interface decides is whether the interior factorizes (Chapter 5, Notes). Irofti, Romero-Ben, Stoican and Puig [39] tie the snapshots of a time window together with a persistence factor on the leak; a joint model of T network copies sharing one leak variable is the same construction, and its junction tree has the shared variable as every separator. The reuse of one factorization across many hypotheses in §8.5 is what makes a leak search affordable: a score test at the leak-free optimum costs one sparse solve per candidate junction against the cached factorization and shortlists the few hypotheses worth an exact evidence. Dellaert and Kaess [19] present the elimination algorithm, the Bayes tree and incremental re-elimination for the same sparse Gaussian computations in the language of robotics.

Summary

- On a tree, two sweeps of sum-product messages give every marginal exactly. Gaussian messages are precision-information pairs; a factor-to-variable message is a small Schur complement.
- On a loopy graph, exact inference runs on a junction tree of clusters, which is an elimination order made explicit; for Gaussian models it is the sparse Cholesky factorization.
- Physical regions with their ports as separators are a junction tree. A region's message is the Schur complement of its interior in its own precision: the region as its neighbors see it, an equivalent network with error bars. The reduced port system is exact and back-substitution recovers every interior exactly.
- The message depends only on the region's own factors. A change inside one region costs that region and the port solve; every other region is reused.
- On the two-triangle network the reduced system agrees with the full model to fourteen decimals; region B 's message is its total load 2.10 ± 0.35 and nothing about the angle, which is exactness at a cut with an error bar; an interior meter moves B 's loads and leaves its message untouched.
- With three uncertain feeders the two-region network has eight branches; four carry ninety-nine percent of the prior and one carries 0.999 of the posterior. Regions eliminate their branches on their own interiors, mb eliminations for m regions of b branches, not b^m .
- On two data halls sharing a wall, a hall with its own reservoir sends a Thevenin equivalent: an equivalent temperature with an error bar and an equivalent resistance. Without the hall's thermometer the resistance is the Kron reduction, 1.433 kelvin per kilowatt; with it, 1.30, and the equivalent temperature's spread falls from 1.02 to 0.43 degrees.

Exercises

Exercise 8.1. Write out the sum-product messages for the chain of Figure 2.1 rooted at G , with the priors and sensor of Figure 3.1 and hard physics, and show that they reproduce the second column of Table 3.2. Which message is the Schur complement of which block?

Exercise 8.2. Construct a junction tree for the DC triangle in row-per-factor form (Figure 2.3) from an elimination order of width two, verify the running intersection property, and identify the separators. Then do the same with the availability a_{23} added and say which cluster holds the discrete variable.

Exercise 8.3. In the worked example, add a second cross-tie from bus 6 to bus 1. The cut now has two edges and four ports. Recompute region B 's message and show that its precision on the angles is no longer zero; read off the equivalent susceptance between the two port buses and compare it with the Kron reduction of the susceptance matrix of region B alone.

Exercise 8.4. Prove the claim of §8.5 for the meter on F_{56} : show that, with B 's only connection to the reference through the tie, the tie flow is a function of the sum of B 's loads alone, and hence that any interior meter whose reading is a combination of loads with zero coefficient sum leaves the message unchanged. Find an interior meter that does change it.

Exercise 8.5. Give region B two uncertain feeders, so that it has four branches, and region A one, so that it has two. Compute the eight-component mixture on the ports, its weights, and the number of components that carry more than 99 percent of the weight. At what number of uncertain feeders per region does the mixture stop being enumerable on your machine?

Solutions to selected exercises

Exercise 8.1. With hard physics and one sensor on T_2 , the only row that ties the uncertain quantities to the reading is $T_2 = T_a + G/hA$; the other rows determine T_1 and the flows, which nothing reads. The graph is then a star, one physics factor on (T_2, G, T_a) with three leaves: the prior on G , with information pair $(\lambda, \eta) = (0.0025, 0.25)$; the prior on T_a , $(0.111, 2.222)$; and the sensor on T_2 , $(4, 288)$. Each leaf sends itself. The physics factor's message to G integrates T_2 and T_a against their incoming messages, $T_2 \sim \mathcal{N}(72, 0.5^2)$ and $T_a \sim \mathcal{N}(20, 3^2)$: then $G/hA = T_2 - T_a \sim \mathcal{N}(52, 9.25)$, so $G \sim \mathcal{N}(104, 6.083^2)$, the pair $(0.0270, 2.811)$. The marginal of G is the product of its two incoming messages, precision $0.0025 + 0.0270 = 0.0295$ and mean $(0.25 + 2.811)/0.0295 = 103.66$, a spread of 5.82. The message to T_a is $T_a = T_2 - G/2$ with $G/2 \sim \mathcal{N}(50, 10^2)$ from G 's prior message, that is $\mathcal{N}(22, 10.01^2)$, and the marginal of T_a is 20.16 ± 2.87 . Both are the second column of Table 3.2. The message to G is the Schur complement of the (T_2, T_a) block in the precision of the physics factor times the messages from T_2 and T_a : the two variables are eliminated onto G , which is equation (8.2) for Gaussians.

Exercise 8.3. With the second tie, region B has two port buses, 4 and 6, and four port variables: the tie flows F_{34} into bus 4 and F_{61} out of bus 6, and the two angles. Kron reduction of B 's own susceptance matrix, the three feeders 4–5, 4–6, 5–6 of susceptance 10, onto buses 4 and 6 eliminates bus 5: the 3×3 matrix $10 \begin{pmatrix} 2 & -1 & -1 \\ -1 & 2 & -1 \\ -1 & -1 & 2 \end{pmatrix}$ loses its middle row and column through the Schur complement, leaving $\begin{pmatrix} 20 & -10 \\ -10 & 20 \end{pmatrix} - \frac{1}{20} \begin{pmatrix} 100 & 100 \\ 100 & 100 \end{pmatrix} = \begin{pmatrix} 15 & -15 \\ -15 & 15 \end{pmatrix}$. The equivalent susceptance

between the two port buses is 15: the direct feeder of 10 in parallel with the path through bus 5, two feeders of 10 in series, which is 5. Region B 's message now constrains the tie flows given the port angles, and the script finds the injections into B through its ports respond to (θ_4, θ_6) through exactly this matrix: the message's slope is the Kron-reduced susceptance, because B has no sensor and its load priors enter only the intercept. What B still cannot say is the level of its angles: the matrix has rows summing to zero, and only the tie to the reference through region A fixes the level. The message's precision on the angles is no longer zero, but it is singular along the direction that shifts both port angles together.

Exercise 8.4. With one tie, region B 's three buses have balances $F_{34} - F_{45} - F_{46} + P_4 = 0$, $F_{45} - F_{56} + P_5 = 0$ and $F_{46} + F_{56} + P_6 = 0$; their sum is $F_{34} + P_4 + P_5 + P_6 = 0$, so the tie flow is minus the sum of the loads whatever the internal flows. The message on (F_{34}, θ_4) is therefore a statement about the sum $\Sigma = P_4 + P_5 + P_6$ alone, and a meter changes it only if it changes the posterior of Σ given the port. A meter reading a combination $\sum_i c_i P_i$ with $\sum_i c_i = 0$ is, under priors of equal spread, uncorrelated with Σ a priori, since $\text{Cov}(\sum_i c_i P_i, \Sigma) = \sigma^2 \sum_i c_i = 0$, and for Gaussians uncorrelated is independent; conditioning on it leaves Σ 's distribution unchanged. The flow on feeder 5–6 is such a combination: within B , $F_{56} = (P_6 - P_5)/3$ plus a term in F_{34} that the port already fixes. The script confirms it: a meter on F_{56} changes the message by 4×10^{-12} , and a meter on $P_5 - P_6$ by 3×10^{-11} . A meter on the sum changes it completely, the tie flow the message implies moving from 2.100 ± 0.347 to 2.299 ± 0.026 ; a meter on one load, P_5 , changes it partly, to 2.199 ± 0.284 , because one load's reading is correlated with the sum.

Exercise 8.2. The first part is Figure 8.2. In the row form of Figure 2.3, with the loads as fixed injections, the order $F_{12}, F_{13}, F_{23}, \theta_2, \theta_3$ has width two, and its cliques are the three clusters of the figure, with separators $\{\theta_2, F_{23}\}$ and $\{\theta_3, F_{23}\}$. The running intersection property holds: F_{23} is in all three clusters, and each angle is in two adjacent ones. If the loads are uncertain variables, as in the triangle of Exercise 5.3, eliminate them first. P_2 forms the cluster $\{P_2, F_{12}, F_{23}\}$ and P_3 the cluster $\{P_3, F_{13}, F_{23}\}$, and each joins the cluster holding its flow through the separator of that flow and F_{23} . The width stays two, since the new clusters also have three variables, and the property still holds: F_{23} is now in all five clusters, and each load is in one. With the availability a_{23} added, the closure of feeder 2–3 becomes $F_{23} - a_{23}B(\theta_2 - \theta_3)$, and a_{23} joins the cluster that holds that row, the middle one, which becomes $\{F_{23}, \theta_2, \theta_3, a_{23}\}$. The discrete variable lives in one cluster, and every message out of that cluster is a two-component mixture: Chapter 7's branch structure, seen as a junction tree.

Exercise 8.5. This is the configuration of §8.8: feeder 2–3 uncertain in region A , and feeders 4–5 and 5–6 in region B , each out with probability 0.05. Table 8.2 lists the eight components with their weights. Before the meters, four components carry more than 99 percent of the weight; after them, one does, at 0.99904. The mixture's size is the product of the regions' branch counts, so with ℓ uncertain feeders in each of m regions it has $2^{m\ell}$ components, of which the region-wise route eliminates only $m 2^\ell$ interiors and combines the rest on the ports. Two regions of 20 uncertain feeders each already give $2^{40} \approx 10^{12}$ port combinations, past what a workstation enumerates in an afternoon. Beyond that, the components have to be pruned by weight and by the readings, as Chapter 9 does, and the mixture carried as its few heavy components.

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

The room seen from its port *exact elimination by Schur complement; a region's message is an equivalent conductance and an equivalent injection; part of a region's source never reaches its port*

`foundation_hvac/thermal_local_to_global/problems/the_room_seen_from_its_port`

Chapter 9

Approximate inference

Chapter 8 computed posteriors exactly, and said when that is affordable: when the treewidth of the factorization is small, when the number of discrete branches is small, and when every factor is Gaussian per branch. This chapter is about what to do when one of those fails. It has an unusual shape for a chapter on approximate inference, because its first and longest section is about a method that does not work on the graphs of this book. Loopy belief propagation, the standard approximate method for graphical models, fails to converge on every physical model the book has built, for a reason that is structural and worth understanding. The methods that do work are the ones that respect the structure the earlier chapters found: exact elimination within regions, approximate messages between them, and simulation inside a region that emits a compact summary to its ports. The chapter closes with the hierarchy of methods, from exact and analytical to simulation inside factors, and a rule for choosing among them.

9.1 When exact is too expensive

Three things make the exact route of Chapter 8 too expensive, and they call for different remedies.

Treewidth. The largest cluster of the junction tree, hence the largest dense block of the factorization, is too big. For the nearly-planar networks of this book this rarely happens in the Gaussian part; it happens for three-dimensional meshes and for factorizations chosen badly. The remedy is a better partition (Chapter 18) or an iterative solver in place of a direct one.

Branches. The number of discrete configurations is 2^k with k in the dozens or hundreds, as when every feeder of a network may be out. The remedy is to prune branches by their evidence, to exploit separation between discrete variables, and to sample the rest.

Non-Gaussian factors. A factor whose message has no closed form: a bounded prior, a saturating closure that the active-set loop cannot resolve, a region whose interior physics is strongly nonlinear. The remedy is to approximate the message, either by projecting it onto a Gaussian or by representing it by samples.

What follows treats the standard approximate methods in the order a graphical-model text would, but tested on the book's models, and the test changes the conclusions.

9.2 Loopy belief propagation

The sum-product messages (8.1)–(8.2) were derived for trees. Nothing stops one from running them on a loopy graph: initialize every message, update all of them from their current neighbors, repeat, and stop when they change by less than a tolerance. This is *loopy belief propagation*. It has been extraordinarily successful in decoding and in computer vision, where the graphs are loopy, the factors are weak, and approximate marginals are what is wanted. Its properties on Gaussian models are known precisely.

Proposition 9.1 (Gaussian loopy propagation). *On a Gaussian model with precision Λ , if loopy belief propagation converges, the means it returns are exact. Convergence is not guaranteed. A sufficient condition is walk-summability: the spectral radius of the matrix of absolute partial correlations, $|\mathbf{R}|$ with $\mathbf{R} = \mathbf{I} - \mathbf{D}^{-1/2}\Lambda\mathbf{D}^{-1/2}$ and $\mathbf{D} = \text{diag}(\Lambda)$, is less than one. When it converges, the variances it returns are sums over a subset of the walks that the exact variances sum over, and are wrong in general; for models whose partial correlations are all non-negative they are underestimates.*

Proof of the claim about the means. Write the message from i to j as a precision P_{ij} and an information m_{ij} , and define for each edge the *cavity* precision and mean of i without j , $P_{i\setminus j} = \Lambda_{ii} + \sum_{k \neq j} P_{ki}$ and $\mu_{i\setminus j} = (\eta_i + \sum_{k \neq j} m_{ki})/P_{i\setminus j}$. The iteration sets $P_{ij} = -\Lambda_{ij}^2/P_{i\setminus j}$ and $m_{ij} = -\Lambda_{ij}\mu_{i\setminus j}$, and the belief of i has precision $P_i = \Lambda_{ii} + \sum_k P_{ki}$ and mean $\mu_i = (\eta_i + \sum_k m_{ki})/P_i$. At a fixed point, rearrange the belief of i : $\eta_i = P_i\mu_i - \sum_k m_{ki} = \Lambda_{ii}\mu_i + \sum_k (P_{ki}\mu_i + \Lambda_{ki}\mu_{k\setminus i})$. So the i -th row of $\Lambda\mu = \eta$ holds if, for every edge, $P_{ki}\mu_i + \Lambda_{ki}\mu_{k\setminus i} = \Lambda_{ik}\mu_k$. Write $a = \Lambda_{ik}$, $p = P_{i\setminus k}$, $q = P_{k\setminus i}$, $u = \mu_{i\setminus k}$, $v = \mu_{k\setminus i}$. The beliefs are $\mu_i = (pu - av)/(p - a^2/q) = q(pu - av)/(pq - a^2)$ and, by symmetry, $\mu_k = p(qv - au)/(pq - a^2)$. Then $P_{ki}\mu_i + av = -\frac{a^2}{q} \frac{q(pu - av)}{pq - a^2} + av = \frac{ap(qv - au)}{pq - a^2} = a\mu_k$, which is the identity. $\square$

The convergence condition and the characterization of the variances are Malioutov, Johnson and Willsky's walk-sum analysis, which expands the covariance as a sum over walks in the graph; the proof is longer than this book needs, and the notes give it. What the proof above shows is why a converged iteration is worth having: its means are the exact ones, whatever the loops. The condition has a physical reading. The partial correlation between two variables that share a factor measures how tightly that factor ties them given everything else. Walk-summability says the ties around every cycle must be weak enough, in a precise sense, that the influence circulating around the cycle dies out. A graph of weak, noisy pairwise factors, such as a decoding graph, satisfies it. A graph of tight physics does not.

9.2.1 On the book's models

Run Gaussian loopy propagation, in the standard pairwise form on the posterior precision, on three of the book's models: the soft processor heat path with two sensors, the DC triangle with uncertain loads and one meter, and the two-region network of Chapter 8. Every number is from the script `ch09_approximate.py` in the book's `scripts` directory. Table 9.1 gives the result: the spectral radius that decides walk-summability, and whether the iteration converged, undamped and with damping of one half.

Not one of the physical graphs is walk-summable, and on not one does the iteration converge, damped or not. The only convergent cases are the two-variable reductions, which are trees, on which the messages are exact by construction. Even the angles-only nodal form of the two-region

Table 9.1: Gaussian loopy propagation on the book’s models. $\rho(|\mathbf{R}|)$ is the walk-summability radius; below one guarantees convergence. Row form is the row-per-factor graph; nodal form has the flows eliminated; the last block has the loads eliminated as well. Physics width 0.01.

Model	Form	unknowns	$\rho(\mathbf{R})$	converged
processor heat path	row	6	1.64	no, with or without damping
DC triangle	row	7	1.70	no
two-region network	row	17	2.18	no
processor heat path	nodal	4	1.80	no
DC triangle	nodal	4	1.50	no
two-region network	nodal	10	2.14	no
processor heat path	temperatures only	2	0.20	yes, exact (a tree)
DC triangle	angles only	2	0.18	yes, exact (a tree)
two-region network	angles only	5	1.01	no

network, five variables joined in two triangles and a tie, sits just above the threshold and does not converge.

Figure 9.1 follows the iteration sweep by sweep; the numbers are from the chapter’s second script, `ch09_more.py`. On the triangle in row form the error of the belief means is 1.2 after the first sweep, 2.0 after the second and 1.8 after the thirtieth: the iteration neither settles nor explodes, it wanders at an error of order one hundred percent, which is worse than reporting the priors. On the chain reduced to its two temperatures and on the two-region network reduced to its port pair, both trees, the first sweep is exact to 10^{-11} and 10^{-14} , and nothing moves after it. The difference between the solid curve and the other two is only whether the tight cycles were eliminated before the messages were passed.

Loosening the physics does not rescue it. Sweep the physics width on the triangle in row form from 0.01 to 2 per unit, the last being physics so loose as to be nearly absent: the radius falls from 1.70 to 1.14 and never reaches one, and the iteration never converges. The reason is visible in the structure of a physics row. The partial correlation between two variables is $-\Lambda_{ij}/\sqrt{\Lambda_{ii}\Lambda_{jj}}$, and in the row form every entry of Λ is a sum over the few rows that read both variables. A physics variable sits in two or three rows, a flow in one closure and two balances, an angle in the closures of its feeders, and nothing else; only the variables that carry a prior or a sensor have anything on their diagonal that the physics did not put there. So the tie between two physics variables that share a row is of order $1/\sqrt{d_i d_j}$, with d_i, d_j the number of rows each sits in: about one half. Every variable has several such ties, the row sums of $|\mathbf{R}|$ exceed one, and so does its spectral radius. Nor does the physics width matter: scaling every physics row by the same factor scales Λ_{ij} , Λ_{ii} and Λ_{jj} together and leaves the partial correlations where they were, which is why the sweep moved the radius only as far as the priors and sensors, which did not scale, could move it. Eliminating the flows folds rows together and changes the ties a little, but a balance at a bus still ties that bus’s angle to each neighbor’s as tightly as the susceptances say, and the network’s own cycles remain.

One pair shows the mechanism in numbers. The flow on feeder 1–2 and the angle at bus 2 share the closure c_{12} and nothing else, and each sits in two physics rows. Without the meter their partial correlation is -0.500 at every width, which is $-1/\sqrt{2 \cdot 2}$. The meter on F_{12} adds to that variable’s diagonal a weight the physics does not scale, and dilutes the tie to -0.471 at a

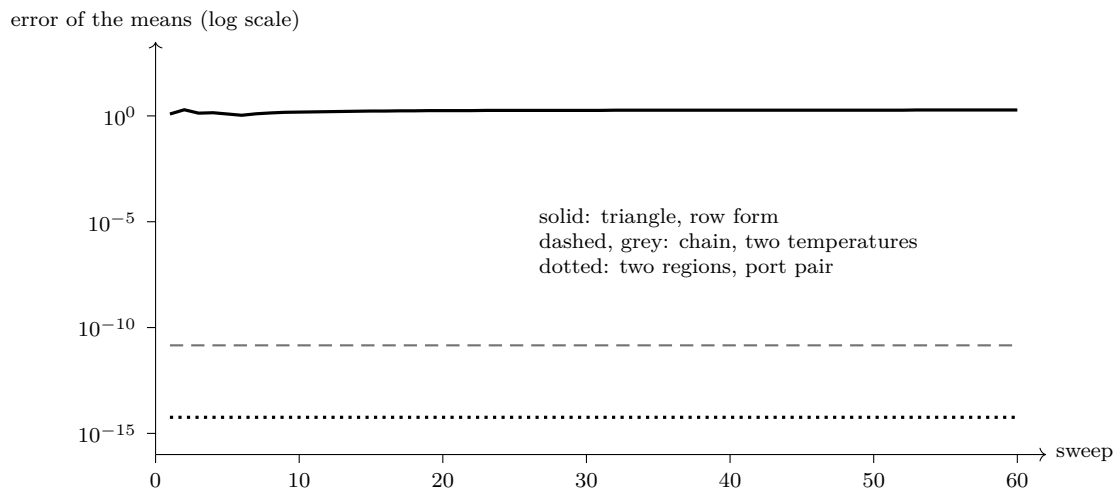


Figure 9.1: Gaussian belief propagation sweep by sweep: the largest error of the belief means against the exact posterior, on a logarithmic scale. Solid: the DC triangle in row form, radius 1.70; the error wanders between one and two, a hundred to two hundred percent, and never settles. Dashed: the chain reduced to its two temperatures, radius 0.20. Dotted: the two-region network reduced to its port pair, radius 0.29. Both reductions are trees and are exact after one sweep.

width of 0.01 and to -0.001 at a width of ten; but the ties that no sensor touches stay at one half, and the radius of the whole never falls below 1.13.

Principle 9.1. *Loopy belief propagation is the wrong tool for a physical graph. Each physics variable is tied to a few others by factors that nothing dilutes, the partial correlations around every physical cycle are of order one half with several per variable, walk-summability fails, and the iteration does not converge. This is not a matter of tuning the widths; it is what conservation and closure do to the graph.*

The remedy is the one Chapter 8 already gave. Do not pass messages between variables around the cycles; eliminate the cycles. Group the variables into regions whose interiors contain the tight cycles, eliminate each interior exactly, and pass messages between regions. If the region graph is a tree, as it is for two regions or for a radial arrangement of regions, the region messages are exact and no iteration is needed. If the region graph has cycles, the messages between regions are loopy propagation at the region level, and the question of convergence returns, but on a graph whose factors are the region messages: dense on the ports, and, because each region's interior has absorbed its own tight ties, much weaker between regions than within them. Whether that graph is walk-summable is a property of the partition, and Chapter 18 measures it. The reader should expect it to hold when regions are large and ports are few, and to fail when the partition is fine.

9.3 Variational methods and expectation propagation

Loopy propagation is one of a family of methods that replace an intractable posterior by the nearest member of a tractable family. The family is chosen for tractability, a Gaussian or a product of independent factors, and *nearest* is measured by a divergence.

Variational inference minimizes the divergence from the approximation to the posterior over a family that is usually a product of independent factors, one per variable or per block. It always converges, to a local optimum, and it always returns a distribution that is too narrow: the divergence it minimizes penalizes the approximation for putting mass where the posterior has none, so the approximation tucks itself inside the posterior's bulk. For a Gaussian posterior with correlated variables, a product-form approximation gets the means right and the variances too small by a factor that grows with the correlation, which for the ridges of Chapter 3 is a large factor. The Laplace approximation of §6.4 is also a member of this family, with the full Gaussian as the tractable class and the matching done at the mode rather than by a divergence; on the book's models it has served better than either, because a full Gaussian at the mode captures exactly the correlations that a product form throws away.

The size of the factor has a closed form for a Gaussian posterior.

Proposition 9.2 (Mean field on a Gaussian). *Let the posterior be $\mathcal{N}(\boldsymbol{\mu}, \boldsymbol{\Lambda}^{-1})$. The product of independent Gaussians $q = \prod_i \mathcal{N}(m_i, s_i^2)$ that minimizes the divergence $\text{KL}(q \| p)$ has $m_i = \mu_i$ and $s_i^2 = 1/\boldsymbol{\Lambda}_{ii}$. Since $1/\boldsymbol{\Lambda}_{ii} \leq (\boldsymbol{\Lambda}^{-1})_{ii}$, with the ratio $1 - R_i^2$ where R_i^2 is the squared multiple correlation of variable i with all the others, mean field never overstates a variance and understates it by that factor.*

Proof. Up to a constant, $\text{KL}(q \| p) = \frac{1}{2} [\sum_i \boldsymbol{\Lambda}_{ii} s_i^2 + (\mathbf{m} - \boldsymbol{\mu})^\top \boldsymbol{\Lambda} (\mathbf{m} - \boldsymbol{\mu}) - \sum_i \log s_i^2]$, since the expectation of $\frac{1}{2} (\mathbf{z} - \boldsymbol{\mu})^\top \boldsymbol{\Lambda} (\mathbf{z} - \boldsymbol{\mu})$ under a product of Gaussians contributes only the diagonal of $\boldsymbol{\Lambda}$ from the variances. The quadratic form is minimized at $\mathbf{m} = \boldsymbol{\mu}$; setting the derivative in s_i^2 to zero gives $\boldsymbol{\Lambda}_{ii} = 1/s_i^2$. And $1/\boldsymbol{\Lambda}_{ii}$ is the conditional variance of z_i given every other variable, by Proposition 6.5, while $(\boldsymbol{\Lambda}^{-1})_{ii}$ is its marginal variance; conditioning on correlated variables removes the fraction R_i^2 of the variance. $\square$

On the chain after one reading the two inputs are correlated at -0.985 . Mean field reports the source to ± 1.00 watts and the inlet temperature to ± 0.49 degrees, against the exact 5.82 and 2.87: the factor 0.172 on each, which Figure 9.2 draws. On all six variables of the soft chain it is far worse. Every physics variable is pinned by its rows to within the physics width once the others are fixed, so the conditional variance of each is of the order of that width, and mean field reports the source to ± 0.010 watts, six hundred times too narrow. Mean field on a physical graph in row form measures the physics widths and nothing else.

Expectation propagation keeps the message-passing structure of sum-product and replaces each message that has no closed form by the Gaussian that matches its first two moments, computed against the current approximation of everything else. It is the natural extension of the Gaussian machinery to the non-Gaussian factors of Chapter 7: a truncated prior, a discrete availability, a saturating closure each become a Gaussian message that is refined in place as the rest of the posterior sharpens. On a tree of regions it is exact for the Gaussian factors and approximate only at the non-Gaussian ones, and its fixed points are often accurate where variational inference is not, because moment matching does not tuck. Its cost is that it can fail to converge, and that the moment-matched Gaussian of a bimodal message is the mixture mean and variance that §7.2.1 showed to be a value no branch believes. §9.4.1 makes that precise for a region message.

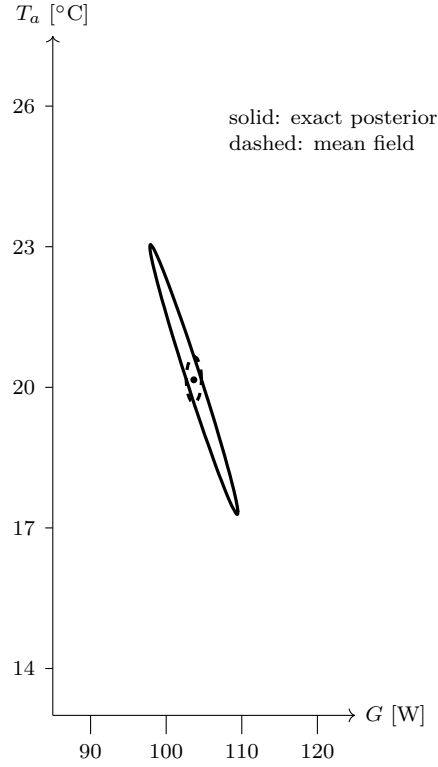


Figure 9.2: The chain’s posterior over the source and the inlet temperature after one reading (solid) and the mean-field approximation to it (dashed), both at one standard deviation. The exact posterior is a ridge at a correlation of -0.985 ; mean field is the axis-aligned ellipse that fits inside it, too narrow in each coordinate by $\sqrt{1 - 0.985^2} = 0.172$.

9.4 Simulation inside a region

The most useful approximate method for a physical system is not a graphical-model method at all. It is to run an ordinary physical simulation, or an ordinary Monte Carlo, inside one region, and to emit the result as a message on the region’s ports.

Take a region whose interior is expensive: nonlinear closures that need a Newton solve, a dozen discrete failure states, weather uncertainty that enters through many parameters at once. Its message to the rest of the system, Proposition 8.2, is the marginal of its factors over its interior, a function of the ports alone. Compute it by sampling: draw the region’s uncertain inputs from their priors N times; for each draw, solve the region with the ports as free boundary variables, which for a linear-Gaussian interior conditional on the draw gives a Gaussian message on the ports by the Schur complement, and for a nonlinear interior gives a Laplace message at the solved mode. The region’s message is then the equal-weight mixture of the N Gaussian components,

$$m_r(S) \approx \frac{1}{N} \sum_{i=1}^N \mathcal{N}(S; \boldsymbol{\mu}_S^{(i)}, \boldsymbol{\Sigma}_S^{(i)}), \quad (9.1)$$

a *particle message* whose particles are Gaussians. Compress it if the rest of the system wants a Gaussian, by moment matching; keep it as a mixture if it is multimodal; keep a few components

with the most weight if it is nearly so.

Three things make this attractive. The samples are drawn once per region and reused for every query the rest of the system puts to that region, because the message is a function of the ports and the queries change only what is combined with it. The expensive solves happen inside the region, on the region's own variables, with the region's own sparse structure, and the number of solves is N times the number of regions, not N times the number of global scenarios. And nothing about the region's interior needs to be Gaussian, linear or even differentiable, so long as it can be solved; the framework's assumptions apply to the message, not to what produced it. This is the sense in which the framework does not replace conventional simulation but organizes it: a region can be a legacy simulator, and its output becomes a factor. Chapter 10 counts what this costs against global sampling.

9.4.1 What a mixture message loses when collapsed

Take region A of the two-region network and make feeder 2–3 uncertain, out with prior probability 0.05. Region A 's message on its ports (F_{34}, θ_4) is a two-component mixture, one Gaussian per branch, weighted by the branch's evidence from the factors inside A , which include the meters on F_{12} and F_{34} , corrected for the physics determinant as Proposition 7.1 requires. The script computes both components. On the angle θ_4 they are -0.4490 ± 0.0096 with weight 0.999 and -0.5099 ± 0.0205 with weight 0.001: the meters inside A have all but ruled the outage out, and the two components are three standard deviations apart. Collapsing the mixture to one Gaussian by moment matching gives -0.4491 ± 0.0098 , which is the dominant component with its spread inflated by two percent to cover the one-in-a-thousand chance of the other. That is a safe collapse: one component dominates, and the inflation is the honest price of the residual doubt. Had the weights been comparable, as they were at the crossover reading of §7.2.1, the collapsed Gaussian would have sat between two modes with a spread that is mostly their separation, and the rest of the system would have been told a falsehood. The rule is the one Chapter 7 stated: collapse when one component carries nearly all the weight; otherwise keep the components.

9.4.2 Worked example: a chilled-water plant as a simulated region

Take plant 1 of the chilled-water example of Chapter 10 as a region. Its interior holds three chiller ratings and a pump limit, its port is the cooling it delivers to the hall, S_1 , and with the wet bulb fixed its message is the distribution of S_1 . That message can be computed exactly on a fine grid, which is what makes the plant a good test: simulate it with N draws, emit the draws as a particle message, and compare both the particles and their moment-matched Gaussian with the exact message. The hall combines two such messages, one per plant, and asks for the probability of a shortfall, $\mathbb{P}(S_1 + S_2 < 2,100)$. Every number is from the script `ch09_region.py`.

At the heat-wave wet bulb of 26.5°C the message is nearly Gaussian, with skewness -0.08 . The Gaussian collapse gives a shortfall probability of 0.563 against the exact 0.557, one percent off, and particle messages need about 5,000 draws each to do as well. On a mild afternoon at 21°C the picture reverses. The chillers bind in 55 percent of the draws and the loop in 45, so the message is the minimum of two comparable quantities, skewed by $+0.33$, and the hall's shortfall is a tail event, with probability 0.0026. The Gaussian collapse puts it at 0.0097, 272 percent too high: a collapsed message is right in the middle of its distribution and wrong in exactly the tail the hall asks about. The particle messages converge to the tail at the rate sampling allows, with an rms error of 24 percent of the probability at 1,000 draws and 9 percent at 5,000. Table 9.2

Table 9.2: Plant 1 as a simulated region: the hall’s probability of a shortfall from two particle messages of N draws each, as an rms error over 200 repetitions and as a percentage of the exact probability, and from the Gaussian collapse of the exact messages.

	wet bulb 26.5°C		wet bulb 21°C	
	rms error	% of $\mathbb{P}$	rms error	% of $\mathbb{P}$
exact $\mathbb{P}(\text{shortfall})$	0.557	—	0.0026	—
$N = 50$	0.058	10	0.0033	126
$N = 200$	0.032	6	0.0014	55
$N = 1,000$	0.013	2	0.0006	24
$N = 5,000$	0.006	1	0.0002	9
Gaussian collapse	+0.006	1	+0.0071	272

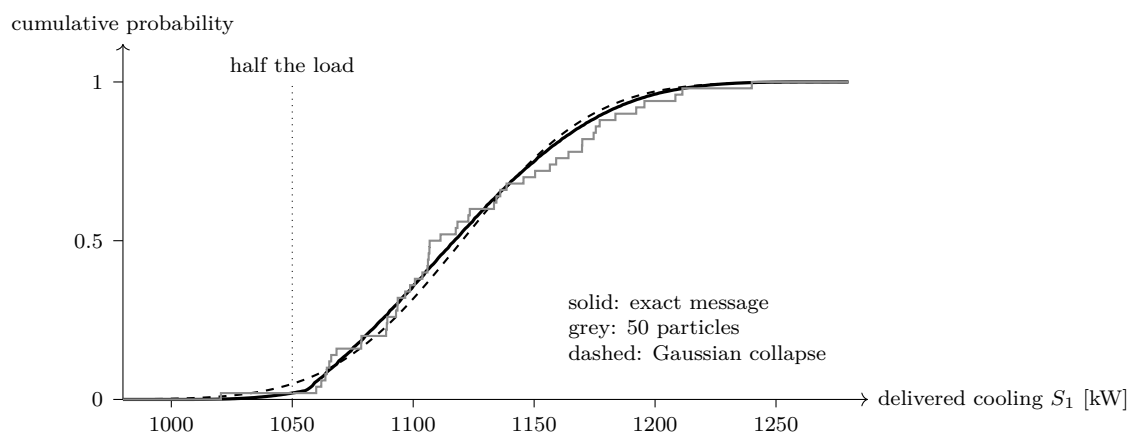


Figure 9.3: Plant 1’s message on its port at a wet bulb of 21°C, as a cumulative distribution. Solid: the exact message. Grey: a particle message of 50 draws. Dashed: the Gaussian with the same mean and spread. The exact message is skewed by the competition between the chiller and loop limits, and its lower tail, which decides whether two plants together fall below the load, is thinner than the Gaussian’s.

gives the convergence at both wet bulbs, and Figure 9.3 draws the 21°C message.

The lesson is the one §9.4 began with, now in numbers. A region whose message is near Gaussian can be collapsed safely, and simulating it is wasted effort. A region whose message is skewed, bounded or multimodal should send its particles, or the questions downstream will be answered from the wrong tail. Which case holds can be read from the message itself, from its skewness or from a comparison of its tail with the Gaussian’s, before the collapse is trusted.

Figure 9.4 sweeps the wet bulb. Above about 23.5°C, where shortfalls are common, the collapse is within a few percent, better than 1,000 particles. Below it the shortfall becomes rare and the collapse’s error grows without bound: 60 percent at 22°C, 270 at 21, 1,900 at 20, and at 19°C, where the exact probability is 5.5×10^{-6} , a factor of about eight hundred. Particles degrade too, since a rare event needs many draws to be seen at all; 1,000 draws give an rms error of 57 percent at 20°C. But they degrade as sampling does, and more draws cure them. No number of draws cures the collapse, whose error is in the shape it assumed.

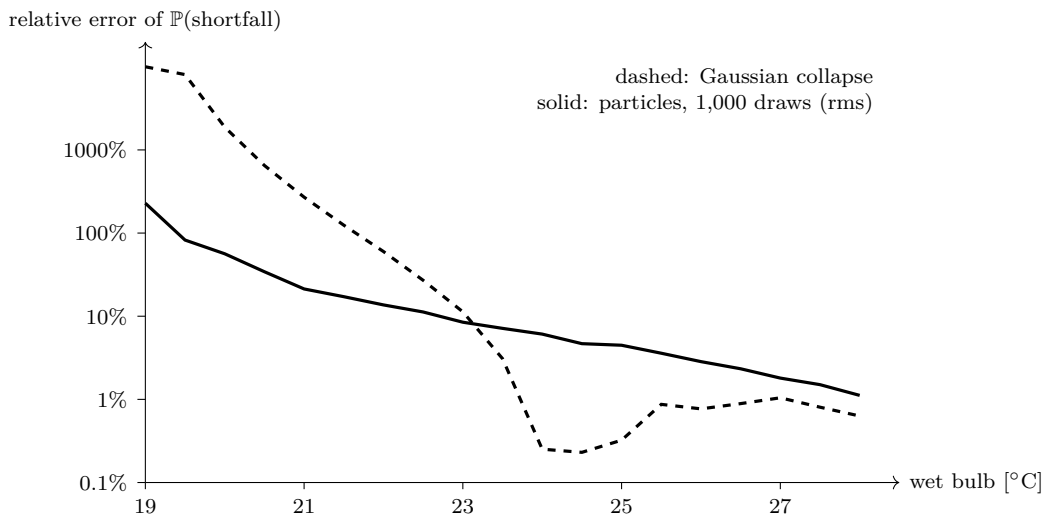


Figure 9.4: The relative error of the hall's shortfall probability across wet bulbs, on a logarithmic scale clipped at 10,000 percent. Dashed: the Gaussian collapse of the two plants' exact messages. Solid: particle messages of 1,000 draws each, rms over 100 repetitions. The collapse is better where shortfalls are common and fails without bound where they are rare.

9.5 Pruning by evidence

When the branches are many, most carry negligible weight, and the weights are known before any branch is fully processed: the evidence of a branch is one number from its factorization, and a branch's prior weight bounds its posterior weight from above whenever the evidence is bounded. Discard the branches whose weight falls below a threshold and renormalize the rest.

Proposition 9.3 (Pruning error). *If the discarded branches carry total posterior weight ϵ , then for every event the probability computed from the retained branches, renormalized, differs from the exact probability by at most ϵ .*

Proof. Write the exact posterior as $p = (1 - \epsilon)p_R + \epsilon p_D$, with p_R the retained branches' mixture renormalized and p_D the discarded branches' mixture renormalized. For any event E , $p(E) - p_R(E) = \epsilon(p_D(E) - p_R(E))$, and both probabilities lie in $[0, 1]$, so their difference is at most one in magnitude. Hence $|p(E) - p_R(E)| \leq \epsilon$. $\square$

The consequence for practice is that one can process branches in order of prior weight, accumulate the retained posterior weight, and stop when the retained fraction is high enough for the accuracy required. How far that goes by prior weight alone is a count. Table 9.3 gives it for a hundred feeders each out with probability 0.01. Keeping every branch with up to three feeders out discards 1.8 percent of the prior weight and keeps 166 751 branches; to discard less than 10^{-6} requires every branch with up to eight feeders out, 2×10^{11} of them, against $2^{100} \approx 1.3 \times 10^{30}$ in all. Pruning by prior weight removes nineteen orders of magnitude and still leaves two hundred billion solves. The rest must come from separation, which lets regions' branches be summed independently (Chapter 8), and from pruning by posterior weight once the readings are in, which Chapter 15 exploits.

Figure 9.5 draws the prior tail of Table 9.3 for both failure probabilities. On a logarithmic scale the tail falls faster than geometrically once k passes the mean number of failures, which is

Table 9.3: Pruning a hundred feeders, each out with probability 0.01, by prior weight: the prior weight discarded by keeping every branch with at most k feeders out, and the number of branches kept.

k	discarded weight	branches kept
1	2.6×10^{-1}	101
2	7.9×10^{-2}	5 051
3	1.8×10^{-2}	166 751
4	3.4×10^{-3}	4 087 976
5	5.3×10^{-4}	7.9×10^7
6	7.1×10^{-5}	1.3×10^9
7	8.2×10^{-6}	1.7×10^{10}
8	8.4×10^{-7}	2.0×10^{11}

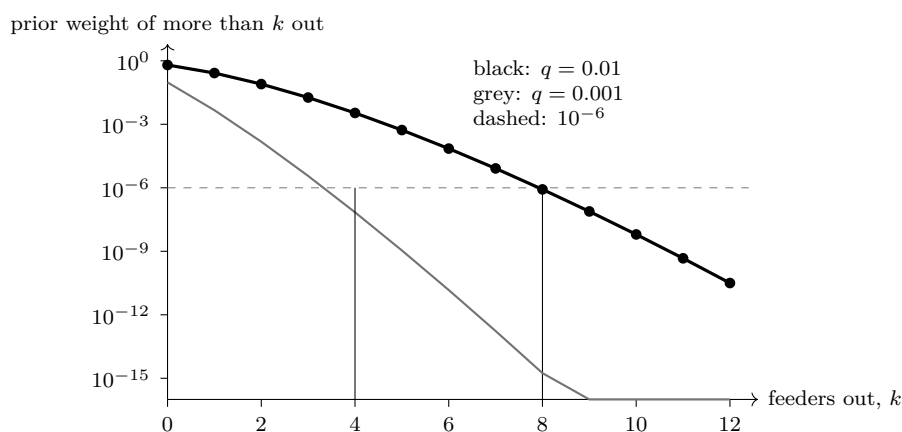


Figure 9.5: The prior weight of more than k of 100 feeders out, each independently with probability q . Black: $q = 0.01$, which crosses 10^{-6} (dashed) at $k = 8$. Grey: $q = 0.001$, which crosses it at $k = 4$. Pruning by prior weight alone keeps every branch with k or fewer feeders out.

why a modest k reaches 10^{-6} at all. What the figure also shows is how much the answer depends on q : the same hundred feeders cross the tolerance at $k = 8$ or at $k = 4$, and the branch count differs by a factor of fifty thousand.

9.6 The hierarchy, and how to choose

Table 9.4 arranges the methods of this chapter and the last from exact and analytical to simulation inside factors, with the condition under which each is the right choice.

The rule that orders the table is: eliminate exactly wherever the structure allows, approximate only at the boundaries between what has been eliminated, and never pass loopy messages through tight physics. For the models of this book the first row that applies is usually the second, regions and ports with exact interiors, with the fourth or sixth used at the few places where a factor is not Gaussian. Loopy propagation between variables is never used. Global sampling is the comparison, not the method, and the next chapter costs it.

Table 9.4: The hierarchy of inference methods for a physical factor graph.

Method	When	What it costs
Exact, analytical (tree messages)	tree-structured factorization, Gaussian factors	two sweeps of small Schur complements
Exact, computational (junction tree; regions and ports)	treewidth manageable; few discrete branches per region	one sparse factorization per region, a dense port solve
Laplace per branch	rows mildly nonlinear across the posterior width	a few Gauss–Newton iterations per branch
Expectation propagation	isolated non-Gaussian unary factors on a tree of regions	repeated moment matching; may not converge
Loopy propagation between regions	region graph has cycles; region messages weak	iteration; verify walk-summability first
Simulation inside a region	interior nonlinear, discrete-heavy, or a legacy simulator	N region solves, once; particle message on the ports
Pruning by evidence	many discrete branches, weights geometric	one evidence per retained branch
Global sampling (Chapter 10)	everything else; the baseline	N solves of the whole model per query

9.7 In practice

Compute the radius before running loopy propagation. The walk-summability radius of the precision takes one eigenvalue computation. If it is above one, do not run the iteration on that graph; on a physical graph in row form it always is.

Eliminate the tight cycles first. Group variables into regions whose interiors contain the physics cycles, eliminate each interior exactly, and pass messages between regions. When the region graph is a tree the messages are exact after one sweep, as the port-pair reduction of Figure 9.1 shows.

Do not trust a converged iteration’s variances. Even where loopy propagation converges its means are exact and its variances are not. Report variances from a factorization, by selected inversion.

Do not use mean field on a physical graph. A product form over physics variables reports the physics widths, six hundred times too narrow on the chain. If a cheap approximation is needed, use the Laplace posterior, which keeps the correlations.

Collapse mixtures only when one weight dominates. A two-component region message with weights 0.999 and 0.001 collapses safely; one with weights 0.7 and 0.3 does not, and the rest of the system must receive both components.

Prune with a stated error. Pruning by weight has the error bound of Proposition 9.3; state the discarded weight with every result, and expect prior weight alone to leave far too many branches for a network of a hundred uncertain components.

Collapse a message only where it is near Gaussian. Before replacing a region’s particles or mixture by a Gaussian, compare the tail the downstream question needs with the Gaussian’s tail. A plant whose message was one percent off at one wet bulb was off by a factor of nearly four at another.

9.8 What is missing

The chapter has said which approximate methods fit a physical graph and which do not, and it has counted their costs in words. Chapter 10 counts them in solves, on one problem, against enumeration and against global Monte Carlo, and states the conditions under which the factorized route wins and the conditions under which it does not. Chapter 11 then treats the approximation that operation needs most, folding in one reading at a time without re-solving, which turns out to be exact.

Notes and further reading

Loopy belief propagation on Gaussian models: Weiss and Freeman [108] proved that the means are exact at any fixed point and gave the first sufficient conditions for convergence; Malioutov, Johnson and Willsky [66] introduced walk-summability, showed that it guarantees convergence, and characterized the variances as sums over a subset of walks. The pairwise form of the iteration used in the script, as a solver for $\mathbf{A}\mathbf{z} = \boldsymbol{\eta}$, is Shental, Siegel, Wolf, Bickson and Dolev’s [93]. The observation that physics variables, sitting in only a few rows each with nothing to dilute the ties, carry partial correlations that no choice of physics width can reduce, and that physical row graphs are therefore not walk-summable, is the book’s; it is elementary once stated, and it is consistent with the message-passing state estimators in the power-system literature [15] operating between areas rather than between variables.

Variational inference and its relation to belief propagation are set out by Wainwright and Jordan [106], with the divergence argument for why mean-field approximations are too narrow. Expectation propagation is Minka’s [71]; Bishop [10] presents both in textbook form and MacKay [64] gives the Laplace approximation its place in the family. Particle representations of messages come from the sequential Monte Carlo literature; Robert and Casella [85] is the general reference and Särkkä and Svensson [91] the one closest to Chapter 16. The idea of a region as a black-box simulator that emits a summary to its boundary is co-simulation [28]; what §9.4 adds is that the summary is a probabilistic message on the port separator.

Summary

- Exact inference fails for large treewidth, many branches, or non-Gaussian factors; each has its own remedy.
- Gaussian loopy propagation has exact means when it converges, converges when walk-summable, and returns wrong variances. On every physical model of this book it is not walk-summable and does not converge, at any physics width, because each physics variable sits in only a few rows with nothing to dilute the ties, and the partial correlations around every cycle stay of order one half however the widths are scaled. Eliminate the cycles by regions instead.

- Variational inference is too narrow on correlated posteriors: mean field keeps the means and reports $1/\mathbf{\Lambda}_{ii}$, too narrow by $\sqrt{1 - R_i^2}$, which is 0.172 on the chain's two inputs and a factor of six hundred on its six physics variables. Expectation propagation extends Gaussian messages to non-Gaussian factors by moment matching, and collapsing a bimodal message is safe only when one component dominates.
- On the triangle in row form loopy propagation wanders at an error of one hundred percent; on tree reductions it is exact in one sweep.
- A region may be simulated and its result emitted as a particle message on its ports: solves stay inside the region, samples are reused across queries, and the interior may be anything solvable. A chilled-water plant's message collapses to a Gaussian within one percent on a hot afternoon and misstates the hall's rare shortfall by 272 percent on a mild one, where particles are needed.
- Pruning branches by evidence errs by at most the discarded weight. By prior weight alone, a hundred feeders at one percent still leave 2×10^{11} branches for an error of 10^{-6} .
- Order of preference: exact by regions; Laplace per branch; EP or simulation at non-Gaussian places; loopy messages only between regions and only after checking walk-summability; global sampling as the baseline.

Exercises

Exercise 9.1. Show that two variables that appear in exactly one row each, the same row, have partial correlation of magnitude one whatever the row's weight, and that a variable appearing in d rows of equal weight and unit coefficients has partial correlation $1/\sqrt{d_i d_j}$ with a neighbor it shares one row with. Compute the partial correlation between F_{12} and θ_2 in the triangle row form with and without the sensor on F_{12} , and explain why the physics width drops out.

Exercise 9.2. Run the script's loopy propagation on the two-region network with the two regions replaced by their exact messages, so that the graph has only the two port variables and the cut factor. Show that it converges in one sweep and is exact, and explain why in terms of the region tree.

Exercise 9.3. Build a ring of m copies of region B from Chapter 8, each tied to the next, so that the region graph is a cycle. Compute the walk-summability radius of the port-level precision as m grows and as the tie susceptance varies, and find the regime in which loopy propagation between regions converges.

Exercise 9.4. Implement the particle message of equation (9.1) for region A with an uncertain feeder and uncertain susceptances, using $N = 200$ draws, and compare its moment-matched Gaussian with the exact two-branch mixture of §9.4.1. How many draws are needed before the message's mean on θ_4 is within one percent of its spread?

Exercise 9.5. For L feeders each out independently with probability q , find the number of feeders out beyond which the discarded weight is below 10^{-6} for $L = 100$, $q = 0.01$, and count the retained branches. Repeat for $q = 0.001$, and say what the comparison implies for pruning by prior weight alone.

Solutions to selected exercises

Exercise 9.1. If variables i and j appear only in one row, with coefficients h_i, h_j and weight w , their block of Λ is $w \begin{pmatrix} h_i^2 & h_i h_j \\ h_i h_j & h_j^2 \end{pmatrix}$, and their partial correlation is $-wh_i h_j / \sqrt{wh_i^2 \cdot wh_j^2} = \mp 1$: magnitude one, whatever w . If i sits in d_i rows and j in d_j , all with unit coefficients and weight w , and they share one row, then $\Lambda_{ii} = d_i w$, $\Lambda_{jj} = d_j w$ and $\Lambda_{ij} = w$, and the partial correlation is $-1/\sqrt{d_i d_j}$. In the triangle, F_{12} sits in b_2 and c_{12} with unit coefficients, and θ_2 in c_{12} and c_{23} with coefficient B : $\Lambda_{F_{12}F_{12}} = 2w$, $\Lambda_{\theta_2\theta_2} = 2B^2 w$, $\Lambda_{F_{12}\theta_2} = Bw$, and the partial correlation is $-Bw/\sqrt{2w \cdot 2B^2 w} = -\frac{1}{2}$, independent of w and of B , which is the script's -0.500 at every width. The width drops out because every entry scales with w . With the meter of weight w_m on F_{12} , $\Lambda_{F_{12}F_{12}} = 2w + w_m$ and the partial correlation is $-1/\sqrt{2(2 + w_m/w)}$; at a physics width of 0.01 and a meter of 0.02, $w_m/w = 0.25$ and the value is $-1/\sqrt{4.5} = -0.471$. Now the width matters, because the meter's weight does not scale with it; but only the ties at metered variables are diluted.

Exercise 9.5. The number of feeders out is binomial with $L = 100$ and $q = 0.01$, so the prior weight of having more than k out is the binomial tail, and the branches kept number $\sum_{j \leq k} \binom{100}{j}$. Table 9.3 gives both: the tail first falls below 10^{-6} at $k = 8$, with 8.4×10^{-7} discarded and 2.0×10^{11} branches kept. At $q = 0.001$ the mean number out is 0.1 instead of 1, and the tail falls below 10^{-6} already at $k = 4$, with about 4.1×10^6 branches kept: fifty thousand times fewer, for components ten times more reliable. Pruning by prior weight works when the expected number of simultaneous failures is well below one, and fails as it approaches one; a large network of ordinary components is in the second regime, which is why the count must be cut further by separation and by the readings.

Exercise 9.2. With each region replaced by its exact message, Proposition 8.2, the graph left to the iteration has two port variables and the cut factor between them, with each region's message attached to its port as a factor on that port alone. That graph is a tree, and on a tree Gaussian propagation is sum-product, exact after one sweep from the leaves inward and back, by Proposition 8.1. The dotted curve of Figure 9.1 is this run: its error is 10^{-14} after the first sweep and nothing moves afterward. The walk-summability radius of the port-level precision is 0.29, well inside the unit circle, but it is not needed: exactness on a tree does not depend on convergence of an infinite walk sum. The region tree has done what the loopy iteration could not, by eliminating every cycle inside the regions before any message was passed.

Exercise 9.3. The script `ch09_region.py` builds the ring in nodal form: each copy of region B has buses 4, 5 and 6 and its three feeders, bus 6 of each copy is tied to bus 4 of the next, bus 4 of the first copy is the reference, and every bus carries a load prior of spread 0.2. Eliminating each region's interior bus leaves the port-level precision on the angles at buses 4 and 6. On the port variables one at a time, loopy propagation never converges: the walk-summability radius is between 1.07 and 1.83 for every ring from $m = 3$ to $m = 20$ and every tie from 1 to 30 per unit, and the iteration diverges in every case. A region's two ports are tied tightly through its own feeders, and that alone breaks the scalar iteration. Propagation between regions should pass one message per region, over both its ports at once. Done that way it converges, and is exact, for the three-region ring at every tie, for four regions up to a tie of 10, and for six only at a tie of 1; from ten regions on it diverges at every tie. The reason is the region graph. In nodal form the

load priors couple each angle to its neighbours' neighbours, so after the interiors are eliminated each region is joined to its second neighbours as well as its first. Three regions make a single loop, on which Gaussian propagation's means converge. From six regions on, every region has four neighbours, and the ring has become a ring of chords. The block walk-summability radius, a sufficient test, is below one only for the three-region ring with the weakest tie, 0.97. It certifies none of the other cases that converge, and it correctly refuses all the ones that do not. The regime in which propagation between regions converges is a coarse partition of a nearly tree-like region graph, which is the advice of §9.2 read backwards. A ring should be cut open, by merging two regions across one tie so that the region graph becomes a tree, or treated by a junction tree over regions, as Chapter 18 does.

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

How deep to enumerate *pruning a combinatorial space by prior weight; the binomial tail sets the depth; the number of sets kept is a vanishing fraction of the whole*
`level1_building/graph_structure_scaling/problems/how_deep_to_enumerate`

Chapter 10

Enumeration, Monte Carlo, and factorized inference

Chapter 5 counted the cost of factorized inference in operations and warned that the count is not an argument against sampling. This chapter makes the comparison properly. It takes one small physical problem with a closed-form answer, computes the same two quantities by enumeration, by Monte Carlo, and by a factorized computation that exploits a separator of the model, and costs each in the one currency that matters for a physical system: the number of times the physics has to be solved. The result is not that sampling loses. It is that the two routes are good at different things, that the factorized route's advantage is reuse, and that reuse is worth a great deal when many questions are asked of one model. A second example, two chilled-water plants that share the outdoor air, repeats the comparison on nine inputs and shows what a shared cause does to the cut. The chapter ends with the claim the book is prepared to defend, in three strengths, and with what has been established for each.

10.1 The question, stated honestly

A Monte Carlo method draws the uncertain inputs from their priors, solves the physics for each draw, and averages. It answers every question this book has posed. It computes expectations, tails, conditionals by filtering the draws, counterfactuals by re-drawing under a changed prior, and attributions by any of the standard variance decompositions. It does not care how many uncertain inputs there are: a hundred thousand draws from a space of 2^{60} states cost a hundred thousand solves. Nothing in Part II gives the factorized route an advantage on those grounds, and a claim that it “handles combinatorial uncertainty without enumeration” is a claim that sampling already makes good on.

What sampling pays for is the solve. Each draw is one evaluation of the physics, and for a real facility that evaluation is a Newton iteration on thousands of unknowns, coupling air and power, at a cost of a fraction of a second to many seconds. A hundred thousand draws is hours. The question is therefore not which method can answer, but how many solves each needs for a given accuracy, and, since a model is rarely asked one question, how many solves the second and third and tenth questions need once the first has been answered. That is the comparison this chapter runs.

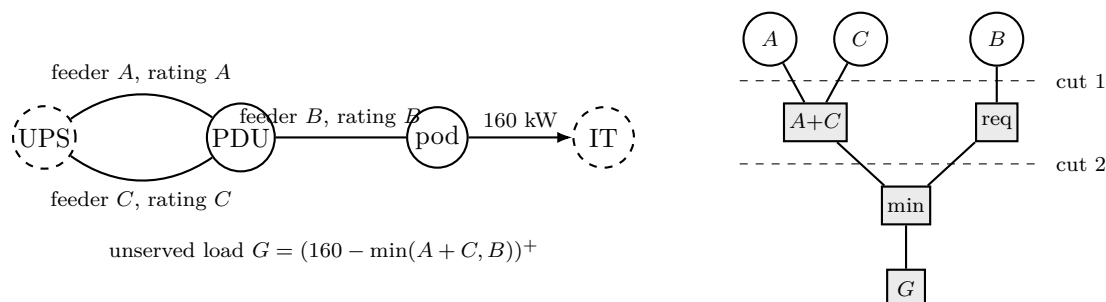


Figure 10.1: Left: the three-feeder network. Two feeders in parallel run from the UPS busbar to a distribution unit; one feeder runs from there to the pod’s racks. Right: the dependency graph of the compiled model, inputs at the top and the unserved load at the bottom. Cut 1 separates the three ratings from everything below; cut 2 separates $(A+C, \text{req})$, two quantities, from the unserved load. Each cut is a separator in the sense of Chapter 5, and §10.6 counts what each saves.

10.2 The problem

Two feeders, A and C , run in parallel from the UPS busbar to a distribution unit; a third feeder, B , runs from that unit to a pod of racks drawing 160 kilowatts. Each feeder has a rating, the most it may carry. The ratings are uncertain, because a busway derates with the ambient it runs through and nobody has measured that ambient, and they are independent: A and C uniform on $[70, 120]$ kilowatts, B uniform on $[140, 180]$. What can be delivered to the load is the smaller of what the parallel pair can carry, $A + C$, and what feeder B can carry; whatever the load needs beyond that is left unserved. The unserved load is

$$G = (160 - \min(A + C, B))^+, \quad (10.1)$$

and because it has this closed form its expectation, variance and probability of being zero are known exactly, by the derivation in the solution to Exercise 10.1: $\mathbb{E}[G] = 16/3$ kilowatts, $\text{Var}[G] = 41.956$, $\mathbb{P}(G = 0) = 0.46$. The Shapley shares of the variance, a standard attribution of $\text{Var}[G]$ to the three ratings that Chapter 14 defines, have no such short closed form. Their reference values are computed with the closed-form G on a grid of 241 points per rating, far finer than any grid scored below; on that grid the same sums return $\mathbb{E}[G]$ within 4×10^{-5} of $16/3$. Feeder B accounts for 93.6 percent and A and C for 3.2 each. Every method is scored against these values.

Figure 10.1 draws the network and the dependency graph of the model as compiled, which is the factor graph of the closures with the balance rows absorbed. Every number of the three-feeder comparison is read from the committed results of the study that ran it; the script `ch10_three_way.py` in the book’s `scripts` directory reads them and prints them, and computes nothing itself. The checks of those numbers, and the second example of §10.7, are computed by `ch10_more.py`.

10.3 Enumeration: the product grid

Discretize each rating on n points and take the product: n^3 combinations, each with a known probability, each solved once. Expectation is the weighted sum of the n^3 unserved loads; so is

Table 10.1: Product-grid quadrature on the three-feeder problem: grid size, solves, and the error of the mean, the variance, and feeder B 's Shapley share against the closed form. The share costs no solves beyond the grid.

n	solves	$\mathbb{E}[G]$ error [kW]	$\text{Var}[G]$ error	share B [%]	share error [pp]
9	729	0.045	2.47	92.47	1.12
17	4,913	0.012	0.60	93.30	0.29
25	15,625	0.0054	0.27	93.47	0.13
33	35,937	0.0026	0.16	93.52	0.075
41	68,921	0.0012	0.11	93.55	0.048

any other functional. This is enumeration, called product-grid quadrature when the inputs are continuous, and it is the exact marginalization of the discretized model. Table 10.1 gives its convergence. At $n = 9$, which is 729 solves, the mean is within 0.045 kilowatts of the closed form; at $n = 41$, 68,921 solves, within 0.0012. The error falls roughly as n^{-2} , as quadrature of a piecewise-smooth integrand should, and the cost rises as n^3 .

That the error falls as n^{-2} deserves a proof, because the familiar error bound of the trapezoid rule assumes a smooth integrand and G is not smooth: it bends where $A + C = B$, where $A + C = 160$ and where $B = 160$. The study's grid is the trapezoid rule on n evenly spaced points per rating, with step h and half weights at the two ends.

Proposition 10.1 (Trapezoid rule across kinks). *Let f be continuous on $[a, b]$ and twice differentiable with $|f''| \leq M$ except at K points, at each of which its slope jumps by at most J . The trapezoid rule with step h has error at most $(b - a)Mh^2/12 + KJh^2/8$. On a product grid in d coordinates, for a function whose one-dimensional sections all obey these bounds, the error is at most d times the one-dimensional bound.*

Proof. On a cell $[x_0, x_0 + h]$ with no kink, the rule integrates the chord through the two end values, and f differs from its chord by $\frac{1}{2}f''(\xi)(x - x_0)(x - x_0 - h)$ for some ξ in the cell. Integrating over the cell gives an error of $h^3|f''(\xi)|/12$ at most, and the $(b - a)/h$ cells contribute at most $(b - a)Mh^2/12$. On a cell with a kink at $x_0 + s$, write $f = \ell + k$, where ℓ continues the left-hand piece smoothly across the kink and $k(x) = j(x - x_0 - s)^+$ carries the jump j in slope. The part ℓ is covered by the first bound. The part k has integral $j(h - s)^2/2$ over the cell and trapezoid value $\frac{h}{2}j(h - s)$, and their difference is $\frac{1}{2}js(h - s)$, at most $jh^2/8$, reached at $s = h/2$. There are K such cells. On a product grid the rule is the one-dimensional rule applied coordinate by coordinate, $Q_1 \cdots Q_d$ in place of $I_1 \cdots I_d$, and the difference telescopes: $Q_1 \cdots Q_d - I_1 \cdots I_d = \sum_k Q_1 \cdots Q_{k-1}(Q_k - I_k)I_{k+1} \cdots I_d$. Term k is the one-dimensional error for a function of x_k alone, the section integrated over the later coordinates, which has no more kinks or curvature than the sections themselves, averaged with the positive weights of the earlier coordinates, which sum to one. $\square$

The unserved load is piecewise linear, so $M = 0$ and only the kink term remains: the error is of order h^2 with a constant set by the jumps in slope. The ratio of the error to h^2 bears this out. It is 0.0012, 0.0013 and 0.0008 per square kilowatt at $n = 9$, 17 and 41. It does not settle to one constant, because the kinks fall at different places in their cells as n changes, and the $s(h - s)$ of the proof moves with them.

Table 10.2: Monte Carlo on the three-feeder problem. Top: the mean, rms error over eight seeds. Bottom: feeder B 's Shapley share by pick-freeze, which needs six further sample sets, $7N$ solves in all, rms over five seeds.

N	solves	rms error of $\mathbb{E}[G]$ [kW]	rms error of $\text{Var}[G]$
300	300	0.50	2.34
1,000	1,000	0.13	1.53
3,000	3,000	0.11	0.68
10,000	10,000	0.059	0.38

N	solves	share B [%]	rms error [pp]
300	2,100	91.9	7.05
1,000	7,000	96.2	3.11
3,000	21,000	87.9	2.64

10.4 Monte Carlo

Draw N triples of ratings, solve each, average. Table 10.2 gives the root-mean-square error of the mean over eight independent seeds: 0.50 kilowatts at 300 draws, 0.059 at 10,000. The error falls as $N^{-1/2}$, as it must.

Proposition 10.2 (Monte Carlo error). *Let $G_1, \dots, G_N$ be independent draws of a quantity with mean μ and variance σ^2 . The sample mean $\bar{G}_N$ has expectation μ and root-mean-square error $\sigma/\sqrt{N}$, whatever the number of uncertain inputs behind each draw.*

Proof. $\mathbb{E}[\bar{G}_N] = \frac{1}{N} \sum_i \mathbb{E}[G_i] = \mu$. The variance of a sum of independent terms is the sum of their variances, so $\text{Var}[\bar{G}_N] = N\sigma^2/N^2 = \sigma^2/N$, and the rms error of an unbiased estimator is the square root of its variance. Nothing in the argument refers to the inputs. $\square$

The constant is the standard deviation of the quantity itself, $\sigma = \sqrt{41.956} = 6.48$ kilowatts. The proposition predicts 0.374, 0.205, 0.118 and 0.065 kilowatts at the four sample sizes of Table 10.2. The study measured 0.50, 0.13, 0.11 and 0.059, each an rms over eight seeds. An rms over eight seeds is itself uncertain by about a quarter, $1/\sqrt{2 \cdot 8}$, so the agreement is as close as eight seeds allow.

Set the two side by side on the mean. The grid at 729 solves has a smaller error than Monte Carlo at 10,000, and Proposition 10.2 says how many draws would match it: $(6.48/0.045)^2$, about 20,600, a factor of twenty-eight in solves. The two figures bound the same gap: at least fourteen as measured, since 729 grid solves beat 10,000 draws, and about twenty-eight by the $\sigma/\sqrt{N}$ law. At $n = 17$ the grid's error of 0.012 would take about 275,000 draws, fifty-six times its 4,913 solves. This is real, and it is not a property of graphical models. It is the usual advantage of quadrature over sampling in low dimension. In solves the grid's error falls as $(n^d)^{-2/d}$, the $-2/d$ power of the solves, against sampling's $-1/2$; the two exponents cross at $d = 4$, and beyond four inputs the grid loses for all but the smallest budgets. The book does not claim this factor as its own.

10.5 Attribution: where the structural difference appears

Now ask the second question: how much of the variance of G is due to each rating? Chapter 14 defines the Shapley share; for now it is enough that computing it needs conditional expectations of G given each subset of the inputs, $\mathbb{E}[G \mid A]$, $\mathbb{E}[G \mid A, B]$, and so on, for every subset.

On the grid, every such conditional expectation is a partial sum over solves already made: fix A at a grid value, sum over the B and C grid values with their weights. The joint distribution is held on a product set, and marginalizing over some coordinates is summing over them. The attribution costs no solves beyond the grid, and at $n = 17$, 4,913 solves, feeder B 's share is within 0.29 percentage points of the reference.

Proposition 10.3 (Conditional expectations on a product grid). *Let the inputs be independent and discretized on a product grid $x = (x_1, \dots, x_d)$ with weights $w(x) = \prod_i w_i(x_i)$, and let G be known at every grid point. For any subset u of the inputs, the conditional expectation of G given $X_u = x_u$ in the discretized model is*

$$\mathbb{E}[G \mid X_u = x_u] = \sum_{x_{-u}} \left(\prod_{i \notin u} w_i(x_i) \right) G(x_u, x_{-u}), \quad (10.2)$$

a partial sum over values already solved, and $\text{Var}(\mathbb{E}[G \mid X_u])$ for all 2^d subsets needs no further solve.

Proof. The conditional probability of x_{-u} given x_u is $w(x) / \sum_{x'_{-u}} w(x_u, x'_{-u})$. The denominator is $\prod_{i \in u} w_i(x_i) \prod_{i \notin u} \sum_{x_i} w_i(x_i) = \prod_{i \in u} w_i(x_i)$, since each marginal sums to one, so the ratio is $\prod_{i \notin u} w_i(x_i)$. The variance of the conditional expectation is the sum over x_u of $\prod_{i \in u} w_i(x_i)$ times the square of (10.2), less the square of the mean. Every term is a value of G at a grid point. $\square$

The proposition leans on the product form twice: the inputs are independent, and the grid is a product set. A cloud of random draws lacks the second property. No two draws share a value of A , so there is nothing to sum over with A held fixed, and a conditional expectation has to be manufactured by pairing draws, which is what pick-freeze does.

By sampling, a conditional expectation given a subset needs a sample designed for it. The standard construction, pick-freeze, draws a second independent sample and recombines the two so that some inputs are held fixed across a pair of draws; for three inputs it needs six further sample sets, $7N$ solves in all. At $N = 3,000$, which is 21,000 solves, feeder B 's share is 2.64 points off, and the error is not falling smoothly with N because the estimator's variance is large. To match the grid's 0.29 points would take, on the $N^{-1/2}$ law, some eighty times the samples.

Figure 10.2 draws all four curves on one plot of error against solves. The two mean curves are the quadrature-versus-sampling story: parallel on the log-log plot, offset by that factor. The two attribution curves are the structural story: the grid's attribution error is its mean error's twin, at the same solves, because it costs no more; the sampling attribution sits an order of magnitude above the sampling mean, because every conditional expectation is a new sample.

Principle 10.1. *The factorized route does not win by avoiding a large state space. It wins when a computation held on a product set answers the second question from the solves that answered the first. Its advantage is reuse, and it is measured in solves per question, not in solves per answer.*

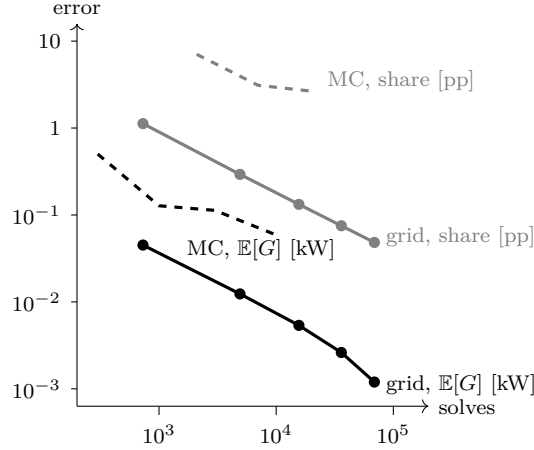


Figure 10.2: Error against solves on the three-feeder problem, from the committed study results. Solid: product grid; dashed: Monte Carlo. Black: error of the mean in kilowatts; grey: error of feeder B 's Shapley share in percentage points. The grid's attribution rides on its mean because it costs no further solves; the sampling attribution needs $7N$ solves and its error is an order of magnitude above the sampling mean's.

10.6 The factorized route: cuts of the dependency graph

The grid of §10.3 enumerated n^3 combinations of the ratings. It did not have to. The dependency graph of Figure 10.1 shows that the unserved load depends on the ratings only through two intermediate quantities, $A + C$ and the requirement at the middle bus, and on those only through their minimum. Each level of the graph is a separator in the sense of Chapter 5: given the quantities on a cut, what lies below is independent of what lies above.

Enumerate on a cut instead of on the inputs. The pair $(A + C, B)$ takes $(2n - 1)n$ distinct values on the grid, not n^3 , because $A + C$ takes $2n - 1$ distinct values and each carries a known probability from the convolution of A 's and C 's. Solving the physics once per distinct value of the cut and weighting by the cut's distribution gives the same expectation as the full grid, exactly, because the expectation of a function of the cut is the same whether one sums over the inputs or over the cut with its induced distribution. Table 10.3 gives the ladder of cuts and the distinct solves each needs. At $n = 17$ the cut $(A + C, B)$ needs 561 solves against the grid's 4,913, and the study verified that the two means agree to 10^{-13} kilowatts. The cut below it, the single quantity that G depends on, needs fewer than n , 33 at $n = 41$: the whole problem is one-dimensional at that level, and G 's distribution is the pushforward of a one-dimensional distribution through a scalar function.

Proposition 10.4 (Enumeration on a cut). *Let X take values on a finite grid with probabilities $p(x)$, and let the quantity of interest depend on X only through a cut $Z = c(X)$, so that $G = h(Z)$. Then for any function ϕ*

$$\mathbb{E}[\phi(G)] = \sum_z \phi(h(z)) q(z), \quad q(z) = \sum_{x: c(x)=z} p(x), \quad (10.3)$$

which needs one evaluation of h per distinct value of the cut on the grid. If a component of the cut is a sum of independent inputs, its distribution is the convolution of theirs.

Table 10.3: The cut ladder of the three-feeder model: for each separator of the dependency graph, its dimension and the number of distinct physics solves needed to compute $\mathbb{E}[G]$ exactly on an n -point grid. The bottom row is the full product grid.

cut (frontier)	dim	$n = 9$	$n = 17$	$n = 25$	$n = 33$	$n = 41$
$\{f_B\}$: what G reads	1	8	14	20	26	33
$\{A+C, \text{ req}\}$	2	85	297	637	1,105	1,701
$\{A+C, B\}$	2	153	561	1,225	2,145	3,321
$\{A, C, \text{ req}\}$	3	405	2,601	8,125	18,513	35,301
$\{A, B, C\}$: the product grid	3	729	4,913	15,625	35,937	68,921

Proof. Group the terms of $\sum_x \phi(h(c(x))) p(x)$ by the value of $c(x)$. Within a group the factor $\phi(h(z))$ is common and the probabilities add to $q(z)$. For a component $Z_1 = X_1 + X_2$ with X_1 and X_2 independent, $q_1(z_1) = \sum_{x_1} p_1(x_1) p_2(z_1 - x_1)$, which is the convolution. $\square$

On the three-feeder grid with trapezoid weights, $n = 5$ puts weights $(2, 4, 4, 4, 2)/16$ on the ratings of A and of C . The convolution puts $(4, 16, 32, 48, 56, 48, 32, 16, 4)/256$ on the nine values of $A + C$, a discrete triangle, which is what the sum of two uniforms is. Recomputing the grid means through the cut reproduces the full-grid means to 2×10^{-15} at every n of Table 10.1. The evaluations of h are the physics. The convolution is arithmetic on weights and costs no solve, because in this model two parallel feeders of ratings A and C act on the rest of the network exactly as one feeder of rating $A + C$ does, which is what equation (10.1) says.

This is Chapter 5's count made physical. The exponent of the cost is the dimension of the cut, not the number of inputs; the cut is a separator of the model's own graph; and the model exposes it, because the compiled dependency graph is the factor graph with the balances folded in. Nothing was approximated, and every functional of G , not just its mean, comes from the same 561 solves, since they determine G 's distribution.

Two honest qualifications. A sampler can exploit the same cut: draw $A + C$ from its convolution instead of drawing A and C , and the draws of the two inputs collapse to one. The error still falls as $N^{-1/2}$, so the cut helps the sampler less than it helps the grid, but it helps. And a cut of dimension two on a three-input problem is a modest saving; the ladder matters because on a large model the cuts are the ports of Chapter 8, their dimension is the port count, and the input count is in the hundreds.

10.7 Second worked example: two chilled-water plants

A data hall rejects 2,100 kilowatts of heat into chilled water supplied by two plants. Each plant has three chillers in parallel, each rated between 350 and 450 kilowatts, uniform and independent. The chillers reject their heat through cooling towers, so a warmer outdoor wet bulb raises the condenser water temperature and lowers every chiller's capacity, here by 1.5 percent per kelvin above 18°C. The wet bulb T is uncertain, uniform on $[18, 28]^\circ\text{C}$, and it is the same for both plants, which sit on one site. Each plant delivers through its own distribution loop. The loop's pump flow limit $\dot{m}_k$ is uncertain, uniform on $[42, 50]$ kilograms per second, and at the design temperature difference of 6 kelvin the loop carries at most $\dot{m}_k c_p \Delta T$, between 1,056 and 1,257 kilowatts. A plant delivers the smaller of its derated chiller capacity and its loop capacity, and

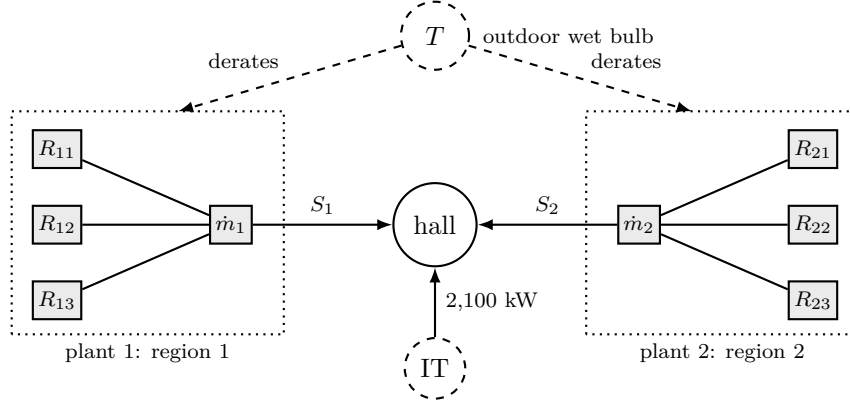


Figure 10.3: Two chilled-water plants serving one data hall. Each plant has three chillers in parallel, ratings R_{kj} , and a distribution loop whose pump flow limit $\dot{m}_k$ caps what it delivers; S_k is the plant's delivered cooling and its port to the hall. The outdoor wet bulb T derates every chiller in both plants. Given T the plants are independent, so the separator between them is $\{T, S_1, S_2\}$, not the ports alone.

the hall's energy balance leaves the rest unserved:

$$S_k = \min\left((1 - \alpha(T - 18)) \sum_{j=1}^3 R_{kj}, \dot{m}_k c_p \Delta T\right), \quad U = (2,100 - S_1 - S_2)^+. \quad (10.4)$$

The unserved cooling U is heat the hall cannot reject, and it shows up as a rising room temperature. There are nine uncertain inputs: six ratings, two pump limits and the wet bulb. Figure 10.3 draws the plants and the cut.

The dependency graph has the shape of the three-feeder model's, twice over, with one node more. Inside each plant the chiller ratings enter only through their sum, a cut of one dimension. The plant's delivered cooling is its port to the hall, and the wet bulb feeds both plants. Given the wet bulb the plants are independent, and each plant's message to the hall is the distribution of its delivered cooling.

Proposition 10.5 (Region messages with a shared input). *Let the inputs be (W, X_1, X_2) , mutually independent, let region k 's port be $S_k = s_k(W, X_k)$, and let $G = h(S_1, S_2)$. Then*

$$\mathbb{E}[\phi(G)] = \sum_w p(w) \sum_{s_1, s_2} \phi(h(s_1, s_2)) q_1(s_1 | w) q_2(s_2 | w), \quad q_k(s | w) = \sum_{x_k: s_k(w, x_k)=s} p_k(x_k). \quad (10.5)$$

The cost is one region solve per distinct value of each region's port for each value of W , and the combination is an evaluation of h . If the two regions are identical in law, $\text{Cov}(S_1, S_2) = \text{Var}(\mathbb{E}[S_1 | W])$. The product of the marginal messages, $q_1(s_1) q_2(s_2)$, which is what the computation gives when W is left out of the separator, implies a covariance of zero, and is wrong whenever $\mathbb{E}[S_1 | W]$ varies with W .

Proof. Condition on $W = w$. The inputs X_1 and X_2 are independent of each other and of W , so given $W = w$ the ports $s_1(w, X_1)$ and $s_2(w, X_2)$ are functions of independent variables and are independent. Their distributions are $q_1(\cdot | w)$ and $q_2(\cdot | w)$ by Proposition 10.4 applied inside each region, which gives $\mathbb{E}[\phi(G) | W = w]$ as the inner double sum; averaging over w

Table 10.4: The two chilled-water plants. For each grid size: the solves of the full product grid on nine inputs; the plant solves of the region route of Proposition 10.5; the errors of $\mathbb{E}[U]$ and $\mathbb{P}(U > 0)$ against the reference; and the rms error of Monte Carlo on $\mathbb{E}[U]$ at as many full solves as the region route’s plant solves, by Proposition 10.2.

n	full grid	plant solves	$\mathbb{E}[U]$ error [kW]	$\mathbb{P}(U > 0)$ error	Monte Carlo rms [kW]
5	2.0×10^6	650	2.34	0.0118	1.08
9	3.9×10^8	4,050	0.593	0.0068	0.433
17	1.2×10^{11}	28,322	0.146	0.0011	0.164
33	4.6×10^{13}	211,266	0.035	0.0007	0.060

gives (10.5). For the covariance, the law of total covariance gives $\text{Cov}(S_1, S_2) = \mathbb{E}[\text{Cov}(S_1, S_2 | W)] + \text{Cov}(\mathbb{E}[S_1 | W], \mathbb{E}[S_2 | W])$. The first term is zero by conditional independence. When the regions are identical in law, $\mathbb{E}[S_1 | W] = \mathbb{E}[S_2 | W]$, and the second term is the variance of that function of W . $\square$

Table 10.4 compares the routes. The full product grid on nine inputs is n^9 solves, 3.9×10^8 at $n = 9$ and 1.2×10^{11} at $n = 17$, and nobody runs it. Proposition 10.5 replaces it by $2n^2(3n - 2)$ plant solves, 4,050 at $n = 9$. For each of the n wet-bulb values each plant is enumerated on its own cut: $3n - 2$ values of the rating sum, from two convolutions, times n pump limits. The combination $U = (2,100 - S_1 - S_2)^+$ is the hall’s energy balance, evaluated by sorting one message against the other, with no physics in it. At $n = 5$ the full grid is still affordable, 1,953,125 solves, and it gives $\mathbb{E}[U] = 12.588677026$ kilowatts; the region route gives the same number from 650 plant solves, to 2.5×10^{-14} . The reference is a region computation at $n = 161$: $\mathbb{E}[U] = 10.248$ kilowatts, $\mathbb{P}(U > 0) = 0.195$ and a standard deviation of 27.6 kilowatts. Twenty million Monte Carlo draws agree with it to 0.008 kilowatts.

Read the last two columns of the table together, and the region route does not beat sampling on the mean. At $n = 9$ its error of 0.59 kilowatts is what Monte Carlo reaches in about 2,200 draws. At $n = 17$ its 0.146 would take Monte Carlo about 36,000 draws, against 28,322 plant solves, and a plant solve is about half a full solve. The probability of a shortfall tells the same story: at 4,050 draws its Monte Carlo standard error is 0.0062, against the region route’s 0.0068. The reason is Proposition 10.1 in five effective dimensions, the wet bulb and two per plant once the ratings are summed. That is past the crossover at four, and the unserved cooling is a tail quantity, zero over four fifths of the input space and bending sharply at its edge. The error is spread over the directions: nine wet-bulb nodes with 33 points on the other inputs still leave 0.40 kilowatts, and 33 wet-bulb nodes with nine points on the others leave 0.23. The cut made the grid possible at all, 4,050 solves in place of 3.9×10^8 . It did not make the grid better than sampling for one number. That is the three-feeder lesson read the other way: quadrature’s advantage in three dimensions was not the book’s, and its absence in five is not the book’s failure.

Now ask the question a site engineer asks: how bad is it on a hot day? The region computation already holds the answer. Its outer sum runs over the wet bulb, and before that sum is taken each term is $\mathbb{E}[U | T = w]$, Proposition 10.3 with $u = \{T\}$. Figure 10.4 draws it. Below 21°C the plants never fall short. At 24.25°C the expected shortfall is 4.5 kilowatts with a 15 percent chance of any; at 28°C it is 66 kilowatts with an 84 percent chance. The nine values cost nothing beyond the 4,050 plant solves, and they are within 0.27 kilowatts rms of the fine computation. A Monte Carlo estimate of the same curve sorts its draws into nine wet-bulb bins and averages

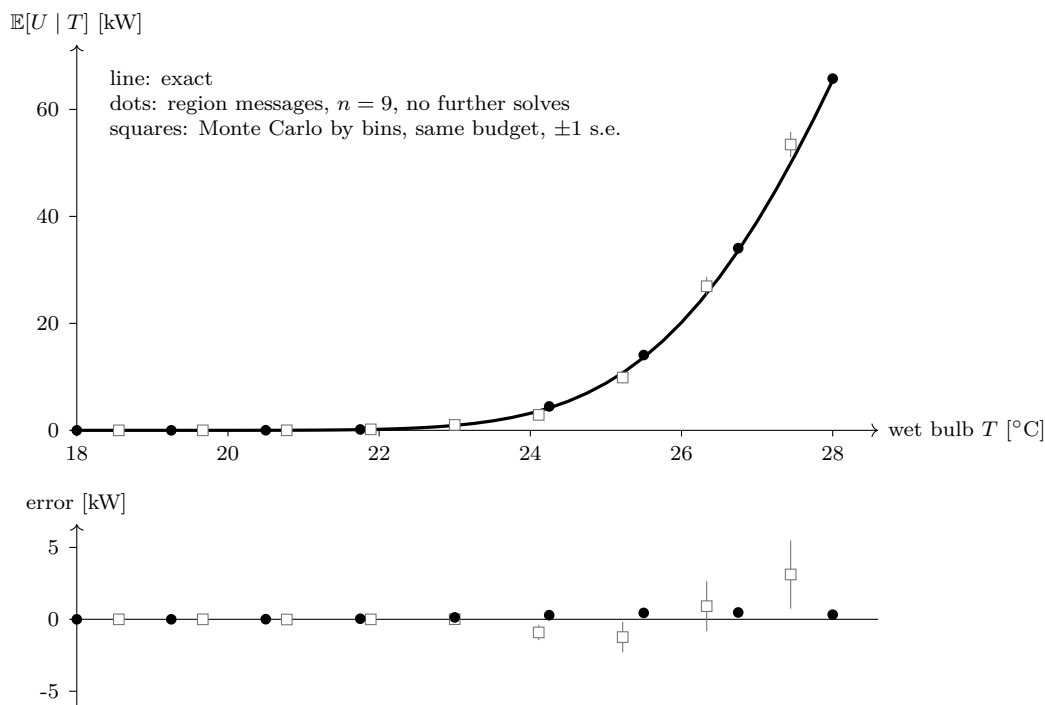


Figure 10.4: The expected unserved cooling given the outdoor wet bulb, for the two chilled-water plants. Top: the feeder is exact, from a region computation at $n = 33$. The dots are the nine values held by the region computation at $n = 9$, which cost nothing beyond its 4,050 plant solves. The squares are Monte Carlo at the same 4,050 draws sorted into nine wet-bulb bins, with one standard error, for one seed of the eight behind the rms error quoted in the text. Bottom: the errors of both against the exact curve, on a scale ten times finer.

each bin. At the same 4,050 draws each bin holds about 450, and the rms error of the nine bin means over eight seeds is 0.97 kilowatts, three and a half times the region route's. Since the error falls as the inverse square root of the draws, matching the region route would take about thirteen times the solves. The weather alone accounts for 39 percent of the variance of U , a first-order attribution in the sense of Chapter 14, and it is again a partial sum.

Tails are a harder test. The probability that the shortfall exceeds t is $\mathbb{P}(S_1 + S_2 < 2,100 - t)$: the same messages with the balance evaluated at a lower load, so it too costs no further solve. Its accuracy is another matter. At $t = 100$ kilowatts the reference probability is 0.0269. The region route gives 0.0325 at $n = 9$ and 0.0281 at $n = 17$, errors of 21 and 4 percent, while Monte Carlo at 4,050 draws has a relative standard error of 9.5 percent. At $t = 150$ kilowatts, a probability of 0.005, the region route is off by 25 and 16 percent and Monte Carlo by 22 percent at 4,050 draws and 8 percent at 28,322. On a tail probability the grid does no better than sampling, and the reason is Proposition 10.1 again, this time by its failure. A probability is the expectation of an indicator, which jumps rather than bends. On a cell containing a jump the trapezoid rule is off by up to half the jump times h , so the error is of order h , not h^2 . The remedy is to integrate one input in closed form inside the last region, which turns the jump back into a kink (Exercise 10.7).

Last, the separator. Leave the wet bulb out of it: compute each plant's message averaged over the weather, and combine the two as independent regions. Every number comes out too small. At $n = 33$ the expected shortfall is 5.8 kilowatts against 10.3, the probability of one is

0.145 against 0.195, and the standard deviation is 19.1 against 27.6. Proposition 10.5 says why. One plant's delivered cooling has mean 1,092 kilowatts and standard deviation 56.0; the part of its variance that the wet bulb explains is 1,324 square kilowatts, so the two plants' deliveries are correlated at 0.42. The standard deviation of their sum is 94.5 kilowatts with the shared wet bulb and 79.2 without it. The unserved cooling is the tail of that sum below 2,100 kilowatts, so a thinner tail means a smaller shortfall. A hot afternoon derates both plants at once. A model that lets one plant's bad day be offset by the other's good one has forgotten that there is only one afternoon.

Principle 10.2. *A common cause belongs in the separator. An input that feeds two regions, such as the weather, a shared supply or a common-mode failure, must be conditioned on before the regions' messages are combined. Combining their marginal messages treats the regions as independent and understates every joint risk.*

10.8 Beyond three inputs

The product grid dies at n^d . With fourteen uncertain inputs and nine points each it is 2×10^{13} solves, and there is no cut of dimension two to save it. What survives is the structure, and it survives in two forms.

The first is Chapter 9's simulation inside a region: sample the inputs of each region, solve each region on its own variables, and combine the regions' particle messages exactly on their ports. The samples are per region, the combination is on the separator, and the solves are of regions rather than of the whole. Chapter 18 measures what that saves on a real network.

The second is to make each solve return more than a number. When the physics is solved once and returns, along with the unserved load, its gradient with respect to every uncertain input, the solves form a census of value-and-gradient pairs from which many questions can be answered without further solves. Chapter 14 develops this. The construction has been run at scale on a stressed power network with 14 uncertain ratings, whose committed results give the count; the census study is a power one, there being no data-center counterpart. A census of 3,000 solves, certified on 2,000 further holdout draws, plus 512 for the mean and 512 for each of two questions that needed a small residual sample, answered the mean and nine planning questions: the marginal value of each feeder's capacity, the attribution of variance to each rating, the value of a measurement, a screening of which ratings matter, the mean under a changed weather belief, the mean under correlated ratings, a what-if, the tail, and the worst case. The total was 6,536 solves. The same nine questions answered by the standard sampling method for each cost 113,876; each has its own sample, except the value of a measurement, which reads the attribution's sample at no further solves. Seven of the nine cost the census route nothing at all beyond the census. That is Principle 10.1 at scale: one computation held in a form that the next question can read.

10.9 The claim

There are three claims one could make for the factorized route, in increasing strength, and the book makes the third.

Weak. The factorized route handles combinatorial uncertainty without enumerating every state.

True, and worthless: sampling does too.

Strong. The factorized route exploits the physical factorization and its separators to reuse expensive physics solves across many uncertain states and many queries. True, and established in this chapter: the cut ladder reuses solves across states, the product set reuses them across queries, and the census reuses them across nine questions.

Strongest. For equivalent accuracy, the number of expensive physics solves the factorized route needs is much smaller than the number sampling needs, and the ratio grows with the number of questions asked. Measured: about twenty-eight to one for one question in three dimensions, which is quadrature's doing and which disappears on the nine inputs of the chilled-water plants; no further solves against $6N$ for the second question; about thirteen to one for the plants' shortfall given the weather; seventeen to one over the mean and nine questions on a real network. The last three are reuse's doing.

The strongest claim carries its conditions. The reuse across states needs a cut of small dimension, which a physical system usually has and a generic function of many inputs usually does not. The reuse across queries needs the computation to be held in a form the next query can read, a product set, a region message, a census with gradients, rather than a single number. And the comparison is in solves; where solves are cheap, sampling's simplicity may be worth more than its solve count. Where they are not, which is every network of operational size, the count is what matters, and it is the count the book keeps.

10.10 In practice

Count solves, at a stated accuracy. Wall-clock time depends on the machine and the implementation, and state counts depend on the discretization. The number of physics solves needed to reach a stated error on a stated question is the comparison that transfers. Plot error against solves, as Figure 10.2 does, not error against grid size or sample size.

Read the cuts from the compiled graph. The dependency graph of the compiled model records what each quantity reads. Walk it upward from the quantity of interest and note the frontier at each level. The smallest frontier is the cheapest exact enumeration, and a frontier component that is a sum of independent inputs is a convolution, which costs no solve.

Put every shared input in the separator. Before combining region messages, list the inputs that feed more than one region: weather, a shared supply voltage or temperature, a common maintenance crew, a common-mode failure. Condition on each. The test is mechanical: an input with edges into two regions is a separator variable, whatever its physical scale.

Check exactness once, on a grid small enough to enumerate. The chilled-water example checked the region route against 1.95 million full solves at $n = 5$ before trusting it at $n = 33$. The check is cheap at small n and catches a misassigned input, which is the usual error.

Match the route to the question. For one mean in many effective dimensions, sampling is simple and competitive, and it should be used. For conditional means, attributions and many questions of one model, hold the computation in a form the next question can read: the product set, the region messages, the census.

Refine where the error is. A grid’s error has a part per coordinate, and refining one coordinate costs in proportion to its nodes, not to the whole grid. In the region route the outer coordinate is the cheapest to refine: refining only the wet bulb, from nine nodes to 33, cuts the plants’ error of the mean from 0.59 to 0.23 kilowatts at 14,850 plant solves.

10.11 What is missing

Every query in this chapter was a forward one: uncertain inputs pushed through the physics to a consequence. Chapter 11 turns to the inverse direction under operation, where readings arrive one at a time and the question is how cheaply each can be folded into the posterior; the answer, a rank-one update, is the cheapest reuse in the book. Part IV then asks the questions an operator asks, and Chapter 14 in particular develops the census with gradients that §10.8 previewed.

Notes and further reading

The three routes are compared on a chain of data halls in Chapter 20, where enumeration and region messages agree to round-off and the sampling route is the only one that cannot certify a small probability. The advantage of quadrature over sampling in low dimension, and the curse of dimensionality that ends it, are standard; Robert and Casella [85] treat both sides. Variance-based attribution and the Shapley share are Sobol’s [95], Owen’s [77] and Song, Nelson and Staum’s [96]; the pick-freeze estimator and its $(d + 4)N$ or $7N$ solve count for $d = 3$ are Saltelli’s [90]. That every conditional expectation is a partial sum on a product grid is Fubini’s theorem and needs no citation; that the model’s compiled dependency graph exposes the cuts on which the sum can be taken is the framework’s. The chilled-water plants of §10.7 were built for this chapter; their constants are typical of a mid-size data-center plant rather than taken from one. The law of total covariance behind Proposition 10.5 and the trapezoid error bound behind Proposition 10.1 are standard, and both are proved on the page.

The three-strength statement of the claim in §10.9 is the book’s, and it was arrived at by conceding the weak claim to sampling first. The reader who has met the literature on “probabilistic power flow” will recognize the weak claim as the one usually made there, and the strong one as the one that point-estimate, cumulant and surrogate methods make implicitly; the census with gradients of §10.8 is a surrogate method, and Chapter 14 says which.

Summary

- Sampling answers every question and does not care about the size of the state space; what it pays for is the solve. The comparison is in solves per question at equal accuracy.
- On three uncertain ratings, the product grid reaches at 729 solves an accuracy that sampling needs about 20,700 draws for: quadrature’s advantage in low dimension, not the book’s.
- The trapezoid grid’s error is of order h^2 even across kinks, and Monte Carlo’s is $\sigma/\sqrt{N}$ whatever the dimension. In solves the grid’s exponent is $2/d$ against sampling’s $1/2$.
- The attribution costs the grid nothing beyond the grid, because conditional expectations are partial sums on a product set; sampling needs $7N$ solves and is an order of magnitude less accurate at 21,000.
- The model’s dependency graph has cuts; enumerating on the cut $(A+C, B)$ needs 561 solves for the same mean to 10^{-13} as the 4,913-solve grid. The exponent is the cut’s dimension.

- Beyond three inputs the grid dies but the structure survives, as region messages and as a census with gradients: 6,536 solves for the mean and nine questions against 113,876 on a 73-bus network.
- On two chilled-water plants with nine inputs, region messages conditioned on the shared wet bulb replace n^9 solves by $2n^2(3n - 2)$, exactly. They match sampling on the mean and beat it by about thirteen in solves on the shortfall given the weather.
- A common cause belongs in the separator: combining the plants' marginal messages understates the expected shortfall by more than forty percent.
- The book's claim is the strongest one, with its conditions: a small cut, a reusable form, and expensive solves.

Exercises

Exercise 10.1. Derive the closed form of $\mathbb{E}[G]$ for the three-feeder problem from equation (10.1) and the uniform priors, and confirm $16/3$. Then derive $\mathbb{P}(G = 0)$ and confirm 0.46.

Exercise 10.2. Show that on an n -point uniform grid for A and for C , the sum $A + C$ takes $2n - 1$ distinct values, and derive their probabilities. Confirm the $(2n - 1)n$ entries of the third row of Table 10.3.

Exercise 10.3. Implement pick-freeze for the three-feeder problem and reproduce the $7N$ solve count. Then implement the sampler that draws $A + C$ from its convolution and show how many of the seven sample sets it saves.

Exercise 10.4. The grid's mean error falls as n^{-2} and Monte Carlo's as $N^{-1/2}$. For d uncertain inputs the grid costs n^d solves. Find the dimension at which, for an error of 0.01 kilowatts on a problem with the same constants as this one, sampling first needs fewer solves than the product grid.

Exercise 10.5. For the two-region network of Chapter 8 with all five loads uncertain, list the cuts of its dependency graph in nodal form, their dimensions, and the distinct solves each needs on an n -point grid. Which cut is the port pair, and what does enumerating on it cost?

Exercise 10.6. For the chilled-water plants of §10.7, derive $\mathbb{E}[S_k | T]$ in closed form when the loop limit never binds, and from it $\text{Var}(\mathbb{E}[S_k | T])$. Compare with the 1,324 square kilowatts computed with the loop limit, and explain the sign of the difference.

Exercise 10.7. In the region computation for $\mathbb{P}(U > t)$, replace plant 2's grid over its pump limit by the exact uniform distribution, so that given the wet bulb, plant 2's rating sum and plant 1's delivery, the probability of a shortfall above t is a continuous, piecewise-linear function of the remaining inputs. Show that the error in $\mathbb{P}(U > 100)$ then falls as h^2 , and find the n at which it beats Monte Carlo at the same number of plant solves.

Solutions to selected exercises

Exercise 10.1. Write $S = A + C$. Because S and B are both at least 140, $\min(S, B) \geq 140$ and G never exceeds 20. For $0 \leq t < 20$, $G > t$ exactly when $\min(S, B) < 160 - t$, which is the complement of the event that both $S \geq 160 - t$ and $B \geq 160 - t$. The ratings are independent, so

$$\mathbb{P}(G > t) = 1 - \mathbb{P}(S \geq 160 - t) \mathbb{P}(B \geq 160 - t).$$

B is uniform on $[140, 180]$, so $\mathbb{P}(B \geq 160 - t) = (20 + t)/40$. The sum of two independent uniforms on $[70, 120]$ has the triangular density $(s - 140)/2500$ on $[140, 190]$, so $\mathbb{P}(S < 160 - t) = (20 - t)^2/5000$. The mean of a nonnegative variable is the integral of its tail:

$$\mathbb{E}[G] = \int_0^{20} \left[1 - \frac{20+t}{40} + \frac{(20-t)^2(20+t)}{200,000} \right] dt = 20 - 15 + \frac{1}{3} = \frac{16}{3},$$

the last integral by $u = 20 - t$: $\int_0^{20} u^2(40 - u) du / 200,000 = (320,000/3 - 40,000) / 200,000 = 1/3$. At $t = 0$ the tail is $1 - 0.92 \times 0.5 = 0.54$, so $\mathbb{P}(G = 0) = 0.46$. The same route gives the second moment, $\mathbb{E}[G^2] = \int_0^{20} 2t \mathbb{P}(G > t) dt = 400 - 1000/3 + 56/15 = 70.4$, and the variance $70.4 - (16/3)^2 = 41.956$ quoted in §10.2.

Exercise 10.2. On the n -point grid the ratings of A and C take the values $70 + ih$, $i = 0, \dots, n-1$, with $h = 50/(n-1)$. A sum $a_i + c_j = 140 + (i+j)h$ depends only on $i+j$, which runs over $0, \dots, 2n-2$: $2n-1$ distinct values. By Proposition 10.4 the probability of the k -th is $\sum_{i+j=k} w_i w_j$, the discrete convolution of the weight vector with itself. With the trapezoid weights, $w_0 = w_{n-1} = 1/(2(n-1))$ and $w_i = 1/(n-1)$ otherwise, the result is a discrete triangle with ramps at its ends, $(4, 16, 32, 48, 56, 48, 32, 16, 4)/256$ at $n = 5$. The rating of B takes n values independently of $A + C$, so the pair $(A + C, B)$ takes $(2n-1)n$ values: 153, 561, 1,225, 2,145 and 3,321 at $n = 9, 17, 25, 33$ and 41, the third row of Table 10.3. Computing $\mathbb{E}[G]$ on those pairs, with the convolved weights times B 's weights, reproduces the full-grid means of Table 10.1 to 2×10^{-15} .

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

Three routes to one expectation *the cost of a forward-uncertainty question in solves; a product grid pays an exponent equal to the number of inputs; a consequence that reads a group of inputs only through a function of them admits a cut*

`foundation_hvac/thermal_local_to_global/problems/three_routes_to_one_expectation`

Chapter 11

Sequential evidence

Every posterior so far was computed with all the readings in hand. In operation they are not. A sensor reports, then another, then the first again a minute later, and the question after each is what the system now believes. Re-solving the whole model after every reading is correct and wasteful: the reading is one row, and one row changes the posterior by a rank-one term. This chapter shows that folding a reading into a Gaussian posterior costs one solve against a factorization already held, that the same solve yields the number by which the reading surprised the model, that the value of a reading can be computed before it is taken, and that at the scale of a real model the update is tens of times cheaper than a re-solve. It closes Part III.

11.1 Readings arrive one at a time

Take the posterior of a linear-Gaussian branch after the readings so far: precision $\mathbf{\Lambda}$, information $\boldsymbol{\eta}$, mean $\boldsymbol{\mu} = \mathbf{\Lambda}^{-1}\boldsymbol{\eta}$, covariance $\boldsymbol{\Sigma} = \mathbf{\Lambda}^{-1}$, with $\mathbf{\Lambda}$ held as a sparse factorization. A new reading y of the linear combination $\mathbf{h}^\top \mathbf{z}$ with accuracy σ_y is one more row of $\mathbf{g}$, and by §6.1 it adds $w \mathbf{h} \mathbf{h}^\top$ to the precision and $w y \mathbf{h}$ to the information, $w = 1/\sigma_y^2$. For a sensor on one variable, $\mathbf{h}$ is a unit vector and the change is one diagonal entry. The new posterior could be had by refactoring the new precision. It need not be.

11.2 One reading, one rank-one update

Proposition 11.1 (Rank-one conditioning). *Let $\mathbf{z} \sim \mathcal{N}(\boldsymbol{\mu}, \boldsymbol{\Sigma})$ and let $y = \mathbf{h}^\top \mathbf{z} + \nu$ with $\nu \sim \mathcal{N}(0, \sigma_y^2)$ independent of $\mathbf{z}$. Then $\mathbf{z} \mid y$ is Gaussian with*

$$\boldsymbol{\mu}' = \boldsymbol{\mu} + \mathbf{k}(y - \mathbf{h}^\top \boldsymbol{\mu}), \quad \boldsymbol{\Sigma}' = \boldsymbol{\Sigma} - \mathbf{k} \mathbf{s}^\top, \quad \mathbf{s} = \boldsymbol{\Sigma} \mathbf{h}, \quad \mathbf{k} = \frac{\mathbf{s}}{\sigma_y^2 + \mathbf{h}^\top \mathbf{s}}. \quad (11.1)$$

Proof. In information form the reading adds $w \mathbf{h} \mathbf{h}^\top$ to the precision and $w y \mathbf{h}$ to the information, $w = 1/\sigma_y^2$. Write $S = \sigma_y^2 + \mathbf{h}^\top \mathbf{s}$. The claim for the covariance is that $\boldsymbol{\Sigma}' = \boldsymbol{\Sigma} - \mathbf{s} \mathbf{s}^\top / S$ inverts $\boldsymbol{\Lambda}' = \boldsymbol{\Lambda} + w \mathbf{h} \mathbf{h}^\top$. Multiply, using $\boldsymbol{\Lambda} \boldsymbol{\Sigma} = \mathbf{I}$ and $\boldsymbol{\Lambda} \mathbf{s} = \mathbf{h}$:

$$\boldsymbol{\Lambda}' \boldsymbol{\Sigma}' = \mathbf{I} + w \mathbf{h} \mathbf{s}^\top - \frac{(1 + w \mathbf{h}^\top \mathbf{s})}{S} \mathbf{h} \mathbf{s}^\top = \mathbf{I} + w \mathbf{h} \mathbf{s}^\top - w \mathbf{h} \mathbf{s}^\top = \mathbf{I},$$

since $(1 + w \mathbf{h}^\top \mathbf{s})/S = (\sigma_y^2 + \mathbf{h}^\top \mathbf{s})/(\sigma_y^2 S) = w$. This is the Sherman–Morrison identity. For the mean, $\boldsymbol{\mu}' = \boldsymbol{\Sigma}'(\boldsymbol{\eta} + w y \mathbf{h})$. The first part is $\boldsymbol{\Sigma}' \boldsymbol{\eta} = \boldsymbol{\mu} - \mathbf{s}(\mathbf{h}^\top \boldsymbol{\mu})/S$. The second uses

$\Sigma' \mathbf{h} = \mathbf{s} - \mathbf{s}(\mathbf{h}^\top \mathbf{s})/S = \mathbf{s} \sigma_y^2/S$, so $y \Sigma' \mathbf{h} = y \mathbf{s}/S$. Adding, $\boldsymbol{\mu}' = \boldsymbol{\mu} + \mathbf{s}(y - \mathbf{h}^\top \boldsymbol{\mu})/S$, which is $\boldsymbol{\mu} + \mathbf{k}(y - \mathbf{h}^\top \boldsymbol{\mu})$. $\square$

Three things about equation (11.1) carry the chapter.

The only expensive object is $\mathbf{s} = \Sigma \mathbf{h}$, and it is not computed by forming Σ . It is the solution of $\Lambda \mathbf{s} = \mathbf{h}$ against the factorization already held: two triangular solves, the same operation as one selected inversion in §6.3. For a sensor on a single variable, $\mathbf{s}$ is one column of the posterior covariance, the covariance of that variable with every other, which is what a reading of that variable needs to know in order to move every other.

The vector $\mathbf{k}$ is the *gain*. It says how far each variable moves per unit of surprise, and it is the covariance column scaled by the total uncertainty of the reading, prior plus sensor. A variable tightly correlated with the measured one moves a lot; an independent one does not move.

And the covariance update is a subtraction of a rank-one matrix that is never formed. Keep Σ implicit: hold the factorization of the original Λ and a list of the pairs $(\mathbf{k}_i, \mathbf{s}_i)$ from the updates so far. Then any product $\Sigma' \mathbf{v}$ is a solve against the factorization followed by a subtraction per pair, and any marginal variance is a solve followed by a few inner products. After r readings each solve costs r extra inner products, which is nothing until r approaches the ratio of a factorization's cost to a solve's, at which point one refactors and empties the list.

Principle 11.1. *A reading is a rank-one change to the posterior. Folding it in costs one solve against the factorization already held, and the same solve yields the covariance column the reading needed and the gain it produced. Nothing is refactored.*

11.3 The innovation

The scalar $y - \mathbf{h}^\top \boldsymbol{\mu}$ in equation (11.1) is the *innovation*: the reading minus what the model predicted for it. Its predicted spread, $\sqrt{\sigma_y^2 + \mathbf{h}^\top \mathbf{s}}$, is the sensor's accuracy combined with the posterior's own uncertainty about the measured quantity, and the ratio of the two, the *standardized innovation*, is a number the model should see distributed as a standard Gaussian if the model is adequate. A reading that lands three or four spreads from its prediction is either a faulty sensor or a faulty model, and it is flagged before it is folded in. Chapter 12 builds detection on this; here it is enough that the number costs nothing beyond the update, because $\mathbf{h}^\top \mathbf{s}$ was computed for the gain.

Proposition 11.2 (Innovations). *Let readings $y_1, \dots, y_r$ of an adequate linear-Gaussian model be folded in one at a time, and let e_i and s_i be the innovation of reading i and its predicted variance, both computed before reading i is folded in. Then the standardized innovations $e_i/\sqrt{s_i}$ are independent standard Gaussians, $\sum_i e_i^2/s_i$ is chi-squared with r degrees of freedom, and the log predictive density of all the readings is*

$$\log p(y_1, \dots, y_r) = -\frac{1}{2} \sum_{i=1}^r \left(\log 2\pi s_i + \frac{e_i^2}{s_i} \right). \quad (11.2)$$

Proof. By the chain rule of probability, $p(y_1, \dots, y_r) = \prod_i p(y_i \mid y_1, \dots, y_{i-1})$. Under the model, y_i given the earlier readings is Gaussian with mean $\mathbf{h}_i^\top \boldsymbol{\mu}_{i-1}$ and variance s_i : the prediction that Proposition 11.1 makes before it updates. So each factor is the Gaussian density of e_i with

variance s_i , and taking logs gives (11.2). For independence, $e_i/\sqrt{s_i}$ given $y_1, \dots, y_{i-1}$ is standard Gaussian whatever those readings are. The earlier standardized innovations are functions of them, so $e_i/\sqrt{s_i}$ is standard Gaussian given the earlier innovations too. A sequence each member of which is standard Gaussian given all the earlier ones has a joint density that factors into standard Gaussians, which is independence. The sum of squares of r independent standard Gaussians is chi-squared with r degrees of freedom by definition. $\square$

Equation (11.2) is the prediction-error decomposition. The predictive density that Proposition 7.1 used to weigh branches accumulates one reading at a time, from the two numbers each update computes anyway.

The chain, one reading at a time. Return to the processor heat path of Figure 3.1 with hard physics. Every number is from the script `ch11_sequential.py` in the book's `scripts` directory. Under the prior, T_2 is predicted at 70.00 ± 10.45 . The reading is 72.0: innovation $+2.00$, standardized $+0.19$, unremarkable. One rank-one update gives $G = 103.66 \pm 5.82$ and $T_a = 20.16 \pm 2.87$, the second column of Table 3.2. Now T_1 is predicted at 92.73 ± 1.43 , the virtual sensor of §3.4 with its spread now including the instrument's. The reading is 93.0: innovation $+0.27$, standardized $+0.19$ again. The second update gives $G = 104.63 \pm 2.86$, $T_a = 19.73 \pm 1.73$, the third column. The batch posterior with both readings agrees with the two sequential updates to eight decimals in the mean and seven in the covariance, the residual being the conditioning of the tight physics rows and not the method.

Figure 11.1 adds a third reading, $T_a = 19.5$ with accuracy 0.5, and folds the three in three orders. In every order the source ends at 104.97 ± 0.97 , the batch posterior with all three readings. The paths differ. Read the inlet temperature first and the source does not move at all, 100.00 ± 20.00 , because under the prior the inlet temperature and the source are independent and the reading carries nothing about G . Read T_2 next and the source drops to ± 1.40 , far better than the ± 5.82 that T_2 gave alone, because the inlet temperature reading has pinned the one quantity that T_2 confounds with the source. Read T_1 first and the source is at 104.09 ± 4.25 , after which the inlet temperature removes 94 percent of what remains. No innovation in any of the three orders exceeds a quarter of its spread, as it should not for readings consistent with the model.

11.4 Many readings

Readings in sequence are updates in sequence, and for a linear-Gaussian model the result does not depend on the order, since each update is exact and the final posterior is the one with all rows present. A block of r readings taken together is the Woodbury identity in place of Sherman–Morrison: r solves, an $r \times r$ dense system, the same result.

This is the Kalman filter with a static state. The filter of Chapter 16 adds a prediction step between updates, in which the state moves and its uncertainty grows; with no dynamics the prediction is the identity and only the update remains, and the update is equation (11.1). The reader who knows the filter will recognize $\mathbf{k}$ as the Kalman gain and $\sigma_y^2 + \mathbf{h}^T \mathbf{s}$ as the innovation covariance. What the sparse factorization adds is that the state may have a hundred thousand components and the update still costs one solve, because Σ is never formed. The block form is derived in the solution to Exercise 11.1.

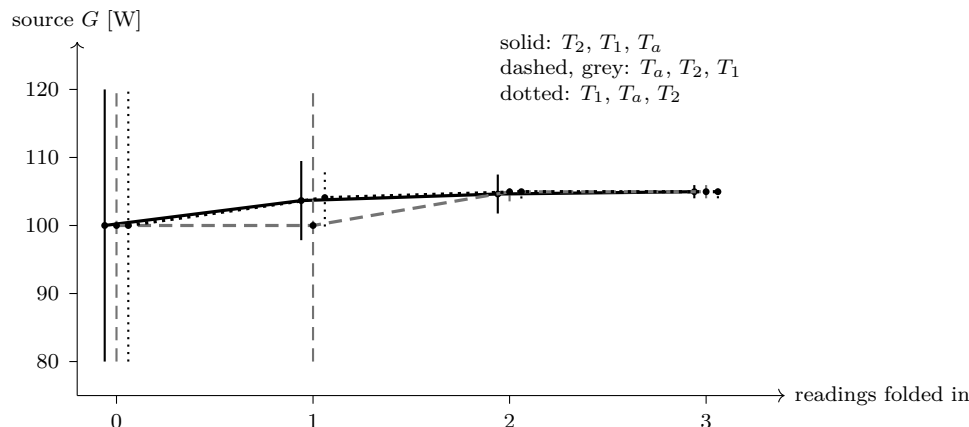


Figure 11.1: The source of the processor heat path as three readings are folded in, in three orders: $T_2 = 72.0$, $T_1 = 93.0$ and $T_a = 19.5$, each of accuracy 0.5. Dots are posterior means and bars one posterior standard deviation; the three orders are offset slightly for legibility. Every order ends at the batch posterior. Read first, the inlet temperature moves nothing, because under the prior the inlet temperature and the source are independent.

11.5 Worked example: a stream of flow readings

The two-region network of Chapter 8 carries six flow meters, on lines 1–2, 2–3, 3–4, 4–5, 4–6 and 5–6, each of accuracy 0.02 per unit. They report in rounds, one after another, and the loads do not change between rounds: twenty-four readings of a static state. The state is a draw from the prior, with loads at buses 2 through 6 of -1.407 , -0.601 , -0.297 , -1.315 and -0.275 . From the third round the meter on line 4–5 reads 0.10 high, a calibration drift of five times its accuracy. Every number is from the script `ch11_more.py`.

Figure 11.2 plots the standardized innovation of each reading and, below it, their running sum of squares against the 99 percent point of the chi-squared distribution with as many degrees of freedom as readings. In the first round the innovations are large in the units of the readings, up to 0.20, and ordinary in their own, none beyond 1.7 spreads, because the predicted spread of a first reading is mostly the prior’s uncertainty about the flow: 0.19 for line 1–2. By the second round every flow is known to about the meters’ accuracy, and the predicted spreads have fallen to between 0.026 and 0.028. The drifting meter’s first biased reading, the sixteenth, lands 4.2 spreads high, and its second, the twenty-second, 3.7. No other reading in the stream exceeds 1.7.

The running sum tells the same story less sharply. It crosses the quantile at the sixteenth reading, falls back below it at the twentieth as clean readings dilute the one bad one, and crosses again for good at the twenty-second. A cumulative test spreads a sudden fault over every reading that follows; a per-reading test sees it at once. The cumulative test is the right one for a slow drift that no single reading reveals.

Detection matters because a folded-in fault corrupts everything the reading touches. Folding all twenty-four readings in puts the load at bus 5 at -1.355 ± 0.017 , 2.3 standard deviations from the true -1.315 . Withholding the two flagged readings gives -1.304 ± 0.020 , 0.6 from it. The rule that did the withholding, to hold aside any reading whose standardized innovation exceeds three, used nothing the update had not already computed. Chapter 12 turns the rule into a test with a stated false-alarm rate and asks which fault explains a flag.

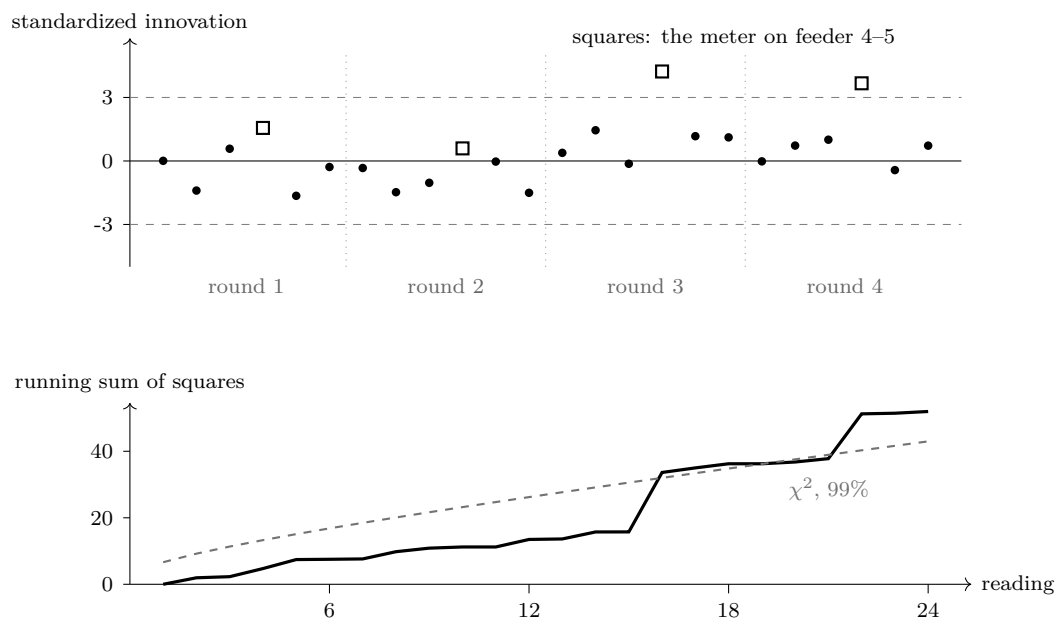


Figure 11.2: The two-region network’s six flow meters read in four rounds, a static state. Top: the standardized innovation of each reading; squares mark the meter on line 4–5, which reads 0.10 high from the third round, and the dashed lines are at ± 3 . Bottom: the running sum of squared standardized innovations (solid) against the 99 percent point of the chi-squared distribution with as many degrees of freedom as readings (dashed).

Last, the evidence. The sum over the stream of the per-reading terms of equation (11.2) is 32.146284. The log predictive density of all twenty-four readings at once, a twenty-four-dimensional Gaussian with its own determinant and quadratic form, is the same to the six decimals shown.

11.6 The Laplace posterior and re-linearization

For a nonlinear model the posterior is Gaussian only in the Laplace sense of §6.4: the Gaussian at the mode with the curvature there. Proposition 11.1 conditions that Gaussian exactly. What it does not do is move the linearization point: the new mode of the true posterior differs from μ' by the amount the nonlinear rows curve between the old mode and the new mean.

The right procedure is the cheap one first. Fold the reading in by the rank-one update; check the standardized innovation and the size of the shift $\mu' - \mu$ against the posterior width; if both are modest, the linearization is still good and nothing more is needed. If either is large, take one Gauss–Newton step from μ' , which lands on the exact new mode when the rows are nearly linear across the shift, and refactor there. For a model whose rows are linear, which the DC and thermal models of this book are, the check always passes and the update is always exact. For an AC model the check fails only when a reading moves the state by a sizable fraction of the region over which the sines and cosines curve, which under normal operation is rarely.

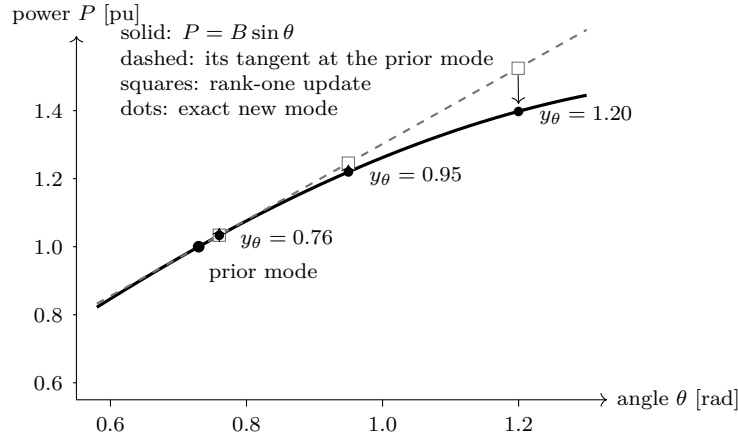


Figure 11.3: A line with flow $P = B \sin \theta$, $B = 1.5$, and three phasor readings of its angle. The Laplace posterior before the readings lies along the tangent at the prior mode (dashed). The rank-one update of that Gaussian moves along the tangent (squares), while the exact new modes lie on the curve (dots). The error grows with the shift, from a thirtieth to two and then eleven posterior standard deviations. One Gauss–Newton step from each square reaches its dot.

A worked example on a nonlinear line. Take one line whose flow is $P = B \sin \theta$ with $B = 1.5$ per unit, a prior of 1.0 ± 0.3 on the power it carries, a physics row of width 0.01, and a phasor measurement of the angle θ with accuracy 0.01 radians. Before any reading the Laplace posterior sits at $\theta = 0.7297$, $P = 1.000 \pm 0.300$, θ to within ± 0.269 , and the two are correlated at 0.9994: the Gaussian lies along the tangent to the sine at the mode. Figure 11.3 draws three readings of the angle, 0.76, 0.95 and 1.20. For the first, the rank-one update gives $P = 1.0338$ against the exact new mode 1.0333 ± 0.0148 , an error of a thirtieth of a posterior standard deviation. For the second it gives 1.2457 against 1.2197 ± 0.0133 , two standard deviations off. For the third it gives 1.5245 against 1.3975 ± 0.0114 , eleven off. The update moves along the tangent, and the sine has bent away from it. In every case one Gauss–Newton step from the updated mean lands on the exact mode to 2×10^{-8} .

The two checks of the procedure coincide here, because the reading is of θ itself and much sharper than the prior: the standardized innovations are 0.11, 0.82 and 1.75, and so are the shifts in units of the prior’s standard deviation of θ . Neither innovation of the bad cases would raise an alarm as a fault. The shift is what matters, and a shift of 0.82 prior standard deviations already cost two posterior ones. Re-linearize whenever the shift exceeds about a quarter of the prior’s standard deviation along the reading; the step costs one factorization.

11.7 The value of a reading before it is taken

Look at the covariance update in equation (11.1): it does not contain y . The reduction in uncertainty that a reading brings is known before the reading is taken. For a target quantity $g = \mathbf{c}^T \mathbf{z}$, the posterior variance after a reading of $\mathbf{h}^T \mathbf{z}$ with accuracy σ_y is

$$\text{Var}'(g) = \text{Var}(g) - \frac{(\mathbf{c}^T \mathbf{\Sigma} \mathbf{h})^2}{\sigma_y^2 + \mathbf{h}^T \mathbf{\Sigma} \mathbf{h}}, \quad (11.3)$$

Table 11.1: The value of the next sensor, computed before any reading. Top: the chain, target G , prior spread 20. Bottom: the two-region network, target P_5 , prior spread 0.200, flow meters of accuracy 0.02.

chain, sensor on	sd of G after	reduced by
<i>under the prior</i>		
T_1 (acc. 0.5)	4.25	95%
T_2 (acc. 0.5)	5.82	92%
T_a (acc. 0.5)	20.00	0%
Q_{2a} (acc. 2.0)	1.99	99%
<i>after T_2 is read (sd 5.82)</i>		
T_1	2.86	76%
T_a	1.40	94%
Q_{2a}	1.89	89%
network, meter on	sd of P_5 after	reduced by
F_{12}	0.187	12%
F_{23}	0.179	20%
F_{34}	0.164	33%
F_{45}	0.093	78%
F_{46}	0.179	20%
F_{56}	0.145	48%

whatever the reading turns out to be. It follows from the covariance update of equation (11.1) by multiplying on both sides by $\mathbf{c}$: $\mathbf{c}^\top \Sigma' \mathbf{c} = \mathbf{c}^\top \Sigma \mathbf{c} - (\mathbf{c}^\top \mathbf{k})(\mathbf{s}^\top \mathbf{c})$, and $\mathbf{c}^\top \mathbf{k} = \mathbf{c}^\top \Sigma \mathbf{h} / (\sigma_y^2 + \mathbf{h}^\top \Sigma \mathbf{h})$. The reduction is the squared covariance between the target and the measured quantity, scaled by the measured quantity's total uncertainty. A sensor is valuable to a target exactly insofar as the two are correlated under the current posterior, and its value changes as the posterior does.

When the target is the whole state rather than one quantity, the natural measure is the reduction in entropy, which for a Gaussian is half the log of the ratio of determinants of the covariances before and after. A single reading gives

$$\frac{1}{2} \log \frac{\det \Sigma}{\det \Sigma'} = \frac{1}{2} \log \frac{\det \Lambda'}{\det \Lambda} = \frac{1}{2} \log \left(1 + \frac{\mathbf{h}^\top \Sigma \mathbf{h}}{\sigma_y^2} \right). \quad (11.4)$$

The last step is the matrix determinant lemma: $\det(\Lambda + w \mathbf{h} \mathbf{h}^\top) = \det \Lambda \det(\mathbf{I} + w \Sigma \mathbf{h} \mathbf{h}^\top)$, and $\mathbf{I} + w \Sigma \mathbf{h} \mathbf{h}^\top$ has the eigenvalue $1 + w \mathbf{h}^\top \Sigma \mathbf{h}$ on $\mathbf{h}$ and the eigenvalue 1 on every vector orthogonal to $\mathbf{h}$, so its determinant is $1 + w \mathbf{h}^\top \Sigma \mathbf{h}$. A reading is worth most to the whole state where the state's own uncertainty about the measured quantity is largest compared with the sensor's accuracy.

Table 11.1 applies it. On the chain, a sensor on the inlet temperature is worth nothing to the source under the prior: the two are independent, as Chapter 5 said, so their covariance is zero and equation (11.3) subtracts nothing. A sensor on either temperature is worth most of the source's variance, and a direct flow meter, even a poor one, nearly all of it. Now read T_2 and ask again. The source's spread is 5.82, and the sensor that would reduce it most is the one on the inlet temperature, by 94 percent, because the reading has correlated the source with the inlet temperature at -0.985 and a reading of one is now a reading of the other. The sensor that

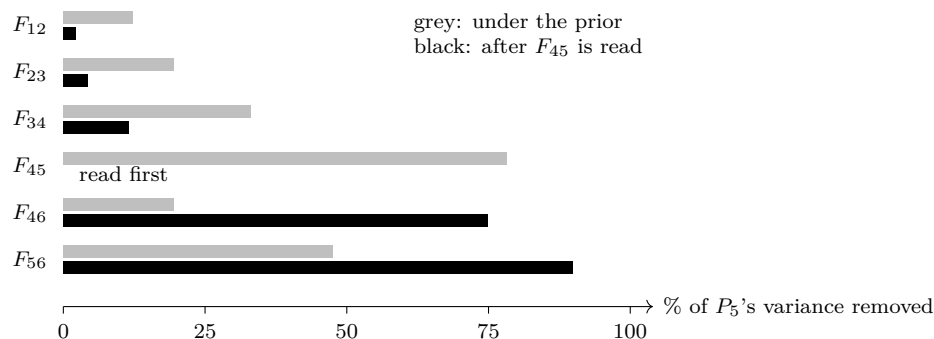


Figure 11.4: The value of each flow meter to the load at bus 5, as the percentage of its current variance the meter would remove, computed before any reading. Grey: under the prior. Black: after the meter on line 4–5 has been read. The meter on line 5–6 goes from second to decisive, because the load at bus 5 is the difference of the two flows at the bus.

was worthless has become the best. That is the ridge of §3.4 read as a decision: the next sensor should be placed where the posterior’s remaining uncertainty is concentrated, and the posterior says where.

On the two-region network the target is the load at bus 5, and the candidates are flow meters on each line. The meter on the line into bus 5 from bus 4 is worth 78 percent of the load’s variance; the meter on the tie line, two buses away, a third; the meter on line 1–2 in the other region, an eighth. The ordering follows the graph, and equation (11.3) computes it from one solve per candidate against the factorization already held.

Figure 11.4 shows how the values change once the best meter has been read. After the meter on line 4–5, the meter on line 5–6, worth 48 percent of the prior variance, is worth 90 percent of what remains, and the meter on line 4–6 is worth 75 percent; the meters in region *A* fall to a few percent. The balance at bus 5 makes the load the difference of the two flows at the bus. With one flow known, the other is the load, and the meter that reads it directly becomes decisive. The whole-state measure of equation (11.4) orders the meters differently. The meter on the tie line is worth 2.86 nats to the whole state, the most of the six, and the meter on line 4–5 only 2.02. The target chooses the sensor; there is no best sensor in the abstract.

Choosing sensors by this criterion, one at a time, each chosen given the last, is greedy sensor placement, and the criterion is the expected reduction in a target’s variance. Chapter 12 generalizes the criterion to the expected information gain about the whole state, which is the classical measure of an experiment’s value, and shows that for a Gaussian it is the log of a determinant ratio, computed by the same solves.

Principle 11.2. *The uncertainty a reading removes is known before the reading is taken. It is the squared covariance between target and measurement, divided by the measurement’s total spread, and it is one solve per candidate.*

11.8 Cost at scale

The chain has six unknowns and the comparison is not worth timing. Take instead a conducting plate of $m \times m$ nodes, each conducting to its four neighbors and losing heat to an ambient

Table 11.2: A conducting plate of $m \times m$ nodes: one sparse factorization against one rank-one update, and ten readings folded in by refactoring each time against factoring once and updating ten times. Means agree to 10^{-13} .

m	unknowns	factor nonzeros	one factorization	one update	ratio	ten readings, ratio
30	900	7.0×10^4	6.2 ms	0.13 ms	48	6.9
100	10,000	2.0×10^6	117 ms	3.5 ms	33	10.7
300	90,000	3.3×10^7	3.55 s	49 ms	72	9.1

reservoir, with an uncertain source at every node; eliminating the sources leaves one soft row per node on the temperatures, and the precision is sparse with the plate's own structure, which in two dimensions has fill. Ten temperature sensors at random nodes report in turn. Table 11.2 times the two ways of folding them in.

One rank-one update costs between a thirtieth and a seventieth of a factorization across three decades of size, the ratio being that of a solve to a factorization, which for a two-dimensional sparse structure grows slowly with size. Over ten readings the factor-once route is about ten times faster than refactoring, the first factorization being paid either way; over a hundred it would be some fifty times faster, and the limit is the per-update ratio. The means agree to thirteen decimals. At ninety thousand unknowns a reading is folded in fifty milliseconds, which is faster than sensors report.

11.9 Worked example: where to put the next thermometer

A cold plate spreads the heat of a component into a coolant. Model it as the plate of §11.8 at 30×30 nodes with stronger conduction: 4 watts per kelvin between neighbouring nodes, 0.25 watts per kelvin from each node to the coolant, and an uncertain source of standard deviation 1 watt at every node. The component sits at the centre, where no thermometer can go, and the temperature there is the target. Thermometers of accuracy 0.05 kelvin can go on any other node. Under the prior the centre's temperature has a standard deviation of 0.288 kelvin, and it is correlated with each neighbour at 0.92.

Figure 11.5(a) maps the value of a thermometer at each node near the centre, by equation (11.3). The whole map needs one column of the covariance, the centre's, and its diagonal. A neighbour removes 82.6 percent of the centre's variance, a node two steps away 74.0, three steps 59.1, and seven steps 23.3. Conduction spreads the correlation over several nodes, so the value falls off slowly with distance. Greedy placement takes a neighbour first, and the centre's standard deviation drops to 0.120 kelvin.

Panel (b) is the map after that reading. The best next position is the opposite neighbour, now worth 56.6 percent of what remains. The nodes beside the first thermometer have lost most of their value, and those on the far side have kept it. The first reading told the model the temperature on one side of the centre, and what remains uncertain is the gradient across it, which the opposite side measures. The second thermometer brings the centre to 0.079 kelvin. The third, on a side neighbour, removes 14.5 percent of what remains, and the fourth, on the last neighbour, 20.5 percent, more than the third did. A thermometer's value can rise as others are placed: readings on opposite sides of a node are worth more together than apart, the explaining away of Proposition 5.2 again.

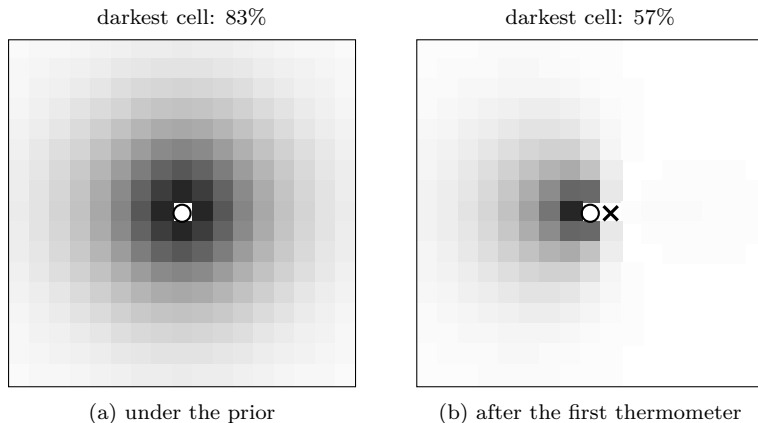


Figure 11.5: The value of a thermometer at each node near the centre of a 30×30 cold plate, for the temperature at the centre (ringed), where no thermometer can go. Darker cells remove more of the centre’s current variance; each panel is scaled to its own largest value. (a) Under the prior: the four neighbours are worth 82.6 percent each, and the value falls off slowly with distance. (b) After a thermometer on the east neighbour (cross), whose own cell is now worth nothing: the opposite neighbour is now worth most, 56.6 percent of what remains.

The four thermometers leave the centre at 0.065 kelvin, and no thermometer outside the centre can do much better. With its four neighbours known exactly the centre would still be uncertain by 0.060 kelvin, and with every other node of the plate known exactly, by 0.055. What remains is the centre’s own source. It enters only the centre’s balance, where it is divided by the total conductance at the node, $4 \times 4 + 0.25$ watts per kelvin, which sets the scale: $1/16.25$ is 0.062 kelvin. The neighbours’ balances recover a little more, through the conduction between them and the centre, and that is all there is. A virtual sensor at the centre is limited not by where the thermometers go but by what the physics lets through.

11.10 In practice

Hold one factorization and a correction list. Factor the precision once, keep the pairs $(\mathbf{k}_i, \mathbf{s}_i)$ of the updates, and refactor when the list costs more to apply than a factorization costs to redo. Table 11.2 puts the break-even between thirty and seventy updates for the plate.

Test every reading before folding it in. Compute the standardized innovation from the solve the update needs anyway, and hold aside a reading beyond three spreads. Count the holds per sensor. A sensor that is held once may have glitched; a sensor held repeatedly is drifting, as the meter on line 4–5 was.

Run a cumulative test as well, and know what it dilutes. The running sum of squared innovations catches a slow drift that no single reading reveals, and it blurs a sudden fault over every reading that follows. In the stream of §11.5 it dipped back below its quantile between the two biased readings. Use both tests.

Re-linearize by shift, not by surprise. On a nonlinear model the error of the rank-one update grows with how far the reading moves the state, measured in prior standard deviations along the reading. A modest innovation does not certify a small error. One Gauss–Newton step from the updated mean restores the mode.

Choose the next sensor for the question. Compute the value of each candidate for the target that matters, by equation (11.3), and recompute after every reading, since the values change. The whole-state measure of equation (11.4) is for when there is no single target.

Order does not change the answer; it changes what is known early. Every order ends at the batch posterior. When decisions are made between readings, read first the sensor worth most now.

11.11 What is missing

Part III has organized the computation: exactly by regions, approximately where the structure runs out, costed against sampling in solves, and updated one reading at a time without re-solving. What it has not done is ask a question. Every computation so far returned a posterior, and a posterior is not an answer until someone asks it something: what is the temperature where there is no sensor, is this reading a fault or a leak, what would happen if that line were taken out, which input drives the risk, which lines are most likely to fail together. Those are the operator’s questions, and Part IV asks them in turn, beginning with the first.

Notes and further reading

The Sherman–Morrison and Woodbury identities and their history are reviewed by Hager [34]. The update (11.1) is the measurement update of the Kalman filter [42], whose gain and innovation are the same objects; Särkkä and Svensson [91] give the modern treatment, including the information form used here and the relation to Gaussian inference on a graph. Computing the covariance column by a solve against a cached sparse factorization rather than by forming the covariance is selected inversion again [23]; the correction-list scheme of §11.2 is the standard way to apply low-rank updates to a factorized matrix without refactoring, and is what a Kalman filter on a sparse state amounts to.

That the covariance reduction from a Gaussian measurement is independent of the measurement’s value, and can therefore be used to choose measurements before they are made, is the basis of Bayesian experimental design. Lindley [59] defined the value of an experiment as its expected information; Chaloner and Verdinelli [14] review the Bayesian theory, and the greedy variance-reduction criterion of §11.7 is its simplest instance. The reading of the criterion on the chain, that the inlet-temperature sensor’s value goes from nothing to nearly everything once one temperature is known, is the book’s illustration of a general fact: a measurement’s value is a property of the current posterior, not of the sensor.

The prediction-error decomposition of equation (11.2) is standard in filtering, where it is how the likelihood of a model’s parameters is computed from a run of the filter; Särkkä and Svensson [91] derive it in that setting. The counterexample to greedy placement in the solution to Exercise 11.4 is the explaining-away of Proposition 5.2 read as a design problem.

Summary

- A reading adds a rank-one term to the precision. Conditioning on it is one solve against the held factorization for the covariance column, a gain, and a subtraction never formed. Exact for a linear-Gaussian branch.
- The same solve gives the innovation's predicted spread; the standardized innovation is the running adequacy test. Both of the chain's readings surprised the model by a fifth of a spread.
- Readings in sequence commute; blocks use Woodbury; the whole is the static Kalman filter on a sparse state. For a Laplace posterior, update first and re-linearize only when the innovation or the shift is large.
- The variance a reading removes from a target is known before the reading: squared covariance over total spread. On the chain the inlet-temperature sensor is worth nothing before T_2 is read and 94 percent of the remaining variance after; on the network the meter nearest the target is worth most.
- On a plate of ninety thousand unknowns one update costs a seventieth of a factorization and takes fifty milliseconds.
- Standardized innovations of an adequate model are independent standard Gaussians, and their log densities sum to the evidence. On the network stream a meter drifting by five times its accuracy was flagged at 4.2 spreads on its first biased reading; folding it in would have moved the load at bus 5 by 2.3 standard deviations.
- On a nonlinear line the rank-one update errs by up to eleven posterior standard deviations when a reading shifts the state by 1.75 prior ones. One Gauss–Newton step repairs it.
- On a cold plate the best place for a thermometer near an inaccessible hot spot is a neighbour, and after it the opposite neighbour. Four thermometers bring the hot spot to 0.065 kelvin, against a floor of 0.055 that no outside thermometer can pass.
- A sensor's value depends on the target and on what has been read: after the meter on line 4–5, the meter on line 5–6 goes from 48 to 90 percent of the load's remaining variance.

Exercises

Exercise 11.1. Derive equation (11.1) from the information-form update $\Lambda' = \Lambda + w\mathbf{h}\mathbf{h}^\top$, $\boldsymbol{\eta}' = \boldsymbol{\eta} + wy\mathbf{h}$ and the Sherman–Morrison identity. Then derive the Woodbury form for r simultaneous readings and show it reduces to r sequential applications of the rank-one form.

Exercise 11.2. Show that the standardized innovations of a sequence of readings on an adequate linear-Gaussian model are independent standard Gaussians, so that their sum of squares over r readings is chi-squared with r degrees of freedom. Relate this to the misfit statistic of §4.5.

Exercise 11.3. On the chain, read T_a first (say 19.5 with accuracy 0.5), then T_2 , then T_1 , and confirm that the final posterior equals the batch posterior with all three readings. Then compute the value of each of the three sensors under the prior and after each reading, and show the order in which greedy placement would choose them.

Exercise 11.4. For the two-region network, choose two flow meters greedily to minimize the posterior variance of P_5 , then choose the best pair by exhaustive search over the fifteen pairs, and compare. Repeat with the target changed to the tie flow F_{34} .

Exercise 11.5. Rerun the plate timing with a hundred readings instead of ten, and with the correction list refreshed by a refactorization every r readings for $r \in \{10, 30, 100\}$. Find the r that minimizes total time at $m = 100$ and relate it to the per-update ratio of Table 11.2.

Solutions to selected exercises

Exercise 11.1. The rank-one form is the proof of Proposition 11.1. For r readings at once, stack their rows into $\mathbf{H}$, $r \times n$, with noise covariance $\mathbf{R}$, and write $\mathbf{S} = \mathbf{R} + \mathbf{H}\mathbf{\Sigma}\mathbf{H}^\top$. The claim is that $\mathbf{\Sigma}' = \mathbf{\Sigma} - \mathbf{\Sigma}\mathbf{H}^\top\mathbf{S}^{-1}\mathbf{H}\mathbf{\Sigma}$ inverts $\mathbf{\Lambda}' = \mathbf{\Lambda} + \mathbf{H}^\top\mathbf{R}^{-1}\mathbf{H}$. Multiplying,

$$\begin{aligned}\mathbf{\Lambda}'\mathbf{\Sigma}' &= \mathbf{I} + \mathbf{H}^\top\mathbf{R}^{-1}\mathbf{H}\mathbf{\Sigma} - \mathbf{H}^\top\mathbf{S}^{-1}\mathbf{H}\mathbf{\Sigma} - \mathbf{H}^\top\mathbf{R}^{-1}\mathbf{H}\mathbf{\Sigma}\mathbf{H}^\top\mathbf{S}^{-1}\mathbf{H}\mathbf{\Sigma} \\ &= \mathbf{I} + \mathbf{H}^\top\mathbf{R}^{-1}(\mathbf{S} - \mathbf{R} - \mathbf{H}\mathbf{\Sigma}\mathbf{H}^\top)\mathbf{S}^{-1}\mathbf{H}\mathbf{\Sigma} = \mathbf{I},\end{aligned}$$

where the second line inserts $\mathbf{S}\mathbf{S}^{-1}$ into the second term of the first and $\mathbf{R}^{-1}\mathbf{R}$ into the third. The mean follows as in the rank-one case: $\boldsymbol{\mu}' = \boldsymbol{\mu} + \mathbf{\Sigma}\mathbf{H}^\top\mathbf{S}^{-1}(\mathbf{y} - \mathbf{H}\boldsymbol{\mu})$. The cost is r solves for $\mathbf{\Sigma}\mathbf{H}^\top$ and one dense $r \times r$ factorization. To see that r rank-one updates give the same result when $\mathbf{R}$ is diagonal, look at the information form. The batch posterior has precision $\mathbf{\Lambda} + \sum_i w_i \mathbf{h}_i \mathbf{h}_i^\top$ and information $\boldsymbol{\eta} + \sum_i w_i y_i \mathbf{h}_i$. Each rank-one update is exact, so it produces the posterior whose precision and information have exactly one more term of each sum. After r updates both sums are complete, in whatever order they were taken, and a Gaussian is determined by its precision and information. The stream of §11.5 confirms it to machine precision: its sequential evidence equals the batch predictive density.

Exercise 11.3. In every order the source ends at 104.97 ± 0.97 and the inlet temperature at 19.52 ± 0.48 , the batch posterior with all three rows; Figure 11.1 draws the three paths. The values for the source, as percentages of its current variance, are as follows. Under the prior, T_1 is worth 95.5, T_2 91.5 and T_a nothing, so greedy placement takes T_1 . After it, T_a is worth 94.4 and T_2 54.5, so greedy takes T_a . After both, T_2 removes 6.1 percent. The greedy order is T_1 , T_a , T_2 , and the sensor worth nothing at first is chosen second, because the first reading made the inlet temperature the largest remaining uncertainty about the source. In the order the exercise prescribes, T_a first, the source's variance is unchanged by the first reading, as its value of zero said it would be.

Exercise 11.4. For the load at bus 5, greedy placement takes the meter on line 4–5 first, worth 78 percent, and then the meter on line 5–6, which leaves a standard deviation of 0.0296. Exhaustive search over the fifteen pairs finds the same pair best; the next are 4–5 with 4–6 at 0.0468 and 4–6 with 5–6 at 0.0475. For the tie flow F_{34} greedy takes the meter on the tie line itself and then any other: every pair containing it leaves 0.0199 or 0.0200, the meter's own accuracy, and the second meter hardly matters. On this network greedy placement of two meters is optimal for all seventeen variables as targets, for sums and differences of loads, and for the whole-state measure on the five loads.

It is not optimal in general, and the failure is explaining away. Let the target be $t \sim \mathcal{N}(0, 1)$ and let a nuisance $u \sim \mathcal{N}(0, 1)$ be independent of it. Offer three sensors: A reads $t+u$ and B reads u , both with accuracy 0.01, and C reads t with accuracy 0.5. Alone, C removes $1 - 1/(1+4) = 80$ percent of the target's variance, A removes $1/(2+10^{-4})$, about half, and B nothing, since u is independent of t . Greedy takes C , leaving a variance of 0.2. Then A has covariance 0.2 with

the target and variance 1.2, and removes $0.04/1.2$, leaving 0.167, while B is still worth nothing. The pair A and B , which greedy never considers, leaves about 2×10^{-4} : their difference reads t to within 0.014. A meter on a flow that carries none of the target can be worthless alone and decisive in a pair. When candidates come in such pairs, search over pairs.

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

Which thermometer to buy *the value of a reading before it is taken; a reading's worth is its sensitivity squared over its noise variance; the value is computable from the graph and the instrument*

`level1_building/active_sensing/problems/which_thermometer_to_buy`

Part IV

The operator's questions

Chapter 12

Conditioning, diagnosis, and virtual sensors

A posterior is not an answer. It is a distribution over every variable of the system, and an operator asks it something specific: what is the temperature at the node that has no sensor, is this reading a fault or a leak, can this parameter be recovered from these sensors at all, and which sensor should be added next. This chapter shows that each of those questions is a readout of the one posterior, computed from the factorization already held, and that the posterior can also be asked the question that matters most before any other: whether it should be believed. Adequacy, localization, hypothesis comparison, identifiability, experiment design and the validity of the Gaussian approximation are each one section, each with a number on the chain, and each is a solve or a determinant against Λ .

12.1 Everything is a readout

Table 12.1 lists the questions of this chapter and the next three against what each reads from the posterior. The point of the table is its right-hand column: nothing in it is a new model. Adding a question does not add a computation to the model; it adds a readout of a posterior that was computed once. That is the practical consequence of building the probabilistic model on the physics' own rows, and it is why the book insisted in Chapter 3 that sensors and priors be added to the graph rather than the graph be built around them.

12.2 Virtual sensors

The marginal of a variable that no sensor reads is a *virtual sensor*: the physics and the sensors that do exist determine it, and the posterior says how well. It is the same marginal as for a measured variable, read the same way; the only difference is whether a likelihood factor happens to touch it. Table 12.2 gives the full posterior of the chain with both temperature readings, from the script `ch12_diagnosis.py` in the book's `scripts` directory, which supplies every number in the chapter. The two measured temperatures are known to half a degree, their sensors' accuracy less a little for the physics' corroboration. The two heat flows, which no instrument reads, are known to 2.9 watts, and the source and the inlet temperature likewise, all from two thermometers and four rows of physics.

Table 12.1: Operational questions as readouts of one posterior.

	Question	Readout
Q1	estimate a measured quantity	its marginal mean and spread
Q2	estimate an unmeasured one (virtual sensor)	the same marginal, on a variable with no sensor
Q3	is the model adequate?	the misfit against its chi-squared law
Q4	where is it inadequate?	studentized residuals, ranked
Q5	which explanation?	log-evidence of each hypothesis
Q6	can this parameter be recovered?	the parameter block's Schur complement and its flattest direction
Q7	which sensor next?	expected information gain, one solve per candidate
Q8	should the Gaussian be believed?	curvature probes and reweighting efficiency
Q9	what if? (Chapter 13)	clamp, re-infer
Q10	which input drives the risk? (Chapter 14)	gradients from the solve

Table 12.2: The chain's posterior with both readings: every variable, with whether a sensor reads it.

variable	posterior	sensor
T_1	92.97 ± 0.47	yes
T_2	72.04 ± 0.44	yes
Q_{12}	104.63 ± 2.86	no
Q_{2a}	104.63 ± 2.86	no
G	104.63 ± 2.86	no
T_a	19.73 ± 1.73	no

A virtual sensor is only as good as the model behind it, which is why the rest of the chapter is about testing the model.

12.3 Is the model adequate?

Chapter 4 named the misfit, the sum of squared standardized residuals over every factor at the posterior mode, and stated its law with its assumptions. Restated:

Proposition 12.1 (Adequacy). *For a linear-Gaussian model with m_g factors (physics rows, priors and sensors, each a Gaussian pseudo-observation) and n unknowns, if the model is correctly specified, the misfit $\chi^2 = \mathbf{g}(\mathbf{z}^*)^\top \mathbf{\Omega} \mathbf{g}(\mathbf{z}^*)$ is chi-squared distributed with $m_g - n$ degrees of freedom. Its expected value is $m_g - n$, and the probability of a misfit at least as large as the one observed is the model's p -value.*

Proof. Scale each factor by the square root of its weight, so that the factors read $\tilde{\mathbf{c}} = \tilde{\mathbf{H}}\mathbf{z} + \tilde{\mathbf{e}}$, with $\tilde{\mathbf{e}}$ standard Gaussian in m_g dimensions when the model is correctly specified. The mode is the least-squares solution $\mathbf{z}^* = (\tilde{\mathbf{H}}^\top \tilde{\mathbf{H}})^{-1} \tilde{\mathbf{H}}^\top \tilde{\mathbf{c}}$, and the standardized residual vector is $\tilde{\mathbf{c}} - \tilde{\mathbf{H}}\mathbf{z}^* = (\mathbf{I} - \mathbf{P})\tilde{\mathbf{c}} = (\mathbf{I} - \mathbf{P})\tilde{\mathbf{e}}$, where $\mathbf{P} = \tilde{\mathbf{H}}(\tilde{\mathbf{H}}^\top \tilde{\mathbf{H}})^{-1} \tilde{\mathbf{H}}^\top$ is the orthogonal projection onto the columns of $\tilde{\mathbf{H}}$. The second equality holds because $(\mathbf{I} - \mathbf{P})\tilde{\mathbf{H}} = \mathbf{0}$. The misfit is $\tilde{\mathbf{e}}^\top (\mathbf{I} - \mathbf{P})\tilde{\mathbf{e}}$, and $\mathbf{I} - \mathbf{P}$ is

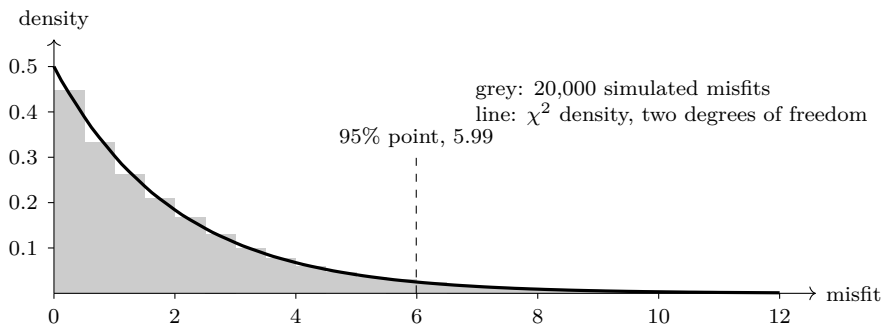


Figure 12.1: Twenty thousand misfits of the chain’s model on readings generated from the model itself, against the chi-squared density with two degrees of freedom that Proposition 12.1 predicts. The dashed line is the 95 percent point, above which 4.9 percent of the simulated misfits fall.

a symmetric projection of rank $m_g - n$. In a basis of its eigenvectors the misfit is the sum of squares of $m_g - n$ independent standard Gaussians, which is the chi-squared law. $\square$

A prior counts as a pseudo-observation of its variable at its mean, and the proof treats it as one; that is where “correctly specified” bites. A broad prior that only keeps a variable identifiable, and from which the truth is not drawn, is not a pseudo-observation in this sense. It belongs in neither the misfit nor the count, and counting it costs a real network its ability to reject a bad reading. The script `ch12_more.py` checks the law by simulation. Twenty thousand reading pairs generated from the chain’s own priors and physics give a mean misfit of 2.00 against the law’s 2, a variance of 3.89 against 4, and 4.9 percent of misfits above the 95 percent point. The physics in those draws was exact, not perturbed at its stated width of 0.01 watts. Perturbing it at that width changes the three numbers to 2.01, 4.12 and 5.2 percent, the same law within simulation error. Figure 12.1 draws the simulated misfits against the density the proposition predicts.

When $m_g - n \leq 0$ the model has no redundancy and adequacy cannot be assessed; a model that exactly fits its data by construction has not been tested by it, and the honest report is that verdict rather than a comfortable fit. On the chain with two readings there are eight factors and six unknowns: two degrees of freedom.

With the consistent readings 72.0 and 93.0 the misfit is 0.07 against an expectation of 2; the p-value is 0.97. With the inconsistent pair 72.0 and 105.0 of Chapter 4, and the physics rows at a diagnostic width of one watt so that they may be violated, the misfit is 70 and the p-value is 5×10^{-16} . The model is wrong, and the test says so with no knowledge of how.

12.4 Where is it wrong?

The natural next step is to look at the residuals one factor at a time. The raw residual of a sensor, $y - \mathbb{E}[z]$, has a variance smaller than the sensor’s, because the fitted mean was pulled toward the reading; the right statistic divides by $\sqrt{\sigma_y^2 - \text{Var}[z]}$, the *studentized* residual, and the same correction applies to any factor. This is the classical bad-data statistic of state estimation and the gross-error statistic of data reconciliation, and it is one selected inversion per factor. The variance $\sigma_y^2 - \text{Var}[z]$ is derived in the solution to Exercise 12.1.

For the inconsistent readings the studentized residuals are, in order of the factors: balance at node 1, +2.4; balance at node 2, -7.8; conduction closure, -8.4; convection closure, +7.8;

Table 12.3: Redundancy of each meter on the two-region network, and the smallest gross error that produces a studentized residual of three. Every meter has accuracy 0.02 per unit.

meter	redundancy r_k	smallest error flagged [pu]
$F_{12}, F_{23}, F_{45}, F_{56}$	0.58	0.079
F_{13}, F_{46}	0.28	0.11
P_2, P_5	0.31	0.107
F_{34} (tie line)	0.019	0.43

source prior, +2.4; inlet-temperature prior, -7.8; the two sensors, +8.3 and -8.4. Six of the eight factors are violated by eight standard deviations, and the pattern does not point at one of them. It cannot. The two readings imply a source of 165 watts and an inlet temperature of -10 degrees, and a model with tight physics distributes that contradiction across every factor that could absorb a piece of it. Ranking residuals localizes a fault when one factor is far more violated than the rest; when the contradiction is global, as here, it says only that something is wrong everywhere downstream of the readings.

Principle 12.1. *Studentized residuals localize a fault when it is local. A global contradiction spreads across every factor that can absorb it, and ranking residuals then says where the model bends, not what broke.*

12.5 Worked example: bad data on a power network

Localization works when the fault is local and the model has redundancy around it. The two-region network shows both conditions, and what happens when the second fails. Give it seven flow meters, one on every line, and injection meters at buses 2 and 5, all of accuracy 0.02 per unit, with the load priors of Chapter 8. The misfit has nine degrees of freedom. With clean readings it is 6.35, a p-value of 0.70, and no studentized residual exceeds 0.8.

A meter's *redundancy* is the fraction of its variance that the rest of the model leaves unexplained, $r_k = 1 - \text{Var}[\mathbf{h}_k^T \mathbf{z}] / \sigma_k^2$, with the variance taken under the posterior. A gross error b on meter k moves its residual by $b r_k$, and the studentized residual divides by $\sigma_k \sqrt{r_k}$, so the error shows up as $b \sqrt{r_k} / \sigma_k$. The smallest error flagged at three spreads is therefore $3 \sigma_k / \sqrt{r_k}$. Table 12.3 lists both. The meters in the two loops have redundancy 0.58 on lines 1-2, 2-3, 4-5 and 5-6 and 0.28 on lines 1-3 and 4-6, and the injection meters 0.31. The meter on the tie line has 0.019. An error there must reach 0.43 per unit, twenty-two times the meter's accuracy, before the test flags it.

The reason is the graph. The tie line is a bridge, the only line between the regions, so nothing else in the model measures the flow it carries except the load priors, which are ten times less precise than the meter. A meter on a bridge is what state estimation calls a critical measurement. It is also the port of Chapter 8 seen from the other side: a separator of size one, across which the two regions can only be reconciled through the one number the meter reads.

Now make one meter read 0.15 high, seven and a half of its accuracies. Figure 12.2 draws the studentized residuals. With the fault on the meter on line 2-3, the misfit jumps to 38.3, a p-value of 1.5×10^{-5} , and the ranking puts the faulty meter first at 5.7, ahead of the injection meter at bus 2 at -4.1 and the meter on line 1-3 at -3.1. The meters around a fault share its

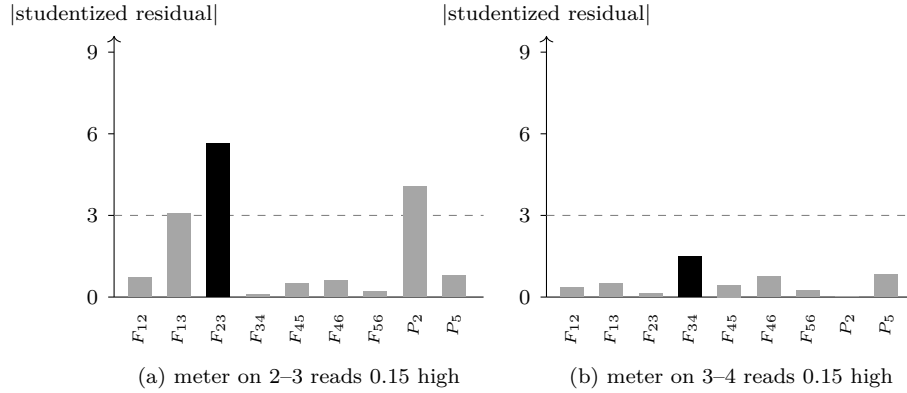


Figure 12.2: Studentized residuals on the two-region network when one meter reads 0.15 per unit high, seven and a half times its accuracy. Black marks the faulty meter, and the dashed line is at three. (a) A meter inside a loop: the fault leads the ranking. (b) The meter on the tie line, a bridge: no residual reaches two, and the error is absorbed into the loads at the two ends of the line.

residual, but the fault itself leads. With the fault on the tie line, the misfit is 8.37, a p-value of 0.50, and no residual exceeds 1.5. The test sees nothing. Meanwhile the estimate of the tie flow has moved 7.4 posterior standard deviations, and the loads at buses 3 and 4 have moved 4.3 each in opposite directions. The model has absorbed the error by trading load between the two ends of the bridge, which is the only explanation the graph allows, and no residual can contradict it.

Principle 12.2. *A measurement is only as checkable as it is redundant. A meter on a bridge of the network, a separator of size one, has nothing to be checked against, and a gross error on it moves the state without moving the residuals. Redundancy is computed before any reading, from the same diagonal as the virtual sensors.*

12.6 Which explanation?

When the residuals cannot say what broke, name the candidates and let the evidence choose. Each candidate is the model plus one latent variable with a zero-centered prior: a leak at node 2, which adds a loss term to that balance; a leak at node 1; a bias on the T_1 sensor, which adds an offset to its likelihood; a bias on the T_2 sensor. Each is a linear-Gaussian model with one more variable, and each has an evidence, the integral of its factors over all its variables, which Chapter 7 gave in closed form:

$$\log Z = -C(\mathbf{z}^*) - \frac{1}{2} \log \det \mathbf{\Lambda} + \frac{d}{2} \log 2\pi + \sum_k \log \frac{1}{\sqrt{2\pi} \sigma_k}, \quad (12.1)$$

with d the number of variables and the last sum over every factor's normalizer. The constants matter here because the hypotheses have different numbers of variables. One factor that does not matter here is the determinant of the physics rows' Jacobian with respect to the solved variables, which Chapter 7 had to restore when its branches changed a closure (Proposition 7.1): every hypothesis in this section adds its latent variable to a balance or a sensor row as an input with a

Table 12.4: Five explanations of the inconsistent readings 72.0 and 105.0, scored by log-evidence. Posterior probabilities at equal prior odds. Physics width 0.01 watts.

hypothesis	fault prior	$\log Z$	G [W]	fault estimate	probability
nothing wrong	–	–43.8	147	–	0.000
leak at node 2	50 W	–14.6	163	57 ± 7 W	0.010
leak at node 1	50 W	–42.4	107	-41 ± 19 W	0.000
bias on T_1 sensor	5 K	–10.9	107	11.3 ± 1.4 K	0.387
bias on T_2 sensor	5 K	–10.5	122	-8.5 ± 1.0 K	0.603

prior, and leaves the physics Jacobian as it was, so that factor is common to all of them and cancels. The determinant term that remains is the *Occam factor*: it charges each hypothesis for the volume of states its extra variable makes plausible, so that a hypothesis with a wide prior on its fault variable is not rewarded merely for being able to fit anything.

Table 12.4 gives the result, and it is not the one Chapter 4 assumed. The null hypothesis and the leak at node 1 are ruled out by thirty nats. The leak at node 2, which Chapter 4 loosened a balance to find, is a possible explanation, at one percent. The two sensor biases are the probable ones, sixty percent to thirty-nine, an eleven-degree bias on one thermometer or an eight-degree bias on the other. The reason is in the columns: the leak explanation needs a leak of 57 watts, comfortable under its 50-watt prior, but also a source of 163 watts, three spreads above its nominal 100; the bias explanations need a bias of two spreads and a source within one. The evidence weighs every factor, and the source prior tips it.

Two things follow. First, the verdict depends on the priors given to the fault variables, and it should: a modeler who knows the thermometers are freshly calibrated would put a one-degree prior on the biases, and the leak would win. The computation makes that judgment explicit and prices it. Second, the computation is one factorization per hypothesis, each on a model one variable larger than the base, and the hypotheses can be as many as the operator can name. Chapter 15 uses the same evidence to rank hundreds of them.

Figure 12.3 prices the first judgment. It holds the leak’s prior at 50 watts and varies the width of the bias priors. Below 2.3 kelvin the leak at node 2 is the better explanation. Above it the bias on T_2 is, and above 6.3 kelvin the bias on T_1 takes over. The evidence for a bias rises steeply as its prior widens from half a degree, because a narrow prior cannot reach the eight- or eleven-degree bias the readings need, and the fit pays for the shortfall. It peaks near ten kelvin, at 9 for the bias on T_2 and 12 for the bias on T_1 , and then falls slowly. A prior far wider than needed spends its probability on biases that did not happen, which is the Occam factor at work.

12.7 Can this parameter be recovered?

Whether a parameter can be recovered from the sensors at hand is a property of $\mathbf{\Lambda}$ alone, before any reading. Partition the variables into the parameters of interest $\mathbf{p}$ and everything else, and take the Schur complement onto the parameters as in Chapter 8. By block elimination the $(\mathbf{p}, \mathbf{p})$ block of $\mathbf{\Lambda}^{-1}$ is the inverse of $\mathbf{\Lambda}_{\mathbf{pp}} - \mathbf{\Lambda}_{\mathbf{ps}}\mathbf{\Lambda}_{\mathbf{ss}}^{-1}\mathbf{\Lambda}_{\mathbf{sp}}$, so the Schur complement’s inverse is the marginal parameter covariance. Its eigenvectors are the directions in parameter space the data constrain, and the eigenvector of the smallest eigenvalue is the *flattest* direction, the combination of parameters the data cannot separate. A scale-free summary per parameter is the ratio of its posterior spread to its prior spread, ρ_i : near zero, the data pinned it; near one, the data said

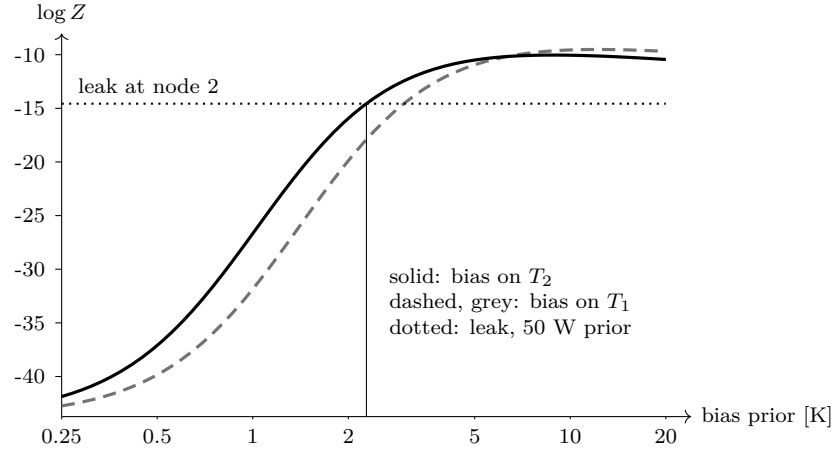


Figure 12.3: Log-evidence of the fault hypotheses for the inconsistent chain readings, as the width of the sensor-bias priors varies with the leak’s prior held at 50 watts. The thin vertical line marks the crossover at 2.3 kelvin, below which the leak is the better explanation.

nothing.

Free the conductance k on the chain with a prior so wide as to be no prior, and ask what the sensors can do for it. With only the T_2 reading, $\rho_k = 0.999$ and the flattest direction is k itself: a single temperature two nodes from the conductance says nothing about it, because T_2 depends on the source and the inlet temperature and not on how the source’s heat gets to the heat sink. Add the T_1 reading and ρ_k falls to zero, with k known to ± 0.34 watts per kelvin: the temperature drop across the path, $T_1 - T_2$, is the source over the conductance, and the source is known from T_2 . The flattest direction is then the source–inlet-temperature ridge, as it has been since Chapter 3. None of this needed a reading; it needed the sensors’ positions and the model.

12.8 Worked example: can fouling be seen?

A counterflow heat exchanger cools a hot water stream with a cold one. Its conductance UA falls as its surfaces foul, and an operator wants to know when to clean it. The hot stream enters at 45°C and the cold at 25°C , both measured. The flows $\dot{m}_h$ and $\dot{m}_c$ are known only from pump curves, 2.0 ± 0.3 and 2.5 ± 0.4 kilograms per second, and the conductance has a prior of 12 ± 3 kilowatts per kelvin. Thermometers of accuracy 0.1 kelvin read both outlets. With $C = \dot{m}c_p$ the capacity rates, $\text{NTU} = UA/C_{\min}$ and $C_r = C_{\min}/C_{\max}$, the exchanger follows the effectiveness relation

$$\varepsilon = \frac{1 - e^{-\text{NTU}(1-C_r)}}{1 - C_r e^{-\text{NTU}(1-C_r)}}, \quad Q = \varepsilon C_{\min} (T_{h,\text{in}} - T_{c,\text{in}}),$$

and the outlets are $T_{h,\text{out}} = T_{h,\text{in}} - Q/C_h$ and $T_{c,\text{out}} = T_{c,\text{in}} + Q/C_c$. At the nominal values the outlets are 32.52 and 34.98°C and the duty is 104.6 kilowatts. Every number is from `ch12_more.py`.

Proposition 12.2 (A symmetry the thermometers cannot see). *The outlet temperatures are unchanged when UA , $\dot{m}_h$ and $\dot{m}_c$ are multiplied by a common factor. The Fisher information that the outlet thermometers carry about $(UA, \dot{m}_h, \dot{m}_c)$ therefore has the vector $(UA, \dot{m}_h, \dot{m}_c)$ in its null space, and no number of outlet thermometers can resolve that direction.*

Table 12.5: Can fouling be seen? The posterior spread of the exchanger’s conductance for four sensor sets, its ratio to the prior spread, and the shift of the conductance’s estimate caused by a 20 percent fouling, in units of its own posterior spread. Flow and heat meters have accuracy 2 percent.

sensors	sd of UA [kW/K]	ρ_{UA}	fouling seen at
outlet thermometers	1.21	0.40	1.9 sd
+ hot-stream flow meter	0.30	0.10	9.0 sd
+ cold-stream flow meter	0.31	0.10	8.8 sd
+ heat meter on the duty	0.26	0.09	10.5 sd

Proof. Under the scaling by λ , the capacity rates C_h , C_c , $C_{\min}$ and $C_{\max}$ scale by λ , and so does UA . The quantities NTU and C_r are ratios and do not change, so neither does ε . The duty scales by λ through $C_{\min}$, and the outlets depend on it only through Q/C_h and Q/C_c , which do not change. The outlets are therefore constant along the ray $\lambda(UA, \dot{m}_h, \dot{m}_c)$, their derivative along it is zero, and the vector lies in the null space of the outlets’ Jacobian $\mathbf{J}$ and hence of the Fisher information $\mathbf{J}^T \mathbf{R}^{-1} \mathbf{J}$. $\square$

The script confirms it. Scaling all three by 0.8 or by 1.3 leaves the outlets unchanged to six decimals, while the duty moves to 83.6 or 135.9 kilowatts. The smallest eigenvalue of the thermometers’ Fisher information is zero to rounding, along the scaling ray to three decimals. What the thermometers do fix is the NTU, and with it the ratio of the conductance to either flow: $UA/\dot{m}_h$ is known to 1.5 percent. The conductance itself is known only as well as the flow priors allow, to ± 1.21 kilowatts per kelvin, 40 percent of its prior spread (Table 12.5).

Now let the exchanger foul by 20 percent, UA from 12 to 9.6 kilowatts per kelvin, with the flows unchanged. The outlets move by +1.22 and -0.98 kelvin, twelve and ten times the thermometers’ accuracy, so the change is plainly seen. What the thermometers alone cannot say is that it is fouling. A 25 percent rise in both flows at the old conductance gives the same outlets, by the proposition, and the posterior splits the change between the two explanations: the conductance falls by 1.9 of its own standard deviations and both flows rise a little. Figure 12.4 draws the two posteriors. One flow meter on either stream breaks the symmetry. The conductance is then known to ± 0.30 kilowatts per kelvin, and the same fouling moves its estimate by nine standard deviations with the flows left where they were. A heat meter on the duty does as well. The question the operator asked, fouling or a valve that someone opened, is answered by the flow meter and by nothing else.

Principle 12.3. *A transformation of the inputs that leaves every reading unchanged is a direction no data can resolve. Find the symmetries of the physics before choosing sensors; each one needs a sensor that breaks it.*

12.9 Which sensor next?

Chapter 11 chose the next sensor by the variance it would remove from one target. The general criterion is the information it would add about the whole state, and for a Gaussian model it has

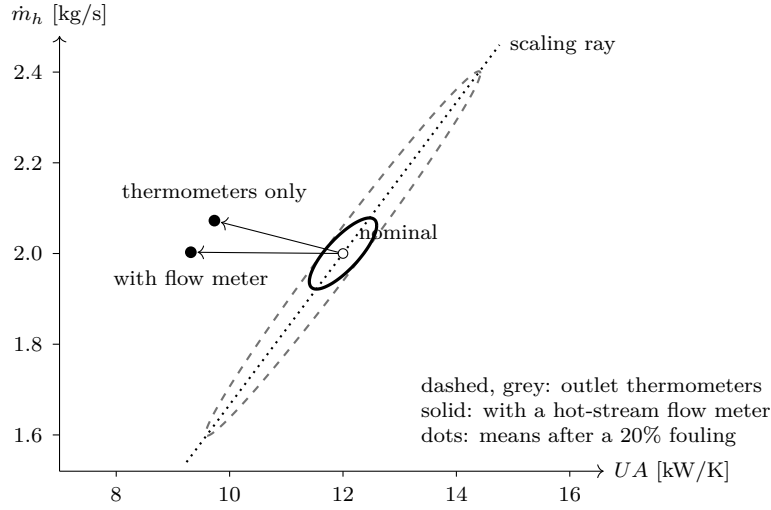


Figure 12.4: The heat exchanger’s posterior over its conductance and the hot-stream flow, at two standard deviations. Dashed grey: outlet thermometers only, an ellipse along the scaling ray (dotted), the direction the thermometers cannot see. Solid: with a flow meter on the hot stream. Dots: the posterior means after a 20 percent fouling. With thermometers only, the change is split between the conductance and the flows; with the flow meter, it goes to the conductance.

Table 12.6: Four candidate sensors on the chain under the prior: expected information gain about the whole state, and the spread of the source after the reading (the criterion of Chapter 11).

sensor on	accuracy	EIG [nats]	sd of G after
T_1	0.5	3.36	4.25
T_2	0.5	3.04	5.82
T_a	0.5	1.81	20.00
Q_{2a}	2.0	2.31	1.99

a closed form that, like the variance reduction, does not depend on the reading:

$$\text{EIG} = \frac{1}{2} \log \det(\mathbf{I} + \mathbf{\Sigma} \mathbf{H}), \quad \text{EIG} = \frac{1}{2} \log \left(1 + \frac{\mathbf{h}^\top \mathbf{\Sigma} \mathbf{h}}{\sigma_y^2} \right) \text{ for one sensor,} \quad (12.2)$$

with $\mathbf{H}$ the Fisher information the candidate contributes. This is the expected reduction in the posterior’s entropy, in nats, and choosing the sensor that maximizes it is D -optimal design. For one sensor it is one solve. The one-sensor form is equation (11.4) of Chapter 11; the block form follows the same way, from $\det(\mathbf{\Lambda} + \mathbf{H}) = \det \mathbf{\Lambda} \det(\mathbf{I} + \mathbf{\Sigma} \mathbf{H})$.

Table 12.6 sets the two criteria side by side under the prior. They agree on the best single sensor, T_1 , and disagree elsewhere: the inlet-air thermometer carries 1.8 nats about the state, since it pins one of the two uncertain inputs outright, and no information at all about the source, since under the prior the two are independent; the flow meter, poor as it is, carries less information in total but nearly all that there is about the source. Information gain is the right criterion when the whole state matters, and the target criterion when one quantity does, and the posterior supplies both from the same solve. For discrete hypotheses, where the value of a reading

Table 12.7: Laplace validity probes on the chain with the natural-convection closure $Q = C \Delta T^p$ and one T_2 reading, in input space. Curvature: objective increment over its quadratic prediction along the widest posterior axis. ESS: effective sample size fraction under importance reweighting, 20,000 draws.

p	sensor accuracy	sd of G	curvature at ± 1 sd	at ± 2 sd	ESS/ N
1.25	0.5	7.1	1.01, 0.99	1.03, 0.99	0.995
4	0.5	15.3	1.11, 1.00	1.40, 1.06	0.86
1.25	0.05	7.0	1.16, 1.13	1.67, 1.50	0.59
4	0.05	15.2	6.7, 4.9	29, 15	0.066

depends on which hypothesis it favors, the corresponding quantity is the mutual information between hypothesis and reading, and it is evaluated by quadrature over the predictive mixture of Chapter 7.

12.10 Should the Gaussian be believed?

Every readout above assumed the posterior is Gaussian, exactly for linear rows and by the Laplace approximation otherwise. Chapter 7 named the three ways the approximation fails and promised tests that detect them from the model itself. Two tests, both built from what the model solve already produced, do it.

Curvature. Along an eigenvector of the posterior covariance, the Laplace posterior predicts that the objective rises by exactly $\frac{1}{2}k^2$ at k standard deviations from the mode, whatever the eigenvalue. Evaluate the true objective there and take the ratio to the prediction: one for a quadratic objective, far from one where a row curves within the posterior's width. Probing the widest directions is enough, since they are where the posterior extends farthest.

Reweighting. Draw from the Laplace Gaussian and weight each draw by the ratio of the true posterior density to the Gaussian's. If the two agree the weights are uniform and the *effective sample size*, $(\sum w)^2 / \sum w^2$, equals the number of draws; where they disagree the weights concentrate and the ratio collapses.

Table 12.7 runs both on the natural-convection chain of Chapter 7, in the four combinations of a mild and a strong exponent with a coarse and a precise sensor. With the coarse sensor the probes confirm what Chapter 7 found: the Gaussian holds, the curvature ratios are within a few percent of one, and 99 percent of the draws are effective at $p = 1.25$ and 86 percent at $p = 4$. Make the sensor ten times more precise and the picture changes. At $p = 1.25$ the ratios reach 1.7 at two spreads and the effective sample fraction falls to 0.59: a warning. At $p = 4$ the objective at one spread is nearly seven times its quadratic prediction and at two spreads nearly thirty; only seven percent of the draws are effective. The Gaussian is wrong, and the probes say so without any exact posterior to compare against.

The mechanism is the third failure mode of §7.4, now seen. A precise sensor confines the posterior to a thin band around the curve $T_a + (G/C)^{1/p} = 72$ in the input plane. A thin band around a curve is a curved ridge, and a Gaussian, whose ridges are straight, cannot follow it. Along the Gaussian's widest axis, which is straight, the true objective rises several times faster

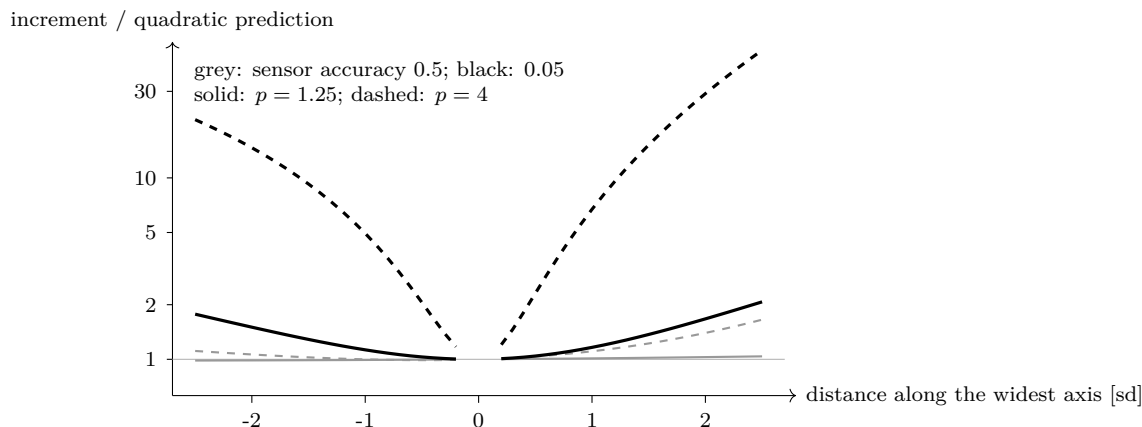


Figure 12.5: The curvature probe on the natural-convection chain as a function of distance along the widest posterior axis: the increment of the objective over its quadratic prediction, on a logarithmic scale, for the four cases of Table 12.7. A Gaussian posterior would give one everywhere.

than the quadratic on both sides, because the straight axis leaves the curved ridge in both directions. The posterior spread of G is no narrower than with the coarse sensor, so the width test of Chapter 7 would not have noticed; the curvature test does.

Figure 12.5 draws the ratio as a function of distance along the widest axis for all four cases. The coarse-sensor curves stay within ten percent of one out to one spread, and within forty percent at two. The precise sensor at $p = 1.25$ sits between, at 1.5 and 1.7 at two spreads. The precise sensor at $p = 4$ leaves one at once: 4.9 at one spread on one side and 6.7 on the other, 14.7 and 29 at two. The asymmetry is the ridge’s curvature, which bends one way.

Escalation. When the probes fail the answer is not to return the Gaussian anyway. The cheap correction is importance reweighting itself: the reweighted draws are samples from the true posterior, and their weighted moments correct skew and curvature near the mode, at the cost of the draws and with the effective sample size as the measure of how well. It cannot find a mode it never visits. It also inherits the scale of the Gaussian it draws from, so where that scale is itself wrong the reweighting cannot repair it. Genuine multimodality, the first failure mode, escalates to a sampler that does not start from the Laplace Gaussian at all: a particle filter that draws the parameters from the prior and integrates the variables the physics determines out of each particle, at the cost of one solve per particle. All three return the same readouts, so what changes downstream is only how much they cost.

Principle 12.4. *A posterior is a claim, and the model carries the instruments to test it: the misfit for adequacy, studentized residuals for location, evidence for explanation, the parameter Schur complement for recoverability, and curvature and reweighting for the Gaussian itself. None needs anything the mode solve did not produce.*

12.11 In practice

Run the misfit test first, and report its degrees of freedom. A p-value on zero degrees of freedom does not exist, and a model with none has not been tested by its data. Report the verdict together with the count.

Compute every sensor's redundancy before trusting its residual. Redundancy comes from the posterior's diagonal and needs no reading. A meter with redundancy below about a tenth cannot be checked. The fix is another measurement that covers the same quantity: a second meter across the bridge, or an injection meter at one of its ends.

Look for the physics' symmetries before placing sensors. A common scaling of a conductance and the flows through it, a common offset of every temperature in a model driven by differences, a change of a bridge's susceptance that only its angles feel: each leaves some set of sensors blind. Test each candidate sensor set against them. The flattest direction of the parameter Schur complement finds the symmetries that nobody thought of.

Rank studentized residuals only when the misfit fails, and expect company. The meters around a local fault share its residual. The fault leads the ranking when it is local and redundant; when the ranking is flat, the contradiction is global.

When residuals smear, name hypotheses and write down their priors. Score each by its evidence. The verdict depends on the fault priors, so report them, and report where the verdict would change, as Figure 12.3 does.

Probe the Gaussian where sensors are precise and closures curve. Evaluate the objective at one and two spreads along the widest axes. A ratio beyond about two, or an effective sample fraction below a half, means the readouts need reweighting or a sampler.

A virtual sensor is valid only while the misfit passes. Put the misfit next to every virtual reading an operator sees. When it fails, the virtual readings are the first casualty.

12.12 What is missing

Every question here was asked of the world as it is. The next two chapters ask about the world as it might be: what would happen if a line were taken out or a setpoint changed (Chapter 13), and which uncertain input the answer depends on most (Chapter 14). The first needs an idea the factor graph does not contain, which is what it means to intervene; the second needs the solve to return its gradient.

Notes and further reading

The misfit test and the studentized residual are the chi-squared test and the normalized residual of power-system state estimation, developed for bad-data detection and identification and treated in full by Monticelli [73] and Abur and Gómez Expósito [1]; the correction $\sigma_y^2 - \text{Var}[z]$ in the

denominator is theirs. The same statistics are the global test and the measurement test of process data reconciliation [65]. The observation that a global contradiction spreads across every factor, so that residual ranking fails exactly when it is most needed, is old in both fields under the name of smearing, and hypothesis comparison by evidence is the standard remedy in the reconciliation literature as “serial elimination” of suspected gross errors. Measurement redundancy and critical measurements, those whose removal leaves part of the state unobservable, belong to the observability analysis of state estimation [1, 73]; the meter on the tie line of §12.5 is the textbook case.

The evidence with its Occam factor, equation (12.1), and its use to compare models of different dimension are MacKay’s [64]; Kass and Raftery [45] review Bayes factors. Identifiability through the Fisher information’s eigenstructure is classical; the parameter Schur complement is its Gaussian-posterior form. Expected information gain and D -optimal design are Lindley’s [59] and are reviewed by Chaloner and Verdinelli [14]. The curvature probe is the book’s simplest form of a check on the Laplace approximation; the effective sample size under importance reweighting is standard [85], and the escalation to a particle filter over the prior is Gordon, Salmond and Smith’s bootstrap filter [30].

Summary

- Every operational question is a readout of one posterior; adding a question adds no model.
- A virtual sensor is the marginal of an unmeasured variable. Two thermometers and four rows of physics give the chain’s flows to 2.9 watts.
- The misfit is chi-squared with factors minus unknowns degrees of freedom, because the standardized residuals are a projection of rank $m_g - n$ of standard Gaussian noise; 0.07 on two for consistent readings, 70 for inconsistent. Studentized residuals localize local faults; a global contradiction smears across every factor.
- A meter on a bridge of the network, the tie line, has redundancy 0.019. An error of 0.15 per unit on it passes the misfit test at a p-value of 0.50 and moves the loads at the line’s ends by 4.3 standard deviations; the same error inside a loop is flagged at 5.7.
- Named hypotheses scored by evidence decide what residuals cannot: for the inconsistent readings, a biased sensor at 99 percent over a leak at one, and the verdict is priced by the fault priors. Below a 2.3-kelvin bias prior, the leak wins.
- Symmetries of the physics are blind spots of the sensors. Scaling a heat exchanger’s conductance and both flows together leaves its outlets unchanged, so thermometers alone see a 20 percent fouling at 1.9 standard deviations; one flow meter makes it nine. No flow meter sees the susceptance of a bridge; a phasor measurement across it does.
- Recoverability is the parameter Schur complement’s flattest direction: k is invisible to one thermometer and known to 0.34 with two.
- Expected information gain is a log-determinant, one solve per sensor; it and the target criterion agree on the best sensor and disagree on the inlet-air thermometer, for a reason the graph explains.
- Curvature probes and reweighting detect a failed Gaussian from the model alone: a precise sensor on a strongly curved closure gives a curvature ratio of 29 and seven percent effective draws.

Exercises

Exercise 12.1. Derive the variance of a sensor's raw residual $y - \mathbb{E}[z]$ under the posterior, $\sigma_y^2 - \text{Var}[z]$, from the rank-one update of Chapter 11, and show it is always positive.

Exercise 12.2. Re-run the hypothesis comparison of Table 12.4 with the sensor-bias priors tightened to one degree. Find the prior width at which the leak at node 2 overtakes the biases, and explain the crossover in terms of equation (12.1)'s terms.

Exercise 12.3. Add a hypothesis to Table 12.4: both sensors biased, each with a five-degree prior. Compute its evidence, split it into the fit term and the rest, and explain how it scores against the single-bias hypotheses.

Exercise 12.4. For the two-region network of Chapter 8 with the tie susceptance freed, compute the parameter Schur complement onto the five loads and the susceptance for each single flow meter, and find the meter for which the susceptance has the smallest ρ . Compare with the expected information gain of each meter.

Exercise 12.5. Implement the profiled curvature probe: instead of moving the full state along an eigenvector, clamp one variable at $\pm k$ spreads and re-minimize the rest. Apply it to the $p = 4$, precise-sensor case of Table 12.7 and compare the ratios with the unprofiled ones; explain why the profiled probe stays on the physics manifold and the unprofiled one need not.

Solutions to selected exercises

Exercise 12.1. Let v be the variance of z under the posterior without the sensor, and $S = \sigma_y^2 + v$ the predicted variance of the reading. By Proposition 11.1 the posterior mean with the sensor is $\mu' = \mu + (v/S)(y - \mu)$, so the raw residual is $y - \mu' = (y - \mu) \sigma_y^2 / S$. Under the model $y - \mu$ has variance S , so the raw residual has variance σ_y^4 / S . The posterior variance with the sensor is $\text{Var}[z] = v - v^2 / S = v \sigma_y^2 / S$, and $\sigma_y^2 - \text{Var}[z] = \sigma_y^2 (S - v) / S = \sigma_y^4 / S$, the same number. It is positive whenever the sensor has any noise at all. It falls toward zero as v / σ_y^2 grows, which is a sensor whose quantity nothing else in the model knows: the fit follows the reading, the residual cannot move, and a gross error on it is invisible. Divided by σ_y^2 it is the redundancy $r_k = \sigma_y^2 / S$ of §12.5.

Exercise 12.2. At a one-degree bias prior the bias on T_2 has $\log Z = -26.7$ against the leak's -14.6 , and the leak wins by twelve nats. The crossover is at 2.28 kelvin (Figure 12.3). In the terms of equation (12.1), the fit term $-C(\mathbf{z}^*)$ of the bias hypothesis is -19.5 at one degree and -2.1 at five, because a one-degree prior can afford only a 4.3-degree bias, half of the 8.5 the readings need, and the rest of the contradiction is paid by the source prior and the sensors. The volume and normalizer terms together move by much less, from -7.2 at one degree to -8.4 at five. Tightening the prior makes the bias cheaper in Occam terms by 1.3 nats and dearer in fit by 17.4, and the fit wins. The leak's terms do not change.

Exercise 12.3. The two-bias hypothesis has $\log Z = -9.95$, against -10.50 for the bias on T_2 alone and -10.95 for the bias on T_1 alone: it wins, by 0.55 nats over the better single bias, odds of 1.7. Split against the single bias on T_2 , its fit term is -1.27 against -2.06 , better by 0.79, and its volume and normalizer terms are -8.68 against -8.44 , worse by 0.24. The Occam penalty for

the second fault variable is real but small. The fit improves because two moderate biases, $+4.9$ and -5.1 kelvin, sit comfortably inside their five-degree priors where one bias of -8.5 does not, and because they let the source return to 114 watts from 122. The biases are poorly determined one by one, ± 3.9 and ± 2.9 kelvin, and correlated at 0.94: the readings fix their difference to ± 1.6 kelvin and leave their sum to the priors. More faults are not always penalized; two small faults can be more probable than one large one, and the evidence says when.

Exercise 12.4. With the tie susceptance freed around 10 ± 2 per unit, every single flow meter leaves its ratio ρ at 1.000: no flow meter says anything about it. The expected information gains of the meters about the whole state still differ, from 1.58 nats for the meter on line 5–6 to 2.86 for the meter on the tie line, and none of that information is about the susceptance. The reason is that the tie is a bridge. The flow on a bridge is the total load beyond it, whatever the bridge’s susceptance, and the flows elsewhere are set by the loads and by the susceptances of the loops they lie in, which do not include the tie. The susceptance moves only the angles across the tie, and flow meters do not read angles. A phasor measurement of the angle difference $\theta_3 - \theta_4$, of accuracy 0.001 radians, does. Alone it brings ρ to 0.64, since the flow it would need to compare with is itself uncertain through the loads; together with the tie flow meter it brings ρ to 0.058, since the pair reads the line’s own Ohm’s law, flow against angle. The meter worth most to the state is worth nothing to this parameter, which is Principle 12.3 in another form.

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

Power is not efficiency *a ratio of two measured quantities and its width; a threshold on one channel cannot see a change in their ratio; the counterfactual draw at the baseline efficiency*
`level2_room_hall/cop_drift/problems/power_is_not_efficiency`

Chapter 13

Interventions and counterfactuals

An operator does not only ask what is. An operator asks what would happen: if that feeder were opened, if this load were capped, if the setpoint were raised. Those are questions about a world that has been acted on, and a factor graph, which encodes compatibility among variables, does not by itself say what acting on the world does to it. This chapter supplies what is missing. The physics rows of Chapter 1 are mechanisms; the inputs of Chapter 4 are the quantities nothing in the model determines; and an intervention is either the imposition of an input or the replacement of a named mechanism by another. With that semantics, seeing and doing become different operations on the same graph, a counterfactual becomes three steps of which two are already familiar, and a decision becomes a tree of branches that share one posterior up to the point where they diverge. Each is worked on the book's models, and the difference between seeing and doing comes out in numbers.

13.1 Why the graph is not enough

Chapter 2 chose the factor graph over the directed graph because a closure has no direction: $Q = UA(T_h - T_c)$ relates three quantities and computes none of them. That choice served every chapter since. It has a price, and the price falls due here.

Conditioning on a reading is well defined on any factor graph: multiply by the likelihood, renormalize. It answers “given that I have seen $T_2 = 72$, what do I believe?” It does not answer “if I make $T_2 = 72$, what will happen?” The two differ because seeing $T_2 = 72$ is evidence about everything that could have caused it, the source and the inlet temperature among them, while making $T_2 = 72$ causes it by some means and leaves the source and the inlet temperature as they were. To say what making does, one must say what mechanism was used to make it, and that is a statement about which relation in the model was overridden. The undirected graph does not contain that statement. Pearl's directed models contain it as the arrows: intervening on a variable severs the arrows into it and leaves the rest. The book's models have no arrows to sever, and something has to stand in for them.

13.2 Rows are mechanisms; inputs are exogenous

What stands in for them is the distinction Chapter 4 already drew. The variables of a model split into *inputs* $\mathbf{u}$, the quantities that carry priors because nothing in the model determines them (parameters, boundary conditions, sources, discrete availabilities), and *solved variables* $\mathbf{x}$,

which the physics determines from the inputs. Each physics row is a *mechanism*: a relation the system enforces, and one that could be enforced differently, by a different device, a different law, a controller. The well-posedness of §1.5 says that the rows, taken together, determine the solved variables from the inputs; no single row determines any single variable, but the set determines the set.

Definition 13.1 (Intervention). An intervention on a physical model is one of two operations:

1. *Impose an input*: replace the prior on an input u_j by the fixed value $u_j = v$. The physics rows are untouched.
2. *Replace a mechanism*: remove a named physics row r_k and add in its place a new row r'_k that the intervening device enforces. The inputs and every other row are untouched.

The posterior after an intervention is the posterior of the modified model, with the evidence that was conditioned on before the intervention retained only where the intervention has not made it inapplicable.

The first operation needs no further choice; an input is exogenous by construction, and fixing it is what “do” means. The second needs a choice, and the definition makes the modeler state it: which row is replaced, and by what. “Make $T_2 = 72$ ” is not an intervention until it says whether the heat sink is held at 72 by a fan controller that runs the fans at whatever speed removes the heat, which replaces the convection closure, or by an inlet temperature that the cooling units adjust until the heat sink reads 72, which replaces the inlet temperature’s prior. These are different devices, they leave different things unchanged, and they lead to different posteriors. A directed graph would have committed to one of them when its arrows were drawn. The factor graph defers the commitment to the moment of intervention, which is where it belongs.

Principle 13.1. *Seeing is conditioning. Doing is replacing: an input’s prior by a value, or a named mechanism by another. A value alone does not specify an intervention; the mechanism that imposes it does, and the modeler must name it.*

This is a structural-causal-model layer laid over the acausal graph. In Pearl’s terms the physics rows are the structural equations, the inputs are the exogenous variables, and the replacement of a row is the surgery that “do” performs; what is different is that the equations are not written with an output variable, so the surgery must name the equation rather than the variable. That is not a limitation. It is the honest form of the operation for a physical system, in which the same variable can be set by different means.

13.3 Seeing versus doing, on the chain

Take the processor heat path with hard physics and the priors of Chapter 3. Every number is from the script `ch13_interventions.py` in the book’s `scripts` directory. Table 13.1 sets four posteriors side by side.

Seeing. A thermometer on the heat sink reads 72. The source’s belief tightens from ± 20 to ± 5.8 and moves up; the inlet temperature’s moves a little; the two become correlated; T_1 is predicted to ± 1.3 . The reading is evidence about its causes, and the posterior distributes it among them in proportion to how much each could have contributed. This is Chapter 3’s result.

Table 13.1: The chain: prior predictive; conditioning on a reading of T_2 ; two interventions that both make $T_2 = 72$ by different mechanisms; and doing versus seeing on an input.

	Q_{2a}	T_1	T_2	G	T_a
prior predictive	100 ± 20	90.0 ± 14.3	70.0 ± 10.4	100 ± 20	20.0 ± 3.0
see $T_2 = 72$ (sensor, acc. 0.5)	103.7 ± 5.8	92.7 ± 1.3	72.0 ± 0.5	103.7 ± 5.8	20.2 ± 2.9
do $T_2 = 72$, fan control replaces c_{2a}	100 ± 20	92.0 ± 4.0	72.0	100 ± 20	20.0 ± 3.0
do $T_2 = 72$, inlet control replaces π_{T_a}	100 ± 20	92.0 ± 4.0	72.0	100 ± 20	22.0 ± 10.0
do $G = 120$		104.0 ± 3.0	80.0 ± 3.0	120	20.0 ± 3.0
see $G = 120$ (meter, acc. 2)		103.9 ± 3.3	79.9 ± 3.2	120.0 ± 2.0	20.0 ± 3.0

Doing, one way. A fan controller holds the heat sink at 72, running the fans at whatever speed removes the heat it must. The mechanism replaced is the convection closure at its fixed hA , which no longer describes how heat leaves the heat sink. The source is untouched: 100 ± 20 , as under the prior. So is the inlet temperature. The flow through the heat sink is still the source, by the balances, and the package temperature is 72 plus the source over the conductance: 92 ± 4 , its spread now the source's spread through the conductance rather than the heat sink's. Nothing upstream of the heat sink has learned anything, because nothing was observed.

Doing, another way. The cooling units upstream regulate the inlet temperature until the heat sink reads 72. The mechanism replaced is the inlet temperature's prior: the inlet temperature is no longer a loosely held setpoint but a control variable set to whatever the heat sink needs, $T_a = 72 - G/hA$, which is 22 ± 10 with the source's uncertainty passed through. The package temperature and the source are exactly as under the first intervention, since the heat sink is at 72 and the source is untouched either way; the inlet temperature is entirely different, and so is the physical device. Both are “do $T_2 = 72$ ”. Neither is “see $T_2 = 72$ ”.

Doing on an input. Set the source to 120 watts. There is no mechanism to name: the source is an input and setting it replaces its prior. The temperatures follow: $T_2 = 80 \pm 3$, the inlet temperature's spread passed through. Now instead *observe* the source at 120 with a meter accurate to two watts, and condition. The posteriors are the same to within the meter's accuracy. For an exogenous input, seeing and doing coincide, because an input has no causes in the model for a reading of it to be evidence about. That is the sense in which the inputs are exogenous, and it is why the first operation of Definition 13.1 needs no choice.

Proposition 13.1 (Seeing and doing on an input). *Let u_j be an input whose prior is a factor on u_j alone. Whatever other evidence the model holds, the posterior over every other variable after a noiseless reading $u_j = v$ equals the posterior after imposing $u_j = v$.*

Proof. Conditioning on the reading multiplies the joint density by $\delta(u_j - v)$ and renormalizes. Under the delta, the prior factor $p_j(u_j)$ becomes the constant $p_j(v)$, which cancels in the normalization. Imposing the value replaces $p_j(u_j)$ by $\delta(u_j - v)$ directly. The two unnormalized products differ by the constant factor $p_j(v)$, so their normalized versions are the same. $\square$

For a solved variable the argument fails, because conditioning keeps every row and doing removes one. The removed row carried information about the other variables, and the chain's two interventions show how much: each removes a different row and each leaves a different posterior. Figure 13.1 draws the three in the plane of the two inputs, which are what the worlds

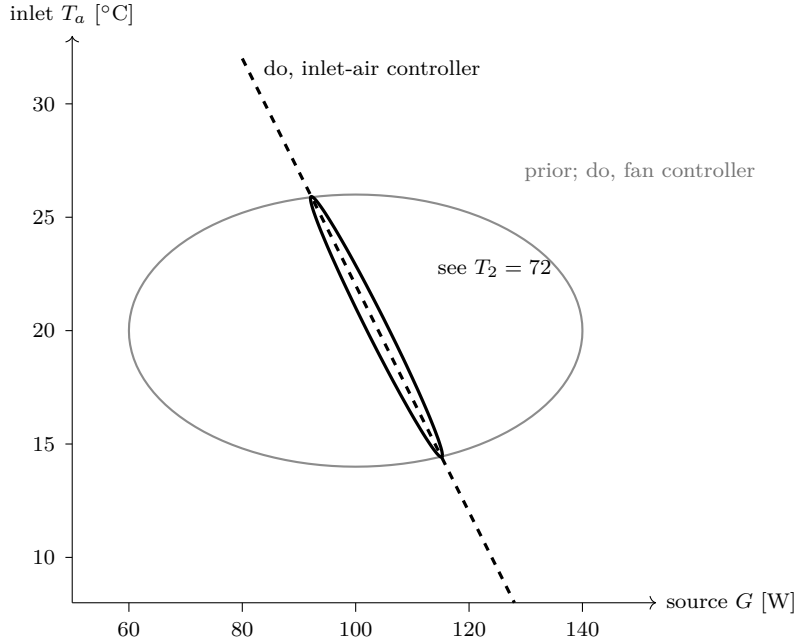


Figure 13.1: Seeing and doing on the chain, in the plane of the two inputs, at two standard deviations. Grey: the prior, which is also the input posterior after a fan controller holds $T_2 = 72$. Black: after seeing $T_2 = 72$, a thin ridge. Dashed: after an inlet-air controller holds $T_2 = 72$, the line $T_a = 72 - G/2$, along which the source keeps its prior.

share. Seeing the heat sink at 72 confines the inputs to a thin ridge, $G/2 + T_a \approx 72$, correlated at -0.985 : the reading is evidence, and it moves the belief about the causes. Doing it with a fan controller leaves the inputs at their prior, since nothing was observed. Doing it with an inlet-air controller puts them on the line $T_a = 72 - G/2$ exactly, since the inlet temperature is now whatever the source requires. The source keeps its prior spread along that line, which is why the inlet temperature's spread becomes ± 10 .

13.4 Counterfactuals: three steps

A counterfactual asks what would have happened, given what did. It combines evidence about the world as it is with an intervention on the world as it might be, and the combination has a definite order.

1. *Abduction*. Condition on the evidence in the factual model and read off the posterior of the inputs. This is what the evidence says about the exogenous quantities, which are what the two worlds share.
2. *Action*. Apply the intervention: impose the input or replace the mechanism.
3. *Prediction*. Push the abducted posterior of the inputs through the intervened model, with the evidence removed, since it was evidence about the factual world.

The evidence is used once, in step one, to learn about the inputs. It is not used in step three, because in the counterfactual world the readings would have been different; what carries over is not the readings but what they revealed about the loads, the parameters, the sources.

Table 13.2: The triangle: factual posterior with the meter reading; the counterfactual outage by abduction, action and prediction; and the naive re-conditioning of the outage model on the same reading.

	F_{12}	F_{23}	P_2	P_3
factual: feeder in, $y_{12} = 1.25$	1.25 ± 0.02	-0.35 ± 0.09	-1.60 ± 0.09	-0.55 ± 0.18
counterfactual: feeder out, loads abducted	1.60 ± 0.09	0	-1.60 ± 0.09	-0.55 ± 0.18
naive: feeder out, re-conditioned on y_{12}	1.25 ± 0.02	0	-1.25 ± 0.02	-0.50 ± 0.20

Proposition 13.2 (Counterfactuals in a linear model). *Let the physics rows be linear and hard, let the factual posterior of the inputs be $\mathcal{N}(\mathbf{m}_u, \Sigma_u)$, and let the intervened rows determine the solved variables as $\mathbf{x}' = \mathbf{A}'\mathbf{u} + \mathbf{b}'$. Then the counterfactual distribution of $\mathbf{x}'$ is $\mathcal{N}(\mathbf{A}'\mathbf{m}_u + \mathbf{b}', \mathbf{A}'\Sigma_u\mathbf{A}'^\top)$. The naive computation conditions the prior of the inputs on the readings through the intervened map in place of the factual one, and it agrees with the counterfactual only when the intervention leaves the readings' dependence on the inputs unchanged.*

Proof. Abduction conditions the factual model on the readings. The inputs' posterior is Gaussian, since the factual model is linear-Gaussian, and it is $\mathcal{N}(\mathbf{m}_u, \Sigma_u)$. After the action the solved variables are the linear function $\mathbf{A}'\mathbf{u} + \mathbf{b}'$ of the inputs, by the well-posedness of the intervened rows, and a linear image of a Gaussian is Gaussian with the mean and covariance stated. The naive computation treats a reading $y = \mathbf{h}^\top \mathbf{x}$ as $\mathbf{h}^\top (\mathbf{A}'\mathbf{u} + \mathbf{b}')$ where the factual world had $\mathbf{h}^\top (\mathbf{A}\mathbf{u} + \mathbf{b})$. The two conditionings coincide exactly when $\mathbf{h}^\top \mathbf{A}' = \mathbf{h}^\top \mathbf{A}$ and $\mathbf{h}^\top \mathbf{b}' = \mathbf{h}^\top \mathbf{b}$. $\square$

The triangle with a feeder out. Feeder 1–2 is metered at 1.25 with the loop intact and the loads uncertain as in Chapter 7. What would the flows have been if feeder 2–3 had been out? Table 13.2 gives the three answers one could compute.

Abduction: the reading, with the loop intact, says the load at bus 2 is -1.60 ± 0.09 and the load at bus 3 -0.55 ± 0.18 , correlated at -0.94 since the meter sees a combination of them. Action: replace the closure of feeder 2–3 by $F_{23} = 0$. Prediction: with the loop open, bus 2 is served by feeder 1–2 alone, so the metered feeder would carry the whole of bus 2's load, 1.60 ± 0.09 , a third more than it does, with the load's uncertainty passed through. That is the counterfactual, and it is what an operator wants to know before opening the feeder.

The naive computation conditions the outage model on the reading, as if the meter had read 1.25 with the feeder already out. It concludes that the metered feeder would carry 1.25, which is what it does now, and that bus 2's load is -1.25 , which contradicts what the factual world established. It has used the reading as evidence in a world where the reading would not have occurred. The difference between the two rows is the whole content of the word “counterfactual”, and it is a third of a per-unit on the feeder in question. In the terms of Proposition 13.2, the outage makes bus 2 radial, so the row of $\mathbf{A}'$ for the metered flow picks out the load at bus 2 alone, and the counterfactual flow is that load's abducted posterior with its sign changed. The meter's row under the outage reads $-P_2$ where the factual one read a mixture of both loads, so the naive computation is conditioning on a different functional of the inputs. Figure 13.2 draws the counterfactual flow against the limit: 49 percent of it lies beyond. The naive answer, a spike at the factual flow, would have told the operator the feeder was safe.

Principle 13.2. *A counterfactual learns the inputs from the factual evidence, changes the mechanism, and predicts with the evidence removed. Re-conditioning the changed model on the old evidence answers a different question, and usually the wrong one.*

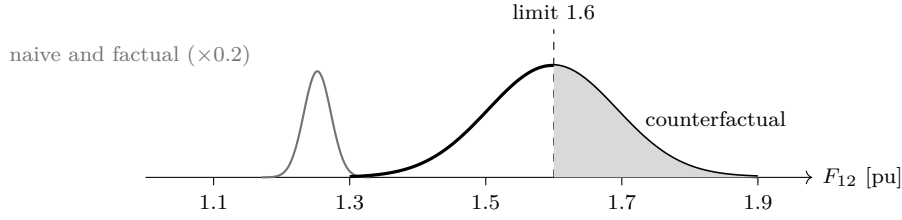


Figure 13.2: The flow on feeder 1–2 had feeder 2–3 been out, given the factual reading of 1.25 with it in. Black: the counterfactual, 1.60 ± 0.09 , with the 49 percent beyond the limit shaded. Grey, drawn at a fifth of its height: the naive re-conditioning, which coincides with the factual flow.

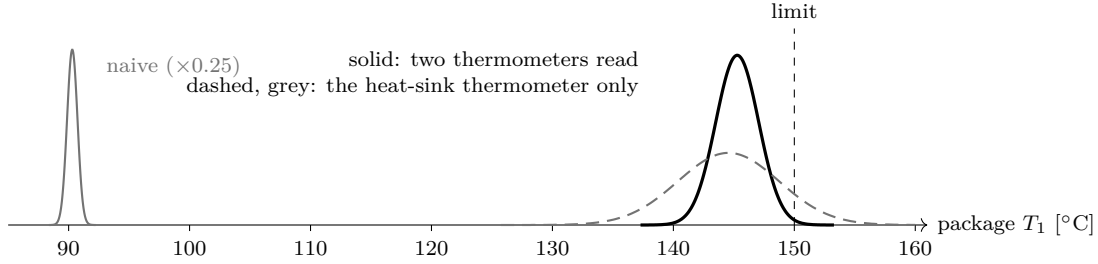


Figure 13.3: The chain’s package temperature had its fan run at half speed. Solid: the counterfactual with both thermometers in the factual world, 145.3 ± 1.8 . Dashed: with the heat-sink thermometer only, 144.6 ± 4.2 , of which 9.7 percent lies beyond the 150°C limit. Grey, drawn at a quarter of its height: the naive re-conditioning at 90.3, which bends the inputs to fit the old readings.

The chain with the fan at half speed. The same distinction in the thermal domain, with a closure in place of a feeder. Both thermometers of the chain read, 72 and 93, with the heat sink’s convection conductance at 2 watts per kelvin. What would the temperatures have been had the fan run at half speed, the conductance at 1? Abduction gives the inputs the chain’s posterior: the source at 104.63 ± 2.86 and the inlet temperature at 19.73 ± 1.73 , correlated at -0.979 . Action replaces the convection closure by $Q_{2a} = 1.0 (T_2 - T_a)$. Prediction pushes the abducted inputs through: the heat sink would have been at 124.4 ± 1.2 and the package at 145.3 ± 1.8 , with a probability of 0.004 of exceeding 150°C . The naive computation re-conditions the half-speed model on the two readings and concludes that the heat sink would have read 75.3, the package 90.3, the source 75 watts and the inlet temperature 0°C . It has bent the inputs until the old readings fit the new fan, which answers the question of what inputs would have produced these readings at half speed, and nobody asked it. With only the heat-sink thermometer in the factual world the counterfactual package temperature is 144.6 ± 4.2 and the probability of exceeding 150°C is 0.097. The second thermometer, by pinning the ridge, cuts that probability by a factor of about twenty-four: a counterfactual is only as sharp as its abduction. Figure 13.3 draws the three answers.

Table 13.3: Four actions on the triangle, evaluated on the shared abducted posterior of the loads. Limit on feeder 1–2: 1.6 per unit.

action	F_{12}	$\mathbb{P}(F_{12} > 1.6)$	F_{13}
do nothing	1.25 ± 0.02	0.000	0.90
open feeder 2–3	1.60 ± 0.09	0.49	0.55
cap 0.3 at bus 2	1.05 ± 0.02	0.000	0.80
open 2–3 and cap 0.3	1.30 ± 0.09	0.001	0.55

13.5 Decisions as branches

An operator choosing among actions asks the counterfactual question once per action, and the three steps have a structure that makes this cheap. Abduction is done once: the posterior of the inputs, which every action shares, is the one computation on the factual evidence. Each action is then a branch: an intervened model, evaluated with the shared input posterior. The branches form a tree whose root is the factual posterior, whose edges are interventions, and whose leaves are the worlds that result; a second intervention under a first is a child branch, and a second failure that may or may not occur under an action is a pair of children weighted by its probability. The readouts of Chapter 12 apply at every leaf, and a weighted reduction over leaves, a mean, a tail quantile, an expected shortfall, gives the action’s risk.

The do-nothing baseline. One branch is always the identity: no intervention, the factual posterior carried forward. It is the baseline against which every action is judged, and its inclusion is not a formality. An action is worth taking only if its leaf is better than the baseline’s, and “better” is a reduction over the leaf’s posterior that must be computed for the baseline too, with the same inputs and the same evidence. Recommending an action without the do-nothing leaf beside it is recommending it against nothing.

Four branches on the triangle. The quantity at risk is the flow on feeder 1–2 against a limit of 1.6 per unit. Four actions: nothing; open feeder 2–3; cap bus 2 by 0.3; both. Table 13.3 gives each leaf’s flow and the probability of exceeding the limit, all from the one abducted posterior of the loads.

Opening the feeder alone puts the metered feeder at its limit with even odds of exceeding it; the loop was carrying a third of bus 2’s load around the other way. Capping alone is safe and unnecessary. Opening the feeder with capping is safe, at a tenth of a percent, and it is the branch an operator who needs the feeder out for maintenance would choose. The four leaves cost four solves on a shared prior; on a large network they cost four region messages, with the abduction and every region the actions do not touch reused across the tree, as Chapter 8 arranged.

Figure 13.4 draws the tree, with a second failure added under both actions that open feeder 2–3 (Exercise 13.4): feeder 1–3 fails with probability 0.02. With both feeders out, bus 3 is de-energized and its load, 0.55 ± 0.18 per unit, is shed. The flow on feeder 1–2 is unchanged, since bus 2 was already fed by that feeder alone. The second failure leaves the probability of an overload where it was and adds an expected shed load of 0.011 per unit to both branches. A leaf must report every quantity that matters, not only the one that motivated the tree.

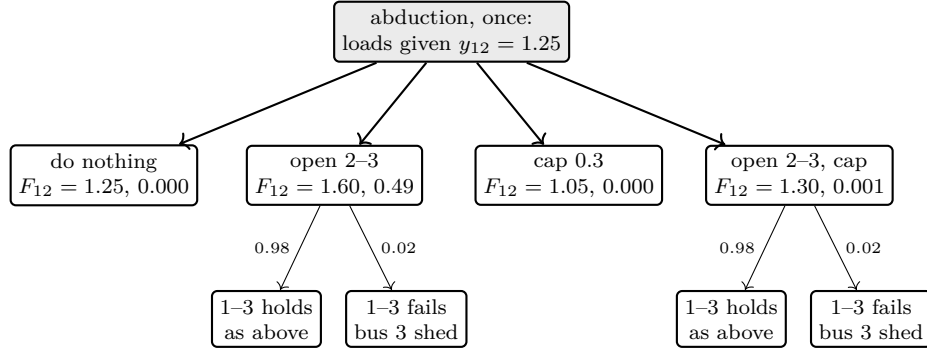


Figure 13.4: The decision tree of Table 13.3. The root is the abduction, done once; each edge below it is an intervention; each leaf is evaluated on the shared input posterior and shows the flow on feeder 1–2 and the probability that it exceeds its limit of 1.6. Under the two actions that open feeder 2–3, a second failure splits the leaf: feeder 1–3 fails with probability 0.02, de-energizing bus 3.

Table 13.4: Five branches on the chilled-water plants in a heat wave, on 200,000 shared draws from the abducted inputs: the expected unserved cooling, the probabilities of any shortfall and of one above 50 kilowatts, the change against doing nothing, and that change’s standard error computed on the shared draws and on independent ones.

action	$\mathbb{E}[U]$ [kW]	$\mathbb{P}(U > 0)$	$\mathbb{P}(U > 50)$	change [kW]	s.e., shared	s.e., independent
do nothing	30.45	0.554	0.263	—	—	—
standby chiller	2.30	0.085	0.013	−28.15	0.086	0.093
pump limit +10%	30.14	0.545	0.261	−0.31	0.007	0.128
shed 100 kW	2.27	0.081	0.014	−28.17	0.078	0.094
standby chiller and pump	2.30	0.085	0.013	−28.15	0.086	0.093

13.6 Worked example: an afternoon heat wave

The two chilled-water plants of Chapter 10 face a hot afternoon. The forecast puts the wet bulb at $26.5 \pm 0.7^\circ\text{C}$, and that is the abduction here: the one piece of evidence, folded into the inputs’ posterior, while the chiller ratings and pump limits keep their priors. The hall’s load is 2,100 kilowatts. Besides doing nothing, the operator has four actions: start the standby chiller in plant 1, a fourth machine rated like the others; raise plant 2’s pump limit by 10 percent; shed 100 kilowatts of IT load; or start the standby chiller and raise the pump. Each is a branch, and each is evaluated on the same 200,000 draws from the abducted inputs, which is the Monte Carlo form of a shared posterior. Table 13.4 gives the leaves.

Doing nothing leaves an even chance of a shortfall and a one-in-four chance of more than 50 kilowatts. The standby chiller cuts the expected shortfall from 30.5 to 2.3 kilowatts and the chance of any to 8.5 percent, as much as shedding 100 kilowatts of IT load does, without shedding anything. Raising the pump limit does almost nothing, 0.31 kilowatts, and adding it to the standby chiller does nothing at all. The reason is in the do-nothing leaf: at this wet bulb both plants are limited by their chillers in 93 percent of the draws, and more water through a chiller-limited plant carries no more cold. The model has answered a question the operator did not ask, which constraint binds, and that answer decides between two actions that sound equally plausible.

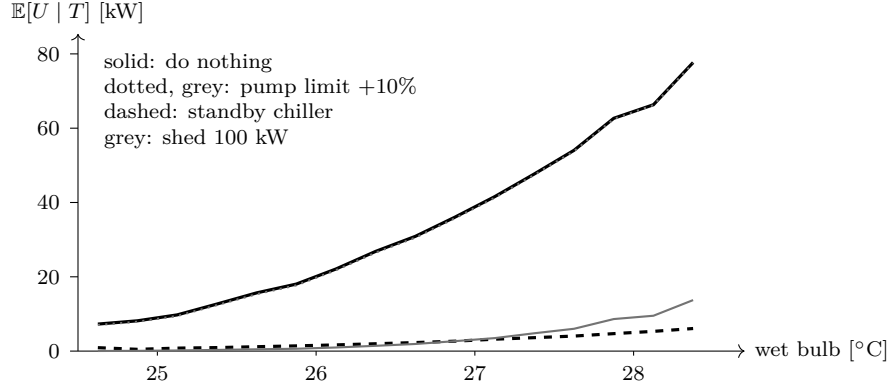


Figure 13.5: The expected unserved cooling given the wet bulb, for four branches of Table 13.4, read from the shared draws in bins of a quarter kelvin. The pump’s curve lies on the do-nothing curve. The standby chiller and the load shed cross: shedding does slightly better on milder afternoons and the standby chiller on the hottest.

The last two columns are about the arithmetic of branches. The decision rests on the differences between leaves, and computing every leaf on the same draws makes the noise of a difference small where the actions are similar. The pump’s effect, -0.31 kilowatts, has a standard error of 0.007 on the shared draws and 0.128 on independent ones: the independent route would need 388 times the draws to resolve it as well. For the standby chiller, whose leaf is far from the baseline, sharing the draws helps little, since the difference is almost all of the baseline’s own variability. This is the sampling counterpart of sharing the abduction: the branches share not only the posterior but the samples of it, and the comparison is sharper for it.

Proposition 13.3 (Shared draws). *Let two branches be evaluated on N draws each, giving estimates $\bar{U}_a$ and $\bar{U}_0$ of their means, and let σ_a and σ_0 be the spreads of their outcomes. With independent draws, $\text{Var}(\bar{U}_a - \bar{U}_0) = (\sigma_a^2 + \sigma_0^2)/N$. With shared draws it is $(\sigma_a^2 + \sigma_0^2 - 2\rho\sigma_a\sigma_0)/N$, where ρ is the correlation of the two outcomes across draws. Sharing helps exactly when $\rho > 0$.*

Proof. With shared draws the difference of the means is the mean of the N differences $U_a(\mathbf{x}_n) - U_0(\mathbf{x}_n)$, whose variance is $\text{Var}(U_a - U_0)/N = (\sigma_a^2 + \sigma_0^2 - 2\text{Cov}(U_a, U_0))/N$. With independent draws the two means are independent and their variances add. $\square$

For the pump, the two leaves differ by a third of a kilowatt on draws whose shortfall varies by tens of kilowatts, so ρ is nearly one and sharing is worth a factor of 388. For the standby chiller the leaves are nearly uncorrelated, since the chiller removes most of the shortfall wherever it occurs, and the factor is close to one.

Figure 13.5 splits the leaves by the wet bulb, a partial sum on the shared draws. The pump’s curve lies on the do-nothing curve at every wet bulb. The standby chiller and the load shed are close overall, but they are not the same action. On a milder afternoon a shortfall happens when some plant’s chillers are weak, and plant 1’s loop caps what a standby machine there can add; shedding load helps wherever the shortfall comes from, and it does slightly better. On the hottest afternoons both plants are derated together, the standby machine adds as much as plant 1’s loop allows, about 130 kilowatts at the mean pump limit, more than the 100 shed, and it does better.

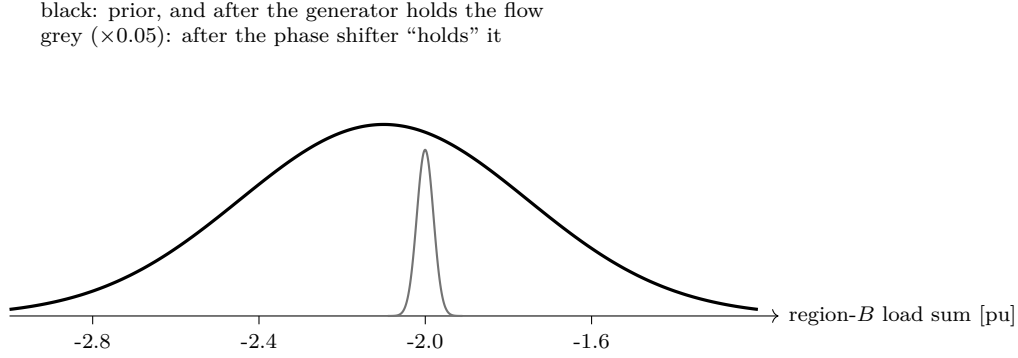


Figure 13.6: The sum of the region- B loads, with nothing observed. Black: the prior, which is also the posterior after the inverter at bus 4 holds the tie flow at 2.0. Grey, drawn at a twentieth of its height: after the phase shifter is told to hold it, a spike at -2.000 . The device has conditioned the exogenous loads, which no physical device can do.

13.7 Worked example: holding the tie flow

An operator wants the cross-tie of the two-region network held at 2.0 per unit, below its expected 2.10. Definition 13.1 requires a device, and two are candidates. A phase-shifting transformer on the tie adds an adjustable angle ϕ to the tie’s closure, $F_{34} = B(\theta_3 - \theta_4 + \phi)$, and its controller sets ϕ to hold the flow. A controllable battery inverter at bus 4 adds an injection g_4 to that bus’s balance, and its controller sets g_4 to hold the flow. Each intervention adds the controller’s target, $F_{34} = 2.0$, and frees the control variable it acts through. Every number is from `ch13_more.py`.

The inverter does what was asked. The loads are untouched: the sum of the region- B loads is -2.10 ± 0.35 , as before the intervention. The inverter’s output is 0.10 ± 0.35 per unit; it absorbs whatever the loads do. The phase shifter does something else. With nothing observed, the posterior of the region- B loads moves: their sum goes from -2.10 ± 0.35 to -2.000 ± 0.020 , and each load rises by 0.033 with its spread falling from 0.20 to 0.16. The phase angle, meanwhile, is left wherever its prior put it, ± 1000 radians: the model has no use for it. The loads are exogenous, and an intervention has conditioned them. The reason is the bridge. The flow on a bridge is the total load beyond it, fixed by the balances whatever the angles, so no phase shift can change it. The model says so twice, by leaving ϕ undetermined and by bending the loads to meet the target. Figure 13.6 draws the region- B load sum under the two devices.

Proposition 13.4 (Realizable interventions). *Let the physics rows be linear. Let an intervention replace mechanism rows, possibly adding control variables. If the modified rows determine the solved and control variables uniquely for every value of the inputs, then, with no evidence, the posterior of the inputs after the intervention is their prior. If they determine them only for inputs on a proper subspace, the posterior of the inputs is confined to that subspace.*

Proof. Write the modified rows as $\mathbf{G}_x \mathbf{x} + \mathbf{G}_u \mathbf{u} = \mathbf{c}$, with $\mathbf{x}$ now including the control variables. If $\mathbf{G}_x$ is square and nonsingular, then $\mathbf{x} = \mathbf{G}_x^{-1}(\mathbf{c} - \mathbf{G}_u \mathbf{u})$ for every $\mathbf{u}$, and the joint density is the prior of $\mathbf{u}$ times a delta on $\mathbf{x}$ whose integral over $\mathbf{x}$ is the constant $1/|\det \mathbf{G}_x|$. The marginal of $\mathbf{u}$ is its prior. If $\mathbf{G}_x$ has a left null vector ℓ , then $\ell^T(\mathbf{c} - \mathbf{G}_u \mathbf{u}) = 0$ is a condition on the inputs alone, which every solution requires, and the marginal of $\mathbf{u}$ is the prior restricted to that hyperplane. With soft rows the restriction is a Gaussian of the rows’ width about the hyperplane. $\square$

For the phase shifter, the left null vector sums the balances of region B and the target row: the balances say $F_{34} + P_4 + P_5 + P_6 = 0$, the target says $F_{34} = 2.0$, and together they say $P_4 + P_5 + P_6 = -2.0$, a condition on inputs alone. That is the hyperplane to which the loads were confined, at the width of the physics rows.

Principle 13.3. *An intervention that moves the posterior of an exogenous input, with nothing observed, is not realizable by the named device. Check it before reading any other number: after an intervention, and before any evidence, the inputs must be where their priors put them.*

The inverter's intervention sits inside region B : region A 's message to the tie is unchanged and is reused, and only region B 's is recomputed, with g_4 in it. That is the reuse of Chapter 8 applied to decisions: an action changes the messages of the regions it touches and no others.

13.8 What the semantics does not decide

Three things are outside what Definition 13.1 settles, and the reader should know where the feeder is.

It does not decide which row a real device replaces. A fan controller on the heat sink replaces the convection closure in the example because the example said so; a real one may also change the airflow over the server's other components, draw fan power that appears as a source, and fail. The definition requires the modeler to state the replacement; it does not validate it.

It does not decide what evidence survives an intervention. The rule given, that evidence is retained where the intervention has not made it inapplicable, is a rule about which readings still describe the counterfactual world, and applying it requires judgment: a meter on a feeder that is opened reads nothing afterward; a meter on a feeder elsewhere reads something, but not what it read before. The three-step recipe sidesteps the question by using the evidence only in abduction, which is the safe default, and the modeler who wants to retain a reading in the counterfactual world should say why it would still hold.

And it does not, by itself, quantify how well the model's mechanisms correspond to the world's. An intervention computed on a wrong model is a wrong prediction with an honest error bar; the diagnostics of Chapter 12 say whether the factual model fits, and nothing in this chapter says whether the counterfactual one would.

13.9 In practice

Name the device, then the row it replaces. “Set T_2 to 72” is a wish. “A fan controller replaces the convection closure” is an intervention. Write the second form down for every action, including the control variable the device acts through.

Check that the inputs did not move. Before reading any other number, compare the inputs' posterior after the intervention, with no evidence, against their prior. If it moved, the device cannot do what the row claims, as the phase shifter on a bridge could not.

Abduce once, branch many, and keep the do-nothing leaf. The abduction is the only step that sees the evidence, and every branch shares it. The do-nothing branch is the baseline every recommendation is judged against.

Drop the evidence in prediction. A reading describes the factual world. Carry it into a counterfactual only when you can say why the device leaves it unchanged, and say so in the report.

Evaluate every branch on the same draws. When the leaves are computed by sampling, share the samples across branches, as the branches share the abduction. For two actions whose leaves are close, this is worth hundreds of times the draws; for actions far apart it costs nothing.

Report every quantity at every leaf. A second failure may leave the quantity that motivated the tree unchanged and move another, as feeder 1–3’s failure left the overload probability alone and shed the load at bus 3.

Sharpen the abduction to sharpen the counterfactual. A counterfactual inherits the spread of the inputs’ posterior. The second thermometer on the chain cut the probability of the half-speed package temperature exceeding its limit from 0.097 to 0.004.

13.10 What is missing

Every branch here reported a mean, a spread and a probability. What it did not report is why: which uncertain input the risk depends on most, how much a better forecast of the load at bus 3 would change the verdict, and whether the probability of 0.49 is a floor, a ceiling or a point estimate. Those are questions of sensitivity and attribution, and they need the solve to return its gradient. That is Chapter 14. And every intervention here was one feeder or one load; Chapter 15 asks about the failures the operator did not choose, many at once.

Notes and further reading

The distinction between seeing and doing, the “do” operator, the surgery on structural equations that defines it, and the three-step abduction-action-prediction account of counterfactuals are Pearl’s [80]; Peters, Janzing and Schölkopf [81] give a compact modern treatment with structural causal models as the primary object. In those accounts each structural equation has a designated output and the intervention severs the arrows into it. The version in Definition 13.1, with the equation named rather than the variable, is the book’s adaptation to models whose equations are acausal, and it is what a physical intervention amounts to: a device that enforces a different relation. The reading of a Chapter 1 model as a structural causal model whose exogenous variables are the inputs and whose mechanisms are the rows is the book’s, and it is the reason the input/solved-variable split of Chapter 4 was drawn where it was.

Decision trees over interventions and second failures, evaluated by weighted reductions over leaves, are standard in reliability and risk analysis; expected shortfall as the tail reduction is Rockafellar and Uryasev’s [86], and Part VI uses it. The do-nothing baseline as a mandatory branch is a rule of this book’s case-study practice, adopted after enough reports had recommended actions against no comparison.

Summary

- A factor graph encodes compatibility, not mechanism; it cannot say what acting does until the mechanism is named.
- Physics rows are mechanisms, inputs are exogenous. An intervention imposes an input or replaces a named row. “Do $T_2 = 72$ ” by a fan controller and by an inlet-air controller are different interventions with different posteriors; seeing $T_2 = 72$ is a third. On an input, seeing and doing coincide.
- A counterfactual is abduction, action, prediction, with the evidence used only in the first. On the triangle the counterfactual outage flow is 1.60 ± 0.09 ; naive re-conditioning gives 1.25, the factual flow, and is wrong.
- Decisions are branches on a shared abducted posterior, with the do-nothing leaf always present. Opening the feeder alone: even odds of exceeding the limit; with capping: a tenth of a percent.
- In a linear model a counterfactual is the abducted input posterior pushed through the intervened map. Had the chain’s fan run at half speed, the package would have been at 145.3 ± 1.8 ; the naive computation says 90.3 and bends the inlet temperature to 0°C .
- An intervention is realizable only if it leaves the exogenous inputs where their priors put them. A phase shifter on a bridge cannot hold its flow, and the model shows it by moving the loads; an inverter in region B can.
- On the chilled-water plants in a heat wave the standby chiller is worth as much as shedding 100 kilowatts and the pump nothing, because both plants are chiller-limited. Evaluating the branches on shared draws resolves the pump’s 0.3-kilowatt effect with 388 times fewer samples.
- A leaf reports every quantity: a second failure under “open feeder 2–3” leaves the overload probability at 0.49 and adds an expected shed load of 0.011.
- The semantics requires the modeler to name the replaced mechanism and to decide what evidence survives; it does not do either for them.

Exercises

Exercise 13.1. On the chain, define a third intervention that makes $T_2 = 72$: a heater at node 2 that adds whatever power is needed, which adds a source term to the balance at node 2 and leaves both closures intact. Compute its posterior and compare T_1 , Q_{2a} and T_a with the two interventions of Table 13.1.

Exercise 13.2. Show that for an input with an independent prior, conditioning on a noiseless reading of it and imposing it give identical posteriors over every other variable, and that for a solved variable they do not in general. State the condition on the graph under which they coincide for a solved variable.

Exercise 13.3. Repeat the counterfactual of Table 13.2 with a second meter on feeder 1–3 in the factual world. Show that the abducted posterior of the loads is now tighter and less correlated, and that the counterfactual outage flow’s spread falls accordingly. What does the naive computation give with two meters?

Exercise 13.4. Add to the branch tree of Table 13.3 a second failure: under the “open feeder 2–3” action, feeder 1–3 also fails with probability 0.02. Compute the leaf for that second failure, the

weighted probability of exceeding the limit on feeder 1–2 over the two leaves, and the expected shortfall of F_{12} at the 95 percent level.

Exercise 13.5. For the two-region network of Chapter 8, formulate the intervention “hold the tie flow at 2.0 per unit” in two ways: by a phase-shifting device that replaces the tie closure, and by capping in region B that shifts the load priors. Compute both posteriors, identify which region’s message each intervention changes, and say what is reused.

Solutions to selected exercises

Exercise 13.1. The heater adds its power s to the balance at node 2, $Q_{2a} = Q_{12} + s$, and its controller sets s so that $T_2 = 72$. The replaced mechanism is the free choice of s , and both closures stay. The source is untouched at 100 ± 20 , and so is the inlet temperature at 20 ± 3 . The conduction closure gives $T_1 = 72 + G/5 = 92.0 \pm 4.0$, as in both interventions of Table 13.1. The convection closure gives $Q_{2a} = 2(72 - T_a) = 104 \pm 6$, whose spread is now the inlet temperature’s rather than the source’s, and the heater’s power $s = Q_{2a} - G = 4 \pm 21$ carries both. Against the fan controller, T_1 is the same and Q_{2a} differs, 104 ± 6 against 100 ± 20 . Against the inlet-air controller, the inlet temperature differs, 20 ± 3 against 22 ± 10 . Three devices, one value, three posteriors.

Exercise 13.2. The first part is Proposition 13.1. For a solved variable x_i , seeing keeps every row and adds $\delta(x_i - v)$, while doing by a device removes the row the device overrides and adds the same delta. The two coincide when the removed row, with the delta and every other factor in place, contributes a constant. That happens when the row contains a variable that appears in no other factor and has a flat prior: integrating the row over that variable gives the same number whatever the other variables are. A controller’s actuator is such a variable. The heater of Exercise 13.1 is the example. Its power s appears only in the balance at node 2, with a flat prior, and holding $T_2 = 72$ with the heater gives exactly the posterior of seeing $T_2 = 72$ in the model where the heater’s power is free, since the rows are the same. The fan controller and the inlet-air controller are not of this form in the original model. The convection closure ties the inlet temperature to the source, and the inlet temperature’s prior carries a setpoint, so removing either changes what the other variables may be, and the posteriors of Table 13.1 differ from seeing.

Exercise 13.3. The second meter reads 0.90, where the one-meter posterior predicted 0.899 ± 0.092 . With both meters the abduced loads are $P_2 = -1.597 \pm 0.047$ and $P_3 = -0.552 \pm 0.047$, correlated at -0.77 instead of -0.94 : each meter reads a different combination of the loads, and together they pin both. The counterfactual outage flow on feeder 1–2 is $-P_2$, 1.597 ± 0.049 , half the spread of the one-meter answer. Its probability of exceeding 1.6 is 0.47, barely moved, because the mean sits almost exactly at the limit. The naive computation conditions the outage model on both readings, which under the outage read $-P_2$ and $-P_3$ directly. It concludes $F_{12} = 1.25$, $P_2 = -1.25$ and $P_3 = -0.89$, now wrong for both loads. More factual evidence sharpens the counterfactual and leaves the naive answer as wrong as before.

Exercise 13.4. Under “open feeder 2–3” the leaf without the second failure has $F_{12} = 1.60 \pm 0.09$ and a probability of 0.49 of exceeding 1.6. With feeder 1–3 also out, bus 3 is de-energized: its

load of 0.55 ± 0.18 per unit is shed, and feeder 1–2 still carries bus 2’s load alone, the same 1.60 ± 0.09 . The weighted probability over the two leaves is therefore still 0.49. For a Gaussian the mean of the worst five percent is $\mu + \sigma \varphi(z_{0.95})/0.05$, with φ the standard normal density and $z_{0.95} = 1.645$, so the expected shortfall of F_{12} at 95 percent is 1.79 per unit, the same in both leaves. What the second failure adds is a shed load, expected $0.02 \times 0.55 = 0.011$ per unit. Under “open 2–3 and cap 0.3” the same second failure sheds the same load, and the flow’s expected shortfall is 1.49, below the limit.

Exercise 13.5. The phase shifter is worked in §13.7. It replaces the tie closure, so it changes the relation on the port itself, and with nothing observed it moves the region- B loads to a sum of -2.000 ± 0.020 while leaving its own angle undetermined: by Proposition 13.4 it is not realizable, because the flow on a bridge does not depend on the angle across it. Capping that shifts the load priors, by 0.1 per unit of expected region- B load, changes only region B ’s factors, so only region B ’s message is recomputed and region A ’s is reused. It leaves the tie flow at 2.00 ± 0.35 : the mean is where it was asked to be, but the flow is not held, since the loads still vary. Holding it exactly takes a controller with an actuator inside region B , the inverter at bus 4 of §13.7, which again changes only region B ’s message and absorbs the loads’ variability in its own output, 0.10 ± 0.35 .

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

What if the fan slows *abduction; action and prediction as three separate steps; the posterior over unmeasured inputs is what a counterfactual is evaluated on*
`level2_room_hall/setpoint_relaxation/problems/what_if_the_fan_slows`

Chapter 14

Attribution, sensitivity, and certificates

The previous chapter left three questions unanswered at every leaf of its decision tree: which uncertain input the risk depends on most, how much a unit change in each would move it, and whether a reported number is a floor, a ceiling or a guess. All three are questions about how a consequence of the physics varies with the inputs, and all three become cheap when the solve returns, along with the consequence, its gradient with respect to every input. This chapter shows where that gradient comes from, what attribution means and how it differs from sensitivity, and how a census of solves with gradients, harvested once, answers the three questions and several more at no further cost, with a certificate, whenever the consequence is convex in the inputs. It ends with the one trap that a certificate cannot survive: a gradient taken across a kink.

14.1 Three questions, one derivative

Let $G(\mathbf{u})$ be a scalar consequence of the physics, the unserved load, the tie flow, the temperature of a component, as a function of the uncertain inputs $\mathbf{u}$. The operator's three questions are, in order of how much they ask of G :

1. *Sensitivity*: by how much does G change per unit change in u_i at the current state? That is $\partial G / \partial u_i$, one number per input, at one point.
2. *Attribution*: how much of the uncertainty in G is due to the uncertainty in u_i ? That is a property of G over the whole prior, not at a point, and it needs the joint behavior of G and the inputs.
3. *Certification*: is the reported expectation, tail or worst case of G a bound, and in which direction? That needs a global property of G , and convexity is the one that delivers.

Sensitivity is the derivative. Attribution can be approximated by it and is exactly it only for a linear G . Certification uses it as a supporting plane. All three start from the same object, and the first task is to obtain it without differencing.

14.2 Sensitivities from the solve

At a solved state $\mathbf{F}(\mathbf{z}^*, \mathbf{u}) = \mathbf{0}$ the solved variables are an implicit function of the inputs, $\mathbf{z} = X(\mathbf{u})$, and the implicit function theorem gives their derivative from the two Jacobians the solve already

assembled:

$$\frac{\partial X}{\partial \mathbf{u}} = -\mathbf{J}_z^{-1} \mathbf{J}_u, \quad \mathbf{J}_z = \frac{\partial \mathbf{F}}{\partial \mathbf{z}}, \quad \mathbf{J}_u = \frac{\partial \mathbf{F}}{\partial \mathbf{u}}. \quad (14.1)$$

$\mathbf{J}_z$ is the Jacobian of Chapter 1, square and already factored; $\mathbf{J}_u$ is the same assembly with the input columns kept rather than dropped, which costs nothing extra. For n_u inputs the forward form is n_u solves against the held factorization, one per column of $\mathbf{J}_u$. For one consequence $G = \mathbf{c}^\top \mathbf{z}$ the *adjoint* form is a single solve, $\mathbf{J}_z^\top \boldsymbol{\lambda} = \mathbf{c}$, after which $\partial G / \partial \mathbf{u} = -\boldsymbol{\lambda}^\top \mathbf{J}_u$ for every input at once. A model with a hundred inputs and one consequence pays one solve; with one input and a hundred consequences, one solve the other way.

Derivation. Differentiate the identity $\mathbf{F}(X(\mathbf{u}), \mathbf{u}) = \mathbf{0}$ with respect to $\mathbf{u}$: $\mathbf{J}_z \partial X / \partial \mathbf{u} + \mathbf{J}_u = \mathbf{0}$. At a well-posed solution $\mathbf{J}_z$ is nonsingular, which gives equation (14.1). For $G = \mathbf{c}^\top \mathbf{z}$ the derivative is $\partial G / \partial \mathbf{u} = -\mathbf{c}^\top \mathbf{J}_z^{-1} \mathbf{J}_u$. Grouped from the left, $\boldsymbol{\lambda}^\top = \mathbf{c}^\top \mathbf{J}_z^{-1}$ is the solution of $\mathbf{J}_z^\top \boldsymbol{\lambda} = \mathbf{c}$, one solve, after which $-\boldsymbol{\lambda}^\top \mathbf{J}_u$ is a sparse product. Grouped from the right, $\mathbf{J}_z^{-1} \mathbf{J}_u$ is n_u solves, one per input column. $\square$

On the processor heat path with the conductance k freed, the inputs are (G, T_a, k) ; here G is the chain's heat source, not the consequence $G(\mathbf{u})$ of §14.1. The script `ch14_attribution.py` in the book's `scripts` directory, which supplies every number in the chapter, evaluates equation (14.1) at the nominal state:

$$\frac{\partial(T_1, T_2)}{\partial(G, T_a, k)} = \begin{pmatrix} 0.700 & 1.000 & -4.000 \\ 0.500 & 1.000 & 0 \end{pmatrix}, \quad (14.2)$$

agreeing with central differences to 2×10^{-9} . The package temperature rises 0.7 degrees per watt of source, one degree per degree of inlet temperature, and falls four degrees per unit of conductance; the heat sink does not see the conductance at all. The same numbers are the lever arms that Chapters 3 and 11 read off by hand, now read off the Jacobian for any model.

At scale. On the chain, with three inputs, the choice between the forward and adjoint forms hardly matters. Take instead the cold plate of Chapter 11 at 100×100 nodes, with an uncertain heat source at every node: ten thousand unknowns, ten thousand inputs, and one consequence, the temperature at the centre, where a component sits. The forward form would solve once per source, ten thousand solves, about 23 seconds against the held factorization. The adjoint form solves once, in 1.2 milliseconds after a factorization of 33 milliseconds, and returns all ten thousand sensitivities; at the nodes checked they agree with finite differences to six digits. The centre warms by 0.123 kelvin per watt of its own source, 0.063 per watt of a neighbour's and 0.0025 per watt of a source ten nodes away. The sensitivities sum to 4.000 kelvin per watt, which is $1/h$: a uniform extra watt at every node must raise every node by $1/h$ for the plate to reject it. And the centre follows the coolant temperature one for one. Figure 14.1 draws the sensitivities around the centre. The map is the plate's Green's function seen from the centre, and since the plate is linear it is also the attribution: with independent sources of equal spread, each source's share of the centre's variance is proportional to the square of its sensitivity, by Proposition 14.1.

14.3 Attribution

Attribution asks for a decomposition of $\text{Var}[G]$ into shares due to each input. Two definitions are standard.

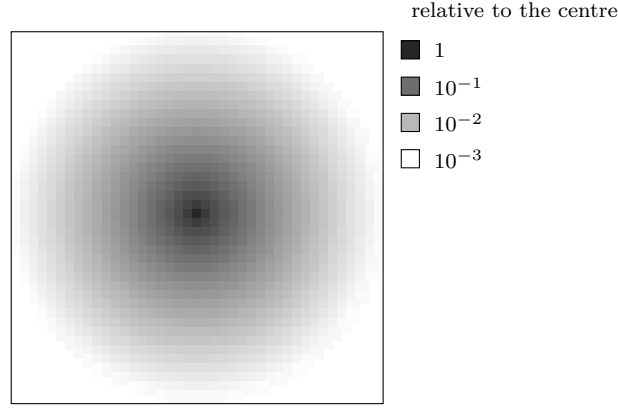


Figure 14.1: The sensitivity of the centre temperature of a 100×100 cold plate to the heat source at each node within twenty nodes of the centre, relative to the centre's own, on a logarithmic grey scale. One adjoint solve computes all ten thousand values.

The *Sobol* first-order index of input i is the fraction of the variance explained by the conditional expectation given u_i alone, $S_i = \text{Var}[\mathbb{E}[G \mid u_i]] / \text{Var}[G]$; the *total* index adds every interaction involving u_i . When G is additive in independent inputs the first-order indices sum to one and equal the totals; when it is not, the difference measures interaction, and the indices do not by themselves say how to divide the interaction among the inputs involved.

The *Shapley* share does. It averages, over every ordering of the inputs, the increase in explained variance that input i brings when added to the inputs before it. Shares sum to one, respect symmetry, and give an input that matters only jointly with another half the joint credit. For d inputs the average runs over $d!$ orderings and 2^d subsets, each subset needing a conditional expectation; that is the computation Chapter 10 found to cost the sampling route $(d + 4)N$ solves and the grid route nothing beyond the grid.

The cheap proxy is the gradient, and for a linear consequence it is exact.

Proposition 14.1 (Attribution of a linear consequence). *Let $G = g_0 + \sum_i g_i u_i$ with independent inputs of variances σ_i^2 . Then $\text{Var}[\mathbb{E}[G \mid u_S]] = \sum_{i \in S} g_i^2 \sigma_i^2$ for every subset S of the inputs. The Sobol first-order and total indices of input i are both $g_i^2 \sigma_i^2 / \text{Var}[G]$, and so is its Shapley share.*

Proof. By independence, $\mathbb{E}[G \mid u_S] = g_0 + \sum_{i \in S} g_i u_i + \sum_{i \notin S} g_i \mathbb{E}[u_i]$, whose variance is $\sum_{i \in S} g_i^2 \sigma_i^2$. The first-order index takes $S = \{i\}$. The total index is one minus the explained fraction of the complement of $\{i\}$, which leaves the same term. In the Shapley average every marginal contribution of input i , $v(S \cup \{i\}) - v(S)$, equals $g_i^2 \sigma_i^2$ whatever S is, so the average is that value too. $\square$

On the chain, T_1 has variance 205, of which the source contributes 196, 95.6 percent, and the inlet temperature 9. For a nonlinear G the same formula with the gradient averaged over the prior, the *activity* $\mathbb{E}[(\partial G / \partial u_i)^2] \text{Var}[u_i]$, is a first-order proxy that a census of gradients provides at no cost. It can be wrong, and the three-feeder problem shows how: the activity shares are 11.7, 76.7 and 11.7 percent for the ratings of feeders A , B and C , against Shapley shares of 3.2, 93.6 and 3.2. The parallel feeders' ratings matter only when their sum is the binding constraint, which is rarely, and only jointly; the gradient is nonzero whenever they bind and does not see

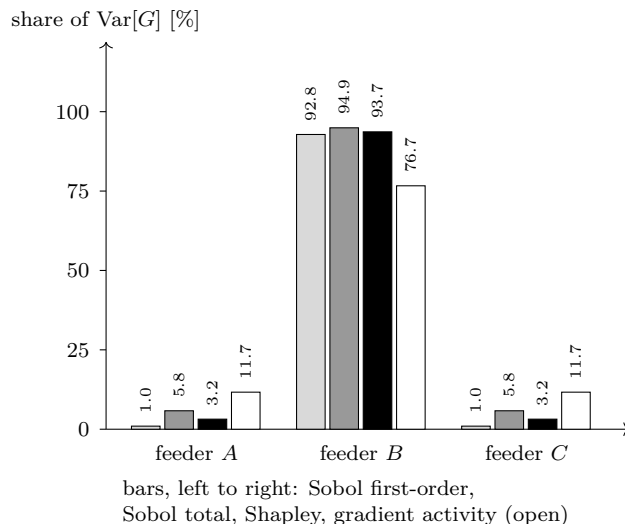


Figure 14.2: Four attributions of the three-feeder unserved load’s variance, in percent: Sobol first-order and total indices and Shapley shares on the 25^3 grid, and the gradient activity from the 300-point census. For feeders *A* and *C* the Shapley share lies between the first-order and total indices; the activity lies outside them.

that they bind together. Activity is a screening tool, useful for saying which inputs can be ignored; it is not an attribution.

Figure 14.2 sets four measures side by side, from the script `ch14_more.py`. The Sobol first-order indices of the parallel feeders are 1.0 percent each and their totals 5.8: each feeder matters mostly through its interaction with the other, and 5.2 percent of the variance is interaction, which the first-order indices credit to no one. The Shapley share splits it, 3.2 each, between the first-order and total indices. The activity proxy, 11.7 each, lies outside that bracket: the gradient counts every draw on which the pair binds, as if each feeder bound alone.

Principle 14.1. *Sensitivity is a derivative at a point; attribution is a decomposition over the prior. The gradient gives the first exactly and the second only for a linear consequence. Where inputs interact, attribution needs conditional expectations, and the question is where to get them cheaply.*

14.4 A census with gradients

Suppose each solve returns G and ∇G at the drawn input, and suppose G is convex in the inputs. Then every solve yields a *supporting plane*, $G(\mathbf{u}) \geq G(\mathbf{u}_j) + \nabla G(\mathbf{u}_j)^\top (\mathbf{u} - \mathbf{u}_j)$ for all $\mathbf{u}$, and a census of C solves yields C of them. Their pointwise maximum, floored at whatever lower bound G is known to obey,

$$L(\mathbf{u}) = \max\left\{0, \max_{j \leq C} [G(\mathbf{u}_j) + \nabla G(\mathbf{u}_j)^\top (\mathbf{u} - \mathbf{u}_j)]\right\} \leq G(\mathbf{u}) \quad \text{for every } \mathbf{u}, \quad (14.3)$$

is a piecewise-linear convex *surrogate* that lies below G everywhere, not only at the census points and not only under the prior the census was drawn from. This is the cutting-plane construction of convex optimization, used here not to optimize but to bound.

Proposition 14.2 (Supporting planes bound a convex consequence). *Let $G \geq 0$ be convex, and let $\mathbf{s}_j$ be a subgradient of G at $\mathbf{u}_j$ for each census point. Then L of equation (14.3), with $\mathbf{s}_j$ in place of $\nabla G(\mathbf{u}_j)$, satisfies $L \leq G$ everywhere. Consequently, under any distribution of the inputs, $\mathbb{E}[L] \leq \mathbb{E}[G]$ and $\mathbb{P}(L > g) \leq \mathbb{P}(G > g)$ for every g . The surrogate L is convex and piecewise linear, and its maximum over a box is attained at a vertex.*

Proof. A subgradient satisfies $G(\mathbf{u}) \geq G(\mathbf{u}_j) + \mathbf{s}_j^\top(\mathbf{u} - \mathbf{u}_j)$ for every $\mathbf{u}$, by definition, and the gradient of a differentiable convex function is one. The maximum of quantities each at most $G(\mathbf{u})$, together with $0 \leq G(\mathbf{u})$, is at most $G(\mathbf{u})$. A pointwise inequality survives any expectation, and the event $\{L > g\}$ is contained in $\{G > g\}$. A maximum of affine functions is convex. A convex function on a box attains its maximum at a vertex, because every point of the box is a convex combination of the vertices and the function there is at most the same combination of the vertex values. $\square$

The inequality is a theorem given convexity. The *certificate* is its empirical check: evaluate G on a holdout set of draws, and verify $L \leq G$ on every one. A violation is not a statistical fluctuation; it is proof that either G is not convex or a gradient is wrong, and either invalidates every bound below.

14.4.1 What the census answers

Once L is built, it is a function that costs nothing to evaluate, and everything asked of G can be asked of L instead, with a known direction of error:

- $\mathbb{E}[L]$ under any belief is a *floor* on $\mathbb{E}[G]$ under that belief, including beliefs other than the one the census was drawn from: a changed forecast, a correlated prior, a what-if on the box.
- $\mathbb{P}(L > g)$ is a floor on $\mathbb{P}(G > g)$: a tail floor at every level.
- $\max L$ over a box is a floor on the worst case, and since L is convex the maximum over a box is at a vertex.
- The mean census gradient is the mean sensitivity, the shadow price of each input's capacity.
- Attribution is computed on L by any method, at zero solves, since L is cheap; where L is close to G the shares are close.

14.4.2 The three-feeder problem

The unserved load $G = (160 - \min(A + C, B))^+$ is convex in the ratings: the minimum of linear functions is concave, its negative convex, and the positive part preserves convexity. Its gradient at any point is the gradient of the active piece: $(-1, 0, -1)$ when the parallel pair binds, $(0, -1, 0)$ when feeder B does, zero when nothing is left unserved. A census of 300 draws with these gradients gives the surrogate of equation (14.3). Table 14.1 certifies it on 20,000 holdout draws and answers the questions.

On this problem the surrogate is not merely a floor; it is exact, and the reason is instructive. The unserved load has three linear pieces, and once the census has landed at least one point on each, the three supporting planes reproduce the function everywhere. The gap between L and G on the holdout is zero to machine precision, the floors are the values, and the Shapley shares computed on a midpoint grid of L , at zero further evaluations of G , are the reference shares of Chapter 10 to a tenth of a point. On a real load-shedding model, a linear program whose value has as many pieces as the program has bases, the gap is finite and the floors are floors; the same

Table 14.1: A census of 300 evaluations with active-set gradients on the three-feeder unserved load: the certificate on 20,000 holdout draws and the answers read from the surrogate at zero further evaluations, against the truth.

question	from the surrogate L	truth	direction
certificate: $\max(L - G)$ on holdout	3×10^{-14}	≤ 0 required	—
$\mathbb{E}[G]$ under the census belief	5.322	5.333 (holdout 5.322)	floor
$\mathbb{E}[G]$, A , C shifted to $[60, 110]$	8.274	8.274	floor
worst case over the box	20.0	20.0 at $(70, 140, 70)$	floor
$\mathbb{P}(G > 5)$, $\mathbb{P}(G > 10)$, $\mathbb{P}(G > 15)$	0.400, 0.266, 0.131	same	floors
shadow prices $\mathbb{E}[\nabla G]$	$(-0.05, -0.51, -0.05)$	—	—
Shapley shares on a 25^3 midpoint grid of L	3.2, 93.7, 3.2	3.2, 93.7, 3.2	—

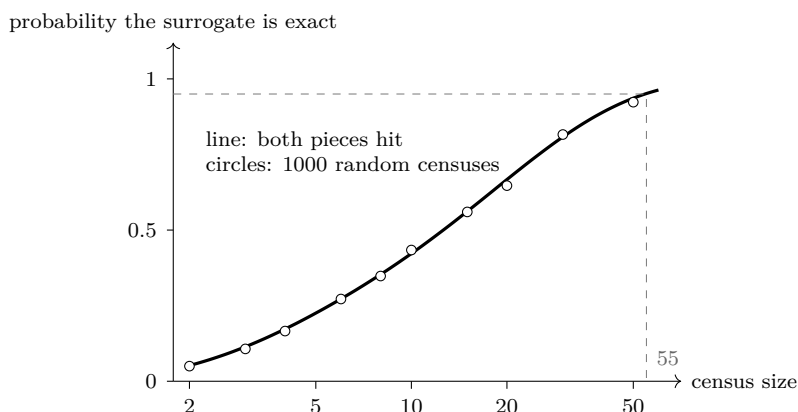


Figure 14.3: The probability that a census of random draws gives an exact surrogate of the three-feeder unserved load, against the census size. Feeder: the probability that the census hits both left unserved pieces. Circles: the fraction of 1,000 random censuses whose surrogate is exact on the holdout. The dashed line marks 95 percent, reached at 55 points.

construction, run on a stressed network with fourteen uncertain ratings and nine questions, gave the solve counts Chapter 10 quoted: 6,536 against 113,876.

The floors under a shifted belief deserve a second look. The census was drawn with the parallel feeders' ratings on $[70, 120]$; the question asked what the unserved load would be if they were on $[60, 110]$, a worse world. No new evaluation of G was made. The surrogate, being a bound everywhere, is a bound there too, and in this case it is the answer. A sampler would have drawn a new sample.

How many census points does exactness take? The surrogate is exact once the census has a point on each left unserved piece, the one where the parallel pair binds and the one where feeder B binds; the zero piece is the floor. A draw lands on the first with probability 0.054 and on the second with 0.486, so a census of C random points is exact with probability $1 - (1 - 0.054)^C - (1 - 0.486)^C + (1 - 0.054 - 0.486)^C$. Figure 14.3 draws it against 1,000 random censuses at each size. The rare piece sets the size: 55 points for 95 percent and 84 for 99, against two placed deliberately, one on each piece. A census drawn from the prior spends its points where the prior puts its mass, and a rare regime needs either many points or one placed on purpose.

Table 14.2: The certificate with active-set gradients and with central finite differences of G (step 1 kW) on the same 300 census points and 20,000 holdout draws.

gradient	census points at a kink	holdout violations	$\max(L - G)$
active set	0 of 300	0 of 20,000	3×10^{-14} kW
central differences	18 of 300	984 of 20,000	+0.124 kW (1.9% of sd)

Principle 14.2. *A convex consequence with gradients from the solve yields supporting planes, and their maximum is a surrogate that bounds the consequence everywhere. Every question asked of the surrogate is answered at zero further solves with a known direction of error, and the certificate is a holdout check that fails loudly.*

14.5 The kink

Everything in the previous section rested on the gradient being a subgradient: a slope that supports the function from below. For a convex function that is smooth the gradient is the only subgradient and any correct computation of it will do. For a convex function with a kink, the minimum of the three-feeder problem, the positive part, the maximum in a limiter, the active-set gradient is a subgradient and the finite difference is not.

Replace the active-set gradients of the census by central differences of G with a step of one kilowatt, and re-certify. Table 14.2 gives the result. Eighteen of the three hundred census points straddle a kink, in the sense that the difference step crosses from one linear piece to another; at each of them the central difference averages the two slopes and the resulting plane crosses the kink and sits above G nearby. On the holdout the surrogate exceeds G at 984 of 20,000 points, by up to 0.12 kilowatts, two percent of the unserved load's spread. The certificate fails. Nothing about the function has changed; only the gradient, and only where the function bends.

Proposition 14.3 (A central difference across a kink). *Let f be convex and piecewise linear in one variable, with a single kink at which its slope rises by J . A central difference with step h , taken at a centre within h of the kink, gives a feeder that lies above f at the kink by up to $Jh/8$, the largest value reached when the centre is $h/2$ from the kink. A central difference whose centre is farther than h from every kink returns the slope of its piece, which is a subgradient.*

Proof. Put the kink at 0 and subtract the left-hand line, which changes neither the difference quotient's error nor the violation, so that $f(x) = Jx^+$. For a centre $x_0 \in (-h, h)$ the central difference is $s = (f(x_0 + h) - f(x_0 - h))/(2h) = J(x_0 + h)/(2h)$. The feeder through $(x_0, f(x_0))$ with slope s has height $f(x_0) - sx_0$ at the kink, where f is zero. For $x_0 < 0$ that height is $-Jx_0(x_0 + h)/(2h)$, and for $x_0 > 0$ it is $Jx_0(h - x_0)/(2h)$. Both are positive, and each is largest, $Jh/8$, at $|x_0| = h/2$. A centre farther than h from the kink differences a single linear piece and returns its slope. $\square$

The census violation of 0.124 kilowatts in Table 14.2 matches this bound: the slope along the rating of feeder B jumps by one where B takes over from the parallel pair, and the step was one kilowatt, so $Jh/8 = 0.125$. Figure 14.4 draws it on a feeder through the kink. In several variables the bound is only a lower estimate. Each coordinate's difference errs by its own amount, so the plane is tilted along the kink as well as across it, and along the kink the violation grows with distance; on the overload of Exercise 14.5 it reaches fifteen times the one-dimensional bound.

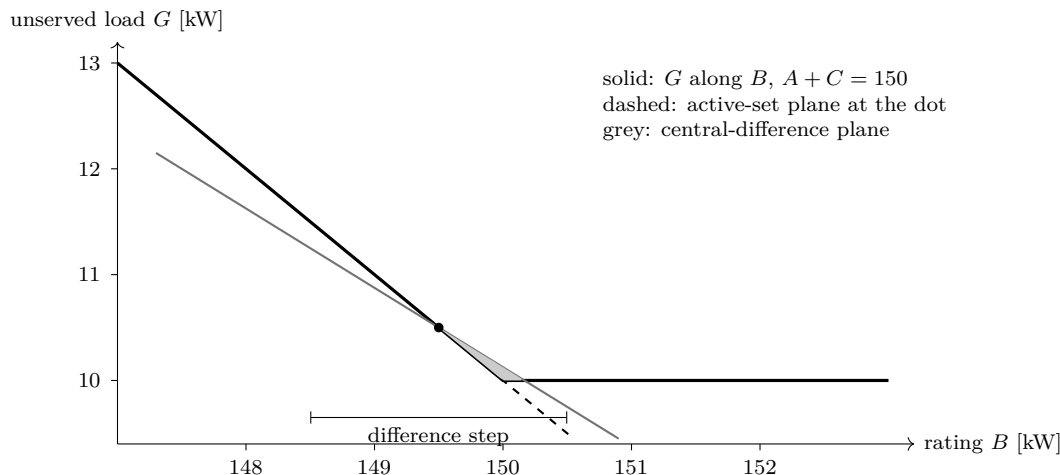


Figure 14.4: The three-feeder unserved load along the rating of feeder B with $A + C = 150$ (solid), which has a kink at $B = 150$ where its slope rises from -1 to 0 . At the dot, 149.5 , the active-set plane (dashed) has the slope of its piece and touches G without crossing it. The central-difference plane (grey), whose step of one kilowatt reaches across the kink, has slope -0.75 and lies above G by up to 0.125 kilowatts, the shaded sliver: an eighth of the step times the jump in slope.

The fix is not a smaller step; a smaller step straddles fewer points and each straddled point is just as wrong. The fix is to difference what is smooth and compose with what is not: the flows and temperatures that the physics solves for are smooth in the inputs, and the kink is in the consequence built from them, a minimum, a positive part, a limit exceeded; take the gradient of the smooth inner map, by equation (14.1) or by differences, and apply the active piece of the outer function at the center point. That is the active-set gradient of Table 14.1, it costs no extra solves, and it is what Chapter 7 meant by differentiating within the regime. The rule is the one that a finite-difference adapter must never break: it may return a gradient, but it must never declare the consequence convex, because its gradients across kinks are not subgradients and the certificate they produce is worthless.

Principle 14.3. *A finite difference across a kink is not a subgradient, even of a convex function. Difference the smooth inner map and apply the active set at the center. Never let a differenced gradient carry a certificate.*

14.6 Worked example: convexity lost and recovered

The chilled-water plants of Chapter 10 test the census in a second domain. Their unserved cooling $U = (2,100 - S_1 - S_2)^+$, with $S_k = \min((1 - \alpha(T - 18)) \sum_j R_{kj}, \dot{m}_k c_p \Delta T)$, has an active-set gradient everywhere, by the same reasoning as the unserved load's. On the chiller-limited piece a plant's delivery rises with each rating at the derated rate and falls with the wet bulb at α times the rating sum; on the loop-limited piece it rises with the pump limit. A census of 500 draws over all nine inputs builds the surrogate, and the holdout refuses to certify it: 3,863 of 20,000 holdout points lie below the surrogate, by up to 5.5 kilowatts, a fifth of the shortfall's spread. Figure 14.6 shows where. The violations sit at hot wet bulbs, 26.4°C on average.

Table 14.3: Attribution of the chilled-water plants’ shortfall variance to three groups of inputs, in percent: Sobol first-order and total indices and Shapley shares by pick-freeze on 400,000 draws per sample set, and the gradient activity summed over each group.

group	first-order	total	Shapley	gradient activity
weather	36.6	76.9	55.9	71.0
plant 1	10.2	35.8	22.2	14.5
plant 2	10.2	35.4	22.0	14.5

The gradients are right; the function is not convex. The derated capacity $(1 - \alpha(T - 18))R$ is bilinear in the wet bulb and a rating, and its Hessian in those two inputs has eigenvalues $\pm\alpha$: a saddle. The shortfall inherits the saddle wherever the chillers bind, which at hot wet bulbs is almost everywhere.

The cure is the separator of Chapter 10. At a fixed wet bulb the derating is a number, each plant’s capacity is linear in its ratings, its delivery is the minimum of two linear functions and so concave, and the shortfall, the positive part of a constant minus two concave functions, is convex in the other eight inputs. Stratify the census by the wet bulb: at each of nine wet-bulb nodes, 120 census points in the other eight inputs and 5,000 holdout points. The certificate holds at every node, with a worst violation of 10^{-12} kilowatts, rounding, in 45,000 holdout points. The floors on the conditional mean are exact at the four hottest nodes, 3.91, 14.23, 33.02 and 64.81 kilowatts. At 23°C the floor is 0.92 against 1.03, and at the two cooler left unserved nodes it is zero, because the census found little or none of the small left unserved region there.

Attribution by groups. The nine inputs fall into three groups an operator would name: the weather, plant 1 with its three chillers and its pump, and plant 2. Table 14.3 gives four measures for the groups, from seven sample sets of 400,000 draws each by pick-freeze; the plants’ model costs almost nothing to evaluate, so the sampling route is affordable here. The weather’s first-order index is 37 percent, the share of the shortfall’s variance that the wet bulb alone explains; the nine-node grid of Chapter 10 put it at 39. Each plant’s is 10. The first-order indices sum to 57 percent, so 43 percent of the variance is interaction: a shortfall needs a hot afternoon and a weak plant together. The totals, 77, 36 and 35, count the interaction in full for every group that takes part in it. Shapley splits it, 56 percent to the weather and 22 to each plant. The gradient activity says 71 and 15. It weighs each input by its slope where the shortfall is positive, and the wet bulb’s slope, the derating of six chillers at once, is large wherever there is a shortfall. It does not see that the shortfall exists only when a plant is also weak, which is where the plants earn their Shapley share.

A floor under a forecast. The stratified census is a set of surrogates, one per wet bulb, and it can answer questions about any belief over the wet bulb at no further cost, provided the step between wet-bulb nodes is bounded too. Extend it to 29 nodes from 24 to 31°C, a quarter kelvin apart, with 120 census points each: 3,480 evaluations in all. The census floors the conditional mean at each node. Between nodes the physics supplies the rest of the argument. The shortfall never falls as the wet bulb rises, since a hotter afternoon derates every chiller and changes nothing else, so on each interval between nodes the conditional mean is at least its value at the lower node. Weighting each node’s floor by the forecast’s probability of the interval above

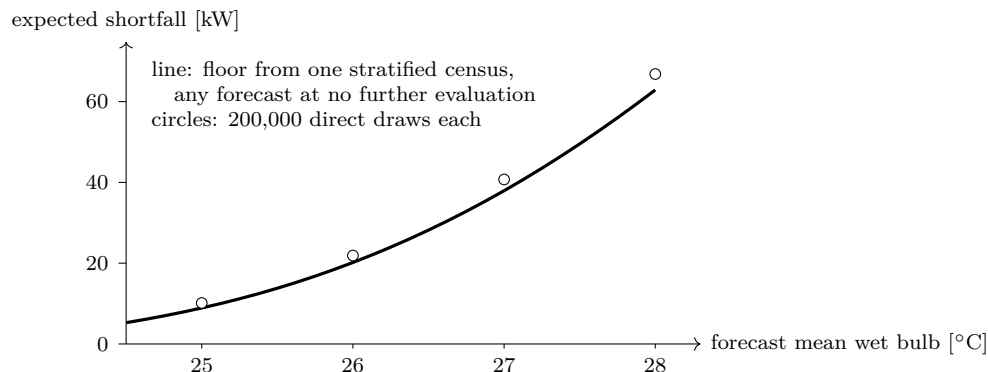


Figure 14.5: The expected unserved cooling of the chilled-water plants under a wet-bulb forecast of mean μ and spread 0.7°C , as μ sweeps from 24.5 to 28°C . Feeder: the certified floor from one stratified census of 3,480 evaluations, a lower sum over wet-bulb nodes that uses the shortfall's monotonicity in the wet bulb; every forecast costs no further evaluation. Circles: 200,000 direct draws at each of four forecasts.

it therefore gives a certified floor, a lower Riemann sum.

Proposition 14.4 (A floor under any belief over a monotone input). *Let $G(t, \mathbf{x}) \geq 0$ be nondecreasing in a scalar input t for every $\mathbf{x}$, let $t_1 < \dots < t_m$ be nodes, and let $L_i(\mathbf{x}) \leq G(t_i, \mathbf{x})$ for each i . For any distribution of t independent of $\mathbf{x}$, with $t_{m+1} = \infty$,*

$$\mathbb{E}[G] \geq \sum_{i=1}^m \mathbb{P}(t_i \leq t < t_{i+1}) \mathbb{E}[L_i(\mathbf{x})]. \quad (14.4)$$

Proof. For t in $[t_i, t_{i+1})$, monotonicity gives $G(t, \mathbf{x}) \geq G(t_i, \mathbf{x}) \geq L_i(\mathbf{x})$, and for $t < t_1$, $G(t, \mathbf{x}) \geq 0$. Take the expectation over $\mathbf{x}$ with t fixed, which by independence does not change the distribution of $\mathbf{x}$, and then over t , splitting its range at the nodes. $\square$

Under the heat-wave forecast of Chapter 13, $26.5 \pm 0.7^\circ\text{C}$, it is 28.18 kilowatts, against 30.58 ± 0.09 from 200,000 direct draws. Under a hotter forecast of $27.5 \pm 0.7^\circ\text{C}$ it is 49.53, against 53.05 ± 0.11 . Figure 14.5 sweeps the forecast.

The floor is loose by roughly half a node spacing times the slope of the conditional mean, two or three kilowatts here, and halving the spacing halves it, at twice the census. The tempting alternative is to weight each node by the forecast's density instead. That gives 30.44 under the heat wave, much closer, but it is not a bound: under a mild forecast of $25 \pm 0.7^\circ\text{C}$ it gives 10.55 kilowatts where direct draws give 10.14 ± 0.05 . The conditional mean is convex in the wet bulb, and a density-weighted sum over nodes overstates a convex function. A floor at each node becomes a floor over the forecast only through an argument about what happens between the nodes, and here monotonicity is that argument. Each new forecast costs no evaluation of the plants at all.

Principle 14.4. *Convexity is a property of a consequence in chosen inputs. When one input spoils it, condition on that input and certify the rest; the input to condition on is usually a separator already.*

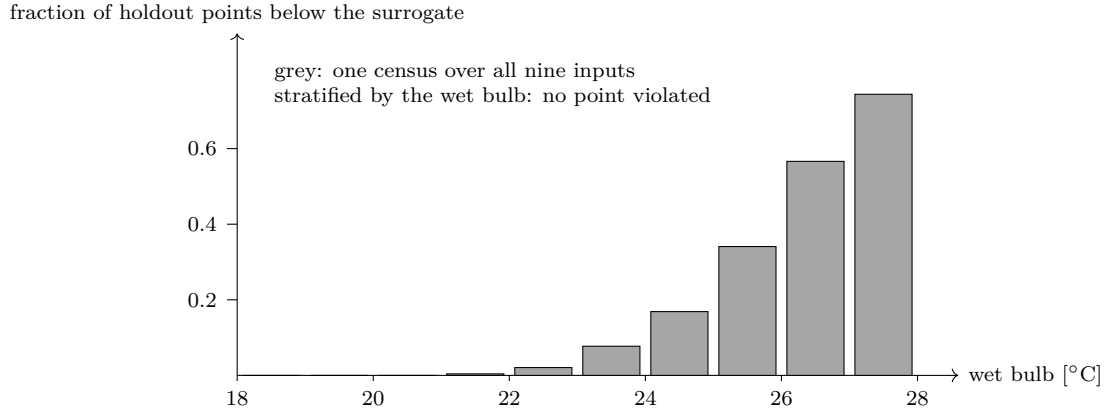


Figure 14.6: The chilled-water plants’ shortfall and a census with active-set gradients over all nine inputs: the fraction of holdout points at which the surrogate exceeds the shortfall, by wet-bulb bin. The violations are at hot wet bulbs, where the derating’s saddle matters. Stratified by the wet bulb, the same construction violates at no holdout point.

14.7 Conditions

The chapter’s method rests on two conditions, and it is worth stating where each holds.

The solve must return its gradient. Equation (14.1) does this for any model whose residuals are differentiable in the inputs, at the cost of keeping the input columns of the Jacobian. A load-shedding linear program returns its gradient as the dual variables on the rating constraints, for free. An iterative solver that returns only a value must be differenced, with the caveat of §14.5.

The consequence must be convex in the inputs. The value of a linear program is convex in its right-hand sides, so any consequence that is the optimal value of a linear allocation, load shed, rebalancing cost, is convex in the capacities and loads that bound it. A DC power flow’s feeder flows are linear in the injections, so any convex function of them, an overload measured as a positive part, is convex. An AC power flow is not linear, its flows are not convex in the injections, and a surrogate built on it is a surrogate without a certificate: still useful for screening, mean sensitivities and variance reduction, none of which need the bound, but no longer a floor. The same nine questions have been put to an AC model, a 14-bus network with eight uncertain loads and total feeder overload as the consequence, in a congested regime and an intermittent one. The shadow prices, the total Sobol indices and the first-order indices survive as estimates in both. The screening bound stays certified in both, because it never needed the inequality. The five questions that read a floor from the surrogate, a new belief, correlated loads, a what-if curve, the tail floors and the worst case, lose the certificate. In the congested regime they are empirical: $L \leq G$ held on all 2,000 holdout and 10,000 reference draws, but nothing guarantees that it holds elsewhere. In the intermittent regime they are estimates: $L \leq G$ fails on 1,149 of the 10,000 reference draws, by at most 7×10^{-4} of the standard deviation of G .

14.8 In practice

Take gradients from the solve. Keep the input columns of the Jacobian when assembling it. For one consequence and many inputs, solve the adjoint system once; for one input and many consequences, solve forward once. Differentiate only what the solver cannot differentiate, and only the smooth part of it.

Screen with the gradient, attribute with conditional expectations. The activity proxy says which inputs can be dropped. The shares that go into a report come from Shapley or Sobol on a grid or on a certified surrogate, where they cost no further solves.

Certify before using any floor. Check $L \leq G$ on a holdout drawn independently of the census. One violation invalidates every bound built from that surrogate, and it points at either a wrong gradient or a lost convexity.

Place census points on purpose. A census drawn from the prior finds a rare regime late: 55 random points for what two placed points do on the three-feeder problem. Seed the census at the vertices of the box and at the boundaries of the regimes you know about.

Turn floors at nodes into a floor over a belief with an argument. A surrogate stratified on one input bounds the consequence at each node and nowhere between. A monotone input gives the argument that carries the bound between nodes, Proposition 14.4; without one, a density-weighted sum over the nodes is an estimate, and it can overstate.

Check convexity in the coordinates you use. A product of inputs, a derating, an efficiency that varies with load: each can make a consequence non-convex. Stratify on the input that causes it, and certify within each stratum.

14.9 What is missing

Every input in this chapter was continuous. The inputs that fail discretely, the availabilities of Chapter 7, have no gradient, and the question of which of them matter most, alone and together, needs the branch machinery instead: which combinations of failures are most probable, which most damaging, and how a common cause ties them together. That is Chapter 15, the last of Part IV.

Notes and further reading

Sensitivities by the implicit function theorem and their adjoint form are standard in design optimization and in data assimilation; Nocedal and Wright [75] treat the linear algebra, and the observation that a linear program's duals are the derivatives of its value with respect to its right-hand sides is the sensitivity theorem of linear programming, found there and in Boyd and Vandenberghe [12], who also give the convexity of the optimal value in the constraint data that §14.7 relies on. Variance-based attribution is Sobol's [95]; the Shapley share as an attribution that resolves interactions is Owen's [77], with estimation by Song, Nelson and Staum [96]; the

pick-freeze estimator is Saltelli's [90]. The gradient-based activity as a screening proxy is common in sensitivity analysis under various names; its failure on the three-feeder problem is the book's illustration.

Supporting planes of a convex function and their pointwise maximum are the cutting-plane method of Kelley [48]; the use of that construction as a certified surrogate, evaluated under beliefs other than the census's and checked on a holdout, is the framework's, and the case study cited in §14.4 is its first full instance. The kink caveat of §14.5 was found the hard way, on an AC model whose consequence was a sum of positive parts. In the AC part of the surrogate case study, in its intermittent regime, differenced gradients produced certificate violations of 1.09 kilowatts, about a sixth of the consequence's spread of 6.38. The active-set correction cut them by more than two orders of magnitude, to 0.0046 kilowatts; the residue, under a thousandth of the spread, is the model's non-convexity itself. The caveat is recorded here so that no reader repeats it.

Summary

- Sensitivity, attribution and certification all start from $\partial G/\partial \mathbf{u}$, which the implicit function theorem gives from the two Jacobians the solve assembled: n_u forward solves or one adjoint solve. On a 100×100 cold plate one adjoint solve, 1.2 milliseconds, gives the centre temperature's sensitivity to all ten thousand sources, against 23 seconds forward.
- Attribution is a variance decomposition over the prior; Sobol indices and Shapley shares define it; the gradient gives it exactly only for a linear consequence. On the three-feeder problem the gradient proxy says 12/77/12 and the truth is 3/94/3, with the parallel feeders' Shapley shares between their first-order and total Sobol indices.
- A convex consequence with gradients yields supporting planes whose maximum bounds it everywhere. On the three-feeder problem 300 solves give an exact surrogate; floors on the mean, the tail, the worst case and a shifted belief, and the Shapley shares, follow at zero further solves.
- A finite difference across a kink is not a subgradient: 18 straddled census points broke the certificate at 984 holdout draws, by up to $Jh/8$, an eighth of the step times the jump in slope. Difference the smooth inner map and apply the active set at the center.
- The surrogate is exact once the census hits every piece; a random census needs 55 points for that with probability 0.95, two placed points always suffice.
- On the chilled-water plants a census over all nine inputs fails its certificate at hot wet bulbs, because the derating is bilinear; stratified by the wet bulb it holds at every holdout point. With the shortfall's monotonicity in the wet bulb it floors the expected shortfall under any forecast at no further evaluations: 28.2 kilowatts under the heat wave, against 30.6 by direct sampling. A density-weighted sum over the nodes is closer but is not a bound.
- Over three groups the plants' shortfall is 56 percent weather and 22 percent each plant by Shapley. 43 percent of its variance is interaction, and the gradient proxy overstates the weather at 71.
- Conditions: the gradient must come from the solve, and the consequence must be convex. Linear programs and DC flows qualify; AC flows do not, and lose the bound but not the screening.

Exercises

Exercise 14.1. Derive equation (14.1) by differentiating $\mathbf{F}(X(\mathbf{u}), \mathbf{u}) = \mathbf{0}$, and derive the adjoint form for $G = \mathbf{c}^\top \mathbf{z}$. Count the solves for n_u inputs and n_c consequences in each form and state when each is preferable.

Exercise 14.2. For the three-feeder problem, compute the Sobol first-order and total indices of the three ratings on the 25^3 grid, and show that the totals exceed the first-order indices for feeders A and C . Relate the difference to the interaction the activity proxy missed.

Exercise 14.3. Prove that the positive part of a convex function is convex, that the minimum of two linear functions is concave, and hence that the three-feeder unserved load is convex. Then give a two-feeder network whose unserved load is not convex in its ratings.

Exercise 14.4. Reduce the census of Table 14.1 to 30 points and re-certify. Find the smallest census for which the surrogate is still exact on the holdout, and explain the number in terms of the pieces of G .

Exercise 14.5. Implement the kink fix for the three-feeder problem with finite differences: difference the smooth quantities $A + C$ and B (trivially) and apply the active piece of G at the center, and show the certificate holds. Then apply the same construction to the DC triangle with an overload consequence $\max(0, |F_{12}| - 1.4)$ and uncertain loads, differencing the flows and applying the active set.

Solutions to selected exercises

Exercise 14.1. The derivation is given after equation (14.1). For n_u inputs and n_c consequences the forward form needs n_u solves, each giving one column of $\partial X / \partial \mathbf{u}$ and hence the sensitivity of every consequence to that input. The adjoint form needs n_c solves, each giving the gradient of one consequence with respect to every input. With the factorization held, each solve is two triangular solves, so the cheaper form is the one with the smaller count: adjoint when there are fewer consequences than inputs, forward otherwise. On the chain the package temperature's sensitivities, (0.700, 1.000, -4.000) to the source, the inlet temperature and the conductance, come from one adjoint solve with $\mathbf{c}$ the unit vector on T_1 .

Exercise 14.2. On the 25^3 grid the variance is 41.92. The first-order indices are 1.0, 92.8 and 1.0 percent for feeders A , B and C ; the totals are 5.8, 94.9 and 5.8. The first-order indices sum to 94.8 percent, so 5.2 percent of the variance is interaction, and for each parallel feeder the total exceeds the first-order index by 4.8 points: almost all of what the parallel feeders contribute, they contribute jointly. Feeder B 's total exceeds its first-order index by only 2.1 points. The activity proxy missed exactly this: the gradient $(-1, 0, -1)$ on the piece where the pair binds credits each feeder with the full slope whenever the pair binds, as though either alone could be varied to relieve the unserved load, which is the interaction counted twice.

Exercise 14.4. A 30-point census still certifies, as every census with active-set gradients must, since its planes are subgradients; what it may lose is exactness. It is exact with probability 0.81 (Figure 14.3), and when it is not, its mean gap is small, 0.06 kilowatts on average over random 30-point censuses. The smallest census that is exact is two points, one on the piece where the

parallel pair binds and one on the piece where feeder B binds, since the unserved load has three linear pieces and the floor at zero supplies the third. Drawn at random, the rare piece, hit with probability 0.054, sets the size: 55 points for 95 percent.

Exercise 14.3. If f is convex, $\max(f, 0)$ is the maximum of two convex functions. A maximum of convex functions is convex, because at a convex combination of points each function is at most the same combination of its values, and so is their maximum. The minimum of two linear functions is concave by the same argument with the inequality reversed, and its negative is convex. The unserved load is the positive part of 160 minus that minimum, so it is convex. For a two-feeder network whose unserved load is not convex, feed a load of D through a transfer switch from either of two feeders, one at a time, whichever has the larger rating. The deliverable power is $\max(A, B)$, which is convex, and the unserved load $(D - \max(A, B))^+$ is the positive part of a concave function, which need not be convex: on the segment from $(A, B) = (D, 0)$ to $(0, D)$ it is zero at both ends and $D/2$ in the middle. A census on it would produce planes that cut above it, and the certificate would say so.

Exercise 14.5. On the DC triangle with equal susceptances the flow on feeder 1–2 is linear in the loads, $\partial F_{12}/\partial(P_2, P_3) = (-0.667, -0.333)$, and the overload $\max(0, |F_{12}| - 1.4)$ is convex, positive on 19.8 percent of the box $P_2 \in [-2, -1]$, $P_3 \in [-1, -0.2]$. With central differences of the overload, step 0.05 per unit, 18 of 200 census points straddle the kink, and the surrogate exceeds the overload at 7,445 of 20,000 holdout points, by up to 0.065 per unit. That is fifteen times the one-dimensional bound $Jh/8 = 0.0042$ along P_2 : each coordinate's difference errs differently, the plane tilts along the kink line, and the violation grows with distance along it. Differencing the flow instead, which is exact here because the flow is linear, and applying the active piece of the overload at the centre gives no violations, the largest gap being 2.6×10^{-15} . The three-feeder construction of the exercise's first part is the same: difference $A + C$ and B , which are the inputs themselves, and apply the active piece.

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

A floor from three solves *a convex consequence and a census of value-and-gradient pairs; each solve yields a supporting plane; the maximum of the planes is a certified lower bound*
`level0_site/tower_sets_the_bill/problems/a_floor_from_three_solves`

Chapter 15

Combinatorial failure

The interventions of Chapter 13 were chosen by the operator. The failures of this chapter are not. Feeders trip, cooling units stop, valves stick, and they do so in combinations that nobody selected, at rates that depend on the weather, and sometimes for a shared reason. The operator's questions are then combinatorial: which components are most likely to fail together, which combinations would hurt most, how much of the total risk the plausible combinations carry, and what it costs to leave the rest unexamined. This chapter treats those questions as inference on the hybrid model of Chapter 7, one branch per failure set, and shows that the machinery already built answers them: a prior over failure sets that the pruning proposition of Chapter 9 makes enumerable, a consequence per branch that is an intervention of Chapter 13 and a rank-one update of Chapter 11, and a mixture over the branches whose weights and tails are the risk. Two worked examples carry it, an electrical network of six buses and a cooled room with four units, and the second shows what the first cannot: that a shared cause defeats redundancy in a way independent failures never do.

15.1 The question

A system with L components that can fail has 2^L possible failure sets. Let $S \subseteq \{1, \dots, L\}$ be the set of failed components, let $\mathbb{P}(S)$ be its prior probability, and let $C(S) \geq 0$ be the consequence of that failure set: the load that cannot be served, the overload beyond ratings, the number of degrees a room exceeds its limit, or whatever the operator counts. The four questions are:

1. *Risk*: what is $\mathbb{E}[C] = \sum_S \mathbb{P}(S) C(S)$, and what is the probability $\mathbb{P}(C > c)$ of a consequence beyond some level?
2. *Ranking*: which failure sets contribute most to the risk, $\mathbb{P}(S) C(S)$ in decreasing order?
3. *Worst case*: among sets of size k , which has the largest consequence, $\max_{|S|=k} C(S)$? This is the $N - k$ question in its deterministic form, and the set that attains it is the one an adversary would choose.
4. *Coverage*: if only sets up to size k are examined, how much of the risk has been captured, and how much probability has been left unexamined?

The deterministic tradition answers only the third, usually for $k = 1$: a system is $N - 1$ *secure* if no single failure produces an unacceptable consequence, and the check is to try each of the L single failures in turn. That is a valuable check and an incomplete one. It weights every single failure equally, though some are far more likely than others; it says nothing about pairs, though pairs happen; and it reports a verdict, secure or not, rather than a risk. The probabilistic

Table 15.1: Coverage by enumeration depth under independent equal-rate failures: the number of failure sets of size exactly k , the probability that at most k components fail, and the probability left unexamined.

k	$L = 7, q = 0.02$				$L = 100, q = 0.01$				$L = 500, q = 0.005$			
	sets	$\mathbb{P}(S \leq k)$	left		sets	$\mathbb{P}(S \leq k)$	left		sets	$\mathbb{P}(S \leq k)$	left	
0	1	0.868	0.13		1	0.366	0.63		1	0.082	0.92	
1	7	0.992	$7.9 \cdot 10^{-3}$		100	0.736	0.26		500	0.287	0.71	
2	21	0.9997	$2.6 \cdot 10^{-4}$	4,950	0.921	0.079	$1.2 \cdot 10^5$	0.543	0.46			
3	35	$1 - 5 \cdot 10^{-6}$	$5.3 \cdot 10^{-6}$	$1.6 \cdot 10^5$	0.982	0.018	$2.1 \cdot 10^7$	0.758	0.24			
4	35	$1 - 7 \cdot 10^{-8}$	$6.5 \cdot 10^{-8}$	$3.9 \cdot 10^6$	0.997	$3.4 \cdot 10^{-3}$	$2.6 \cdot 10^9$	0.892	0.11			
5	21	1	$4 \cdot 10^{-10}$	$7.5 \cdot 10^7$	0.9995	$5.4 \cdot 10^{-4}$	$2.6 \cdot 10^{11}$	0.958	0.042			

version answers all four, and the $N - 1$ check is its $k = 1$ slice.

15.2 The prior over failure sets

15.2.1 Independent failures

The simplest prior takes each component to fail independently with its own probability q_i over the horizon of interest. Then

$$\mathbb{P}(S) = \prod_{i \in S} q_i \prod_{i \notin S} (1 - q_i), \quad (15.1)$$

and when the rates are equal, $q_i = q$, the probability depends only on the size of the set: $\mathbb{P}(S) = q^{|S|}(1 - q)^{L - |S|}$, and the number of failures is binomial with mean Lq . The prior decays geometrically in the size of the set, by a factor $q/(1 - q)$ per additional failure, and this decay is what makes the combinatorial question tractable.

Proposition 15.1 (Coverage by size). *Under independent equal-rate failures, the total probability of all failure sets of size greater than k is the binomial tail $\mathbb{P}(|S| > k) = \sum_{j > k} \binom{L}{j} q^j (1 - q)^{L - j}$. By Proposition 9.3, examining only the sets of size at most k and renormalizing errs in any probability by at most that tail; the risk it misses is at most the tail times the largest consequence.*

Proof. The first statement is the definition of the binomial distribution applied to $|S|$, which is a sum of L independent Bernoulli variables with success probability q . The second is Proposition 9.3 with the discarded set being every S with $|S| > k$ and the discarded weight being its total probability. For the risk, $\sum_{|S| > k} \mathbb{P}(S)C(S) \leq \max_S C(S) \sum_{|S| > k} \mathbb{P}(S)$. $\square$

Table 15.1 evaluates the tail for three systems, from the script `ch15_combinatorial.py` in the book's `scripts` directory, which supplies every number in the chapter. Seven feeders at two percent, the small network below, are covered to 2.6×10^{-4} by 29 sets. A hundred feeders at one percent, a real facility's breaker list, need the 161,700 sets of size three to reach 98 percent and the 3.9 million of size four to reach 99.7. Five hundred components at half a percent, a large network or a data center's equipment list, are not covered to 96 percent until size five, at 2.6×10^{11} sets, which no one enumerates. The decay that makes seven feeders trivial makes five hundred hard, because the expected number of failures, Lq , has grown from 0.14 to 2.5, and the sets that carry the probability are the ones with two or three failures, of which there are millions.

Three things follow from the table. On a small system, enumerate everything; there is no reason not to. On a medium system, enumerate to the depth the tail requires for the accuracy required, which for a risk accurate to one percent is $k = 3$ at a hundred feeders, and report the tail as the unexamined probability. On a large system, enumeration to sufficient depth is impossible, and one of three things must give: the consequence must be cheap enough to sample the prior instead of enumerating it, the structure must separate the components into regions whose failure sets can be enumerated independently, or the question must be narrowed from “all sets” to “the sets that matter”, which is the ranking and worst-case questions with bounds. The rest of the chapter takes the first two systems and the last option.

15.2.2 Failure as an intervention

A failed component is an intervention in the sense of Chapter 13: the closure of a failed feeder is replaced by “no flow”, the closure of a failed cooling unit by “no heat removed”, and in the hybrid model of Chapter 7 the replacement is carried by an availability variable a_i in the closure’s scope, $F_{ij} = a_{ij}B(\theta_i - \theta_j)$. A failure set S is the branch with $a_i = 0$ for $i \in S$ and $a_i = 1$ otherwise. The consequence $C(S)$ is a readout of that branch: the overload of the surviving feeders, the load at buses the failures have cut off, the temperature of a room whose units are down. The prior $\mathbb{P}(S)$ is the product of the availability priors. And the risk $\mathbb{E}[C]$ is the mixture of the branch consequences by their weights, which is what Chapter 7 said a discrete variable does to a posterior, now with L of them.

15.3 The consequence per branch, and how to get it cheaply

For a network in the DC approximation, the consequence of a failure set needs the flows with the failed feeders removed, and two things can happen. The surviving network can remain connected to the reference, in which case the flows redistribute and some may exceed their ratings; or a failure can cut a set of buses off entirely, leaving a *dead section*, in which case those buses can be served by nothing and their load is dropped. Both are visible from the graph before any solve: connectivity from the reference is a graph search, and the de-energized buses’ load is a sum.


For the connected part, the flows after an outage are a rank-one update of the flows before it, and the update has a name.

Proposition 15.2 (Feeder outage distribution factors). *In a DC network, let F_e be the pre-outage flow on feeder e , and let feeder o be removed without de-energizing any bus. Then the post-outage flows are*

$$F'_e = F_e + \text{LODF}_{e,o} F_o, \quad \text{LODF}_{e,o} = \frac{\text{PTDF}_{e,o}}{1 - \text{PTDF}_{o,o}}, \quad (15.2)$$

where $\text{PTDF}_{e,o}$ is the change in the flow on feeder e when one unit of power is injected at the sending end of feeder o and withdrawn at its receiving end, with all feeders in service.

Proof. Write the nodal equations of Chapter 2 as $\mathbf{B}'\boldsymbol{\theta} = \mathbf{P}$, with $\mathbf{B}'$ the reduced susceptance matrix, and let $\mathbf{a}_o$ be the incidence column of feeder o (entries +1 at its sending bus, −1 at its receiving bus, zero elsewhere, reference row dropped). Removing feeder o subtracts its contribution: $\mathbf{B}'' = \mathbf{B}' - B_o \mathbf{a}_o \mathbf{a}_o^\top$, a rank-one change. Rather than invert $\mathbf{B}''$, observe that the network with feeder o removed and the same injections carries the same flows as the network with feeder o present, the same injections, and an additional transfer of F'_o units injected at o ’s

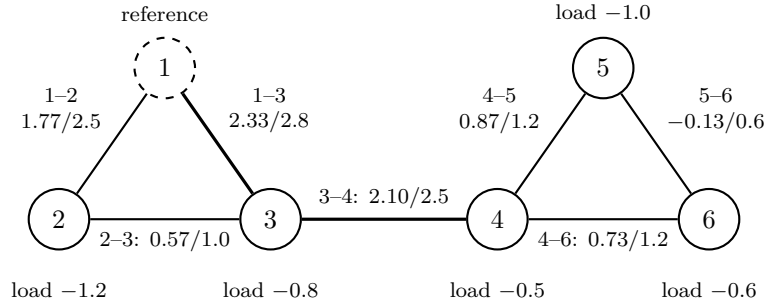

labels: base-case flow / rating, per unit; thick feeders are the two whose loss costs most

Figure 15.1: The six-bus distribution of Chapter 8 with feeder ratings. Every feeder fails independently with probability 0.02. The cross-tie is the only path from region B to the reference: its loss de-energizes buses 4 to 6.

receiving end and withdrawn at its sending end, chosen so that feeder o carries zero net flow. (The transfer cancels the feeder's flow, and a feeder carrying zero flow can be removed without changing anything else.) With feeder o present the flows are linear in the injections, so the transfer of t units along o 's path changes every flow by $t \text{PTDF}_{e,o}$, by definition of the factor. The feeder's own flow becomes $F_o + t \text{PTDF}_{o,o}$, and setting the net flow to zero after subtracting the transfer itself, $F_o + t \text{PTDF}_{o,o} - t = 0$, gives $t = F_o / (1 - \text{PTDF}_{o,o})$. Every other flow is then $F_e + t \text{PTDF}_{e,o}$, which is equation (15.2). The denominator vanishes only when $\text{PTDF}_{o,o} = 1$, which is when feeder o is the only path between its ends, which is when removing it de-energizes the far end, the case excluded. $\square$

The proposition is the Sherman–Morrison identity of Chapter 11 in physical clothing: a feeder outage is a rank-one change to the precision of the network, and its effect on every flow is one column of the pre-outage sensitivity, scaled. The column $\text{PTDF}_{\cdot,o}$ is one solve against the base-case factorization, so the consequences of all L single outages cost L solves against one factorization, and pairs cost two applications of the same formula. On the six-bus distribution the script checks the proposition on the outage of feeder 1–3: the predicted flows agree with a full re-solve to 5×10^{-15} .

15.4 Worked example: a six-bus distribution

Take the two-room distribution of Chapter 8: buses 1 to 3 in a triangle with bus 1 the reference, buses 4 to 6 in a triangle, one cross-tie 3–4, seven runs in all, every susceptance 10 per unit, and the nominal loads of that chapter. Give each feeder a rating, chosen so that the base case is within limits and single outages are not: Figure 15.1 shows the network with its base-case flows and ratings. Each feeder fails independently with probability 0.02 over the horizon. The consequence of a failure set is the total overload of the surviving feeders beyond their ratings plus the load shed at de-energized buses, in per unit.

All 128 sets, exactly. Seven feeders give 128 failure sets, and the script solves every one: a connectivity check, a DC solve on the surviving connected part, the overload and the shed.

Table 15.2: The six-bus distribution: single outages, and the eight failure sets that contribute most to the risk $\mathbb{E}[C] = 0.165$ per unit. C is overload plus shed load.

feeder out	overload	shed	C	$\mathbb{P}(S)C$
1–2	1.50	0	1.50	0.0266
1–3	3.50	0	3.50	0.0620
2–3	0.10	0	0.10	0.0018
3–4	0	2.10	2.10	0.0372
4–5	0.80	0	0.80	0.0142
4–6	0.40	0	0.40	0.0071
5–6	0	0	0	0
failure set	$\mathbb{P}(S)$	C	$\mathbb{P}(S)C$	share of risk
{1–3}	1.8×10^{-2}	3.50	6.2×10^{-2}	37.6%
{3–4}	1.8×10^{-2}	2.10	3.7×10^{-2}	22.5%
{1–2}	1.8×10^{-2}	1.50	2.7×10^{-2}	16.1%
{4–5}	1.8×10^{-2}	0.80	1.4×10^{-2}	8.6%
{4–6}	1.8×10^{-2}	0.40	7.1×10^{-3}	4.3%
{2–3}	1.8×10^{-2}	0.10	1.8×10^{-3}	1.1%
{1–3, 4–5}	3.6×10^{-4}	4.30	1.6×10^{-3}	0.9%
{1–2, 1–3}	3.6×10^{-4}	4.10	1.5×10^{-3}	0.9%

Table 15.2 gives the seven single outages and the eight sets that contribute most to the risk.

The network is not $N - 1$ secure: six of the seven single outages produce an overload or a shed. The loss of feeder 1–3 is the worst, because it carries the most and its flow must then go around through feeder 1–2, which it overloads by 1.6, and through feeder 2–3, which it overloads by 1.9; the two overloads sum to 3.5. The loss of the tie feeder is next: nothing overloads, but region B is de-energized and its 2.1 per unit of load is shed entirely. The loss of feeder 5–6 costs nothing, since the two loads it serves are reached from bus 4 either way. The ranking by $\mathbb{P}(S)C(S)$ is the ranking by consequence among the single outages, because they share a probability, and the first pair enters at seventh place with less than one percent of the risk.

Risk and coverage. The risk over all 128 sets is $\mathbb{E}[C] = 0.165$ per unit, and the probability of any consequence at all is 0.114. Figure 15.2 draws the two coverage curves against enumeration depth: the probability retained by the sets of size at most k , and the fraction of the risk they capture. The single outages carry 99.2 percent of the probability and 90.2 percent of the risk; adding the pairs brings the risk to 99.6 percent; the triples close it. The risk curve lags the probability curve because the consequence grows with the size of the set, so the rare large sets carry more risk per unit of probability than the common small ones. On this network the lag is a few percent; on a network where pairs cause cascades it can be much larger, and the risk curve is the one to watch.

The worst sets. The worst single outage is feeder 1–3, at 3.5. The worst pair is feeder 1–3 with feeder 4–5, at 4.3: the overloads of the first plus the overload the second causes in region B . The pair of feeders 1–2 and 1–3 is close behind at 4.1, and it is a different kind of event: with both feeders from the reference to the triangle gone, bus 2 and bus 3 are served only through feeder 2–3 from each other, and nothing reaches them from bus 1, so the whole network is de-energized

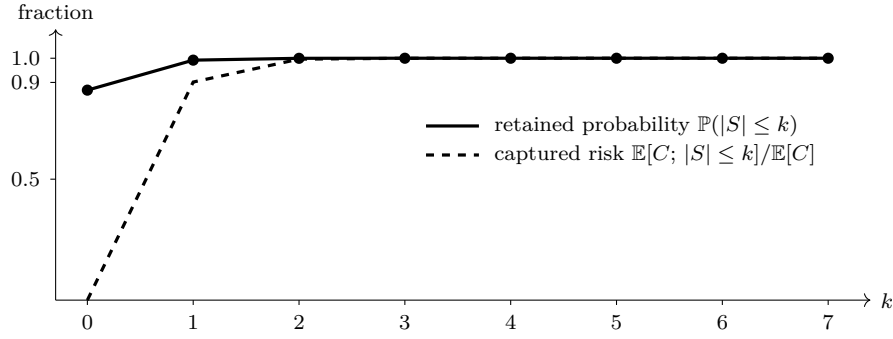


Figure 15.2: Coverage against enumeration depth on the six-bus distribution: the probability carried by the failure sets of size at most k (solid), and the fraction of the total risk they capture (dashed). The risk lags the probability because larger sets have larger consequences.

except the reference; every load is shed. On seven feeders these maxima are found by looking. On seven hundred they are the interdiction problem of §15.7.

Uncertain loads. So far the loads were their nominal values and each branch’s consequence was a number. Give each load the ± 0.2 prior of Chapter 8, and each branch’s consequence becomes a distribution: the flows are linear in the loads, so within a branch the overload is a convex function of a Gaussian vector, and the script samples it. The probability of any consequence rises from 0.114 to 0.225, and the risk from 0.165 to 0.195. The doubling of the probability is the base case: with nominal loads it has no overload, but with the loads uncertain it has a 0.13 probability of one, since feeder 1–3 carries 2.33 against a rating of 2.8 and the load uncertainty pushes it over about one time in eight. Load uncertainty adds risk where the margins are thin, and it adds it to the branch that has all the probability.

15.5 The posterior over failure sets

Everything so far was prior: the risk before any reading. In operation the meters are reading, and the question changes from “which failures might occur” to “which failures have occurred, and what is the risk now”. The hybrid model answers it the way Chapter 7 answered the one-line version: each failure set is a branch, each branch has an evidence given the readings, and the posterior over sets is the prior times the evidence, normalized. A meter on a failed feeder reads zero; a meter on a surviving feeder reads that branch’s flow; and the posterior weighs every set by how well its flows explain what the meters say.

Let the meters on feeders 1–2 and 3–4 read 4.10 and 2.10, each to ± 0.05 ; these are the flows the network carries with feeder 1–3 out and nothing else wrong. Figure 15.3 gives the posterior over the 128 sets. The outage of feeder 1–3 alone takes 94 percent: its prior was 1.8 percent, and two readings raised it by a factor of fifty, because no other single set puts 4.1 on feeder 1–2 while keeping 2.1 on the tie. The remaining six percent is divided equally among three sets, feeder 1–3 together with each of the three feeders inside region B . The meters cannot distinguish these from the single outage, and the reason is Chapter 8’s: a failure inside region B that de-energizes no bus changes nothing that region B tells the rest of the network, so the tie flow stays at 2.10 and the meters are blind to it. Their posterior weight is their prior weight relative to the single

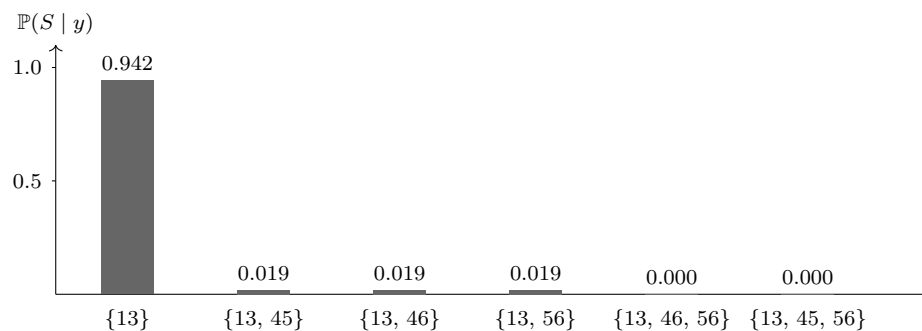


Figure 15.3: The posterior over failure sets on the six-bus distribution after two meters read $F_{12} = 4.10$ and $F_{34} = 2.10$, each to ± 0.05 : the six most probable sets. The outage of feeder 1–3 is identified at 94 percent; the residual weight is on that outage together with a failure inside region B that the two meters cannot see.

outage, one extra failure at two percent each, and only a meter inside region B would separate them. The posterior says which meter to buy next, as Chapter 11 said it would.

The risk conditional on the readings is $\mathbb{E}[C | y] = 3.52$ per unit against a prior risk of 0.165: not because the world has become more dangerous but because the readings have revealed that the largest single consequence has already occurred, and the posterior is nearly certain of it. The probability of a consequence given the readings is one. This is the operational form of the $N - k$ question: not “what could fail” but “what has failed, how sure are we, and what would the next failure cost”. The last is a branch over the surviving feeders with the posterior as its prior, and on this network the expected additional consequence of one more failure in the next horizon is close to zero, since the worst has happened and several further failures would cut off load that is already overloading the feeders that serve it. That is a fact about this small network, not a rule; on a larger one the next failure after a first is often the one that cascades, and the conditional risk is the number to watch.

Principle 15.1. *Given readings, the failure sets have a posterior: prior times evidence per branch. It identifies what has failed, says what the meters cannot tell apart and why, and turns the prior risk into the conditional risk that operation needs.*

15.6 Enumeration by regions

The six-bus distribution has 128 failure sets and each was solved on the whole network. It did not have to be. The network is two regions and a tie, and its failure sets are the product of the regions’ failure sets: region A ’s three feeders give eight, region B ’s three feeders give eight, the tie gives two, and $8 \times 8 \times 2 = 128$. By Chapter 8, each region’s contribution to any branch is its message on the ports of the tie, a two-by-two precision and a two-vector, computed from the region alone. So the 128 branches need eight region solves for A , eight for B , and 128 combinations of two small messages with the tie’s factor: sixteen region solves in place of 128 network solves, and the combinations are two-by-two arithmetic.

The saving is a factor of eight on six buses and it grows with the regions. A network of m regions with L_r failing feeders in region r has $\prod_r 2^{L_r}$ failure sets, but only $\sum_r 2^{L_r}$ region solves,

and the sum is smaller than the product by a factor that is exponential in the number of regions. With pruning by prior weight inside each region, so that only the sets of size up to k_r are kept, the count is $\sum_r \sum_{j \leq k_r} \binom{L_r}{j}$ region solves, which is what makes a hundred-feeder network with three feeders out affordable when the feeders are spread over ten regions and not when they are treated as one.

The script checks the one thing that makes this exact: that a failure inside region B changes region B 's message only through what crosses the tie. With no failure in B , or with feeder 5–6 out, the tie carries 2.100 and the message is the same. With feeders 4–5 and 4–6 both out, buses 5 and 6 are de-energized, 1.60 of load is shed, and the tie carries 0.500: the message has changed, and it has changed because region B 's total draw has changed, which is what its message carries. Region A 's eight solves are reused across all of region B 's eight failure sets, and region B 's across all of A 's, exactly as §8.5 arranged; and the posterior of §15.5 is computed the same way, one evidence per combination of region messages, with the readings inside each region entering that region's message and nowhere else.

15.7 The worst k -set as a query

The third question, $\max_{|S|=k} C(S)$, is an optimization over $\binom{L}{k}$ sets, and it is the one question here that the prior does not help with: the worst set is the worst whatever its probability. On small systems it is found by enumeration, as above. On large ones it is the *interdiction* problem, in which an adversary chooses the k components to disable so as to maximize the damage, and it is hard in general.

Three things the framework offers bear on it. The consequence per set is cheap when it is a rank-one update per component removed, so enumeration reaches further than a re-solve per set would. The convexity of §14.7 gives bounds, and the two directions of bound do different jobs. When C is the value of a linear program in the surviving capacities, the surrogate of Chapter 14 bounds it from below on any set. A lower bound certifies a set already found: its consequence is at least that much. It cannot prune. In a branch-and-bound that maximizes over sets, a branch is a partial set, and it may be discarded only when an upper bound on the consequence of every completion of it falls below the best value found so far. A score that can undercut the true completion value discards branches that may hold the optimum, and a search pruned by it returns a best-found set, not a proved one. And the region structure of Chapter 8 separates the search: a failure inside a region changes that region's message to its ports and nothing else, so the worst set can be sought region by region and then across the ports, at a cost that scales with the regions rather than with the whole.

For the smallest k the global optimum is enumerable, and there the answer is proved. A published stochastic benchmark works this on a 73-bus network with 216 candidate components and 200 background scenarios. It proves the $k = 1$ optimum by evaluating all 216 candidates. It proves the $k = 2$ optimum by evaluating all 15,602 candidates that remain once interchangeable components are merged, at 3,040,242 linear programs. For $k = 3$ to 10 a best-first search reproduces the published optima. Its pruning score is not a valid upper bound, so its certificate is conditional on that score. Every one of those runs stopped at its budget of 500,000 evaluated outage states, and no bound on the optimality gap is reported. The same study finds that ranking the components one at a time and taking the top k recovers the published objective at every k , at about 42,600 outage states whatever k is. The network is capacity-adequate, so the damage a set does is governed by how much reserve it removes, and the problem behaves like a

knapsack rather than a search over interacting failures. Beyond the enumerable k , the honest form of the answer is a best-found set together with what certifies it; when nothing certifies it, the answer says so.

Principle 15.2. *A failure set is a branch, its consequence is an intervention's readout, and its probability is a product of availabilities. Risk is the mixture, ranking is the product, coverage is the binomial tail, and the worst case is a search that the prior does not shorten but the physics does.*

15.8 Common cause and correlated failure

Independence was the assumption of equation (15.1), and it is the assumption most often wrong. Components share a weather, a supply, a maintenance crew, a design flaw; when the shared thing fails, they fail together, at a rate that the product of their individual rates does not approach. Two models capture this, and both fit the factor graph as a variable with a prior.

15.8.1 A shared shock

Let a common cause $c \in \{0, 1\}$ occur with probability r , and let every component fail when it does, in addition to failing independently with probability q when it does not. This is the simplest Marshall–Olkin shock model: independent shocks, one hitting every component and L hitting one each. The probability that a given pair both fail is

$$\mathbb{P}(a_i = 0, a_j = 0) = r + (1 - r)q^2, \quad (15.3)$$

against q^2 under independence, and the probability that all L fail is $r + (1 - r)q^L$ against q^L . For r comparable to q^2 the pairs are twice as likely as independence says; for r comparable to q the shared cause dominates every joint failure, and no amount of redundancy helps, because redundancy protects against independent failures and the shared cause fails everything at once. In the factor graph, c is one discrete variable with a prior $\mathbb{P}(c = 1) = r$, and every availability's prior becomes conditional on it: $\mathbb{P}(a_i = 0 \mid c) = 1$ if $c = 1$ and q otherwise. The branch count doubles, from 2^L to 2^{L+1} , and the shared-cause branch is one of them.

15.8.2 A mixture over the rate

Let the failure rate itself be uncertain, taking the value q_w with probability π_w over a set of conditions w : a hot day, a storm, a normal day. Conditional on the condition the failures are independent; unconditionally they are not. The prior over a set is the mixture

$$\mathbb{P}(S) = \sum_w \pi_w q_w^{|S|} (1 - q_w)^{L - |S|}, \quad (15.4)$$

which is exchangeable but not independent. The induced correlation between two components' failures is

$$\rho = \frac{\mathbb{E}_w[q_w^2] - \bar{q}^2}{\bar{q}(1 - \bar{q})}, \quad \bar{q} = \mathbb{E}_w[q_w], \quad (15.5)$$

which is the variance of the rate across conditions divided by the Bernoulli variance at the mean rate.

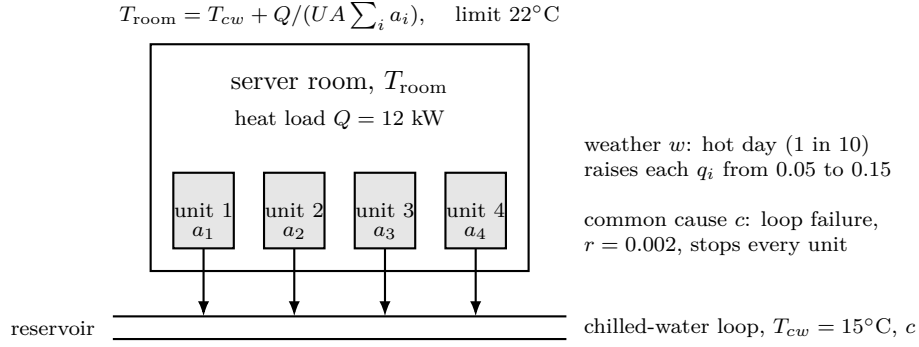


Figure 15.4: A server room cooled by four identical units sharing one chilled-water loop. Each unit has an availability a_i ; the loop's failure c is a common cause; the weather w raises every unit's failure rate together.

Proof. Two failures are indicators X_i, X_j with $\mathbb{E}[X_i] = \mathbb{E}_w[\mathbb{E}[X_i | w]] = \bar{q}$ and, by conditional independence, $\mathbb{E}[X_i X_j] = \mathbb{E}_w[q_w^2]$. Then $\text{Cov}(X_i, X_j) = \mathbb{E}_w[q_w^2] - \bar{q}^2 = \text{Var}_w[q_w]$, and each indicator's variance is $\bar{q}(1 - \bar{q})$. $\square$

The correlation is small when the rate varies little, and it is not the point. The point is the tail: a condition with a high rate makes large failure sets far more probable than the mean rate suggests, since $q_w^{|S|}$ grows with $|S|$ faster for the larger q_w . A ten-percent chance of a day on which the rate triples multiplies the probability of a triple failure by a factor that the correlation of a few hundredths does not hint at. In the factor graph, w is one discrete variable with prior π_w , and the availabilities' priors are conditional on it, exactly as for the shock; the difference is that the shock fails everything and the condition raises everything's rate.

15.9 Worked example: a cooled room

A server room dissipates 12 kilowatts into its air, and $n = 4$ identical cooling units each remove heat to a chilled-water loop at 15 degrees, with conductance 1.5 kilowatts per kelvin each. The room's temperature must stay below 22 degrees. Each unit fails over the horizon with probability 0.05; the chilled-water loop, which all four share, fails with probability 0.002, and when it does no unit removes anything. On a hot day, which is one day in ten, the units' failure rate is 0.15. Figure 15.4 draws the system.

The consequence. With m units working the room is a single node with heat load Q and a conductance mUA to the loop, and its steady temperature is the closed form

$$T_{\text{room}}(m) = T_{cw} + \frac{Q}{mUA}, \quad (15.6)$$

which is the heat path of Example 1.1 reduced to a single node. The temperatures are 17.0, 17.7, 19.0 and 23.0 degrees for four, three, two and one units, and unbounded for none. Two units keep the room under its limit; the room is $N - 2$ tolerant, which is more redundancy than most.

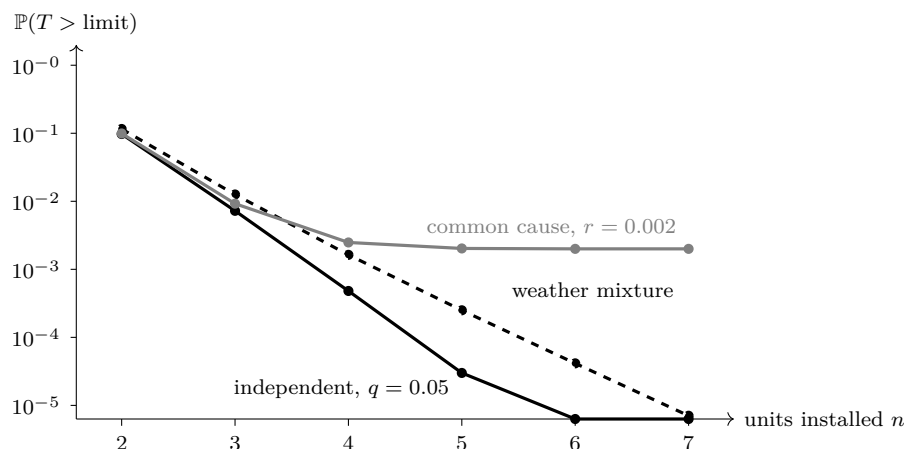


Figure 15.5: Probability of exceeding the room’s limit against the number of units installed, on a logarithmic scale, under three priors: independent failures at $q = 0.05$; the weather mixture; and the shared loop failure at $r = 0.002$. Adding units drives the independent risk down by a factor of twenty per unit and leaves the common-cause risk at its floor.

Independent failures. The limit is exceeded when three or more units fail, which under independence at $q = 0.05$ has probability $\binom{4}{3}q^3(1-q) + q^4 = 4.8 \times 10^{-4}$: once in two thousand horizons.

With the common cause. The loop fails with probability 0.002, and when it does every unit is down whatever its own state. The probability of exceeding the limit is $r + (1-r) \times 4.8 \times 10^{-4} = 2.5 \times 10^{-3}$, five times the independent figure, and four fifths of it is the loop. The four units’ redundancy protected against the independent failures to one part in two thousand; against the shared cause it protected against nothing, and the shared cause, at one part in five hundred, is now the risk.

With the weather. On a hot day the exceedance probability is $\binom{4}{3}(0.15)^3(0.85) + (0.15)^4 = 1.2 \times 10^{-2}$, twenty-five times the cool-day figure; averaged over the one-in-ten hot days, the unconditional probability is 1.6×10^{-3} , three and a half times the independent figure. The correlation the mixture induces between two units’ failures, by equation (15.5), is 0.016, a number that would pass unnoticed in any table of correlations. The tail is where it shows: the probability that three named units fail together is $q^3 = 1.25 \times 10^{-4}$ under independence and $0.1 \times 0.15^3 + 0.9 \times 0.05^3 = 4.5 \times 10^{-4}$ under the mixture, nearly four times as much, and it is the triple failures that exceed the limit.

Figure 15.5 draws the exceedance probability against the number of units installed, from two to seven, under the three priors. Under independence each added unit divides the risk by about twenty, and by seven units it is below one in a million. Under the weather mixture the curve falls too, but more slowly, since the hot-day rate is three times the cool one and each added unit divides the hot-day risk by only about six. Under the common cause the curve flattens at 0.002 and stays there: the seventh unit is as useless as the fifth, because the failure that matters takes all of them. An operator who reads only the independent curve buys units; one who reads the common-cause curve buys a second loop.

Principle 15.3. *Redundancy protects against independent failures and against nothing else. A shared cause puts a floor under the risk that no number of components lowers, and a shared condition fattens the tail far beyond what its correlation suggests. Both are one discrete variable in the graph, and the branches say what the redundancy is worth.*

15.10 In practice

Contingency lists. Operators do not enumerate; they maintain a list of the contingencies worth checking, built from experience and from screening. The ranking of §15.4 is the principled form of that list: every single outage costs one rank-one update, the pairs among the top singles cost two, and the list is the sets with the largest $\mathbb{P}(S)C(S)$ to whatever depth the tail requires. What the probabilistic version adds to the traditional list is the weight, so that a likely small event and an unlikely large one are compared on one scale, and the coverage figure, so that the list's completeness is a number rather than a judgment.

Screening by distribution factors. For a large network, the LODF matrix of Proposition 15.2, L columns of one solve each, screens every single outage for every feeder's post-outage flow at no further cost, and the pairs can be screened by a second application before any is solved exactly. The screen is exact in the DC approximation and a guide in the AC one, where the flows after an outage must be re-solved for the sets the screen flags.

Where to stop. Report the enumeration depth and the tail it leaves. A risk quoted without its unexamined probability is a risk quoted without an error bar. For a hundred components at one percent the depth is three for one-percent accuracy; for five hundred at half a percent no depth is affordable and the honest report is a sampled risk with a sampling error, or a risk over regions with the regions' messages combined exactly.

The common mistakes. Three recur. The first is to treat the $N - 1$ verdict as the risk: a system can be $N - 1$ secure and carry most of its risk in pairs, or insecure to a single failure that almost never happens. The second is to model failures as independent because the data on their dependence is poor; the shared loop of §15.9 raised the risk fivefold at a probability of one in five hundred, and a modeler who does not know r should carry it as a variable with a wide prior rather than set it to zero. The third is to report a worst case without a bound: on any system too large to enumerate, the worst set found is a lower bound on the worst set that exists, and it should be reported as one.

What to report. For each question, the number and its qualifier: the risk with its unexamined tail; the ranked list with its depth; the worst set with its bound; and, always, the do-nothing baseline of Chapter 13, since every mitigation proposed against the ranked list must be compared with leaving the list as it is.

15.11 What is missing

Every failure in this chapter was instantaneous and every consequence was a steady state. Real failures unfold: a feeder trips, flows redistribute, another feeder overloads and trips seconds later,

and the cascade's consequence depends on the order and the timing. That needs the dynamics of Chapter 16. And every enumeration here was over a whole system; Chapter 17 organizes the enumeration by the regions of Chapter 8, where a region's failure sets are enumerated inside the region and combined at its ports, and Chapter 18 asks how large a region can be before that stops working. Part IV ends here; the operator's questions have each been asked, and each has been a readout of one posterior, a branch of it, or a search over its branches.

Notes and further reading

Power-system reliability evaluation, with independent-failure priors, contingency enumeration, and the loss-of-load indices that are this chapter's risk and exceedance probability, is treated at book length by Billinton and Allan [9]. The $N - 1$ criterion and its contingency lists are standard operating practice; Wood, Wollenberg and Sheblé [110] derive the feeder outage distribution factors of Proposition 15.2 and their use in contingency screening, and Guler, Gross and Liu [31] generalize them to multiple simultaneous outages. The reading of the LODF as a Sherman–Morrison update, and of a failure set as a branch of the hybrid model whose consequence is an intervention's readout, is the book's.

The $N - k$ interdiction problem, finding the k components whose loss maximizes the consequence, is studied in a probabilistic form by Sundar, Coffrin, Nagarajan and Bent [99]. Sundar, Mastin, Garcia, Bent and Watson [100] pose its stochastic form on the RTS-GMLC network: the consequence is the minimum load shed of a DC dispatch, averaged over 200 background outage scenarios of weight $1/200$ each, for $k = 1$ to 10. That benchmark has been replicated, with the findings summarized in §15.7, and the scenario distribution conditioned on evidence of fuel and storm regimes. Under fuel evidence the worst single outage moves from the generator at bus 121 to the one at bus 118, and no further linear program is solved, because only the scenario weights change. The shock model of §15.8 is Marshall and Olkin's [67]; the mixture over a shared rate is the standard exchangeable model of common-cause failure in reliability engineering, and the correlation formula (15.5) is elementary. That a shared condition shows in the tail and not in the correlation is the book's emphasis, and Figure 15.5 is its evidence.

Summary

- Four questions: risk, ranking, worst case, coverage. The $N - 1$ check is the $k = 1$ slice of the third.
- Under independent failures the prior decays geometrically in set size; coverage by depth k is the binomial tail. Seven feeders are covered by 29 sets; a hundred need 161,700 for 98 percent; five hundred cannot be enumerated.
- A failure is an intervention, its consequence a readout, and in a DC network a rank-one update: the LODF, derived and checked to 10^{-15} .
- Six buses, seven feeders, 128 sets: risk 0.165, singles carry 90 percent of it, pairs bring it to 99.6; the worst single is the heaviest feeder, the worst pair adds a region's overload. Load uncertainty doubles the probability of any consequence by threatening the base case.
- The worst k -set is a search the prior does not shorten; the rank-one consequence, the convex bound and the region structure do.
- A shared cause puts a floor under the risk that redundancy cannot lower: four units protect the room to one in two thousand against independent failures and to one in five hundred,

five times worse, against a loop failure at one in five hundred. A shared condition fattens the tail fourfold at a correlation of 0.016.

Exercises

Exercise 15.1. Derive equation (15.2) directly from the Sherman–Morrison identity applied to $\mathbf{B}'' = \mathbf{B}' - B_o \mathbf{a}_o \mathbf{a}_o^\top$, and show that the transfer argument in the proof of Proposition 15.2 and the algebraic derivation give the same factor. Identify $\text{PTDF}_{o,o}$ in terms of $\mathbf{a}_o^\top \mathbf{B}'^{-1} \mathbf{a}_o$.

Exercise 15.2. For L components at equal rate q , bound the binomial tail $\mathbb{P}(|S| > k)$ from above by a geometric series and find the smallest k for which the bound is below 10^{-6} when $L = 100$, $q = 0.01$. Compare with the exact tail in Table 15.1.

Exercise 15.3. On the six-bus distribution, add a second cross-tie from bus 6 to bus 1 with rating 1.5 and recompute the 256 failure sets. Which single outage is now the worst, does the tie's loss still de-energize region B , and how does the risk change? Explain in terms of the region message of Chapter 8.

Exercise 15.4. Give the cooled room a second chilled-water loop serving two units each, with each loop failing at 0.002. Compute the exceedance probability under the two-loop common-cause model and compare with the single loop and with independence. At what per-loop failure rate does a second loop stop being worth more than a fifth unit?

Exercise 15.5. For the weather mixture with conditions w and rates q_w , show that the probability of a set of size k under the mixture, relative to the same set under the mean rate $\bar{q}$, is at least one, with equality only when the rate does not vary, and find the ratio for $k = 3$ in the room example. (Hint: Jensen's inequality applied to $q \mapsto q^k$.)

Solutions to selected exercises

Exercise 15.1. Sherman–Morrison gives $(\mathbf{B}' - B_o \mathbf{a}_o \mathbf{a}_o^\top)^{-1} = \mathbf{B}'^{-1} + \frac{B_o \mathbf{B}'^{-1} \mathbf{a}_o \mathbf{a}_o^\top \mathbf{B}'^{-1}}{1 - B_o \mathbf{a}_o^\top \mathbf{B}'^{-1} \mathbf{a}_o}$. The post-outage angles are $\boldsymbol{\theta}' = \mathbf{B}''^{-1} \mathbf{P} = \boldsymbol{\theta} + \frac{B_o \mathbf{B}'^{-1} \mathbf{a}_o (\mathbf{a}_o^\top \boldsymbol{\theta})}{1 - B_o \mathbf{a}_o^\top \mathbf{B}'^{-1} \mathbf{a}_o}$. Now $\mathbf{a}_o^\top \boldsymbol{\theta}$ is the pre-outage angle difference across feeder o , so $B_o \mathbf{a}_o^\top \boldsymbol{\theta} = F_o$; and $\mathbf{B}'^{-1} \mathbf{a}_o$ is the angle response to a unit transfer along o , so $B_e \mathbf{a}_e^\top \mathbf{B}'^{-1} \mathbf{a}_o = \text{PTDF}_{e,o}$ for every feeder e , including $e = o$. The flow on feeder e after the outage is $B_e \mathbf{a}_e^\top \boldsymbol{\theta}' = F_e + \frac{\text{PTDF}_{e,o} F_o}{1 - \text{PTDF}_{o,o}}$, which is equation (15.2); the transfer argument's t is $F_o / (1 - \text{PTDF}_{o,o})$, the same scalar. In particular $\text{PTDF}_{o,o} = B_o \mathbf{a}_o^\top \mathbf{B}'^{-1} \mathbf{a}_o$, the fraction of a transfer along o 's ends that flows on o itself, which is one exactly when o is the only path.

Exercise 15.2. Each binomial term satisfies $\binom{L}{j+1} q^{j+1} (1-q)^{L-j-1} = \binom{L}{j} q^j (1-q)^{L-j} \cdot \frac{(L-j)q}{(j+1)(1-q)}$, and for $j \geq k$ the ratio is at most $\rho_k = \frac{(L-k)q}{(k+1)(1-q)}$, which is below one once $k+1 > (L-k)q/(1-q)$. Then the tail is bounded by the geometric series $\mathbb{P}(|S| > k) \leq \mathbb{P}(|S| = k) \frac{\rho_k}{1 - \rho_k}$. For $L = 100$, $q = 0.01$: at $k = 5$, $\mathbb{P}(|S| = 5) = 2.9 \times 10^{-3}$ and $\rho_5 = 95 \times 0.01 / (6 \times 0.99) = 0.160$, giving a bound of 5.5×10^{-4} against the exact 5.35×10^{-4} ; at

$k = 8$, $\mathbb{P}(|S| = 8) = 7.4 \times 10^{-6}$, $\rho_8 = 0.103$, bound 8.5×10^{-7} , below 10^{-6} . So $k = 8$ suffices, and the bound is within ten percent of the exact tail at every depth because the ratio is small. The $\binom{100}{8} = 1.9 \times 10^{11}$ sets of size eight are the reason enumeration to that depth is not done; the bound says how much is lost by stopping earlier.

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

The worst two to lose *combinatorial failure over a component set; consequence is not capacity; the worst pair need not contain the worst single*
`level1_building/stranded_capacity/problems/the_worst_two_to_lose`

Part V

Time, hierarchy, and scale

Chapter 16

Dynamics and temporal factors

Every balance in the book so far had its accumulation term set to zero. The heat sink did not store heat; the bus did not store power; the state was whatever the flows made it, instantly. Real systems store, and what they store changes the questions. A step in the source does not move the package's temperature at once but over minutes; a feeder that is overloaded does not fail at once but when its conductor has heated; a reading taken now is evidence about the state a minute ago and a prediction about the state a minute hence. This chapter makes the accumulation term live. It shows that integrating the resulting equations in time is a sequence of the steady solves the book already has; that the graph of a system over many time steps is the graph of one step, copied and chained, so that everything Part III said about separators applies with the stored state as the separator between past and future; that filtering, smoothing and prediction are eliminations on that chain, and the Kalman filter is the rank-one update of Chapter 11 preceded by one Schur complement; and that a cascade, the failure that Chapter 15 could not model, is a sequence of events located on a trajectory. Two worked examples carry it: the processor heat path with thermal masses, filtered and smoothed through a drifting source, and the six-bus distribution after a feeder outage, whose conductors heat until one of them trips.

16.1 The accumulation term made live

Return to the balance law of Chapter 1,

$$\frac{dX_{n,d}}{dt} = \sum_{e \in \mathcal{E}(n)} A_{n,e} P_{d,e} + G_{n,d} - L_{n,d}, \quad (16.1)$$

and keep the left side. A node that can accumulate has an extensive state X , and a *storage relation* that ties it to the node's intensive state: $E = CT$ for a thermal mass of capacity C , $M = \rho V$ for a tank, $q = C_{\text{el}}V$ for a capacitor. The unknowns now include the storage states, the rows now include the storage relations, and the balance rows at storing nodes are differential equations while every closure and every balance at a zero-storage node is algebraic. The whole is a *differential-algebraic* system,

$$\mathbf{F}(\mathbf{z}, \dot{\mathbf{z}}, t) = \mathbf{0}, \quad (16.2)$$

of index one: the algebraic rows can be solved for the algebraic variables given the differential ones, which is the well-posedness of §1.5 applied at each instant. Nothing about the graph has changed. The storage relation is one more closure, reading X and T ; the balance row reads $\dot{X}$ as

well as the flows; the factor graph of Chapter 2 gains one variable and one square per storing node.

The chain with masses. Give the package of the processor heat path a heat capacity $C_1 = 200$ joules per kelvin and the heat sink $C_2 = 5$. The two balances become

$$C_1 \dot{T}_1 = G - k(T_1 - T_2), \quad C_2 \dot{T}_2 = k(T_1 - T_2) - hA(T_2 - T_a), \quad (16.3)$$

with the closures substituted in. This is a linear system $\dot{\mathbf{T}} = \mathbf{AT} + \mathbf{b}$, and its eigenvalues say how it moves: from the script `ch16_dynamics.py` in the book's `scripts` directory, which supplies every number in the chapter, they are -0.0071 and -1.42 per second, time constants of 142 seconds and 0.7 seconds. The package responds over minutes; the heat sink, light and well coupled, follows the package within a second. The ratio of the two, about 200, is the system's *stiffness*, and it is the number that decides how the system may be integrated.

16.2 Integration as a sequence of steady solves

To advance the state from time t_n to $t_{n+1} = t_n + \Delta t$, replace the derivative in the differential rows by a difference. The simplest replacement that works for stiff systems is the backward difference,

$$\text{BDF1:} \quad X^{n+1} - X^n - \Delta t \mathcal{B}(\mathbf{z}^{n+1}) = 0, \quad (16.4)$$

where $\mathcal{B}$ is the right side of equation (16.1) evaluated at the new time. The second-order version uses two past values,

$$\text{BDF2:} \quad 3X^{n+1} - 4X^n + X^{n-1} - 2\Delta t \mathcal{B}(\mathbf{z}^{n+1}) = 0. \quad (16.5)$$

Both are *implicit*: the unknown state $\mathbf{z}^{n+1}$ appears inside $\mathcal{B}$, and each step is a nonlinear system in $\mathbf{z}^{n+1}$.

Proposition 16.1 (A time step is a steady solve). *With the storage rows rewritten as equation (16.4) or (16.5) and every algebraic row unchanged, the system to be solved at each step has the same variables, the same sparsity, and the same Jacobian pattern as the steady-state system of Chapter 1, differing only in the storage rows' entries. Simulation is a loop over the steady solver.*

Proof. The steady system has the rows: balances with $\dot{X} = 0$, closures, storage relations, boundary conditions. Equation (16.4) is the balance row with $\dot{X}$ replaced by $(X^{n+1} - X^n)/\Delta t$, which adds the known X^n to the row's constant and the coefficient $1/\Delta t$ to the row's entry on X^{n+1} ; it reads the same variables. Every other row is unchanged. So the Jacobian has the steady Jacobian's pattern with the storage-state columns of the balance rows carrying an extra $1/\Delta t$ (or $3/(2\Delta t)$ for BDF2), and Newton's method with the same assembly and factorization applies. $\square$

The proposition is worth more than its proof suggests. It means there is one model, one assembly and one derivative path for the steady solve, the transient, and, by Chapter 6's Proposition 6.2, the probabilistic estimate at each time. It also means that everything said about the steady Jacobian's sparsity and factorization carries to each step, and, as §16.3 shows, to all steps at once.

Table 16.1: Integrating the chain's step response over 600 s: maximum error against the exact solution. Explicit Euler is accurate below its stability limit of 1.41 s and diverges above it; BDF1 is stable at every step with error proportional to Δt ; BDF2's error is proportional to Δt^2 until the heat sink's fast transient limits it.

method	Δt [s]	max error in T_1 [K]	max error in T_2 [K]
explicit Euler	0.5	0.0091	0.010
	1	0.018	0.033
	2	10^{76}	10^{77}
BDF1	1	0.018	0.013
	5	0.090	0.064
	20	0.34	0.25
BDF2	1	0.0005	0.0083
	5	0.011	0.0091
	20	0.13	0.093

Why implicit. The alternative, the forward difference $X^{n+1} = X^n + \Delta t \mathcal{B}(\mathbf{z}^n)$, is explicit: the new state is computed from the old one without solving anything. It is cheaper per step and it is unusable on a stiff system. For a linear system $\dot{\mathbf{T}} = \mathbf{A}\mathbf{T}$ the explicit step multiplies each eigencomponent by $1 + \lambda\Delta t$, whose magnitude exceeds one, so that the component grows without bound, whenever $\Delta t > 2/|\lambda|$; the fastest eigenvalue sets the limit, and on the chain it is $\Delta t < 1.41$ seconds, dictated by a heat sink whose transient is over in a second and of no interest. BDF1 multiplies by $1/(1 - \lambda\Delta t)$, whose magnitude is below one for every negative λ and every Δt : it is stable at any step, and the step can be chosen for the slow dynamics one cares about. Table 16.1 shows all three on the chain's response to a step in the source from 100 to 120 watts, against the exact solution by matrix exponential.

At a twenty-second step, forty times the heat sink's time constant, BDF1 is within a third of a degree over the whole transient and BDF2 within a tenth. The explicit method at a two-second step has produced numbers of order 10^{76} . The stiff component that the implicit methods damp is the same one the explicit method amplifies, and the book's systems, with light and heavy masses coupled, are stiff as a rule.

Choosing the step. A fixed step is rarely right for a whole transient: fine when the state moves fast, coarse when it settles. The standard control accepts a step when a weighted measure of the change it produced is below one and chooses the next step from the ratio, with a safety factor and a cap on growth. The details are in the notes; what matters here is that the control acts on the same step-change measure for every variable of the graph, and that it shrinks the step wherever a fast trajectory appears, which on a stiff system is exactly where an explicit method would have failed.

16.3 The unrolled graph

Take the factor graph of one step and copy it once per step. The copies are joined by the storage rows, equation (16.4), each of which reads X at two times; every other row reads one time only. The result is the *unrolled* factor graph of the transient, Figure 16.1, and it has a structure that

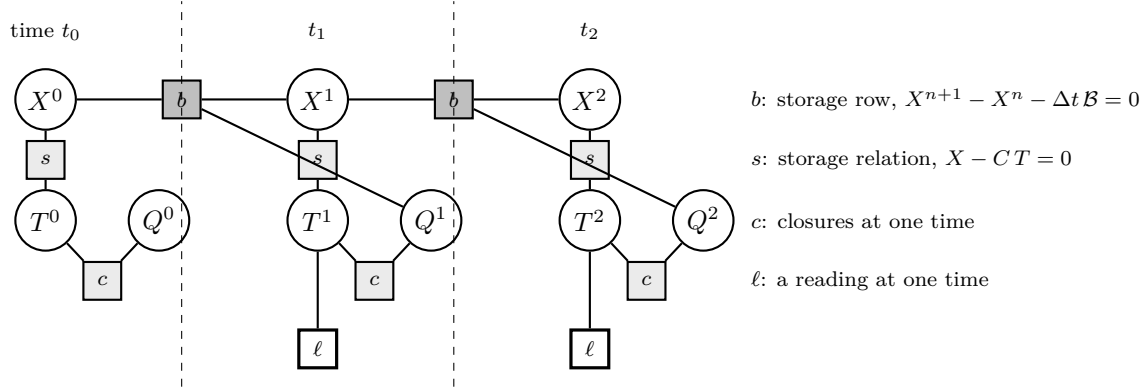


Figure 16.1: The unrolled factor graph of a storing node over three time steps, schematically. Within a step, the storage relation and the closures read variables of that step only. Only the storage rows (dark) read two times, and they read the storage state at both. The dashed cuts pass through the storage states, which are the separators between consecutive steps.

decides everything that follows.

Proposition 16.2 (The stored state separates past from future). *In the unrolled factor graph, the storage states X^n at one time form a separator between all variables at earlier times and all variables at later times. Hence, given X^n , the past and the future are conditionally independent.*

Proof. Every row of the model reads variables of one time step, except the storage rows (16.4), which read X^n , X^{n+1} and the flows and sources at t_{n+1} that enter $\mathcal{B}(\mathbf{z}^{n+1})$. So in the Markov graph, every edge joins two variables of the same step or joins X^n to a variable of step $n+1$. A path from step $m < n$ to step $p > n$ must pass through each intermediate step, and it can enter step n only through X^{n-1} 's edges to step n 's variables and leave it only through X^n 's edges to step $n+1$. Removing X^n removes every edge out of step n into the future, so no path remains, which is separation, and Proposition 5.1 gives the independence. For BDF2 the storage row reads X^{n-1} as well, and the separator is the pair (X^{n-1}, X^n) . $\square$

This is the Markov property of a dynamical system, which filtering theory takes as an axiom; here it is a consequence of the row structure, and it says which variables are the “state” in the sense that matters: the storage states, and nothing else. The temperatures, flows and sources at time n are algebraic functions of X^n and the inputs and need not be carried.

The precision is block-tridiagonal. With every row Gaussian, the unrolled model's precision has the block structure the proposition implies: a diagonal block per step, and off-diagonal blocks only between consecutive steps, from the storage rows. Ordered by time it is banded, with bandwidth equal to the number of variables in two steps. On the chain with a three-variable state over 180 steps the precision is 543×543 with bandwidth 5 and 1.4 percent of its entries nonzero, and its factorization costs what a chain's does: linear in the number of steps.

16.4 Process noise

The storage row (16.4) is a physics row and, like every physics row in Part II, it is given a width. Its width has a name in the filtering literature, *process noise*, and it means what the closure

width of Chapter 4 meant: the amount by which the model's account of how the state moves may be wrong over one step. Unmodeled disturbances, neglected dynamics, a discretization error, an input that drifts: each is a reason the state at t_{n+1} is not exactly what the row predicts from t_n , and the width is their combined size.

Process noise has a second use, and it is the one the worked example needs. An input that is not constant, a source that drifts, a load that ramps, a parameter that ages, can be modeled as a variable at every time step joined to itself at the next by a storage row of its own, $u^{n+1} - u^n = 0$, with a width: a *random walk*. The width says how far the input may move in one step; the prior on u^0 says where it starts; and the readings, through the physics, then track it. The model does not know the input's trajectory. It knows that the trajectory is continuous at a stated rate, and that is often all that is known.

16.5 Filtering, smoothing, and prediction as eliminations

On the unrolled graph, the three questions of estimation in time are three elimination orders.

Filtering asks for the state at time n given readings up to time n . Eliminate the past forward: fold step 0 into step 1, then the result into step 2, and so on, conditioning on each step's readings as it is reached. By Proposition 16.2 what is passed from step to step is a message on the storage state alone, and for a Gaussian model the message is a mean and a covariance.

Smoothing asks for the state at time n given readings up to a later time N . Eliminate forward to N as in filtering, then back-substitute: the same two sweeps as Chapter 8's tree messages, on a tree that is a chain. Equivalently, solve the whole unrolled precision at once; its banded factorization is the forward sweep and its solve is the backward one.

Prediction asks for the state at a time beyond the last reading. It is filtering with no likelihood factors after the last one: the forward messages continue, growing wider by the process noise at each step, and no reading narrows them.

Proposition 16.3 (The Kalman filter is a Schur complement and a rank-one update). *Let the state at time n have posterior $\mathcal{N}(\mu_n, \Sigma_n)$ given readings to time n , let the storage rows be linear, $\mathbf{x}^{n+1} = \mathbf{F}\mathbf{x}^n + \mathbf{c} + \mathbf{w}$ with $\mathbf{w} \sim \mathcal{N}(\mathbf{0}, \mathbf{Q})$, and let a reading $y = \mathbf{h}^\top \mathbf{x}^{n+1} + \nu$ arrive. Then the prediction is*

$$\mu_{n+1|n} = \mathbf{F}\mu_n + \mathbf{c}, \quad \Sigma_{n+1|n} = \mathbf{F}\Sigma_n\mathbf{F}^\top + \mathbf{Q}, \quad (16.6)$$

and the update is the rank-one conditioning of Proposition 11.1 applied to $(\mu_{n+1|n}, \Sigma_{n+1|n})$.

Proof. The joint of $\mathbf{x}^n$ and $\mathbf{x}^{n+1}$ before the reading is the product of the step- n posterior and the storage factor $\exp(-\frac{1}{2}(\mathbf{x}^{n+1} - \mathbf{F}\mathbf{x}^n - \mathbf{c})^\top \mathbf{Q}^{-1}(\cdot))$. Its precision, in the blocks $(\mathbf{x}^n, \mathbf{x}^{n+1})$, is

$$\begin{pmatrix} \Sigma_n^{-1} + \mathbf{F}^\top \mathbf{Q}^{-1} \mathbf{F} & -\mathbf{F}^\top \mathbf{Q}^{-1} \\ -\mathbf{Q}^{-1} \mathbf{F} & \mathbf{Q}^{-1} \end{pmatrix}. \quad (16.7)$$

Eliminating $\mathbf{x}^n$ is the Schur complement of the first block, equation (6.8): the precision on $\mathbf{x}^{n+1}$ becomes $\mathbf{Q}^{-1} - \mathbf{Q}^{-1} \mathbf{F}(\Sigma_n^{-1} + \mathbf{F}^\top \mathbf{Q}^{-1} \mathbf{F})^{-1} \mathbf{F}^\top \mathbf{Q}^{-1}$, which by the Woodbury identity is $(\mathbf{Q} + \mathbf{F}\Sigma_n\mathbf{F}^\top)^{-1}$; inverting gives $\Sigma_{n+1|n}$, and the information vector gives the mean. The reading is then one linear row on $\mathbf{x}^{n+1}$, and Proposition 11.1 conditions on it. $\square$

The filter is thus nothing the book had not already built: a region message from the past onto the state, then a reading folded in. The smoother's backward pass is Chapter 8's equation (8.6),

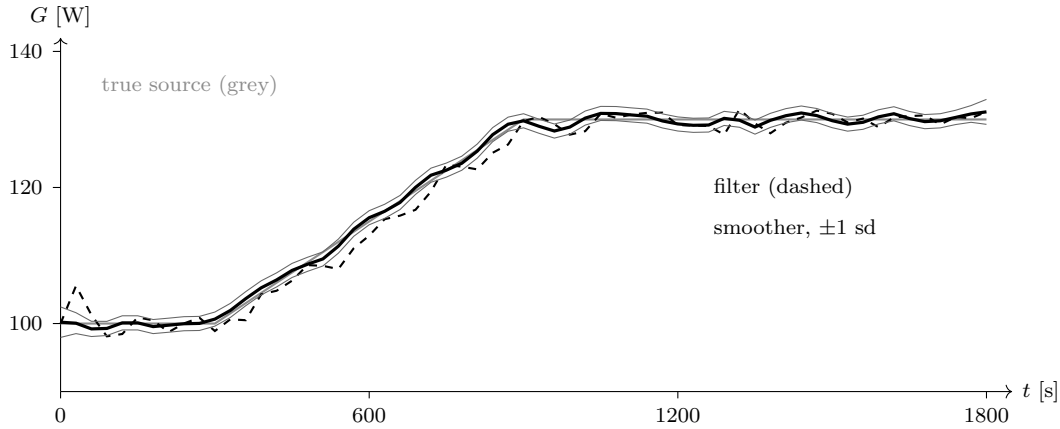


Figure 16.2: The source: true trajectory (grey), the filter’s estimate (dashed), and the smoother’s estimate with its one-standard-deviation band (black). The filter lags the ramp and catches up when it ends; the smoother, seeing the later readings, follows the ramp.

region by region along the chain. The literature has names for each, Kalman for the forward pass and Rauch, Tung and Striebel for the backward, and they are the sum-product messages of Chapter 8 on a chain of storage states.

Principle 16.1. *Time unrolls the graph into a chain whose separators are the stored states. Filtering is forward elimination, smoothing is forward then backward, prediction is forward without readings, and the Kalman filter is one Schur complement and one rank-one update per step.*

16.6 Worked example: tracking a drifting source

Take the chain with its masses, a processor whose power ramps with its workload from 100 to 130 watts between 300 and 900 seconds and then holds, and a thermometer on the heat sink reading every 10 seconds with accuracy 0.3 kelvin. The model does not know the ramp. It carries the source as a random walk with a width of one watt per step and starts it at 100 ± 20 . The state is (T_1, T_2, G) ; the transition is the BDF1 step with the source held at its new value across the step; the horizon is 1800 seconds, 180 steps.

Filter against smoother. Figure 16.2 draws the source’s true trajectory against the filter’s estimate and the smoother’s. Table 16.2 gives the errors. The filter tracks the source to 1.5 watts root-mean-square and the package temperature to 0.24 kelvin, from a thermometer on the heat sink that never reads either. The smoother halves both errors, to 0.65 watts and 0.13 kelvin, and halves the reported spread of the source mid-window, from 1.83 to 1.04 watts: it has the future readings, which the filter did not, and the future of a slowly moving source is evidence about its present. The filter lags the ramp, as a random-walk prior must when the truth moves in one direction; its standardized innovations, which should average zero, average +0.51 during the ramp and +0.02 after it. That drift in the innovations is the test of Chapter 12 running in time, and it is how a filter says that its model of the input’s motion is too slow.

Table 16.2: Tracking the drifting source: errors of the filter and the smoother over the settled window, and the reported spread of the source at mid-window. The batch solve of the unrolled precision agrees with the smoother to 10^{-9} .

	filter	smoother
rms error of G [W]	1.49	0.65
rms error of T_1 [K]	0.24	0.13
reported sd of G at 900 s [W]	1.83	1.04

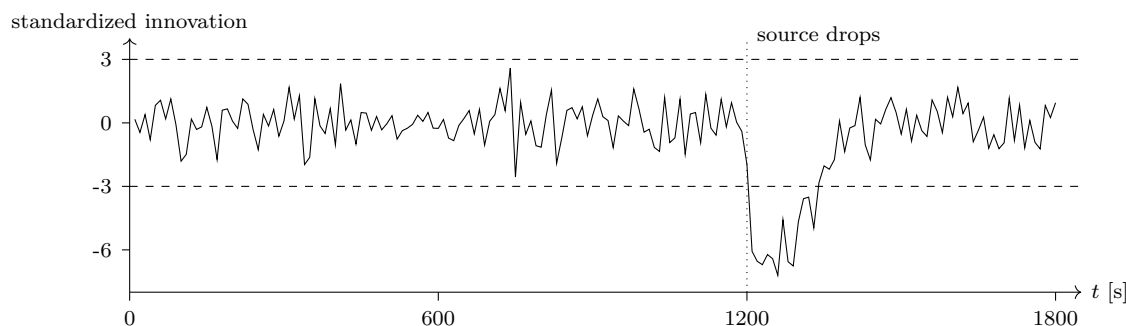


Figure 16.3: Standardized innovations of the filter on the chain when the source drops from 100 to 75 watts at 1200 seconds and the model carries the source as a slow random walk. Before the fault the sequence is white within ± 3 ; the first reading after it is six spreads below its prediction, and the sequence stays there until the filter has moved the source.

The batch check. The script also solves the whole unrolled precision, 543 variables, banded, in one factorization, and compares the result with the smoother’s backward pass. They agree to 10^{-9} . The smoother and the batch posterior are the same object, computed by the same elimination in a different bookkeeping, which is what Proposition 16.3 and Chapter 8 said.

16.7 Detecting a change in time

The innovation of Chapter 11 was a single number per reading. In time it is a sequence, and the sequence is the most useful diagnostic a running model has. Under an adequate model the standardized innovations are independent standard Gaussians: mean zero, spread one, no memory. Anything the model does not know shows up as a departure from that, and the departure has a shape that says what kind of thing it was. A ramp the model is too slow to follow gives a sustained bias, as §16.6 showed; a bad reading gives one outlier; a sudden change in the system gives a jump that persists until the model has caught up.

Run the chain’s filter again with the source held at 100 watts and its random-walk width lowered to 0.3 watts per step, and at 1200 seconds let the source drop abruptly to 75: a partial failure of the processor. Figure 16.3 draws the standardized innovations. Before the fault they have mean 0.00, spread 0.93, and never exceed 2.6 in magnitude over 117 readings. The first reading after the drop, ten seconds later, is 6.1 spreads below what the filter predicted; the next five are 6.5, 6.7, 6.2, 6.4 and 7.2. The alarm fires on the first reading after the fault. The filter, whose prior on the source’s motion is slow, takes 130 seconds to bring its estimate within

three watts of the new level, and its estimate is 81 watts at 1300 seconds and 74.5 at 1500; the innovations return to white as it arrives. The lag is the price of the narrow random walk, and it is the trade the operator makes: a wide walk tracks changes quickly and calls noise a change, a narrow one filters noise and calls a change an anomaly for as long as it takes to believe it. The alarm is right either way; what the width sets is whether the estimate follows the alarm at once or after a decent interval.

Two things distinguish this from a threshold on the thermometer. The threshold would fire when the heat sink had cooled by some fixed amount, minutes after the drop, since the heat sink follows the package's slow transient; the innovation fires on the first reading, because the filter predicted where the heat sink should be and the heat sink was not there. And the threshold says the heat sink is cold; the innovation, through the model, says the source has fallen, which is the thing that failed.

Principle 16.2. *A running model's innovations are its diagnostic in time: white when the model is adequate, biased when it is too slow, spiked when something changed. The alarm fires when the prediction fails, not when the state has drifted far enough to notice.*

16.8 Two hypotheses the steady state cannot separate

The alarm says something changed. Chapter 12 said what to do next: name the candidates, give each a latent variable with a zero-centered prior, and let the evidence choose. Two candidates explain a sudden fall in the heat sink's readings. The source may have dropped, by an amount a ; or the thermometer's bias may have jumped, by an amount b . Each is the running model with one more state, born at the step of the alarm with a prior of thirty units, watts or kelvins, on its amplitude: under the first, the jump enters the storage row of the source exactly as a process-noise step does; under the second, it enters the likelihood row of the thermometer as an offset.

In steady state the two are the same hypothesis. A source drop of 25 watts lowers the heat sink's steady reading by 12.3 kelvins, and a thermometer bias of -12.3 kelvins lowers it by the same, and no number of steady readings tells them apart. Chapter 12 met this in Table 12.4, where a leak and a sensor bias were separated only by their priors. In time they are different hypotheses. A bias moves the reading at once and holds it; a source drop moves the package over its time constant of 142 seconds, and the heat sink follows the package. The shapes differ, and the evidence weighs shapes.

The evidence of a model in time factors along the chain. Write the joint density of the readings as a product of conditionals, $p(y_1, \dots, y_N) = \prod_n p(y_n | y_1, \dots, y_{n-1})$; each factor is the reading's predictive density under the filter, which for the linear-Gaussian model is $\mathcal{N}(e_n; 0, s_n)$ with e_n the innovation and s_n its variance. Hence

$$\log Z = \sum_{n=1}^N \log \mathcal{N}(e_n; 0, s_n) = -\frac{1}{2} \sum_n \left(\log 2\pi s_n + \frac{e_n^2}{s_n} \right), \quad (16.8)$$

which is equation (12.1) computed one reading at a time. The Occam factor is there too: a hypothesis whose extra state is wide inflates s_n at the reading where the state is born, and pays $\frac{1}{2} \log s_n$ for the room it gave itself. The log Bayes factor between two hypotheses is the difference of two such sums, and it can be watched growing reading by reading.

Table 16.3: Log Bayes factor for the true hypothesis against the other, accumulated over the k readings after the alarm, for a source drop of 25 watts and for a thermometer bias of the same steady effect, -12.3 kelvins. Amplitude priors of thirty units on both.

k readings after the alarm	1	2	3	5	10	20	30	60
truth: source drop, log (source : bias)	1.3	0.5	0.6	5.8	72	128	129	129
truth: bias jump, log (bias : source)	73	189	314	568	1055	1386	1404	1404

Table 16.3 gives the result for both truths. When the source has dropped, the first reading barely separates the hypotheses: a fall of one reading is a fall, and either explains it, the source hypothesis ahead by a single nat for having predicted a smaller one. Over the next readings the heat sink keeps falling, as a package cooling through its time constant does and as a stuck bias does not, and the evidence accumulates at eight nats a reading: seventy-two after ten readings, 128 after twenty. Then it stops. By the thirtieth reading the package has reached its new steady state, both hypotheses predict the same reading, and the readings from the thirty-first to the sixtieth add less than a hundredth of a nat between them. Ninety percent of the evidence arrives in the first 150 seconds, which is the time constant. The source hypothesis ends with a jump estimate of -24.5 ± 1.2 watts and a source of 74.5; the bias hypothesis, to fit the falling readings, has had to move its random-walk source as well, and ends with a bias of -2.7 kelvins and a source of 79.9, a compromise that fits the steady state and lost the transient.

When the truth is a bias, the asymmetry shows. A bias of twelve kelvins moves the reading by forty spreads at once, and a source drop cannot do that: through the package's storage, a step of the source moves the heat sink by three hundredths of a kelvin per watt in the first ten seconds. The first reading alone is seventy nats against the source, and the transient it fails to produce adds the rest.

Two lessons. The distinction between a fault in the physics and a fault in the sensing, which Chapter 12 had to buy with a prior, is bought here with time: the storage rows give each hypothesis a shape, and the shapes are not the same. And the window in which they differ is the system's own time constant. An operator who waits for the new steady state before asking which hypothesis holds has waited past the only readings that could answer.

Principle 16.3. *Hypotheses that the steady state cannot separate are separated by the transient, because storage gives each a shape in time. The evidence factors along the chain, one innovation density per reading, and it accumulates only while the shapes differ: for as long as the time constant, and no longer.*

16.9 Events and cascades

A transient rarely runs to its end undisturbed. A temperature crosses a limit and a breaker opens; a tank empties and a pump stops; a valve saturates and a regime changes. Each is an *event*: a scalar indicator $\psi(\mathbf{z}, t)$ crosses zero, and at the crossing the model changes, by an intervention in the sense of Chapter 13, a closure replaced or a component removed. Locating the crossing is part of the integration: after each accepted step the indicator is checked for a sign change, the crossing is found by bisection on the interpolated state, and the handler applies the change and the integration continues on the new model.

A *cascade* is a sequence of events each caused by the last. A feeder trips; the flows redistribute; another feeder, now overloaded, heats; it trips in its turn. Chapter 15 treated failure sets as instantaneous and their consequences as steady states, and could not say which set a cascade would produce or how long it would take. With dynamics it can. The failure set grows one event at a time along the trajectory, and the operator's question changes from "what could fail" to "how long do I have".

16.10 Worked example: the conductors of the six-bus distribution

The conductor of a busway or a feeder cable heats by its current and cools to the air around it, and its temperature, not its current, is what limits it. Let each feeder's conductor obey

$$C \frac{dT_\ell}{dt} = R F_\ell^2 - h (T_\ell - T_{\text{amb}}), \quad (16.9)$$

with F_ℓ the feeder's flow, $T_{\text{amb}} = 30$ degrees, a limit $T_{\text{max}} = 90$ degrees, and a time constant $\tau = C/h$ of 600 seconds. Choose R so that a feeder carrying exactly its rating settles at the limit; then the steady conductor temperature at any flow is

$$T_\infty(F_\ell) = T_{\text{amb}} + (T_{\text{max}} - T_{\text{amb}}) \left(\frac{F_\ell}{F_\ell^{\text{rating}}} \right)^2, \quad (16.10)$$

and the rating of Chapter 15 is the current at which the steady temperature is the limit. A feeder above its rating does not fail; it heats toward a steady temperature above the limit, and fails when it gets there.

Proposition 16.4 (Time to the limit). *If a feeder's flow steps to a constant F_ℓ at $t = 0$ from a conductor temperature $T_0 < T_{\text{max}}$, and $T_\infty(F_\ell) > T_{\text{max}}$, the conductor reaches the limit at*

$$t_{\text{trip}} = \tau \ln \frac{T_\infty - T_0}{T_\infty - T_{\text{max}}}. \quad (16.11)$$

Proof. Equation (16.9) with constant F_ℓ is linear with solution $T_\ell(t) = T_\infty - (T_\infty - T_0) e^{-t/\tau}$; set $T_\ell = T_{\text{max}}$ and solve for t . The argument of the logarithm exceeds one exactly when $T_\infty > T_{\text{max}} > T_0$. $\square$

The cascade. At $t = 0$ feeder 1–3 of the six-bus distribution trips. Chapter 15 found the immediate consequence: feeder 1–2 carries 4.1 against a rating of 2.5, and feeder 2–3 carries 2.9 against 1.0. Both conductors begin to heat. Their steady temperatures under the new flows are 191 and 535 degrees; feeder 2–3, three times over its rating, is heading for the limit far faster than feeder 1–2, and by equation (16.11) it reaches 90 degrees at $t = 52.6$ seconds, while feeder 1–2 would have needed 156. At 52.6 seconds feeder 2–3 trips. The script re-solves the flows: with feeders 1–3 and 2–3 both gone, bus 3 is reached from bus 1 by no path at all, and with it buses 4, 5 and 6; four buses are de-energized and 2.9 per unit of load is shed, a third of the network. Feeder 1–2, now serving bus 2 alone, drops to 1.2 and cools. No further conductor heads for its limit. The cascade is two events long and it has ended worse than either alone: the $N - 1$ consequence of the first outage was an overload of 3.5, and the cascade it started shed 2.9 of load and left the overload gone.

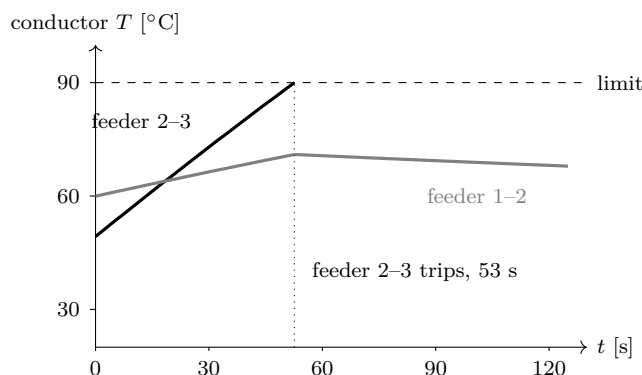


Figure 16.4: Conductor temperatures of feeders 2–3 (black) and 1–2 (grey) after the outage of feeder 1–3 at $t = 0$. Feeder 2–3 reaches its limit at 52.6 seconds and trips, de-energizing four buses; feeder 1–2, relieved, cools toward a new steady value. The operator’s window is the 52.6 seconds.

Figure 16.4 draws the two conductor temperatures. The operator’s window is the 52.6 seconds between the first trip and the second: cap bus 2 or bus 3 within it, by the branch machinery of Chapter 13, and feeder 2–3 never reaches its limit. A steady-state analysis says feeder 2–3 is overloaded; the dynamic one says by how long.

How long, with error bars. The cooling coefficient h depends on wind and on the conductor’s condition, and it is not known to better than thirty percent. Draw it from a log-normal with that spread, rerun the cascade for each draw, and the time to the first trip has a distribution: a median of 52 seconds, a fifth percentile of 32, a ninety-fifth of 86, and an 18 percent chance that the window is shorter than 40 seconds. That is the honest form of “how long do I have”: a time with a tail, and the tail is what the operator plans against.

Principle 16.4. *A cascade is a sequence of events located on a trajectory, each an intervention caused by the last. The steady state says what is overloaded; the dynamics say how long until it fails, and the uncertainty in the dynamics says how much of that time can be counted on.*

The window as a decision. The window is worth something only if an action inside it changes the outcome, and the branch machinery of Chapter 13 says which action does. Suppose the operator acts at 30 seconds, when feeder 2–3’s conductor is at 73 degrees and still 17 short of its limit. The obvious action, capping bus 2, whose feeder 1–2 is also overloaded, does nothing for feeder 2–3: with feeder 1–3 gone, feeder 2–3 carries the load of bus 3 and of region B beyond it, 2.9 per unit in all, and bus 2’s load flows in on feeder 1–2 and stops there. Capping 0.8 at bus 2 leaves feeder 2–3 at 2.9. The graph says where the flow comes from, and the action must be taken downstream of the feeder it is meant to relieve.

Cap the downstream load instead, bus 3 and region B pro rata, and Table 16.4 gives the result. Half a unit buys twelve seconds; a full unit buys thirty-nine; one and a half buys more than two minutes; and 1.9, which brings feeder 2–3 to exactly its rating, stops the conductor at the limit and holds it there. Below 1.9 the trip is delayed, not prevented, and every delay is time

Table 16.4: Capping the load downstream of feeder 2–3 at 30 seconds after the outage of feeder 1–3: the flow on feeder 2–3, its conductor’s steady temperature, and the resulting trip time. Capping bus 2, which is upstream, changes nothing.

capping [p.u.]	F_{23}	steady T_{23} [°C]	trip
0.8 at bus 2	2.90	535	at 53 s, unchanged
0.5 downstream	2.40	376	at 65 s (+12)
1.0 downstream	1.90	247	at 92 s (+39)
1.5 downstream	1.40	148	at 186 s (+133)
1.9 downstream	1.00	90	none; holds at the limit
2.0 downstream	0.90	79	none; cools to 79

in which a further action, a load move or a repair, can be taken. The cascade that would have shed all 2.9 of the downstream load is prevented by capping 1.9 of it, and the operator has 52 seconds, or with the cooling coefficient uncertain some 32, to do so.

16.11 In practice

Integrate implicitly, step for the slow dynamics. The systems of this book couple light components to heavy ones and are stiff by construction. An implicit method with a step chosen for the dynamics of interest is the default; an explicit method is right only when the fastest time constant is the one of interest, which is rare. Let the step control shrink the step at events and transients and grow it when the state settles.

Carry the storage states; recover the rest. The filter’s state is the set of storage states and the random-walk inputs, and nothing else, by Proposition 16.2. Temperatures at zero-storage nodes and every flow are algebraic functions of the state and are recovered by a solve when asked for. Carrying them in the state is a common mistake and it makes the covariance larger and singular.

Set the process noise from the physics, then check it. The width of a storage row is the model’s error over one step; the width of a random walk is how far the input may move in one step. Both are physical statements and should be set as such, then checked by the innovations: a filter whose standardized innovations drift, as in §16.6 during the ramp, has too little process noise on the input that is moving; one whose innovations are too small has too much and is tracking noise.

Smooth when you can, filter when you must. Operation in real time filters; every analysis after the fact should smooth, since the smoother has the same cost and less error. A common mistake is to report filtered estimates of a past state when the later readings were available.

Locate events; do not step over them. An integrator that steps past a limit crossing and applies the change at the end of the step has mis-timed the event by up to a step, and in a cascade the timing is the answer. Locate the crossing by bisection, apply the change there, and restart the step.

Report a window, not a time. The time to a trip depends on quantities, wind and ambient among them, that are not known precisely. Report the window as a distribution, and plan against its short tail.

16.12 What is missing

Every model in this chapter was one system. The unrolled graph is a chain of copies of it, and the chapter organized computation along the chain. Chapter 17 organizes it across the other direction, the regions of Chapter 8 arranged in a tree of subsystems, and asks what it means for a region to be summarized to its parent when both have dynamics; and Chapter 18 asks how to cut a large system into such regions, with the measurements that Chapter 5 and Chapter 9 promised.

Notes and further reading

Differential-algebraic systems, their index, and the backward differentiation formulas for stiff problems are treated by Brennan, Campbell and Petzold [13] and by Hairer and Wanner [35], who also give the stability analysis behind Table 16.1; the step-change controller mentioned in §16.2 follows the PI design of Gustafsson, Lundh and Söderlind [32]. That a BDF step is the steady system with its storage rows rewritten, so that simulation is a loop over one solver, is the book's framing of a standard fact.

The Kalman filter is Kalman's [42] and the fixed-interval smoother is Rauch, Tung and Striebel's [84]; Särkkä and Svensson [91] present both as Gaussian inference on a chain, which is the view of §16.5, and treat process noise, random-walk models and innovation diagnostics. The derivation of the predict step as a Schur complement and of the update as the rank-one conditioning of Chapter 11 is the book's, and it is the reason the filter needed no new machinery.

The conductor model of §16.10 is a linearized lumped form of the IEEE standard for the current-temperature relationship of overhead conductors [38]. In the standard, convective cooling, the larger of a wind-driven and a natural term, grows as a power of the temperature rise, radiative cooling as the fourth power of absolute temperature, and solar heating enters as a source; equation (16.9) keeps the storage and replaces the losses by one linear term. Dynamic rating is the practice of rating a conductor from the conditions it actually sees rather than by a fixed nameplate current. A rating computed that way inherits the uncertainty of those conditions, and because a run is limited by its hottest section — for a busway, wherever it passes through the warmest part of its route — the rating is a quantile of a minimum over correlated sections; a temperature sensor on the run then has a value in the sense of Chapter 11, computable before the sensor is installed. Cascading failure in power networks has a large literature; the event-driven view of §16.9, in which each trip is an intervention on the model that the next integration starts from, is how the reference implementation of Appendix C handles it.

Summary

- With storage, the model is an index-one differential-algebraic system; the graph gains one variable and one square per storing node.

- A BDF step is the steady system with its storage rows rewritten: same variables, same sparsity, same solver. Implicit methods are stable at any step; the explicit method fails above $2/|\lambda_{\max}|$, 1.41 seconds on the chain, and is accurate to 10^{76} degrees at two.
- The unrolled graph is a chain; the storage states separate past from future; the precision is block-tridiagonal and factors in linear time.
- Process noise is the storage row's width; a random walk on an input tracks its drift.
- Filtering, smoothing and prediction are elimination orders on the chain. The Kalman predict step is a Schur complement and the update is a rank-one conditioning. On the chain the smoother halves the filter's errors and the batch solve agrees with it to 10^{-9} .
- The innovations in time are the model's diagnostic: white when it is adequate, biased when it lags, spiked when the system changed. A source drop of a quarter is six spreads on the first reading after it.
- A source drop and a sensor bias with the same steady effect are one hypothesis in steady state and two in time; the evidence, one innovation density per reading, separates them by 128 nats within the time constant and not at all after it.
- A cascade is events on a trajectory. After the loss of feeder 1–3, feeder 2–3's conductor reaches its limit in 52.6 seconds and its trip de-energizes four buses; with the cooling coefficient uncertain by thirty percent the window is 52 seconds with a fifth percentile of 32.
- The window is a decision when an action inside it changes the outcome. Capping upstream of the overloaded feeder does nothing; capping 1.9 of the 2.9 per unit downstream holds the conductor at its limit and prevents the cascade that would shed all 2.9.

Exercises

Exercise 16.1. Derive the BDF2 formula (16.5) by fitting a quadratic through X^{n-1} , X^n and X^{n+1} at equal spacing and requiring its derivative at t_{n+1} to equal $\mathcal{B}(\mathbf{z}^{n+1})$. Show that on $\dot{X} = \lambda X$ the method's amplification factor has magnitude below one for every $\lambda < 0$ and every Δt .

Exercise 16.2. Complete the proof of Proposition 16.3: show that the Schur complement of the joint precision onto $\mathbf{x}^{n+1}$ equals $(\mathbf{Q} + \mathbf{F}\Sigma_n\mathbf{F}^\top)^{-1}$ by the Woodbury identity, and derive the predicted mean $\mathbf{F}\boldsymbol{\mu}_n + \mathbf{c}$ from the information vector.

Exercise 16.3. Rerun the tracking example with the random-walk width raised to 3 watts per step and lowered to 0.3. Report the filter's error and the mean standardized innovation during the ramp for each, and explain the trade-off between lag and noise that the width controls.

Exercise 16.4. In the cascade, suppose the operator, instead of capping, opens the cross-tie 3–4 deliberately at $t = 30$ seconds, de-energizing region B on purpose. Recompute the flow on feeder 2–3, its conductor's trajectory from its value at 30 seconds, and whether it still trips. Compare the load shed by this action with the 1.9 per unit of Table 16.4 and with the 2.9 the cascade sheds, and say which the operator should prefer.

Exercise 16.5. Give the conductor of feeder 2–3 a thermometer reading every 10 seconds with accuracy 2 degrees, and build the filter for its temperature with h as a random-walk parameter. Show that after three readings the filter's predicted time to the limit has a spread narrower than the 32-to-86-second window of §16.10, and say why a direct temperature reading is worth more here than a flow meter.

Solutions to selected exercises

Exercise 16.1. Put $t_{n+1} = 0$ and let the quadratic through $(-2\Delta t, X^{n-1})$, $(-\Delta t, X^n)$, $(0, X^{n+1})$ be $p(s) = X^{n+1} + as + bs^2$. Then $X^n = X^{n+1} - a\Delta t + b\Delta t^2$ and $X^{n-1} = X^{n+1} - 2a\Delta t + 4b\Delta t^2$. Subtracting twice the first from the second gives $X^{n-1} - 2X^n = -X^{n+1} + 2b\Delta t^2$, so $b = (X^{n+1} - 2X^n + X^{n-1})/(2\Delta t^2)$, and then $a = (X^{n+1} - X^n)/\Delta t + b\Delta t = (3X^{n+1} - 4X^n + X^{n-1})/(2\Delta t)$. The derivative at $s = 0$ is a , and setting $a = \mathcal{B}(\mathbf{z}^{n+1})$ gives $3X^{n+1} - 4X^n + X^{n-1} = 2\Delta t \mathcal{B}(\mathbf{z}^{n+1})$, which is equation (16.5). On $\dot{X} = \lambda X$ with $z = \lambda\Delta t$ the recurrence is $(3-2z)X^{n+1} = 4X^n - X^{n-1}$, whose characteristic roots satisfy $(3-2z)r^2 - 4r + 1 = 0$; for $z < 0$ the product of the roots is $1/(3-2z) < 1/3$ and their sum is $4/(3-2z) < 4/3$, and one checks that both roots lie inside the unit disk for every $z < 0$, with the larger root $\rightarrow 1$ as $z \rightarrow 0^-$ and both roots $\rightarrow 0$ as $z \rightarrow -\infty$: the method damps every stable mode at every step, and damps the stiffest modes most.

Exercise 16.2. Write $\mathbf{S} = \Sigma_n^{-1} + \mathbf{F}^\top \mathbf{Q}^{-1} \mathbf{F}$. The Schur complement is $\mathbf{Q}^{-1} - \mathbf{Q}^{-1} \mathbf{F} \mathbf{S}^{-1} \mathbf{F}^\top \mathbf{Q}^{-1}$. The Woodbury identity states $(\mathbf{Q} + \mathbf{F} \Sigma_n \mathbf{F}^\top)^{-1} = \mathbf{Q}^{-1} - \mathbf{Q}^{-1} \mathbf{F} (\Sigma_n^{-1} + \mathbf{F}^\top \mathbf{Q}^{-1} \mathbf{F})^{-1} \mathbf{F}^\top \mathbf{Q}^{-1}$, which is the same expression, so the predicted precision is $(\mathbf{Q} + \mathbf{F} \Sigma_n \mathbf{F}^\top)^{-1}$ and the predicted covariance is $\mathbf{F} \Sigma_n \mathbf{F}^\top + \mathbf{Q}$. For the mean, the joint information vector has blocks $\Sigma_n^{-1} \boldsymbol{\mu}_n - \mathbf{F}^\top \mathbf{Q}^{-1} \mathbf{c}$ on $\mathbf{x}^n$ and $\mathbf{Q}^{-1} \mathbf{c}$ on $\mathbf{x}^{n+1}$; the Schur-complement information vector is $\mathbf{Q}^{-1} \mathbf{c} + \mathbf{Q}^{-1} \mathbf{F} \mathbf{S}^{-1} (\Sigma_n^{-1} \boldsymbol{\mu}_n - \mathbf{F}^\top \mathbf{Q}^{-1} \mathbf{c})$. Multiplying by the predicted covariance and simplifying with $\mathbf{S}^{-1} \Sigma_n^{-1} = \mathbf{I} - \mathbf{S}^{-1} \mathbf{F}^\top \mathbf{Q}^{-1} \mathbf{F}$ gives $\mathbf{F} \boldsymbol{\mu}_n + \mathbf{c}$; the reader who does not want the algebra can verify it on the scalar case, where every matrix is a number and the identity is one feeder.

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

How long before the limit *a first-order thermal transient; the steady value decides whether the limit is reached at all; time to a limit is a logarithm of two differences*

`level3_row_pod/escalating_heatwave/problems/how_long_before_the_limit`

Chapter 17

Hierarchy as physical decomposition

Every engineered system of any size is described at several levels at once. A machine room is a room to the building, a set of rows to the room's cooling plant, a set of racks to each row, and a set of servers to each rack; a rack row is one load to the facility's distribution and a tree of loads to itself; a chemical plant is units to the site and vessels to each unit. The levels are not a convenience of drawing. Each is a boundary-exchanging system in the sense of Chapter 1, with its own balance rows and closures and its own ports, and the levels nest because the cuts nest: the boundary of a rack lies inside the boundary of its row, which lies inside the boundary of the room.

Chapter 8 showed what one cut buys. A region's factors, eliminated onto its ports, are the region as its neighbors see it, exactly. This chapter applies that statement to nested cuts, and finds that it needs nothing new. The same conservation law that makes the flows across a cut exact makes a region's balance the sum of its parts' balances, so that a parent's model of a child is the child's message, and a grandparent's model of the child is the child's message passed through the parent's. Schur complements compose, so the hierarchy of regions is a junction tree whose messages are computed level by level and reused across levels. And the cut that organizes the model organizes control and scale as well: a setpoint is imposed at a port, a child meets it inside, and the cost of a local change is the cost of one path from leaf to root.

17.1 One conservation law used twice

Take a region S of a physical graph: a set of nodes, the edges among them, and the sources at them. Chapter 1's Proposition 1.1 said that in steady state the net flow across the boundary of S equals the net source inside S . Write it as an equation among the residual rows. The balance at node n is

$$r_n = \sum_{e \ni n} \pm F_e - q_n = 0, \quad (17.1)$$

with the sign by the edge's orientation at n . Sum the rows over $n \in S$. Every edge with both ends in S appears twice with opposite signs and cancels; every edge with one end in S appears once. Hence

$$\sum_{n \in S} r_n = \sum_{e \in \partial S} \pm F_e - \sum_{n \in S} q_n, \quad (17.2)$$

which is the balance row of S regarded as a single node with the cut edges as its edges and the total source as its source. This is the whole content of the proposition, and it has a consequence

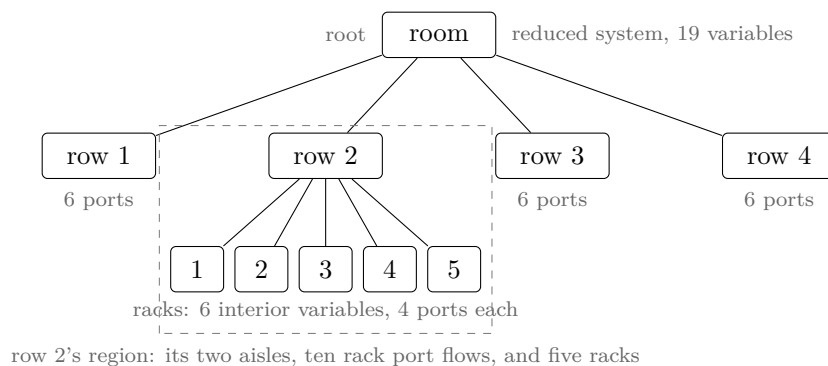


Figure 17.1: The machine room's hierarchy of regions. Each rack eliminates six interior variables onto four ports; each row eliminates its own twelve (two aisle temperatures and the ten rack port flows) onto six; the room solves the reduced system of nineteen. Every edge of the tree is a cut of the physical graph, and the ports of a cut are the message that crosses it.

for modeling that is easy to pass over.

Proposition 17.1 (Aggregation). *Let a region S be replaced, in the parent's model, by one node whose edges are the cut edges of S and whose source is $\sum_{n \in S} q_n$. The parent's balance row at that node is the sum of the region's balance rows. It is exact, and it reads only the cut flows and the total source.*

The proposition is the license for every meter that reads a total. A row's power meter reads the row's total heat; the facility's meter at a distribution unit reads the row's total load; a building's utility meter reads the sum of everything inside. None of these instruments knows the inside, and none needs to: equation (17.2) says that the total source is a function of the cut flows alone, so a factor on the total is a factor on the ports. A meter on the row's heat is, to the room, a factor on the row's port flows; the room can use it without a model of the row. Where the meter is placed in the hierarchy is therefore a choice, and Section 17.4 shows the two placements agree to the physics width.

What the proposition does not license is as important, and Chapter 1 said it: the intensive states do not aggregate. The region-as-node has one balance row and no temperature. If the parent's model gives it a temperature, that temperature is a modeling assumption, not a consequence of conservation, and Section 17.3 shows what the assumption costs. The exact object that replaces the region is not a node with a potential but the region's message, which carries as many potentials as the region has ports.

17.2 Nested messages

Proposition 8.2 eliminated one region's interior onto its ports. In a hierarchy the interior of a row contains the interiors of its racks, and there are two ways to eliminate it: all at once, or rack by rack and then the rest. The two agree, because the Schur complement has a composition property that is the algebraic form of nested cuts.

Proposition 17.2 (Schur complements compose). *Let $\mathbf{A}$ be a precision on variables partitioned as $I_1 \cup I_2 \cup S$, with I_1 and I_2 disjoint. Eliminating I_1 first and then I_2 from the result gives the*

same precision on S as eliminating $I_1 \cup I_2$ at once:

$$(\mathbf{\Lambda}/\mathbf{\Lambda}_{I_1 I_1})/(\mathbf{\Lambda}/\mathbf{\Lambda}_{I_1 I_1})_{I_2 I_2} = \mathbf{\Lambda}/\mathbf{\Lambda}_{II}, \quad I = I_1 \cup I_2, \quad (17.3)$$

where $\mathbf{\Lambda}/\mathbf{\Lambda}_{AA}$ denotes the Schur complement of the block A . The same holds for the information vector.

Proof. Both sides are the precision of the marginal on S of the Gaussian with precision $\mathbf{\Lambda}$. The left integrates out I_1 and then I_2 ; the right integrates out both together. Marginalization is one integral whatever the order in which its variables are grouped, so the two marginals are the same Gaussian and have the same precision and information. In matrix terms the identity is the quotient formula for Schur complements, and it can be verified by block elimination: eliminating I_1 leaves a bordered system on $I_2 \cup S$ whose I_2 block is $\mathbf{\Lambda}_{I_2 I_2} - \mathbf{\Lambda}_{I_2 I_1} \mathbf{\Lambda}_{I_1 I_1}^{-1} \mathbf{\Lambda}_{I_1 I_2}$, and eliminating that block reproduces the 2×2 block inverse of $\mathbf{\Lambda}_{II}$ term by term. $\square$

The proposition is why a hierarchy needs no new machinery. Take the room. Each rack's factors read its interior and its four ports; its message is a 4×4 precision and a 4-vector on those ports, computed by equation (8.5). The row's factors read the row's aisles, the rack port flows, and the row's own ports. Add the five rack messages to the row's precision, and the row's interior at this level is twelve variables, its aisles and the ten rack port flows, with the rack interiors already gone. Eliminate the twelve onto the row's six ports. By Proposition 17.2 the result is the message the row would have sent had its forty-two variables been eliminated at once, and it was computed with five 6×6 solves and one 12×12 solve instead of one 42×42 . Add the four row messages to the room's factors and solve the reduced system on the nineteen variables the room reads. Then back-substitute downward: Proposition 8.3 gives each row's interior from its ports, and, applied again with the row's interior as the rack's ports, each rack's interior from the row's. Figure 17.1 draws the tree.

The pattern generalizes. A hierarchy of regions is a junction tree in which each region's cluster is its own interior together with its ports, and the separators are the ports. Messages go up the tree by Schur complement and down by back-substitution, and the running intersection property of Chapter 8 holds because a variable shared by two regions is a port of the lower one and lies on the path between them. The cost model of Section 8.5 applies level by level: a region with n_r variables eliminated at its level and k_r ports costs one factorization of an $n_r \times n_r$ block and k_r solves against it, and the root costs a solve of the size of what it reads. What the hierarchy adds to the flat partition of Chapter 8 is that n_r at each level is the region's own variables, not the whole subtree's: the rack interiors are eliminated once, at the rack level, and every level above sees them only through four numbers per rack.

Principle 17.1. *Nested cuts give nested messages. A region's message to its parent is computed from its children's messages and its own factors, and it is the same message the region would send if it were eliminated whole. Each level pays for its own variables only.*

17.3 What the parent needs to know

A level of description is a decision about what to carry. The hierarchy makes the decision precise: the parent needs, of each child, exactly the child's message, a precision and an information vector on the child's ports. Nothing less is exact and nothing more is needed. Two readings of that message are useful.

The message is an equivalent network. On the row's six ports the message is a 6×6 precision $\mathbf{S}$ and a 6-vector $\mathbf{h}$. Order the ports as the four flows $\mathbf{f}$ and the two potentials ϕ , and partition. The Gaussian with precision $\mathbf{S}$ has, conditional on the potentials, a mean and covariance for the flows of

$$\mathbb{E}[\mathbf{f} \mid \phi] = \mathbf{S}_{ff}^{-1} \mathbf{h}_f - \mathbf{S}_{ff}^{-1} \mathbf{S}_{f\phi} \phi, \quad \text{Cov}(\mathbf{f} \mid \phi) = \mathbf{S}_{ff}^{-1}, \quad (17.4)$$

which is a network: a matrix of equivalent conductances $-\mathbf{S}_{ff}^{-1} \mathbf{S}_{f\phi}$ from the port potentials to the port flows, an equivalent injection $\mathbf{S}_{ff}^{-1} \mathbf{h}_f$, and an error bar $\mathbf{S}_{ff}^{-1}$ on the flows. This is the Kron reduction of Chapter 8 with uncertainty, and it is what a modeler who knows only the ports would have to build by hand. For row 1 of the machine room the equivalent conductance from the plenum temperature to the row's flow into the plenum is -0.58 kilowatts per kelvin, where the physical edge alone has 5: the message knows that the hot aisle has a thermometer, so that raising the plenum temperature mostly raises the aisle with it rather than reversing the flow. The flows' spreads given the potentials are 0.04, 0.01, 0.33 and 0.03 kilowatts. A building model that treats a machine room as "a load of 128 kilowatts at 24 degrees" has built a one-node equivalent; the message is the many-port equivalent, with the region's readings folded in, and Section 17.4 measures the difference.

The message is the parent's whole knowledge of the child. Whatever the parent asks about the child's interior, it asks by back-substitution, and back-substitution needs the child's factorization, which the child keeps. The parent does not hold the child's variables. This is the level-of-description discipline enforced by the algebra: the room's reduced system has nineteen variables, not one hundred eighty-seven, and the room answers questions about racks by passing them down.

Lumping is the message with an assumption added. The traditional alternative to the message is to *lump*: replace the child by a node with one potential and the total source, as Proposition 17.1 allows for the balance and forbids for the potential. Lumping is exact for the flow through the cut and wrong for everything that depends on which port the flow used. In the row, the heat leaves through the hot aisle at thirty degrees and a little returns to the supply from the cold aisle at twenty; a node at one temperature cannot do both, and the parent's estimate of where the heat went is wrong by the difference. The structural literature knows this as the difference between Guyan reduction, which is the Schur complement onto the retained degrees of freedom and is exact for the static response [33], and a lumped mass, which is not. The message needs no judgment about which potential to keep; it keeps them all, and there are only as many as the cut has edges.

Principle 17.2. *The parent's model of a child is the child's message: exact on the ports, silent on the interior, and answered for by back-substitution when the interior is asked about. A lumped node is the message with one potential where the cut has several, and it is exact for the total flow and wrong for its distribution.*

17.4 Worked example: a machine room in three levels

Figure 17.2 draws the room. Cooling air is supplied at 18 degrees from a plenum that the model treats as a reservoir. Each of four rows has a cold aisle, from which five racks draw air, and a

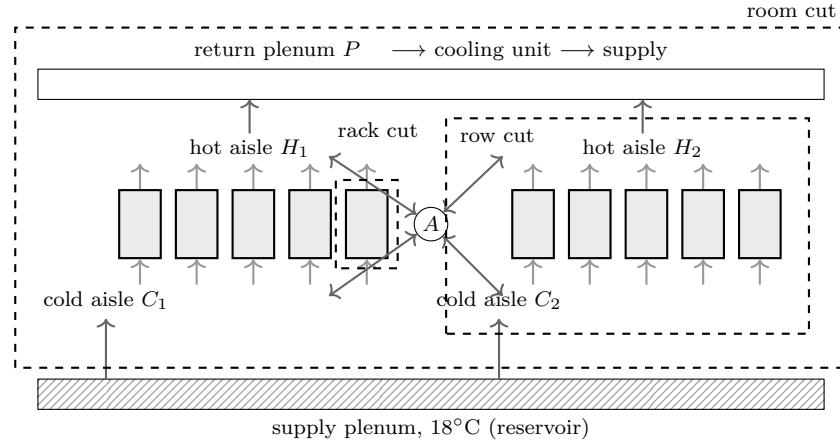


Figure 17.2: The machine room, two of its four rows drawn. Supply air rises into the cold aisles, passes through the racks (front node F , chassis T with its source, exhaust E), collects in the hot aisles and returns through the plenum P to the cooling unit; the mixing node A exchanges with every aisle. The dashed rectangles are three nested cuts. A rack's ports are its inlet and exhaust flows with the aisle temperatures on the far side; a row's are its four exchange flows with P and A ; the room's are the exchange with the supply reservoir.

hot aisle, into which they exhaust; the hot aisle returns to a plenum P that the cooling unit pulls back toward the supply, and both aisles exchange with a mixing node A that stands for the room's recirculating air. A rack has a front node, a chassis with a heat source, and an exhaust node; the chassis heats the air stream, most of which leaves by the exhaust and a little of which conducts back against the fan. Every exchange is a conductance, and the model is the linear-Gaussian one of Chapter 6: one balance row per node, one closure per edge, both with a physics width of ten watts; a prior of 8 ± 1.5 kilowatts on each rack's source; thermometers on every aisle, the plenum and the mixing node with accuracy half a degree; exhaust thermometers on two racks per row with accuracy one degree; and a power meter on each row with accuracy 0.4 kilowatts. The model has 187 variables, seventy potentials, ninety-seven flows and twenty sources, and 209 factors. The truth draws the twenty sources from their prior, and the readings are the truth's values plus noise. Every number is from `ch17_hierarchy.py`.

Three solves agree. The monolithic solve inverts the 187×187 precision, whose condition number is 1.4×10^8 in these units. The hierarchical solve computes twenty rack messages, four row messages, one 19-variable room solve, and back-substitutes; Table 17.1 gives the sizes. The two agree to 4×10^{-6} in every mean and 5×10^{-11} in every standard deviation, which is Proposition 17.2 in floating point. A third solve writes each row's meter on the row's five sources instead of on its four port flows, the two placements Section 17.1 said are equivalent, and agrees with the first to 1.6 watts, the physics width.

What the posteriors say. The truth has cold aisles at 20.5 to 20.7 degrees, hot aisles at 30.5 to 31.5, the plenum at 24.4, and chassis temperatures from 42 to 59. The posterior of the plenum is 24.39 ± 0.03 and of the heat the cooling unit removes 127.8 ± 0.6 kilowatts against a truth of 128.8. Row 1's heat through its cut, the combination $f_p + f_{ao} - f_s - f_{ai}$ of its four port flows, is

Table 17.1: The levels of the machine room: how many regions at each, how many variables each eliminates at its own level, and how many ports it keeps.

level	regions	eliminated per region	ports	what the level reads
rack	20	6	4	front, chassis, exhaust, source, two internal flows
row	4	12	6	two aisles and ten rack port flows
room	1	reduced system of 19	–	P , A , the cooling flow, sixteen row port flows

Table 17.2: Posterior spreads in the machine room as the readings of each level are admitted, from the root down. Sources and heat in kilowatts.

readings admitted	source, with exhaust sensor	source, without	row 2 total	cooling heat
none (priors)	1.50	1.50	3.35	5.58
room thermometers (P , A)	1.48	1.48	3.17	4.20
+ row thermometers and meters	1.34	1.34	0.39	0.64
+ rack exhaust thermometers	0.58	1.26	0.39	0.63

36.78 ± 0.39 kilowatts, and the sum of its five source posteriors is 36.78, the same number, as equation (17.2) requires. Inside the racks the picture is what Chapter 12 would predict: a rack with an exhaust thermometer has its chassis at 50.9 ± 1.6 degrees and its source at 7.94 ± 0.58 kilowatts (truth 51.4 and 8.03); a rack without one has 49.8 ± 3.4 and 7.50 ± 1.26 (truth 50.4 and 7.67), the row meter and the aisle thermometers having narrowed its source from the prior's 1.5 but the chassis remaining a virtual sensor two levels below any reading.

Information by level. Table 17.2 asks which readings narrow what, by solving the room with the readings of each level admitted in turn. The room's two thermometers, on the plenum and the mixing node, narrow the cooling unit's heat from 5.6 to 4.2 kilowatts and the rack sources hardly at all: two readings at the root cannot say much about twenty sources three levels down. The row's thermometers and meters narrow the row total from 3.2 to 0.39 kilowatts, which is the meter's accuracy, and the cooling heat to 0.64, but leave each source at 1.34: the meter pins the sum of five sources and says nothing about their split, so the five posteriors are negatively correlated and each stays wide. Only the rack's own exhaust thermometer narrows its source, to 0.58, and it does nothing for the rack next to it. Information enters at a level and flows through the ports; what a port carries is what a level can learn from above, and a port that carries a total carries a total.

Uncertainty through two levels. Equation (8.6) splits a region's interior covariance into two terms, the region's own conditional uncertainty given its ports and the port uncertainty carried in by the sensitivity $\mathbf{X}$; in a hierarchy the second term is itself the sum of the row's own conditional term and what the row's ports carried down from the room, by the same equation applied one level up. For the unsensed rack the split is stark. Given its four ports, the inlet and exhaust flows and the two aisle temperatures, its chassis is known to 0.02 degrees and its source to 0.02 kilowatts: the rack's own factors are physics rows of width ten watts, and once what crosses its boundary is fixed, conservation fixes the inside. All of its 3.4 degrees and 1.26 kilowatts are carried in through the ports, almost entirely through the exhaust flow, whose posterior spread is 1.16 kilowatts. Principle 1.3 said the boundary is where a model's ignorance concentrates; the hierarchy makes the statement quantitative at every level, because each level's uncertainty about

Table 17.3: The exact hierarchical posterior against the lumped room, in which each row is one node. Heat in kilowatts, temperatures in degrees.

quantity	exact	lumped	true
plenum temperature P	24.39 ± 0.03	21.86 ± 0.02	24.44
heat removed by the cooling unit	127.8 ± 0.6	77.1 ± 0.4	128.8
row 1 flow to the plenum f_p	30.6 ± 0.3	18.2 ± 0.2	30.4
row 1 total source	36.8 ± 0.4	36.8 ± 0.4	36.6
row 1 temperature(s)	20.5 / 30.5	25.5	20.5 / 30.5
misfit on the readings	23.5 / 22	749 / 14	—

a child is a term in the child’s covariance, and the terms can be read off separately.

The lumped room. Now replace each row by one node L_i with the row’s total source, the row’s four exchange edges, and the row’s two thermometers both reading L_i . Table 17.3 compares. The lumped model gets the row totals right, to the meter’s accuracy, because Proposition 17.1 guarantees it. It gets the plenum wrong by 2.5 degrees and the cooling unit’s heat wrong by 50 kilowatts, because its one node at 25.5 degrees sends 19 kilowatts per row back into the supply through the cold-aisle edge, where the true cold aisle at 20.5 sends six. The reported spreads are 0.02 degrees and 0.4 kilowatts: the lumped model is confidently wrong, in the sense of Chapter 4, and its misfit says so, 749 on fourteen readings against the exact model’s 23.5 on twenty-two. Two thermometers ten degrees apart on one node cannot both be fitted. A modeler could lump more carefully, with two nodes per row, and would do better; the message does not require the judgment, because it keeps every port.

A local change. Add an exhaust thermometer to rack (2, 4), which had none. Its chassis posterior moves from 49.8 ± 3.4 to 50.2 ± 1.6 and its source from 7.50 ± 1.26 to 7.68 ± 0.58 , on a truth of 7.67. The largest change of any posterior mean is 0.47 inside that rack, 0.19 in the other racks of its row, whose sources share the row meter with it and are explained away, 0.002 in its row’s aisles, 0.001 in the racks of the other rows, and zero in the room’s nodes. The hierarchy recomputes exactly what moved: the rack’s message, a 6×6 elimination; its row’s message, a 12×12 ; and the room solve of nineteen. Nineteen rack messages and three row messages are reused. The monolithic route refactorizes the 187×187 precision.

Figure 17.3 prices the two routes as the room grows. At 187 variables the monolithic sparse solver is faster, a third of a millisecond against nearly two, because the hierarchical route’s bookkeeping costs more than the algebra it saves. At 2659 variables the routes are within a factor of five, and at 26 000 the hierarchical update takes nine milliseconds against two hundred: a factor of twenty, and growing, because the update’s cost is fixed by the path from the changed rack to the root while the refactorization’s grows with the room. Both routes give the same answer, to 3×10^{-10} at the size where the check was run. The sparse solver’s factorization is itself a nested elimination, chosen by its ordering heuristic, so the hierarchy does not beat it at solving; what the hierarchy adds is the reuse, which a solver that does not know the physics cannot offer.

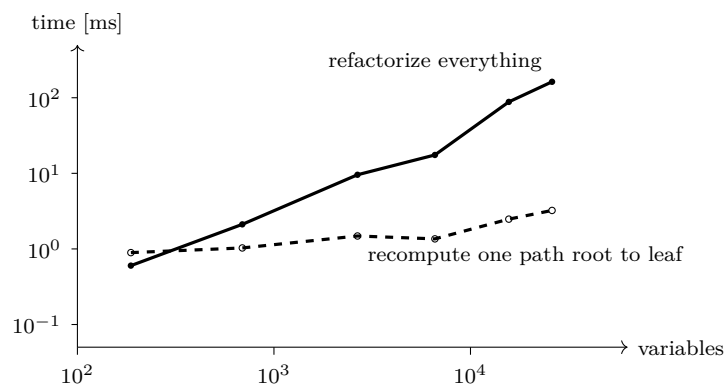


Figure 17.3: Wall-clock cost of incorporating one new thermometer in one rack, as the room grows from four rows of five racks to sixty-four rows of fifty. Filled: refactorize the whole precision with a sparse direct solver. Open: recompute the changed rack’s message, its row’s message and the room solve, with every other message held. Both axes logarithmic; each point is the best of three runs.

17.5 The cut, three times

The hierarchy of cuts has served so far as a way to organize inference. It is the same hierarchy that organizes two other things engineers do with large systems, and the coincidence is not one.

Modeling. A level of description is a choice of cut. The room’s operator models rows, the row’s designer models racks, the server’s designer models components; each draws the boundary that the questions of that level need and treats what is inside as a message and what is outside as a reservoir or a port. Principle 1.3 said a system is defined by what crosses its boundary; the hierarchy says a system is defined at every level by that level’s boundary, and the levels agree because the messages compose.

Control. A controller acts at a port. The cooling unit sets the supply temperature, which is the room’s boundary condition; a facility operator asks a row to hold its branch-circuit flow; a building manager gives a machine room a power budget. Each is an intervention in Chapter 13’s sense, a named quantity imposed at a cut, and each is met by the child, which back-substitutes the imposed port value into its interior and finds what its own inputs must do. The parent needs the child’s message to know how the port responds to what it imposes, and nothing else. This is the structure of hierarchical control as Mesarović, Macko and Takahara set it out [69]: coordination at the interfaces, local decisions inside, the interfaces being exactly the ports. Section 17.6 works one.

Scale. A large system is solved as a tree of regions, and the cost is set by the ports, not by the interiors. The cuts that give a good hierarchy for inference are those with few ports relative to their interiors, and the physical hierarchy, which was drawn for modeling and control, tends to have that property, because engineers build subsystems with narrow interfaces on purpose. Chapter 18 takes this up and measures it.

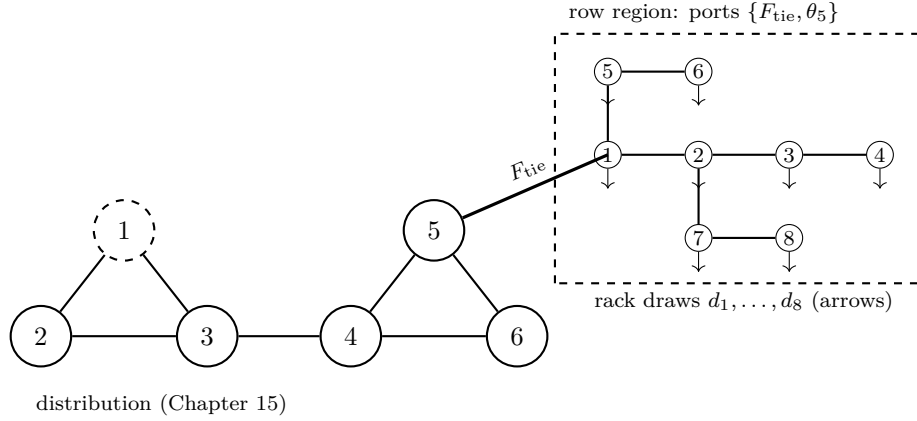


Figure 17.4: A rack row on one radial branch circuit under bus 5 of the six-bus distribution. To the distribution the row is a region behind the tie; its message is a Gaussian on the tie flow and the unit’s angle.

Principle 17.3. *One cut serves three uses. As a level of description it fixes what is modeled and what is summarized; as a control interface it is where a setpoint is imposed and met; as a partition for inference it fixes the cost. The physical hierarchy is a good hierarchy for all three because its interfaces are narrow by design.*

17.6 Worked example: a rack row under a distribution unit

The six-bus distribution of Chapter 15 had a load of one per unit at bus 5. Now bus 5 is a distribution unit, and the load is a row of eight rack positions on one radial branch circuit, with uncertain draws whose prior means sum to one and whose spreads are a quarter of their means; Figure 17.4 draws it. The row is a region with twenty-four interior variables, eight angles, eight branch flows and eight rack draws, and two ports, the tie flow F_{tie} from bus 5 into the row and the angle θ_5 on the distribution side. The distribution has its own factors, the closures and balances of Chapter 15 with two flow meters, and reads the row only through the tie.

The message is an injection. Eliminating the row’s interior onto its two ports gives a precision of 110.65 on the tie flow and 1.9×10^{-9} on the angle. The row says nothing about θ_5 : with only loads inside and no source, its net draw is the sum of its loads whatever the angle at which it is supplied, by Proposition 17.1. Its message is the one-dimensional statement $F_{\text{tie}} \sim \mathcal{N}(1.000, 0.095^2)$, an equivalent injection with error bars, the spread being the loads’ prior spreads in quadrature, 0.090, widened slightly by the physics rows. This is what the facility planner’s “net load at unit 5” has always been, made exact and given a variance. The distribution’s posterior, with its two meters, has the tie at 1.005 ± 0.090 and the feeder from bus 4 at 0.877 ± 0.066 .

A meter at the port narrows the interior. Put a meter on the tie, reading 1.12 ± 0.02 . The tie’s posterior is 1.115 ± 0.020 , and the correction passes down: every rack draw moves up from its prior, by 0.25 to 0.51 of its spread, in proportion to its prior variance, which is the

Table 17.4: The row's eight single-branch outages as messages to the distribution, and the distribution's flows on feeders 4–5 and 5–6 with each message in place. Feeder 5–6 is rated 0.6.

branch out	load dropped	message F_{tie}	F_{45}	F_{56}
0–1 (the tie's own branch)	1.00	0.000 ± 0.010	0.375	0.373
1–2	0.60	0.400 ± 0.062	0.589	0.160
1–5	0.25	0.750 ± 0.083	0.762	−0.012
2–7	0.30	0.700 ± 0.078	0.737	0.012
2–3	0.20	0.800 ± 0.087	0.786	−0.036
7–8	0.14	0.860 ± 0.088	0.813	−0.064
5–6	0.11	0.890 ± 0.090	0.827	−0.078
3–4	0.08	0.920 ± 0.092	0.841	−0.091

virtual-sensor arithmetic of Chapter 12 applied through a port. Each load's spread shrinks only to between 0.91 and 0.98 of its prior, because one number cannot narrow eight; what the meter has narrowed is their sum, from 0.090 to 0.020, and their posterior is correlated to say so.

Failure sets enumerated inside, combined at the port. Chapter 15 enumerated failure sets over a whole system and promised that a hierarchy would enumerate them by region. Here is the mechanism. Each of the row's eight branches is a candidate outage; in a radial circuit an outage de-energizes everything downstream, whose racks are dropped. Table 17.4 lists the eight, each as a row message: an injection reduced by the dropped load, with a variance reduced by the dropped racks' priors. The distribution's consequence of each is one solve of its reduced system of seventeen variables with the row's message swapped. Combined with the distribution's own seven feeder outages, the fifty-six pairs cost eight row messages and fifty-six reduced solves, not fifty-six solves of the whole forty-one-variable model. With more rows the saving compounds: a facility of m rows with b branches each has mb row messages and one reduced system, and the pairs are combinations of held messages.

The port as a setpoint. The distribution, finding feeder 5–6 loaded, asks the row to hold the tie at 0.85. In the model that is one factor on the port, a setpoint with a negligible width, which Chapter 13 would call imposing an input. The row's posterior distributes the required reduction of 0.15 over its eight racks in proportion to their prior variances, shares of 0.16, 0.07, 0.10, 0.04, 0.14, 0.08, 0.18 and 0.14 against prior-variance shares of 0.17, 0.08, 0.11, 0.05, 0.15, 0.09, 0.20 and 0.15, the small differences again the physics rows. That is the row's own decision to make, on its own model, and with its own priors replaced by shedding costs it would be an optimization inside the row; the distribution sees only the port, where the flows on feeders 4–5 and 5–6 become 0.800 and −0.050. The parent imposed, the child met, and each used only its own factors and the message between them.

17.7 Hierarchy in time

Chapter 16 unrolled the graph in time and found the storage states to be separators between past and future. A hierarchy in time therefore has two families of separators, the ports of each cut at each step and the storage states of the whole system between steps, and the question is whether they can be used together. They can, in one order, and not in another that is tempting.

Table 17.5: Filtering the room's twenty sources over eighty steps of thirty seconds, with every state carried jointly (exact) and with each rack carrying only its own chassis and source and the room only its air nodes (regional). Errors over the last sixty steps.

	exact	regional
rms error of a source [kW]	1.06	1.07
reported spread of a source [kW]	1.04	0.34
ratio, error to reported	1.02	3.12
fraction of errors beyond two spreads	0.033	0.425
reported spread of the twenty sources' sum [kW]	0.95	1.53

Proposition 17.3 (Nested elimination in space and time). *In the unrolled graph of a hierarchy of regions, eliminating at each step the regions' interiors onto their ports and the storage states, and then eliminating the step onto its storage states, is exact. The message carried from step to step is a Gaussian on all the storage states of the system jointly.*

Proof. Within a step, the regions' factors read their interiors, their ports and their own storage states at the previous step; the ports separate the interiors as in Proposition 5.3, so eliminating each interior onto its ports and storage states is a region message, and Proposition 17.2 lets it be done level by level. Across steps, Proposition 16.2 says the storage states separate; eliminating everything at the step except the states gives a Gaussian on the states, which is the filter's carried message. Every elimination is a Schur complement and every one is exact. $\square$

The tempting order is to let each region carry its own storage states and nothing else: a filter per rack, a filter for the room, each updating from its own readings and its neighbors' ports. The proposition says what that loses. The carried message is a Gaussian on the states *jointly*, and after one step of conditioning on shared readings, a row meter or a plenum thermometer, the states of different regions are correlated. A row meter that reads five sources at once makes their errors negatively correlated, because a reading that says the total is high says that if one source is higher than estimated another is lower. A per-region filter keeps each region's block of the covariance and drops the rest, which is to say it treats the regions as independent at the start of every step, and then conditions on the same shared reading again as if it were new information about each.

The mechanism is visible in two sources. Let q_1 and q_2 have independent priors of variance v , and let a meter read their sum, $y = q_1 + q_2 + \epsilon$ with $\epsilon \sim \mathcal{N}(0, \sigma^2)$, once per step, with the sources not moving. Exactly: the sum $s = q_1 + q_2$ has prior variance $2v$ and after n readings has variance $(1/2v + n/\sigma^2)^{-1}$, while the difference $d = q_1 - q_2$ is never read and keeps its variance $2v$; since $q_1 = (s + d)/2$,

$$\text{Var}(q_1 \mid y_1, \dots, y_n) = \frac{1}{4} \left[\left(\frac{1}{2v} + \frac{n}{\sigma^2} \right)^{-1} + 2v \right] \longrightarrow \frac{v}{2} \quad (n \rightarrow \infty). \quad (17.5)$$

Half the prior variance is all a sum meter can ever remove from one source. A filter that carries q_1 and q_2 in separate blocks conditions each reading on the current variances v_n of both as if independent, $v_{n+1} = v_n - v_n^2/(2v_n + \sigma^2) = v_n(v_n + \sigma^2)/(2v_n + \sigma^2)$, which decreases at every step and tends to zero. It comes to believe each source is known exactly, when only their sum is. Every shared reading is treated as fresh information about each part because the correlation that records "this was already used" has been thrown away.

Table 17.5 measures the loss on the room with thermal masses on the chassis and the air nodes, the sources random-walking by 0.15 kilowatts per step, and the same readings every step as before. The exact filter's errors are what it reports: root-mean-square 1.06 against a reported 1.04, and three percent of errors beyond two spreads, as a Gaussian should have. The regional filters have the same errors and report a third of them. Forty-two percent of their errors lie beyond two reported spreads. And the error is not one-sided: the exact posterior correlation between two sources in the same row is -0.18 , which makes their sum better known than the sources individually, 0.95 against $\sqrt{20} \times 1.04$; the regional filters, having dropped the correlation, report the sum at 1.53 , worse than the truth, while reporting each source better than the truth. They are overconfident about the parts and underconfident about the whole, which is the signature of dropped negative correlations. The remedy in the filtering literature is either to carry the joint, as the proposition prescribes, or to fuse with a rule that is consistent for any correlation at the price of conservatism, which is covariance intersection [40]; what is not a remedy is to pretend the regions are independent.

Principle 17.4. *In time, ports separate regions within a step and storage states separate steps, and both eliminations are exact in that order. What is carried between steps is the joint Gaussian on all storage states. A region that carries only its own states forgets the correlations that shared readings created, and reports its parts too well and its whole too badly.*

17.8 In practice

Cut where the engineers cut. The physical hierarchy of a system, its rooms, rows and racks or its busbars and branch circuits, was drawn by people who wanted narrow interfaces. Use it. A cut that follows a drawing boundary has ports that already have names and usually have meters.

Put the meter on the ports. A meter that reads a region's total is a factor on the region's port flows by Proposition 17.1. Written that way it belongs to the parent, and the parent can use it before the child's message is available, or with a child that is not modeled at all.

Hold the messages. The value of the hierarchy is reuse, and reuse requires that every region's message and factorization be kept between questions. A change recomputes one path from the changed region to the root; a question about an interior back-substitutes down one path. Nothing else is touched.

Do not lump what you can reduce. A region summarized to one node with one potential is exact for its total flow and wrong for its distribution among the ports. The message costs one elimination and keeps every port. If a lumped model must be used, run its misfit test; the lumped room's misfit was thirty times its degrees of freedom.

Impose at the port, meet inside. A setpoint is a factor on a port. The parent imposes it on the child's message; the child back-substitutes it into its interior and decides, with its own model and costs, how to meet it. Neither needs the other's variables.

In time, carry the joint. A hierarchy of filters that each carry their own states is not a filter; it is a set of filters that condition on shared readings twice. Carry the joint Gaussian on the storage states, or fuse conservatively, and check the reported spreads against the innovations.

17.9 What is missing

The hierarchy of this chapter was given, drawn from the physical layout, and every region's ports were few by construction. Two questions remain. When the layout does not give a hierarchy, or gives one whose regions have many ports, how should a large graph be cut, and what does the cut cost? Chapter 18 answers with the boundary dimension of a partition and measures it on test networks. And when the messages are too many or the regions too large for exact elimination, what approximations respect the hierarchy? Chapter 18 also treats co-simulation, in which regions exchange port values by iteration rather than by message, and shows when it diverges.

Notes and further reading

Aggregation of flows across a cut, Proposition 17.1, is the summation of balance rows and appears wherever conservation laws are discretized; the chapter's contribution is only to say that it places total-reading meters on the ports. The composition of Schur complements, Proposition 17.2, is the quotient formula for Schur complements, and its use to eliminate nested substructures is the substructuring of structural analysis [33] and the nested dissection of sparse direct methods [27]; its extension to dynamics as component mode synthesis is Craig and Bampton's [16]. Kron reduction as the electrical form of the same elimination is [20, 53], and the equivalent injection of Section 17.6 is the Ward equivalent [107] with a variance. The view of the hierarchy as a junction tree is Chapter 8's, following [50, 57]. Model reduction in the control-theoretic sense, which approximates where the message is exact, is surveyed by Antoulas [2]. Hierarchical control as coordination at interfaces is Mesarović, Macko and Takahara's [69]. The failure of per-region filters and the covariance-intersection remedy are Julier and Uhlmann's [40]. The reading of the physical hierarchy as simultaneously a level of description, a control interface and an inference partition is the book's.

Summary

- Summing a region's balance rows gives the balance of the region as a node, exactly; a meter on a region's total is a factor on its ports. Intensive states do not aggregate.
- Schur complements compose, so a hierarchy of regions is a junction tree whose messages are computed level by level. Each level pays for its own variables: the rack six, the row twelve, the room nineteen, for a model of 187.
- Information enters at a level and flows through the ports. A row meter pins the row's total and leaves each source wide; only a rack's own thermometer narrows its source.
- The parent's model of a child is the child's message, an equivalent network with error bars. A lumped node is exact for the total flow and wrong for its distribution: the lumped room misplaced 50 kilowatts and reported a spread of 0.4.
- A local change recomputes one path from leaf to root; at 26 000 variables that is twenty times cheaper than refactorizing, and the ratio grows.

- The same cut is a level of description, a control interface and an inference partition. A setpoint at a port is imposed by the parent and met inside the child.
- A row's message to the distribution is an injection with a variance; its failure sets are enumerated inside and combined at the port; a meter at the distribution unit narrows its racks through the port.
- In time, carry the joint Gaussian on all storage states. Per-region filters report each source three times too well and the sum too badly.

Exercises

Exercise 17.1. Prove equation (17.3) by block elimination. Write $\mathbf{\Lambda}$ in the blocks (I_1, I_2, S) , eliminate I_1 to obtain a 2×2 block matrix on (I_2, S) , eliminate its I_2 block, and show that the result equals $\mathbf{\Lambda}_{SS} - \mathbf{\Lambda}_{SI}\mathbf{\Lambda}_{II}^{-1}\mathbf{\Lambda}_{IS}$ with $I = I_1 \cup I_2$, using the block inverse of $\mathbf{\Lambda}_{II}$.

Exercise 17.2. Row 1 of the machine room has seventeen balance rows, two aisles and three per rack, each with physics width σ_p . Show that the identity $f_p + f_{ao} - f_s - f_{ai} = \sum_j q_{1j}$ holds in the model with a width of $\sqrt{17}\sigma_p$, and hence that placing the row meter on the port flows or on the sources gives posteriors that differ by at most that order. Compare with the 1.6 watts the script found for $\sigma_p = 10$ watts and a meter width of 400.

Exercise 17.3. Lump each row of the machine room to two nodes instead of one, a cold node carrying the supply and mixing-in edges and a hot node carrying the plenum and mixing-out edges, with the row's source at the hot node. Recompute Table 17.3. Which entries does the two-node lump fix, which does it still get wrong, and what would the lump need in order to be exact on all six ports?

Exercise 17.4. In the row example, give each rack a shedding cost c_k per unit dropped, and replace the Gaussian prior on the loads by the constraint that the shed amounts are nonnegative and the objective $\sum_k c_k s_k$. With the tie held at 0.85, which racks are shed? Show that the distribution's view of the row is unchanged by the replacement: the message on the port is still a point at 0.85, and the flows on feeders 4–5 and 5–6 are the same as in Section 17.6.

Solutions to selected exercises

Exercise 17.1. Write

$$\mathbf{\Lambda} = \begin{pmatrix} A & B & C \\ B^\top & D & E \\ C^\top & E^\top & G \end{pmatrix}$$

on (I_1, I_2, S) . Eliminating I_1 gives, on (I_2, S) ,

$$\begin{pmatrix} D - B^\top A^{-1}B & E - B^\top A^{-1}C \\ E^\top - C^\top A^{-1}B & G - C^\top A^{-1}C \end{pmatrix} =: \begin{pmatrix} D' & E' \\ E'^\top & G' \end{pmatrix},$$

and eliminating I_2 from that gives $G' - E'^\top D'^{-1}E'$. On the other side, $\mathbf{\Lambda}_{II} = \begin{pmatrix} A & B \\ B^\top & D \end{pmatrix}$ has the block inverse, with $D' = D - B^\top A^{-1}B$,

$$\mathbf{\Lambda}_{II}^{-1} = \begin{pmatrix} A^{-1} + A^{-1}BD'^{-1}B^\top A^{-1} & -A^{-1}BD'^{-1} \\ -D'^{-1}B^\top A^{-1} & D'^{-1} \end{pmatrix},$$

and $\mathbf{\Lambda}_{SI}\mathbf{\Lambda}_{II}^{-1}\mathbf{\Lambda}_{IS}$ with $\mathbf{\Lambda}_{IS} = (C; E)$ expands to

$$\begin{aligned} C^\top A^{-1}C + C^\top A^{-1}BD'^{-1}B^\top A^{-1}C - C^\top A^{-1}BD'^{-1}E - E^\top D'^{-1}B^\top A^{-1}C + E^\top D'^{-1}E \\ = C^\top A^{-1}C + E'^\top D'^{-1}E', \end{aligned}$$

since $E' = E - B^\top A^{-1}C$. Hence $G - \mathbf{\Lambda}_{SI}\mathbf{\Lambda}_{II}^{-1}\mathbf{\Lambda}_{IS} = G' - E'^\top D'^{-1}E'$, which is the two-stage result. The information vector follows by the same substitution with $\boldsymbol{\eta}$ in place of the last block column.

Exercise 17.2. Each balance row of the row's region is $r_n = \sum_{e \ni n} \pm F_e - q_n$ with $r_n \sim \mathcal{N}(0, \sigma_p^2)$ independently. Summing the seventeen rows, every internal edge cancels and the cut edges remain: $\sum_n r_n = (f_p + f_{ao} - f_s - f_{ai}) - \sum_j q_{1j}$, and the sum of seventeen independent widths σ_p has width $\sqrt{17} \sigma_p$. So the model holds the identity to $\sqrt{17} \times 10 = 41$ watts. A meter of width 400 watts placed on either side of the identity is the same factor up to a width of 41 watts added in quadrature, $\sqrt{400^2 + 41^2} - 400 = 2$ watts, and the posteriors differ by a quantity of that order in the meter's direction, scaled by how much the meter moves the estimate; the script's 1.6 watts is consistent.

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

The row as one number *a region's message to its parent is one injection with a width; independent spreads add in quadrature so aggregates are relatively better known than their parts; a port reading narrows the sum and barely touches the parts*
`level3_row_pod/four_resolutions/problems/the_row_as_one_number`

Chapter 18

Partitioning at scale

Chapters 8 and 17 took the cut as given. The machine room came with rows and racks, the network with a feeder behind a substation, and the ports were few because the engineers who drew the system had made them few. This chapter asks what happens when the cut must be chosen, and what a bad choice costs. The answer has a single currency. Every route through a partitioned model, exact elimination, messages between regions, iteration between regional solvers, enumeration of failure sets region by region, pays in the number of ports: the *boundary dimension* of the partition. A cut with few ports relative to its interiors is cheap on every route; a cut with many ports is expensive on every route and, for the iterative routes, fails.

The chapter measures rather than argues. Three transmission networks of the standard kind, with 73, 118 and 1354 buses, and the machine room of Chapter 17 at four sizes, supply the graphs. On each the chapter measures the elimination width that Chapter 5 promised, the boundary dimension of partitions chosen three ways, the convergence of region-level message passing that Chapter 9 promised, and the convergence of co-simulation. It then reads, from the case studies of Part VI, what the same partitions do when the regions are not Gaussian but sets of failure states, which is the question Chapters 10 and 15 left open. The chapter's own computations, of width, boundary dimension, propagation and co-simulation, are from `ch18_partitioning.py`. The separator compression, the region trees and the data-hall chain are read from the committed results files of the case studies that measured them.

18.1 The cost of a cut

Let a partition divide the variables into region interiors $I_1, \dots, I_R$ and a port set S , as in equation (8.4). Region r has n_r interior variables and k_r ports, and $|S| \leq \sum_r k_r$, with equality when no port is shared. The exact route of Chapter 8 costs one factorization of each $\mathbf{A}_{II}^{(r)}$, k_r solves against it to form the message, and one dense factorization of the $|S| \times |S|$ port system. Write w_r for the elimination width of region r 's interior on its own, the largest front its factorization creates.

Proposition 18.1 (Width of the partition ordering). *Eliminating every region's interior before any port, each interior in an ordering of width w_r , produces fronts no larger than $\max_r(w_r + k_r)$ during the interior phase and no larger than $|S|$ during the port phase. The elimination width of the whole is at most $\max(\max_r(w_r + k_r), |S| - 1)$.*

Proof. While region r 's interior is being eliminated, no other region's interior has been touched

Table 18.1: Elimination width of the nodal graphs, by minimum-degree and minimum-fill orderings, against $\sqrt{n}$. The largest dense block a sparse factorization forms is one more than the width.

graph	nodes	edges	width (min. degree)	width (min. fill)	$\sqrt{n}$
RTS-GMLC	73	108	5	5	8.5
IEEE 118	118	179	4	4	10.9
PEGASE 1354	1 354	1 710	14	12	36.8
room, 4×5	70	92	2	2	8.4
room, 8×10	258	344	2	2	16.1
room, 16×20	994	1 328	2	2	31.5
room, 32×25	2 466	3 296	2	2	49.7

and none is adjacent, by the bordered structure; the only variables outside I_r that an interior variable of r can be joined to are r 's own ports. So a front during that phase is a front of r 's own elimination, of size at most w_r , together with at most k_r ports. Once every interior is gone the remaining graph is on S , and any ordering of it has fronts of size at most $|S|$. $\square$

In operations the same accounting reads

$$\text{cost} \approx \sum_r (n_r w_r^2 + k_r n_r w_r) + \frac{1}{3} |S|^3, \quad (18.1)$$

the first term for factorizing each interior with fronts of width w_r , the second for the k_r solves that form the message, the third for the dense port system; back-substitution adds a solve per region, which is lower order. The two region terms are linear in the region sizes, so a partition can be as fine as one likes without penalty as long as the ports do not grow; the port term is cubic, and it is the one a bad cut inflates.

The proposition says that a partition's cost is governed by two numbers: the width of the worst region plus its ports, and the size of the port set. The first is small when regions are small or themselves well structured; the second is the boundary dimension. Nested dissection, the ordering that sparse direct solvers use, is this proposition applied recursively [27]: cut the graph by a small separator, order the two sides first and the separator last, and recurse into the sides. Planar graphs have separators of size $O(\sqrt{n})$ [60], which bounds the elimination width of nested dissection on them by $O(\sqrt{n})$, and physical networks are nearly planar. What the bound leaves open is the constant, and the constant decides whether a network of a thousand buses has a port system of thirty or of three hundred. The next section measures it.

18.2 Elimination width of physical networks

Table 18.1 gives, for each graph, the elimination width found by the two standard greedy orderings, minimum degree and minimum fill, which are upper bounds on the treewidth of Definition 5.2. The three transmission networks are the IEEE Reliability Test System of 73 buses in three areas, the IEEE 118-bus system, and the 1 354-bus PEGASE model of part of the European grid, all taken as their nodal graphs with parallel branches merged. The machine rooms are the graph of Chapter 17's room, plenum and mixing node and rows of racks, at four sizes.

Two things stand out in Figure 18.1. The transmission networks have widths of 4, 5 and 12, a third of $\sqrt{n}$ and less, so that the largest dense block a direct factorization ever forms on the

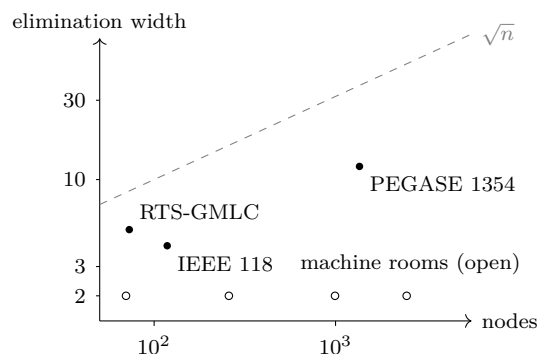


Figure 18.1: Elimination width against the number of nodes, both axes logarithmic. Filled: the three transmission networks. Open: the machine room at four sizes. The dashed line is $\sqrt{n}$, the planar-separator bound's scaling. The transmission networks sit well below it and the rooms do not grow at all.

1354-bus network has thirteen rows. Exact inference on these graphs is not merely affordable; it is cheap, and the reason is the one Chapter 5 gave, that a transmission network is a sparse, nearly planar graph whose cycles are local. And the machine room's width is 2 at every size. Its graph is a set of chains (front, chassis, exhaust) hanging between two aisle nodes per row, with every row hanging on the same two room nodes; eliminate the chains, then the aisles, and the front never exceeds three. This is the hierarchy of Chapter 17 seen by the elimination algorithm: a system built from subsystems with narrow interfaces has an elimination width set by the interfaces, not by the size.

Principle 18.1. *Physical networks have elimination widths far below the planar bound: four to twelve on standard transmission systems of 73 to 1354 buses, two on a machine room at any size. Exact Gaussian inference on them is cheap, and a partition is chosen for reuse and for what it enables, not to make the solve possible.*

18.3 Choosing the cut

Three ways to cut a graph into regions are compared. The *physical* cut follows labels the system carries: the three areas of the Reliability Test System, which are its three synchronous regions. The *spectral* cut bisects the graph by the sign of the Fiedler vector, the eigenvector of the susceptance-weighted Laplacian belonging to its second-smallest eigenvalue [26], splitting at the median so that the halves are equal, and recurses to give 2, 4, 8, ... regions [83]; a Kernighan–Lin pass [49] could refine it and, on these graphs, changes little. The *random* cut assigns buses to equal-sized regions at random, and stands for a partition chosen without regard to the physics: by owner, by alphabetical order, by whatever data happened to be at hand.

Table 18.2 and Figure 18.2 give the result. Cut in two, the 1354-bus network has thirty boundary buses, two percent of the total; cut in two at random it has 950, seventy percent. The ratio is thirty, and it is the ratio of the port systems' sizes and, cubed, of their factorization costs. The same holds at every R : the random cut's boundary is essentially every bus once R exceeds a handful, because a random region of size n/R in a graph of average degree three has almost no interior. The spectral cut's boundary grows with R , as it must, since more regions mean more

Table 18.2: Boundary dimension of partitions of the three networks and of two machine rooms. Ports are boundary nodes, counted once each; $k_{\max}$ is the largest region’s port count. The rooms’ physical cut is by rows, with the plenum and mixing node as a root region.

network	cut	R	ports	$ S $	share of buses	$k_{\max}$	cut branches
RTS-GMLC	areas	3	10		14%	4	5
	spectral	2	11		15%	6	7
	spectral	4	26		36%	8	19
	spectral	8	42		58%	9	32
	random	2	60		82%	30	56
	random	8	71		97%	10	106
IEEE 118	spectral	2	16		14%	8	12
	spectral	4	38		32%	12	26
	spectral	8	55		47%	10	39
	random	2	96		81%	50	89
	random	8	118		100%	15	162
PEGASE 1354	spectral	2	30		2%	17	24
	spectral	4	87		6%	29	82
	spectral	8	240		18%	67	211
	spectral	16	359		27%	41	328
	spectral	32	489		36%	27	487
	random	2	950		70%	477	965
	random	32	1 334		99%	43	1 922
room 8×10	rows	9	18		7%	2	24
	spectral	8	160		62%	32	135
	random	8	256		99%	33	308
room 32×25	rows	33	66		3%	2	96
	spectral	32	1 532		62%	77	1 416
	random	32	2 464		100%	78	3 194

cuts, but from a base two orders of magnitude lower. On the Reliability Test System the physical cut, three areas with ten boundary buses, is as good as the best spectral cut and better than the spectral cut into four, which is the observation of Chapter 17 made quantitative: the areas were drawn by engineers who wanted few ties, and on a transmission network the eigenvector finds cuts of the same quality.

The room, cut three ways. The machine room makes the comparison in the other domain, and adds a caution. Cut by rows, with the plenum and mixing node as a root region of their own, the room of eight rows and ten racks has eighteen boundary nodes among 258, seven percent, and no region has more than two ports; at thirty-two rows of twenty-five racks the shares are 66 of 2 466, under three percent, and still two ports per region. Cut spectrally into the same number of regions it has 160 boundary nodes, sixty-two percent; cut at random, 256, all but two. The spectral cut fails here for a reason worth knowing: recursive bisection at the median insists on equal halves, and a graph in which every row hangs on the same two hub nodes has no balanced cut that respects the rows, so the Fiedler vector slices across them. The physical cut is unbalanced, a root region of two nodes and thirty-two regions of seventy-seven, and that is exactly what makes it good. Balance is a constraint of parallel computing, not of inference;

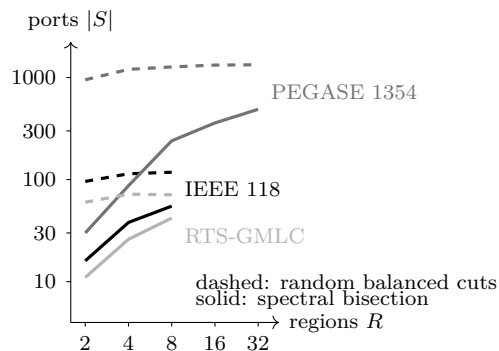


Figure 18.2: Boundary dimension against the number of regions for the spectral cuts (solid) and the random cuts (dashed) on the three networks, both axes logarithmic. A random cut puts most buses on the boundary at any R ; a spectral cut's boundary grows roughly as $R^{0.8}$ from a small base.

the cost model of Section 18.1 charges for ports and region widths, and an unbalanced partition with narrow interfaces beats a balanced one with wide ones.

The largest region port count $k_{\max}$ tells the same story from the region's side. A spectral region of the PEGASE network has 17 to 67 ports; a random region of the same size has hundreds. Since a region's message is a dense $k_r \times k_r$ block, and since the discrete enumeration of Section 18.5 is exponential in what the ports can express, $k_{\max}$ is the number that decides whether a region can be summarized at all.

Principle 18.2. *Cut where the flows are thin. A cut chosen by the physics, by the system's own areas or by the Fiedler vector of its weighted Laplacian, has a boundary of a few percent of the variables; a cut chosen without the physics has a boundary of most of them, and every route through the partition pays the difference.*

18.4 Coupling the regions: messages, propagation, or iteration

Once the regions are cut, their interiors are eliminated onto the ports and what remains is the port system, a precision on S built from the region messages. There are three ways to solve it; Figure 18.3 draws the first and the third for two regions.

The first is exact: factor the port system as one dense matrix. It costs $|S|^3/3$ and never fails. When the region graph is a tree, as for two regions, the factorization is one message each way (Chapter 8).

The second is to pass messages between regions and iterate: Gaussian belief propagation on the region graph, with each region's ports as one vector-valued variable. Chapter 9 found that propagation on the physical graph itself never converges, and asked whether it converges on the region graph, whose factors are messages that have absorbed the tight ties. The walk-summability criterion of Chapter 9 for scalar variables is that the spectral radius of the absolute partial-correlation matrix, $\rho(|\mathbf{R}|)$, is below one; for vector variables the natural analogue replaces each scalar partial correlation by the spectral norm of the normalized block, $\|\mathbf{D}_r^{-1/2} \mathbf{A}_{rs} \mathbf{D}_s^{-1/2}\|_2$, with $\mathbf{D}_r$ the region's own port block, and asks whether the spectral radius ρ_B of the matrix of

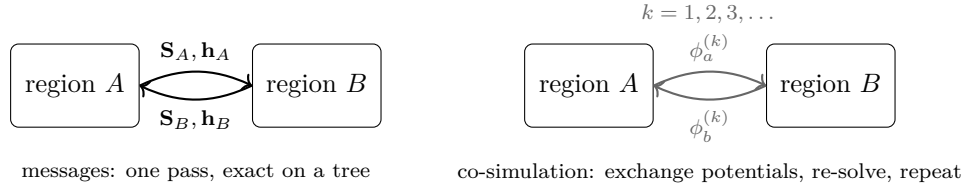


Figure 18.3: Two ways to couple two regions. Left: each region sends the other its Schur complement onto the ports, a precision and an information vector; the port posterior is exact after one exchange. Right: each region re-solves with the other's last boundary potential and sends the new one; the sequence converges to the same answer at a rate set by the tie strength.

those norms is below one. Both are computed here, and the propagation is also simply run, to 10^{-8} or to failure.

The third is co-simulation: each region solves its own physics with its neighbors' boundary potentials held at the last exchanged values, and the regions exchange again. Exchanging simultaneously is block Jacobi on the nodal system; exchanging in sequence is block Gauss–Seidel. Both converge on these systems, since the nodal matrix with a slack is an M-matrix and block splittings of M-matrices are regular [103], but at a rate set by the partition.

The convergence factor of an exchange. The rate has a closed form for two regions joined by one tie. Eliminate each region's interior onto its boundary bus; region A becomes an equivalent conductance g_a from its boundary potential ϕ_a to the reference together with an equivalent injection, region B likewise with g_b , and the tie has conductance g_t . The port system is

$$\begin{pmatrix} g_a + g_t & -g_t \\ -g_t & g_b + g_t \end{pmatrix} \begin{pmatrix} \phi_a \\ \phi_b \end{pmatrix} = \begin{pmatrix} p_a \\ p_b \end{pmatrix}. \quad (18.2)$$

Simultaneous exchange solves each row with the other's potential from the previous round, $\phi_a^{(k+1)} = (p_a + g_t \phi_b^{(k)}) / (g_a + g_t)$ and likewise for b , whose iteration matrix has spectral radius

$$\rho_J = \frac{g_t}{\sqrt{(g_a + g_t)(g_b + g_t)}}, \quad \rho_{GS} = \rho_J^2 \quad (18.3)$$

for the sequential variant. The factor is near zero when the tie is weak against the regions' own stiffness and near one when it is strong; a tie as strong as the regions it joins gives $\rho_J = 1/2$ and twenty exchanges for six digits, and a tie ten times stronger gives 0.91 and 150. The message route computes the fixed point of this iteration in one step, because the message *is* g_a , g_b and the injections, and the port solve inverts the 2×2 matrix. With more ports the factor is the spectral radius of the corresponding block iteration, and the closed form becomes a measurement.

Table 18.3 gives the measurements; the model is the linear-Gaussian one of Chapter 6 in the book's own variables, angles, flows and injections, with a physics width of 10^{-3} , injection priors of spread 0.1 and flow meters on a third of the branches. Four things are worth reading off.

First, the scalar walk-summability radius of the port system is above one for every partition, at 1.03 to 3.00, as it was 3.2, 5.1 and 8.1 for the three full graphs. Eliminating the interiors does not make the port system walk-summable in the scalar sense; the region messages are dense blocks, and dense blocks of partial correlations of order one half among a region's own ports are exactly what Chapter 9 found fatal. Scalar propagation among the ports is no better than scalar propagation among the buses.

Table 18.3: Coupling the regions of each partition. $\rho(|\mathbf{R}|)$ is the scalar walk-summability radius of the port system; ρ_B is its block analogue with regions as vector variables; the propagation column says whether region-level belief propagation reached 10^{-8} and in how many sweeps; the last two columns are the block Jacobi and block Gauss–Seidel convergence factors of co-simulation on the physics and the sequential exchanges needed for 10^{-6} .

network	cut	ports	$\rho(\mathbf{R})$	ρ_B	propagation	ρ_J	ρ_{GS}	exchanges
RTS-GMLC	areas 3	10	1.05	1.48	converged, 20	0.734	0.541	22
	spectral 2	12	1.03	0.90	converged, 1	0.906	0.821	70
	spectral 4	32	3.00	1.99	converged, 20	0.975	0.950	270
	spectral 8	53	3.00	2.75	failed	0.979	0.958	322
	random 4	139	2.69	3.00	failed	0.995	0.990	1 364
IEEE 118	spectral 2	19	2.17	1.00	converged, 1	0.872	0.761	51
	spectral 4	43	2.97	1.86	failed	0.968	0.937	213
	spectral 8	64	2.92	2.89	failed	0.975	0.951	273
	random 4	192	2.93	3.00	failed	0.996	0.991	1 560
PEGASE 1354	spectral 2	37	2.99	1.00	converged, 1	0.961	0.924	175
	spectral 4	117	3.00	2.84	failed	0.991	0.983	791
	spectral 8	332	3.00	4.62	failed	0.995	0.990	1 308
	spectral 32	770	3.00	7.20	failed	0.999	0.998	8 843
	random 4	2 211	3.00	3.00	failed	1.000	1.000	55 369

Second, block propagation, with regions as vector variables, behaves as Chapter 9 predicted. On two regions the region graph is a tree and one sweep is exact. On the Reliability Test System’s three areas, whose region graph is a triangle, it converges in twenty sweeps, and on its spectral cut into four, also in twenty; on every partition into eight or more, and on every random partition, it fails, the beliefs’ precisions turning indefinite within a sweep. The block radius tracks this: below one on the two-region cuts, 1.5 and 2.0 where propagation converged on a cycle, 2.8 and above where it failed. The condition $\rho_B < 1$ is sufficient, and the measurements say that a small excess over one is survivable on a region graph with one short cycle and a large excess is not. Region-level propagation is therefore a tool for a few large regions, and not a substitute for the port solve when the regions are many.

Third, co-simulation always converges on the physics, and the rate is what equation (18.3) predicts. On the three areas, with five tie lines against three regions of two dozen buses, the Jacobi factor is 0.73, the Gauss–Seidel factor is 0.54, close to the square 0.54 that the two-region formula gives, and six digits take twenty-two exchanges. On two spectral regions of the PEGASE network the factor is 0.92 and six digits take 175 exchanges; on thirty-two regions, 8 843; on a random cut into four, 55 000, the factor being one to four decimals. Figure 18.4 plots the exchange counts against the number of regions for both kinds of cut on the three networks. Each exchange is a full regional solve. The message route does the same regional solves once, plus the port factorization, and is finished.

Fourth, the port count orders every column. Read down any network’s rows: as $|S|$ grows the block radius grows, propagation goes from converging to failing, and the exchange count grows by an order of magnitude and more. The boundary dimension is the one number that predicts the cost of every route.

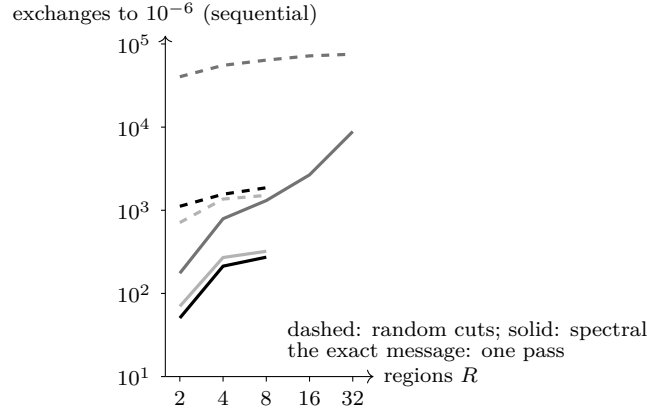


Figure 18.4: Sequential exchanges of co-simulation needed for six digits, against the number of regions, for spectral (solid) and random (dashed) cuts of the three networks. The exact message route needs one. Both axes logarithmic.

The port count as a cost predictor. The exact route was also timed: every region’s message by sparse factorization of its interior, then the dense port solve, best of three runs. Figure 18.5 plots the time against the port count for every partition of the three networks. The points from three networks and two kinds of cut fall on one curve, flat where the port solve is negligible and rising with the third power of $|S|$ once it dominates: on the 1354-bus network the spectral cut in two takes some tens of milliseconds and the random cut in two about half a second, the spectral cut into thirty-two half a second and the random cut into thirty-two eleven seconds. A monolithic sparse solve of the same model takes about a dozen milliseconds, less than any partition, which is Chapter 17’s point again: the partition is not for the one solve but for the reuse, and its cost is a function of the ports. Proposition 18.1 said as much; the figure says the constant is one.

Principle 18.3. *Between regions, pass the exact message and solve the port system. Scalar propagation on the ports fails as it does on the buses; block propagation converges only among a few large regions; co-simulation converges at a rate set by the ties’ strength against the regions’ and needs tens to tens of thousands of exchanges where the message needs one. Every route’s cost rises with the boundary dimension.*

18.5 Enumeration by region

The Gaussian measurements above bound what a partition costs when the regions’ messages are precisions. Chapters 10 and 15 asked a harder question: when a region’s state is a set of failed components, its message is not a Gaussian but a distribution over what the ports can take, one value per distinct separator value the region’s failure states produce, and the question is how many such values there are. If many failure states of a region produce the same port values, the region compresses: its $|E_r|$ states become $|S_r|$ separator values, and the regions combine on the ports at the cost of $|S_r| \times |S_s|$ pairs rather than $|E_r| \times |E_s|$. If they do not, the partition buys nothing on this route.

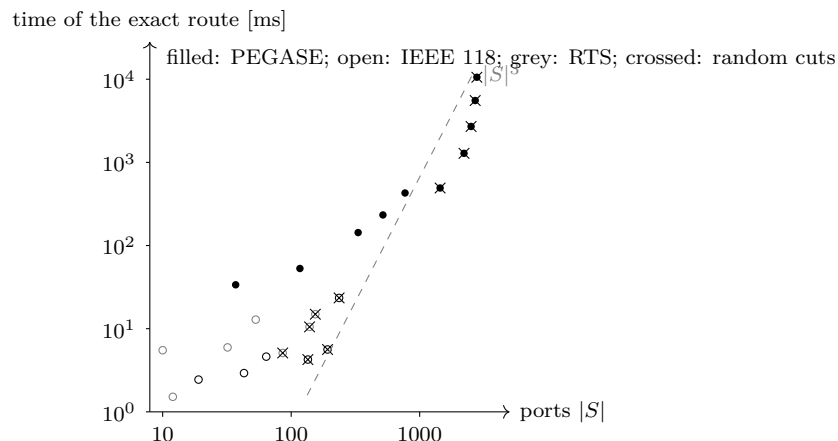


Figure 18.5: Time of the exact route, all region messages and the port solve, against the port count, for every partition of the three networks, both axes logarithmic. The dashed line has slope three. The points of three networks and two kinds of cut lie on one curve.

The compression ratio $C_r = |E_r|/|S_r|$ has been measured on the same three networks, with separator values distinguished at the precision the physics gives. On the Reliability Test System and the IEEE 118-bus system it took physical, spectral and random cuts and enumerated each region's failure states to a residual mass of 10^{-2} , with a cap of 100 000 states per region. On the PEGASE system it took spectral cuts only, enumerated to a residual target of 10^{-1} with a cap of 5 000 states, and the cap binds: the enumerated states leave a residual mass of 0.97 to 1.00. Where a region stops at its cap, its ratio is censored, measured on a shallower enumeration than the target. Table 18.4 summarizes what the committed results contain, and its notes mark the censored rows.

The finding is sobering and instructive. Compression is large only where the cut is a single tie and the region has interchangeable parts: a replica of the Reliability Test System's Area 1 behind one tie compresses sixteenfold, because its many twin generating units produce the same tie flow whichever twin fails. It falls to three at two ties and to between one and six on the real networks. On the IEEE 118-bus system, whose generating units are all different, it is 1.02 on one region, where every failure state is its own separator value, and 1.63 on the other, measured at the state cap; the partition saves almost nothing on the enumeration route. The study's own gate, a median compression of ten at three ports or fewer on two grids, was not met, and its verdict is recorded as unfavorable. What the partition does predict, even there, is which cut is cheapest: on three of the four grids the partition with the fewest ports was also the one that measured cheapest, and on the fourth the two differed by a refinement pass.

This is the honest answer to Chapter 15's question of how large a region can be before enumeration by region stops working. It works when the region's failure states collapse onto few port values, which is a property of the physics inside the region, twin units, radial feeders, symmetric layouts, and not of the cut alone. Where the regions are heterogeneous, the port values are as many as the states, and the route through the ports is a reorganization of the enumeration rather than a reduction of it. The Gaussian route has no such condition, because a Gaussian message is a fixed-size object whatever the region contains, and this is the strongest practical argument for the Laplace approximation of Chapter 7 within regions wherever it is valid.

Table 18.4: Separator compression measured by a case study of Part VI: enumerated region failure states per distinct separator value, for the physical, spectral or refined spectral (spectral+KL) cut of each network, with the boundary dimension of the region measured. Ranges run over the regions of the cut. The last column is the partition the study found cheapest by measurement against the one the port count alone predicted.

network	cut	k_r	C_r	best: measured / predicted
RTS Area 1, two replicas, one tie	replica	1	15.9	–
RTS Area 1, two replicas, two ties	replica	2	3.4	–
RTS-GMLC, three areas	areas	2–4	3.7–5.7	areas / areas
RTS Area 1 (24 buses)	spectral	3–4	1.8–2.5	spectral / spectral
RTS Area 1 (24 buses)	spectral+KL	3–4	1.6–3.3	–
IEEE 118	spectral	8	1.02, 1.63 ^b	spectral+KL / spectral
PEGASE 1354	spectral	13–17	1.5–2.0 ^a	spectral / spectral

^aEnumerated to a residual target of 10^{-1} with a cap of 5 000 states per region; the cap binds, with residual mass 0.97 and 1.00, so both ratios are censored.

^bThe second region stopped at the cap of 100 000 states with residual mass 0.032, so its ratio is censored. The spectral cuts of the full RTS-GMLC, not tabulated, stop at the same cap with residuals 0.023 and 0.026.

What the discrete message costs. When the regions are discrete the message is a histogram: one entry per distinct separator value, carrying the total probability of the region states that produce it and, for each consequence of interest, their contribution. Combining two regions is then a sum over pairs of entries, $|S_r| \times |S_s|$ of them, and the physics is evaluated once per region state, not once per pair, because a region state’s flows are fixed by its own separator value and the other region’s. The two-replica system with one tie, dispatched at peak load, shows the arithmetic at a residual of 10^{-2} per region. Each region enumerates 11 336 states, which fall on 712 separator values, so one table over pairs of separator values has $712^2 = 506\,944$ entries; that is the interface count of Table 18.4. The two-region pass builds one such table for each region, 1 013 888 interface pairs in all, with 21 916 physics evaluations. Its bracket on the probability of any overload, $[0.664, 0.684]$, has the joint residual mass 0.020 as its width and contains the Monte Carlo reference 0.679. The global enumeration of the same system, with 100 000 states, reached $[0.58, 0.69]$. It needs five million states to reach a residual of 0.019, about the two-region residual, which the regional route reaches with 22 672 enumerated states, some 220 times fewer. The difference is ordering: the global enumeration must order 124 components’ failure sets by probability, while the regional one orders sixty-two of them twice and takes the product. Where the ports compress, the pairs are far fewer than the states; where they do not, the pairs are the states, and only the ordering advantage remains.

Where the condition holds, the same studies show what it buys. Table 18.5 reads their results for chains of Area 1 replicas joined by single ties, whose region graph is a path and whose messages therefore combine exactly on a one-dimensional lattice of tie flows. The joint state count grows from 10^8 for two regions to 10^{24} for six, beyond any enumeration; the region-tree pass brackets the probability of any overload on the enumerated mass to a width of two to three thousandths in minutes. With the residual mass added to its upper end, the bracket contains the Monte Carlo reference at every length; without it, the reference lies above the bracket for three regions or more. These chains are dispatched pro rata at sixty percent load, so their two-region member is not the peak-dispatch system of the previous paragraph: its probability of

Table 18.5: Region trees for chains of R single-tie regions, read from a case study of Part VI: the joint state count, the certified bracket on the probability of any overload before the residual mass is added, and the reference. At $R = 2$ the reference is the exact value on the same enumerated mass. Wall-clock is that study's last refinement pass.

R	components	joint states	bracket	reference	pass time
2	124	$10^{8.1}$	[0.1207, 0.1227]	0.1227 (exact)	7 s
3	186	$10^{12.2}$	[0.1000, 0.1023]	0.113 (MC)	63 s
4	248	$10^{16.2}$	[0.0765, 0.0793]	0.088 (MC)	230 s
6	372	$10^{24.3}$	[0.0452, 0.0476]	0.056 (MC)	511 s

any overload on the enumerated mass is 0.1227, where the peak system's is near 0.68.

Two remarks on that table. The Monte Carlo references at $R \geq 3$ lie above the bracket, by about one percentage point, 0.011, 0.009 and 0.008; the bracket is on the enumerated mass, and the un-enumerated residual, 10^{-2} per region and hence up to six percent for six regions, is what the reference contains and the bracket does not. The study reports the bracket with the residual added, 0.132, 0.119 and 0.106, which does contain the reference in each case. And the wall-clock grows with R although the per-region work does not, because the lattice on which the messages combine widens with the number of regions; the price of combining exactly is paid on the separator, as everywhere in this chapter.

18.6 The machinery is not this domain's

Nothing in the partition machinery of this chapter — separators, exact two-region messages, certified brackets — was written for cooling. It was written for electrical networks, where a region is a control area, a port is a tie line and a component is a generator or a branch, and it reaches a chain of data halls through an adapter of about forty lines: a conductance for a susceptance, heat for power, a cooling unit for a generator, a path's heat-flow capacity for a line rating, the reference plenum for the slack bus. The probability layer never sees a room.

Chapter 20 is that run, and its numbers are the evidence for the claim this chapter has been making. Two halls joined by one wall path, twelve failing components and 4 096 joint states: the region messages give every probability and every path the exhaustive enumeration gives, to 9×10^{-12} , in a sixteenth of the time. Three halls with two wall paths per interface and twenty-eight components, where enumeration is not available: a certified bracket that contains a 20 000-draw Monte Carlo reference, computed in a third of the time the sampling took.

Two things follow, and the second is the one worth keeping. The first is that the method is not domain-specific, which the book has claimed since Chapter 1 and which a second domain demonstrates rather than argues. The second is that the transfer found a defect: the first version of the message machinery evaluated each region's own paths and left the *ties* to neither region, an omission that had never shown on a transmission network because those ties were rated well above their flows. On the hall chain they are not — a lost cooling unit pushes heat through the wall to the neighbour — and the omission surfaced immediately. Chapter 20 reports it.

That the collector substations of Table 18.1 have elimination width two, and that the data halls compress and combine exactly on their walls, are the same fact: systems assembled from repeated units behind narrow interfaces are cheap on every route through a partition. Transmission networks are harder on every count, wider, with more ports per region and with

heterogeneous regions that do not compress, and they are still far from the bounds. Between the two lie most physical systems.

18.7 In practice

Measure the width before partitioning. A minimum-degree ordering costs nothing and gives the elimination width. If it is small, and on physical networks it is, exact inference on the whole is cheap and a partition is for reuse, for hierarchy and for enumeration, not for tractability.

Take the physical cut when there is one, the spectral cut when there is not. Areas, feeders, buildings and rows are cuts with few ports by design. Without labels, the Fiedler vector of the weighted Laplacian finds cuts of the same quality on a meshed network; on a hub-and-spoke system it does not, because it insists on balance, and the physical cut, unbalanced, is the right one. Never partition by anything that ignores the graph, and never require balance that the physics does not have.

Count the ports and believe them. The boundary dimension predicts the port solve, the message sizes, the convergence of propagation, the exchanges of co-simulation and, where regions compress, the enumeration. A candidate partition with more ports is worse on every route.

Solve the port system; do not iterate on it. Scalar propagation on the ports fails. Block propagation is for a handful of regions. Co-simulation converges but pays a regional solve per exchange, and the number of exchanges is set by the ties against the regions. The message and the port factorization do the work once.

Expect compression only where the region is uniform. A region behind one tie with interchangeable parts compresses its failure states by an order of magnitude; a heterogeneous region does not. Check the ratio on the region before building the enumeration around it, and use a Gaussian message within the region wherever the Laplace approximation holds.

18.8 What is missing

Part V has treated time, hierarchy and scale as the three directions along which a model grows, and found in each the same structure: a separator, a message, a cost set by the separator's size. What the part has not done is run the whole machine on a whole problem from the operator's question to the answer, with every choice of Chapters 1 to 18 made and defended against a naive baseline. That is Part VI, one chapter per study, each read cold, each with its numbers rendered from the committed results that the two tables of this chapter have already drawn on.

Notes and further reading

Elimination width, treewidth and the greedy orderings are Chapter 5's, following [3, 87, 111]; nested dissection is George's [27] and the planar separator theorem Lipton and Tarjan's [60]. Spectral bisection is Fiedler's vector [26] as Pothen, Simon and Liou used it for sparse-matrix orderings [83]; Kernighan–Lin refinement is [49], and multilevel partitioners such as METIS [44]

combine the two at scale. Block splittings and their convergence for M-matrices are treated in the domain-decomposition literature [103]; co-simulation as the exchange of interface values between subsystem solvers, and the conditions under which it converges or diverges, is surveyed by Gomes and co-authors [28]. Walk-summability is Malioutov, Johnson and Willsky's [66]; the block analogue ρ_B is the chapter's own measurement device and is offered as a sufficient condition, not as a theorem. The measurements of elimination width, boundary dimension, region-level propagation and co-simulation on the three networks are the book's; the separator compression, the region trees and the thermal chain are read from the case studies of Part VI, which state their own assumptions, in particular that reliability data for the IEEE 118 and PEGASE systems are class rates borrowed from the Reliability Test System.

Two water-network estimators partition for the reasons of §18.1. Han, Eguchi, Mehrotra and Venkatasubramanian [36] cut a large damaged network at its articulation points so that components can be estimated independently under disaster conditions, accepting the coupling through the bridge flows that Chapter 5's Notes describe. Irofti, Romero-Ben, Stoican and Puig [39] cut in time rather than in space: a leak-free estimation over a window, then a localization graph on its residuals, each solved once, which bounds the cost per scenario on their 268-junction benchmark at the price of passing point estimates rather than posteriors between the two stages. The incremental re-elimination of Dellaert and Kaess [19], which re-solves only the part of the Bayes tree that new factors touch, is the robotics form of §18.3's question of where the cut should fall when the graph grows.

Summary

- The elimination width of a partition ordering is at most the worst region's width plus its ports, or the port count; every route through a partition pays in the boundary dimension.
- Measured widths: 5, 4 and 12 on transmission networks of 73, 118 and 1354 buses, 2 on a machine room at any size. Exact inference on physical networks is cheap.
- A physical or spectral cut of the 1354-bus network in two has 30 boundary buses; a random cut has 950. Random regions have almost no interior.
- Scalar propagation on the ports is not walk-summable on any partition. Block propagation converges among two to four large regions and fails beyond. Co-simulation converges at the rate $g_t / \sqrt{(g_a + g_t)(g_b + g_t)}$ and needs 22 to 55 000 exchanges where the message needs one.
- Enumeration by region compresses only where the region is uniform: sixteenfold behind one tie on a system of twin units, hardly at all on the IEEE 118-bus system. Where it compresses, chains of six regions with 10^{24} joint states are bracketed to a few thousandths on the enumerated mass.
- The same machinery on a chain of data halls reproduces brute force to 4×10^{-16} in probability and 8.9×10^{-12} W in expected severity, sixteen times faster.

Exercises

Exercise 18.1. Derive equation (18.3): write the block Jacobi iteration matrix of the two-port system, find its eigenvalues, and show that the block Gauss–Seidel matrix has the square of the Jacobi radius. Then evaluate both for a tie of conductance 10 joining regions of equivalent conductance 2 and 5.

Exercise 18.2. Prove that the elimination width of a graph is at least the size of its largest clique minus one, and use Proposition 18.1 to show that a partition of the machine room into rows, with the room nodes as ports, has an elimination width of at most three whatever the number of rows and racks. Compare with Table 18.1.

Exercise 18.3. Take the IEEE 118-bus network's spectral cut into two and compute the block radius ρ_B of the two-region port system with the regions' own port blocks as normalizers. It is 1.00 in Table 18.3, yet propagation converges in one sweep. Explain why a two-region system converges regardless of ρ_B , and what ρ_B measures there.

Exercise 18.4. A region behind a single tie contains m identical generating units, each failed independently with probability q , and the tie flow depends only on how many are failed. Compute the number of enumerated states with probability above ϵ and the number of distinct separator values, and hence the compression ratio C as a function of m , q and ϵ . Then replace the units by m units of distinct sizes and show that $C = 1$.

Solutions to selected exercises

Exercise 18.1. With D the block diagonal $\text{diag}(g_a + g_t, g_b + g_t)$ and $E = A - D$ the off-diagonal part, block Jacobi iterates $\phi^{(k+1)} = D^{-1}(p - E\phi^{(k)})$, whose iteration matrix is

$$M_J = -D^{-1}E = \begin{pmatrix} 0 & \frac{g_t}{g_a + g_t} \\ \frac{g_t}{g_b + g_t} & 0 \end{pmatrix}, \quad \lambda^2 = \frac{g_t^2}{(g_a + g_t)(g_b + g_t)},$$

so $\rho_J = g_t / \sqrt{(g_a + g_t)(g_b + g_t)}$. Gauss-Seidel updates a then b with the new ϕ_a : $M_{GS} = -(D + L)^{-1}U$ with L the strictly lower and U the strictly upper part, which for a 2×2 system gives $M_{GS} = \begin{pmatrix} 0 & \rho_{ab} \\ \rho_{ab}\rho_{ba} & 0 \end{pmatrix}$ with $\rho_{ab} = g_t/(g_a + g_t)$ and $\rho_{ba} = g_t/(g_b + g_t)$; its nonzero eigenvalue is $\rho_{ab}\rho_{ba} = \rho_J^2$. For $g_t = 10$, $g_a = 2$, $g_b = 5$: $\rho_J = 10/\sqrt{12 \times 15} = 0.745$ and $\rho_{GS} = 0.556$, so six digits take $\log 10^{-6} / \log 0.745 = 47$ simultaneous or 24 sequential exchanges.

Exercise 18.2. In any elimination ordering, consider the first vertex of a largest clique Q to be eliminated. At that moment every other vertex of Q is still present and adjacent to it, since edges are never removed, so its front has at least $|Q| - 1$ vertices, and the width is at least $|Q| - 1$. For the room, take each row as a region with interior its aisles and its racks' nodes, and the two room nodes P and A as the port set, $|S| = 2$. Within a row, eliminate each rack's chain front-to-exhaust first: the front node has neighbors C and T , the chassis then has C and E , the exhaust then has C and H , so w_r counts at most two interior neighbors, and each row node is adjacent to at most the two ports, so $w_r + k_r \leq 2 + 2 = 4$ is the proposition's bound; a sharper count notes that a rack node's front never contains both ports, giving 3. Then the two aisle nodes each see $\{P, A\}$ and each other's eliminated fill, a front of three. The port phase is on two nodes. The width is at most three at any size, and Table 18.1 measures two, one better, because the minimum-degree ordering eliminates the rows' aisles before the mixing node and never forms the three-clique.

Problems from the studies

Each of these is stated, solved and committed beside the study it came from, with a script that regenerates its answer. The path is relative to `docs/terra_graph_engine/case_studies/`.

Where to cut a building *the cost of exact inference by partition against monolithic factorization; the saving grows with the system and is bounded; the bound is set by the interior-to-port ratio alone*

`level1_building/scaling_to_a_building/problems/where_to_cut_a_building`

Part VI

Case studies

Chapter 19

Case studies

The chapters before this one taught the methods on small systems chosen so that every number could be checked by hand. The chapters of this part apply them to systems where no number can be checked by hand, and report what happened. Each is a complete application of the book to one question on one system, and each was run as a study in its own right, with its code and its results committed to the repository that accompanies the book.

19.1 What a case study is here

A case study in this part is a question, a system, a model and a run. The question is one an engineer or an operator would ask. The system is a standard test network or a constructed plant, described fully enough to rebuild. The model is a factor graph of the kinds in Part I, with the uncertainty placed where Part II puts it. The run is a script that produces a results file, and every number in a chapter of this part is read from that file by a script in the book’s `scripts` directory. Nothing is retyped.

Every study was run with TERRA, the author’s implementation of the constructions of this book, and its plugins. The engine compiles a conservation graph into its residual rows, solves them by Newton’s method, and lifts the same rows into the MAP and Laplace inference of Part III. The plugins carry what is specific to a domain or a method: power-flow and allocation models, reliability enumeration, the census and its surrogate. Appendix C describes both and maps each construction of the book to the module that implements it. In the chapters of this part, “the engine” means TERRA. The studies count cost in *engine solves*, one evaluation of the physics at one setting of the uncertain inputs. In the three-route, AC and bad-data studies that is a Newton or MAP solve of a compiled model. In the census and $N - k$ studies it is a DC minimum-load-shed linear program solved by the power-flow plugin. In the partitioning studies it is a region-local linear network flow under a fixed allocation rule. Neither of those passes through the Newton solver.

The chapters share one order. Each states the question, describes the system, draws the model as a factor graph, lists the method with a pointer to the chapter that justifies each step, gives the results, says what surprised, and ends with how to reproduce the run. The section on what surprised is not decoration. Several of these studies found that a method did less than expected, or that a bound was not a bound, and those findings are reported with the same care as the ones that went well.

19.2 The studies

- Chapter 20, *Three routes on two halls*: enumeration, region messages and Monte Carlo costed on a chain of data halls, with the probability layer of Chapter 15 run unchanged on a thermal network through a forty-line adapter.
- Chapter 21, *Which of two identical racks*: a posterior with two peaks and no mass between them, where the Gaussian summary lands on a configuration the prior excludes, and what should be reported instead.
- Chapter 22, *Where the Gaussian band stops*: a room with a thermal-runaway pole, one parameter and one reading, so that every Laplace band can be graded against the exact posterior and the engine's own self-check can be graded too.
- Chapter 23, *The expensive chiller nobody sees*: a plant whose metered power falls while its efficiency drops, one fitted parameter per window recovering the loss, and the detection statistic graded against fourteen healthy machines that fabricate a drift of their own.
- Chapter 24, *When one explanation is not enough*: a plant with two faults at once, where the best single explanation is plausible and wrong, and two measurements chosen by expected information gain take the true pair from seventh of eighteen to first.
- Chapter 25, *Telemetry you should not trust*: four sensor corruptions that stay inside the alarm band, found by asking what the rest of the physics predicts for each channel, and a peer-comparison baseline that degrades exactly where the hierarchy is thinnest.
- Chapter 26, *Which sensor to install next*: the value of a reading computed before it is taken, on a stuck diagnosis and on a capital budget, where the experienced placement comes out behind a random one.
- Chapter 27, *How much capacity can we actually use*: a building with half its installed capacity stranded by a damper, a headroom dashboard wrong by a factor of sixteen, and three capital projects that unstrand nothing until they are applied in order.
- Chapter 28, *What the graph is worth*: the same building solved with and without its block structure from eight racks to a thousand, and the correction of an earlier version of the same study whose exciting result came from networks that were never sized.
- Chapter 29, *Same heatwave, four resolutions*: one real ninety-six-hour event read at four levels of the same hierarchy, where the building view misses the violation, the hall view over-cools, and the rack view acts correctly for nothing.

The studies are in the power domain, and the partitioning chapter also runs a thermal one. The first five follow the parts of the book they draw on most: Part III first, then Part IV, then Part V. The last returns to diagnosis, on a system large enough for its failures to show.

19.3 Reading a case study

Each chapter can be read on its own after the chapters it points to. A reader who wants to rerun a study needs the repository, a Python environment with the engine of Appendix C, and the command in the chapter's last section. Most studies run in minutes on a workstation; the chapters say where one takes longer. A rerun reproduces the committed results file, and the book's script for the chapter then reproduces every number in the chapter from it.

Chapter 20

Three routes on two halls

Chapter 10 put three routes to the same question side by side: enumerate every case, sample cases at random, or factorize the question along the graph and combine. It costed them in physics solves on a problem small enough to have a closed form. This chapter runs the three routes on a system with no closed form — a chain of data halls, each a star of racks around its return-air plenum, coupled to its neighbours through the walls — and reports what each route cost and what each route could and could not certify.

The study is `foundation_hvac/thermal_local_to_global` in the repository, and every number below is read from its committed results by `scripts/ch20_two_halls.py`.

The chapter carries a second load. The probability layer that computes the region messages was written for power networks and was not modified to run here. The thermal network reaches it through an adapter of about forty lines, which maps a conductance to the reciprocal of a reactance, a cooling unit to a generator, a rack's heat load to an electrical load, a path's heat-flow capacity to a line rating, the reference plenum to the slack bus, and the negated temperature to a voltage angle. Nothing in the layer sees a room or a duct. That the answers come out right is the book's domain-independence claim measured rather than asserted, and Chapter 1 predicted it: what the machinery reads is a balance, a closure and a cut, and those do not know what is flowing.

20.1 The question

A facility engineer asks a question with a number in it: what is the probability that some air path in this facility carries more heat than it is sized for, over the horizon for which the failure rates hold, and which paths are they? The failures that would cause it are ordinary. A cooling unit trips and its duty is re-shared among the units that have headroom, which pushes heat along paths that were sized for less. A plenum return or a rack's air path is blocked or closed for work, and the heat it carried goes somewhere else. Either can happen in combination with the other, and the combinations are what matter: with twelve components that can fail independently there are 4 096 joint states, and with twenty-eight there are more than 10^8 .

Three things make this harder than counting failures. The consequence is not a property of the failed set but of the physics that follows it: which path overloads depends on where the heat goes, and where the heat goes is the solution of a network. The halls are coupled, so a failure in one changes the flows in its neighbour. And the answer an operator can act on is not one probability but a probability per path, because the action — open a damper, stage a unit, move

route	size of the computation	time	answer
exhaustive enumeration	4 096 joint states	211 ms	exact
region messages	128 interface pairs	13 ms	exact
Monte Carlo	20 000 draws	659 ms	sampling error

Figure 20.1: The three routes on the two-hall system, with the size of the computation each performs, the time it took, and what it can claim about its answer. The first two return the same numbers; only the third has a sampling error.

a load — is taken at a path.

20.2 The system

A hall is a star. Four racks each dissipate 30 kilowatts into the hall’s return-air plenum through a rack air path of conductance 3.0 kilowatts per kelvin, sized to carry 45 kilowatts. The plenum returns to the coil of each cooling unit through a path of conductance 4.0 kilowatts per kelvin sized to carry 90. The units are the hall’s heat sinks: each has a capacity and a duty, the duty set pro rata so that the hall’s units together remove exactly the hall’s 120 kilowatts of load. Consecutive halls are joined by wall paths of conductance 0.4 kilowatts per kelvin sized to carry 30; the wall is the hall’s boundary, and the number of wall paths is the number of boundary nodes each hall has, the k of Chapter 8.

The physics is the steady linear network of Chapter 1: one balance row per node, one gradient closure per path, heat as the conserved quantity and temperature as the potential. The reference is hall 0’s plenum, which absorbs whatever the units’ headroom cannot, in the manner of a slack bus, and the study says so rather than hiding it.

Two sizes are run.

- *Two halls.* Three cooling units of 60 kilowatts per hall, each at a duty of 40. Twelve components can fail: the six units, and six of the paths. One wall path joins the halls, so $k = 1$. The joint state space is $2^{12} = 4096$, small enough that every state can be visited.
- *Three halls.* Six cooling units of 30 kilowatts per hall, each at a duty of 20; the finer unit granularity makes the re-sharing after a trip more interesting. Twenty-eight components can fail, eighteen units and ten paths, and two wall paths join each consecutive pair, so $k = 2$. The joint state space is 2^{28} , about 2.7×10^8 , which cannot be visited.

A cooling unit fails over the horizon with probability 0.03 and a path with probability 0.002, independently. A failed unit’s duty is re-shared among the survivors in proportion to their headroom; a failed path is removed, and removing it may cut a rack off from the plant, which is a different outcome from an overload and is counted separately.

20.3 The three routes

Enumerate. Visit all 4096 joint states. For each, re-share the duties, remove the failed paths, solve the network, and record which paths exceed their capacity and by how much. Accumulate

each outcome weighted by the state's probability. This is exact and it is the definition; it is also 2^n and stops being available somewhere between the two systems.

Pass region messages. Cut the chain at the walls. By Proposition 1.1 what crosses a cut is exact, so each hall can be summarized by what its failure states do at its boundary: the heat crossing the wall, and whether the hall is short of cooling. Enumerate each hall's own states, group them by the value they produce at the boundary — the *separator value* of Chapter 5 — and pass the resulting distribution to the neighbour. The halls' answers are then combined over pairs of separator values rather than over pairs of joint states. On the two-hall system each hall's states collapse to eight separator values, so the combination is over $8 \times 8 = 64$ pairs in each direction, 128 interface pairs in all, against 4096 joint states. This is Chapter 8's elimination with a discrete message instead of a Gaussian one, and, like that one, it is exact.

Sample. Draw component states from their independent Bernoulli laws, solve the whole network for each draw, and average. Twenty thousand draws. This is exact in the limit and has a standard error at any finite budget; the standard error is the thing the other two routes do not have and the thing that makes it unable to certify a small probability.

On the three-hall system the first route is unavailable and the second needs one more idea. Enumerating a hall's twenty-eight-component state space exactly is still too much, so each hall's enumeration is stopped when it has covered all but a tolerance $\varepsilon_r = 10^{-3}$ of its own probability mass, and the mass left over is carried as an explicit residual rather than discarded. Each hall then covers between 35 and 43 separator values, the joint residual is 0.0030, and every reported quantity comes out as a *bracket* rather than a number: a lower end from the mass actually enumerated and an upper end from the union bound over hall and wall events, with the residual added last. That construction is Chapter 15's, and the point of running it here is that its guarantee survives the change of domain.

20.4 Results

Two halls: the messages are the enumeration. Table 20.1 sets the two exact routes side by side. Every metric agrees, and so does every path. The largest disagreement anywhere — over four aggregate metrics and fifteen paths — is 9×10^{-12} , in the expected severity, which is a sum of kilowatt-scale quantities and so is where floating point shows first. The probabilities agree to the last digit either route prints.

The numbers themselves are worth a sentence. The probability that some path is over its capacity is 0.158, which is large, and almost all of it sits on two paths: `H0_rack0_air` at 0.0790 and `H1_rack0_air` at 0.0788. Those are the two racks whose air path is also a wall endpoint, so they carry their own hall's heat and whatever the neighbour pushes through the wall. The wall itself overloads with probability 0.0050. A rack is de-energized with probability 0.0119, and the facility is short of cooling altogether with probability 0.0005.

The cost is the point of the comparison. The enumeration took 211 milliseconds and the messages 13, a factor of sixteen, on a system deliberately small enough for the enumeration to finish. The factor is not the result; the result is that the two agree to round-off, because that is what licenses using the messages where the enumeration cannot run.

Table 20.1: Two halls, twelve failing components, 4096 joint states: exhaustive enumeration against region messages over 128 interface pairs. The three paths listed are the only ones that carry any overload probability at all; the other twelve are at zero under both routes.

quantity	enumeration	region messages	difference
$\mathbb{P}(\text{a path over its capacity})$	0.157727	0.157727	1×10^{-16}
$\mathbb{P}(\text{a rack de-energized})$	0.011940	0.011940	4×10^{-16}
$\mathbb{P}(\text{cooling deficit})$	0.000504	0.000504	5×10^{-17}
$\mathbb{E}[\text{severity}] \text{ [W]}$	1754.0	1754.0	9×10^{-12}
H0_rack0_air	0.078978	0.078978	3×10^{-17}
H1_rack0_air	0.078776	0.078776	0
WALL_H0_H1_0	0.005001	0.005001	3×10^{-18}

Table 20.2: Three halls, twenty-eight failing components, $10^{4.7}$ joint states: region messages with certified brackets against 20 000 Monte Carlo draws. The brackets are what the method guarantees; the Monte Carlo interval is a sampling statement about a particular seed.

	region messages (certified bracket)	Monte Carlo (20 000 draws)
$\mathbb{P}(\text{a path over its capacity})$	[0.01111, 0.02182]	0.01275
with the joint residual added	[0.01111, 0.02480]	[0.01129, 0.01440]
$\mathbb{P}(\text{a path in hall H0})$	[0.00430, 0.00430]	0.00480
$\mathbb{P}(\text{a path in hall H1})$	[0.01111, 0.01111]	0.01230
$\mathbb{P}(\text{a path in hall H2})$	[0.00430, 0.00430]	0.00460
$\mathbb{P}(\text{a wall path})$	[0.00053, 0.00212]	0.00205
$\mathbb{P}(\text{a rack de-energized})$	0.00732	0.00695
$\mathbb{E}[\text{severity}] \text{ [W]}$	[291.4, 291.5]	304.7 ± 21.3
time	179 ms	659 ms

Three halls: the bracket contains the sample. Table 20.2 is the comparison that matters, because here only two routes are available and they answer in different currencies. The messages return a certified bracket: [0.0111, 0.0218] on the probability that some path is over its capacity, and 0.0248 once the joint residual is added to the upper end. Twenty thousand Monte Carlo draws return the point estimate 0.01275 with a Wilson interval of [0.0113, 0.0144].

The sample lies inside the bracket, and so does its interval. Per hall the agreement is closer than the aggregate: the messages give 0.00430, 0.01111 and 0.00430 for the three halls and the sample gives 0.0048, 0.0123 and 0.0046, each within its own sampling error. The wall paths are bracketed at [0.00053, 0.00212] against a sampled 0.00205. The expected severity is bracketed at 291.4 to 291.5 watts against a sampled 304.7 ± 21.3 .

The middle hall is the exposed one, at two and a half times either outer hall's probability, and the reason is structural rather than statistical: hall 1 has a wall on both sides, so it receives heat pushed from either neighbour, while halls 0 and 2 receive it from one. An operator reading the per-hall row would stage the spare capacity in the middle.

The messages took 179 milliseconds in all — under a millisecond to enumerate the halls and three passes of about sixty milliseconds — and the Monte Carlo took 659, of which most is the 565 distinct network solves the draws required. The sampling route is not much slower here. It is the guarantee that differs.

20.5 What surprised

The walls overload, and an earlier version could not see it. The wall paths are the ties between regions, and the first version of the message machinery evaluated each region's own paths and left the ties to neither region. On a power network that omission had never shown, because the ties in those studies were rated well above their flows. Here they are not: a lost cooling unit pushes heat through the wall to the neighbour's units, which is exactly the recirculation an operator worries about, and the wall carries it. The second domain found a defect that the first had not exercised, which is the strongest argument for running one.

Refining the discretization does not narrow the bracket. The bracket is computed on a ladder of cell widths, 5 000, 1 000 and 200 watts, and at every rung it is the same to five decimals: [0.0111, 0.0218]. The width is 0.0107 and none of it is discretization error. All of it is the union bound — the step that adds the halls' and the walls' event probabilities without knowing how much they overlap — plus the 0.0030 of residual mass. This is Chapter 15's warning made concrete: when a bracket is wide, ask which of its two sources is wide before spending anything on the other. Refining the cells here is free and buys nothing; enumerating deeper into each hall, or replacing the union bound with an inclusion argument on the separator, are the two things that would work.

The sampled severity is higher than the certified one, and that is not a contradiction. The sample puts the expected severity at 304.7 ± 21.3 watts and the bracket at 291.4 to 291.5. The bracket is over the enumerated mass only; the residual 0.0030 of unenumerated states contains the deepest failure combinations, which are the severe ones, and the severity bracket does not carry them. A reader who wants a bound on severity rather than an estimate has to enumerate to a tolerance set by the severity, not by the probability — the tail matters more for a mean than for an indicator.

The domain cost forty lines. No file in the probability layer was changed. The adapter is a mapping of names and units, and the constructions it hands over — balance rows, gradient closures, a cut, a separator, a residual — are the ones Part I defined without reference to a domain. The two-hall equality to round-off, per path, is the check that nothing domain-specific had quietly leaked in.

***Principle 20.1.** Region messages over separator values return the enumeration's answer at the enumeration's precision and a fraction of its cost, and they keep working where the enumeration stops. Where enumeration stops altogether, they return a bracket and say what is in it; a sample returns a point and a standard error. The two answer different questions, and an operator asking "can you certify this is small" is asking the first.*

20.6 Reproducing the run

The study runs in about a second:

```
PYTHONPATH=src python docs/terra_graph_engine/case_studies/\
  foundation_hvac/thermal_local_to_global/run.py
```

It rewrites `results.json` and the rendered `results.md` beside it. The chapter's numbers and its three figures and tables are then reproduced from that file by

```
cd docs/books/datacenter && python scripts/ch20_two_halls.py
```

which prints every value quoted above and rewrites the fragments in `figures/`. The Monte Carlo cross-check is seeded, so the sampled numbers are reproducible; the timings are not, and the chapter quotes them only as ratios and orders of magnitude.

Notes and further reading

The three-way comparison of enumeration, sampling and factorization is Chapter 10's, and the discrete region message with its separator values is Chapter 8's applied to a failure distribution rather than a Gaussian. The certified bracket with an explicit residual, and the union bound that dominates its width, are Chapter 15's. The adapter that carries a thermal network into a conservation network is the book's Table 2.2 implemented; the observation that a second domain finds defects the first did not exercise is the study's and is reported in its own results file.

Chapter 21

Which of two identical racks

Chapter 7 said that a posterior stops being Gaussian when the physics bends, when a regime switches, or when the prior itself has more than one lobe, and that the Laplace approximation answers by placing one bell where the posterior has its highest point. This chapter is the case where that answer is not wrong by a little. The posterior has two peaks, the Gaussian puts its mode between them, and the place it chooses is a place the prior says is essentially impossible.

The system is as small as a data center gets: one room, two identical racks, one temperature sensor. It is small on purpose. Everything here can be checked by hand, and the failure of the Gaussian route is not an artifact of scale or of a hard solve — it is what a symmetric question does to a unimodal answer.

The study is `level2_room_hall/bimodal_fault_isolation` in the repository, and every number below is read from its committed results by `scripts/ch21_two_racks.py`.

21.1 The question

A room is running warmer than it should. Its two racks are nominally identical, drawing 300 watts each, and the facility’s telemetry offers exactly one relevant channel: the room-air temperature. An operator wants to know which rack to open.

The difficulty is stated in one sentence. The sensor sees the *sum* of what the two racks dissipate, so a hidden 250 watts on rack *A* and a hidden 250 watts on rack *B* produce the same reading, to the last digit. No amount of thinking about that one reading separates them. The question is what an honest diagnosis should therefore say — and in particular whether it is allowed to say “125 watts on each,” which is the one answer that is false under both explanations.

21.2 The system

Two racks sit in a room. Each rack passes its heat to the room air through a conductance of 45.8 watts per kelvin; the room passes heat to the building loop at 366.7, and the building loop to the chilled water at 366.7, with supply and return legs at 91.7. The chilled water is held at 290 kelvin and is the reservoir. The conductances are not chosen for the story: they are sized by the study’s own rule from a 550-watt design rack at a 12-kelvin rise and a 3-kelvin approach across the room and building links, which is Chapter 1’s sizing discipline applied before any inference is done.

Each rack carries an unknown extra load, a latent variable in the sense of Chapter 12. The prior on it is the part of the setup that matters most, and it is not Gaussian: a rack is either healthy or it is not, so the prior is an even mixture of $\mathcal{N}(0, 20^2)$ and $\mathcal{N}(250, 20^2)$ watts. That is an honest statement of what a facility engineer believes before looking: two lobes, not one broad hump. The truth, which the inference is not told, is 250 watts on rack *A* and nothing on rack *B*.

One sensor reads the room air with a noise of 0.5 kelvin. The healthy room would sit at 293.273 kelvin; the fault lifts it to 294.641, a rise of 1.368 kelvin, which is 2.74 times the sensor's noise. The reading is therefore decisive about *something*: one reading pins the sum of the two faults to 91 watts. It is decisive about nothing else. The difference of the two faults leaves no trace in it at all.

21.3 Two representations of the same posterior

The same model, the same prior and the same reading go to two representations.

The Gaussian route. Replace the mixture prior by its moment-matched Gaussian — mean 125, spread 126.6 watts, which has the mixture's first two moments and none of its shape — find the MAP estimate, and take the Laplace covariance from the curvature there. This is Chapter 6's machinery run without complaint, and it is what a tool that only speaks Gaussian will do.

The sampled route. Draw 1 500 fault pairs from the mixture prior as it actually is, solve the physics once for each, and weight each draw by how well it explains the reading. This is Chapter 9's importance sampling with the prior as the proposal. No resampling was needed: the effective sample size came out at 798 of 1 500, above the study's threshold of 750, so the weighted draws are reported as they fell.

The cost difference is real and should be stated plainly. The Gaussian route needs three physics solves. The sampled route needs 1 500. On a system this small that is nothing; on a building it would not be, and Chapter 9 says when the expense is worth it. This chapter is about what the expense buys.

21.4 Results

Figure 21.1 is the chapter in one picture. The sampled posterior on rack *A* has a peak near zero and a peak near 250 watts, and between about 60 and 180 watts it is flat on the floor. The Laplace Gaussian is centred at 125.0 watts with a spread of 98.3 — squarely in the gap.

Table 21.1 puts the two representations side by side.

What the Gaussian says. Rack *A* carries 125.0 ± 98.3 watts and so does rack *B*, with a 95 percent interval of $[-68, 318]$ watts. The estimate is 1.27 standard deviations from zero, which no threshold would call a fault. The two estimates are correlated at -0.66 , and that correlation is doing real work: the sum of the two is known to 81.4 watts, better than either alone, while the difference stays at 179 watts, which is its prior spread untouched. The Gaussian has correctly learned everything the reading contains — the sum — and correctly learned nothing about the difference. Its failure is not in what it learned. It is in how it reports it.

Because the only thing the reading fixes is the sum, and because a Gaussian is symmetric about its mean, the mode lands on the diagonal at (125, 125). The prior density there, from the

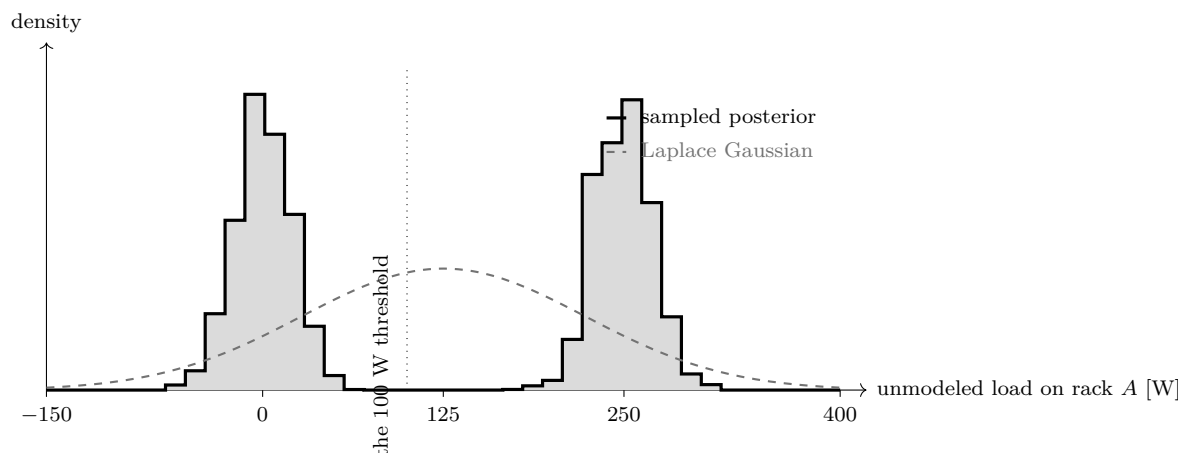


Figure 21.1: The posterior over the unmodeled load on rack *A*. Solid: the weighted draws from the mixture prior, two peaks with nothing between them. Dashed: the Laplace Gaussian, one peak sitting exactly where the sampled posterior has no mass. Both are densities over the same variable and are drawn to the same scale. Rack *B*’s marginal is the mirror image.

committed mixture, is 6.6×10^{-11} per watt. The Laplace approximation has placed its entire answer at a configuration the model’s own prior regards as essentially impossible, and it reports a spread that makes that configuration look merely uncertain rather than excluded.

What the sampled posterior says. It finds two modes per rack, and it puts 0.506 of rack *A*’s mass and 0.494 of rack *B*’s above the 100-watt threshold. Read carelessly that is the same useless answer — each rack about half likely. Read as the joint distribution it is not, and Figure 21.2 shows why.

The mass is in two lobes, off the diagonal. Summed by configuration: 0.489 on rack *A* alone, 0.478 on rack *B* alone, 0.017 on neither and 0.016 on both. Ninety-seven percent of the posterior says *exactly one of these two racks carries about 250 watts*, and it declines to say which. That is a different statement from “each carries 125,” and it is the true one. The medians say the same thing from another angle: rack *A*’s median is 206 watts and rack *B*’s is 39, because the reading does carry a whisper about which rack — the racks are not perfectly symmetric in the network — but the means, 126 and 122, average the two lobes and destroy it.

The action differs. The study’s own ranking turns the sampled posterior into a sentence: investigate rack *A*, on 51 percent of the mass above 100 watts with a median of 206, and treat it as one of several plausible candidates rather than the single root cause, because the posterior is multi-modal. An operator given that opens one rack, expects a coin-flip, and knows the other rack is the alternative. An operator given 125 ± 98 watts on each opens neither, because neither crosses a threshold, and the room stays warm.

Every state is physical. The check that keeps this from being a story about numbers: over all 1 500 sample solves the rack temperatures stay between 297.9 and 309.5 kelvin against a limit of 320, and every energy balance closes to 10^{-14} . The Gaussian estimate’s own solve puts both

Table 21.1: Two representations of the posterior over the two racks’ unmodeled loads, from the same model, the same prior and the same reading. The configuration rows have no Gaussian entry because a single Gaussian cannot express them.

	Gaussian (MAP and Laplace)	sampled (1 500 weighted draws)
estimate, rack <i>A</i> [W]	125.0	median 206, mean 126
estimate, rack <i>B</i> [W]	125.0	median 39, mean 122
95% interval, rack <i>A</i> [W]	[−68, 318]	[−29, 283]
modes per rack	1	2
$\mathbb{P}(\text{load above } 100 \text{ W}), \text{ rack } A$	0.601	0.506
rack <i>B</i>	0.601	0.494
$\mathbb{P}(\text{rack } A \text{ alone})$	—	0.489
$\mathbb{P}(\text{rack } B \text{ alone})$	—	0.478
$\mathbb{P}(\text{both})$	—	0.016
$\mathbb{P}(\text{neither})$	—	0.017
physics solves	3	1 500

racks at 303.9 kelvin — which is itself the tell, since the truth has them at 299.8 and 306.7. The Gaussian’s answer is a physically valid state. It is just not a state anyone believes in.

21.5 What surprised

The correlation is right and the report is wrong. It would be comfortable to say the Gaussian route simply failed. It did not fail at the inference; the -0.66 correlation is the exact statement that the reading constrains the sum and not the difference, and the sum’s spread of 81.4 watts is correct. What failed is the last step, where a two-dimensional Gaussian is reported one marginal at a time. Marginalizing a bimodal joint through a unimodal family is where the information is lost, and it is lost at the point of reporting, not at the point of solving. Chapter 7 warned that the Laplace approximation is a statement about curvature at a point; here the curvature at that point is fine and the point is wrong.

A symmetric question does not need a nonlinear model. The physics here is linear. Every closure is a conductance, every balance is a sum, and the solve is one linear system. The posterior is bimodal anyway, because the *prior* has two lobes and the likelihood is blind to the direction that separates them. Non-Gaussian posteriors are usually introduced through nonlinearity; this one needs none, and a reader who has been checking for curvature as the warning sign would have missed it.

Half the mass above a threshold is not half a fault. The per-rack marginal numbers, 0.506 and 0.494, are the most dangerous in the chapter. They invite the reading “both racks are equally suspect and neither is very suspect,” when the joint says the opposite: one of them is almost certainly at fault. Whenever a diagnosis is reported per component from a posterior that couples the components, the marginals can be individually unremarkable while the joint is decisive. The configuration masses — only *A*, only *B*, both, neither — are what an operator should be shown, and they cost nothing once the joint is in hand.

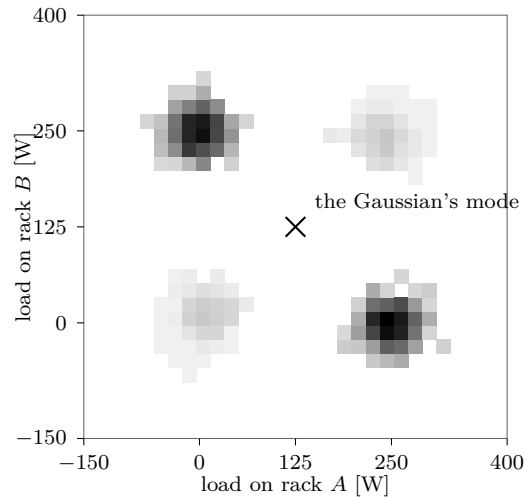


Figure 21.2: The joint posterior over both racks’ unmodeled loads, from the weighted draws. The mass sits in two lobes, one near (250, 0) and one near (0, 250); the cross marks the mode of the Laplace Gaussian, on the diagonal between them, where the sampled density is zero. Darker is denser, on a compressed grey scale.

Principle 21.1. *When two components enter a reading only through their sum, the posterior is bimodal and its Gaussian summary sits between the modes, at a configuration the prior may exclude. Report the joint by configuration — one, the other, both, neither — rather than one marginal per component. The Gaussian’s correlation is the warning sign: a strong negative correlation between two components’ estimates means the data fixed their sum and left their difference to the prior.*

21.6 Reproducing the run

The study runs in seconds and is deterministic at seed 7:

```
PYTHONPATH=src python docs/terra_graph_engine/case_studies/\
  level2_room_hall/bimodal_fault_isolation/run.py
```

It writes `results.json`, which carries the ranked estimates from both routes, the Laplace covariance, the configuration masses, and the binned posterior densities from which this chapter’s two figures are drawn. The chapter’s numbers, figures and table are then reproduced by

```
cd docs/books/datacenter && python scripts/ch21_two_racks.py
```

Two quantities in this chapter are computed by that script rather than read from the results file, and it prints both: the prior density at the Gaussian’s mode, and the Gaussian curve drawn in Figure 21.1. Each is evaluated from the committed prior in `results.json`, not typed in.

Notes and further reading

The bimodal posterior from a sum-only observation is the classic identifiability failure of diagnosis, and the reading of it as competing explanations rather than a compromise is de Kleer and Williams's [18]. The Laplace approximation and its behaviour at a point of low prior density are Tierney and Kadane's [101]; mixture priors and their posteriors are treated by McLachlan and Peel [68]. Importance sampling with the prior as the proposal, the effective sample size and the resampling threshold are Kong, Liu and Wong's [51] and Liu and Chen's [61]. The observation that the Gaussian route's correlation is correct while its marginals mislead is the study's, and is the reason this chapter reports configuration masses.

Chapter 22

Where the Gaussian band stops

Almost every number this book has produced came with a band around it, and almost every band came from the same construction: find the mode, take the curvature there, call the result a Gaussian. Chapter 6 showed that the construction is exact when the rows are linear, and Chapter 7 showed that it is an approximation when they are not. Neither said where the approximation stops being good enough to act on.

This chapter answers that, on a system chosen so the answer can be checked. One parameter, one reading: the exact posterior is a one-dimensional integral and can be computed to any accuracy wanted. Every band the Laplace construction produces is graded against it. The engine's own curvature self-check is graded too — the question is not only whether the band is wrong but whether the tool knows.

The study is `level2_room_hall/when_laplace_lies` in the repository, and every number below is read from its committed results by `scripts/ch22_laplace.py`.

22.1 The question

Equipment in a room dissipates a fixed heat and, on top of it, a leakage heat that grows with the equipment's own temperature. Hotter silicon leaks more, which heats it further; the effect is small at normal temperatures and is why thermal runaway is a real failure mode in integrated circuits rather than a theoretical one. A facility engineer who wants to know how close a room is to that mode has to estimate the leakage coefficient from temperature readings, and will be handed an estimate with a band.

The question is what that band is worth. Specifically: is the 95 percent band a 95 percent band; if it is not, which side is it wrong on; and does the tool that produced it say so.

22.2 The system

The room dissipates $Q_0 = 1$ watt plus a leakage $\alpha(T - T_s)$ that grows with its own temperature T , and loses heat to a cooling supply at $T_s = 300$ kelvin through a conductance $G = 2$ watts per kelvin. One balance row, one gradient closure, in the form of Chapter 1. Solving it gives a closed form:

$$T = T_s + \frac{Q_0}{G - \alpha}, \quad (22.1)$$

which is finite while $\alpha < G$ and has a pole at $\alpha^* = G = 2$ watts per kelvin. That pole is the runaway: at it, the leakage feeds itself exactly as fast as the cooling removes it, and no steady temperature exists. The model is nonlinear in the one place that matters, and the nonlinearity is a cliff rather than a gentle bend.

The leakage coefficient α is unknown and is estimated from a single room-temperature reading. The sweep sits at a true $\alpha = 1.75$ watts per kelvin, a prior of 1.55 ± 0.40 , and a room that settles at 304.0 kelvin. The lever arm there is $\partial T / \partial \alpha = Q_0 / (G - \alpha)^2 = 16$ kelvin per watt per kelvin: a good reading is worth a lot. The sensor's accuracy σ_T is swept from 0.05 to 1 kelvin, which is the range of real room sensors from a calibrated probe to a cheap one.

Because the model has one uncertain parameter and one reading, the exact posterior over α is available by quadrature. Everything below is graded against it.

22.3 Three things are computed at each point

The band. The MAP estimate of α and the Laplace standard deviation from the curvature of the objective at it, by Chapter 6's construction.

The self-check. The engine's curvature score, which probes the objective at ± 1 standard deviation along the band and measures how far the true curvature there departs from the quadratic the band assumes. It has a gate at 0.25: below it the band is reported as trustworthy, above it the band is flagged. A second check, the effective-sample ratio, has a threshold of 0.5. Both are computed at every point.

The truth. The exact posterior by quadrature, from which the study reads the exact standard deviation, the exact probability mass inside the nominal band, and the mass outside it on each side separately. A particle filter of 8 000 particles, with the room temperature integrated out for each, is run as an independent second reference.

22.4 Results

Figure 22.1 is the result. Table 22.1 gives it as numbers.

The self-check is right about where it stops. The score runs from 0.052 at the finest sensor to 2.90 at the coarsest, and crosses its gate exactly once, at $\sigma_T = 0.3$ kelvin. Where it passes, the nominal 95 percent band holds between 0.942 and 0.949 of the exact posterior's mass: correct to within half a point. Where it flags, the coverage falls away, to 0.931, then 0.916, then 0.873, then 0.813, and at a 1-kelvin sensor to 0.744. A band advertised at 95 percent that holds 74 percent is not a detail. The thing worth noticing is that the tool said so, one point before the coverage first slipped below 0.94.

The second check never binds. The effective-sample ratio's lowest value over the whole sweep is 0.705, against a threshold of 0.5. Had the curvature score not been computed, nothing would have fired.

The band errs on the safe side, and the study had to look to know. Coverage alone says a band is wrong; it does not say which way. Figure 22.2 splits the missing mass.

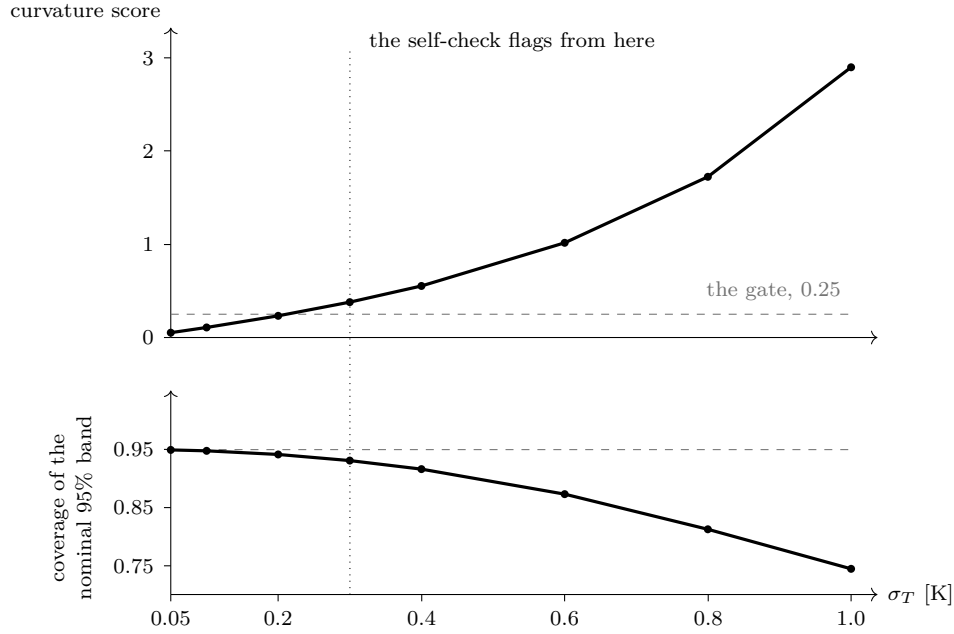


Figure 22.1: Top: the curvature self-check’s score as the sensor’s accuracy is degraded, against its gate of 0.25. Bottom: the exact probability mass the nominal 95 percent band actually holds, against that nominal value. The dotted line is the single place the score crosses its gate, at $\sigma_T = 0.3$ kelvin; it is also where the coverage begins to leave the nominal value.

Above the band — the direction of runaway — the exact mass is never more than 2.1 percent and falls to essentially zero at the coarsest sensor. Below the band it rises from 3.0 percent to 25.6. The exact posterior is skewed toward smaller α , and the Gaussian, being symmetric, must therefore put its upper end beyond where any mass is and its lower end short of where the mass reaches.

So the band is wrong, and it is wrong cautiously. It over-covers toward the cliff and under-covers away from it. An operator who reads the upper end of the band as “how close might we be to runaway” is not being misled into complacency; the true answer is further from the cliff than the band’s edge. An analyst who reads the lower end as “how small might the leakage be” is being misled, and that is the benign direction. It is worth saying plainly that this is a property of this pole and this skew, not a general licence: the sign of the skew is a fact about the model, and it should be checked and not assumed.

Proximity to the cliff is not what breaks the band. The tempting reading of Figure 22.1 is that the Laplace approximation fails near the nonlinearity. The near-runaway point refutes it. At $\alpha = 1.92$, four times closer to the pole than the sweep sits, with a 0.4-kelvin sensor — a sensor that *flags* in the sweep — the score is 0.141, the check passes, the band is 0.00256 watts per kelvin wide, and the exact posterior holds 0.947 of its mass inside it. A band ten times narrower than the sweep’s worst, five times closer to the cliff, and correct.

What orders every point is neither the sensor’s accuracy nor the distance to the pole but their ratio,

$$\kappa = \frac{\hat{\sigma}_\alpha}{\alpha^* - \hat{\alpha}}, \quad (22.2)$$

Table 22.1: Eight points of the sensor-accuracy sweep at $\alpha = 1.75$, and, below the rule, the near-runaway point at $\alpha = 1.92$ with a 0.4-kelvin sensor. *Coverage* is the exact mass inside the nominal 95 percent band and *below* is the exact mass below it; κ is the band’s width as a fraction of the distance from the estimate to the runaway pole.

σ_T [K]	score	self-check	κ	Laplace sd	exact sd	coverage	below
0.05	0.052	passes	0.013	0.00313	0.00313	0.949	0.030
0.10	0.108	passes	0.025	0.00625	0.00629	0.948	0.035
0.20	0.233	passes	0.050	0.01251	0.01281	0.942	0.047
0.30	0.379	flags	0.075	0.01880	0.01986	0.931	0.061
0.40	0.553	flags	0.100	0.02511	0.02779	0.916	0.079
0.60	1.016	flags	0.150	0.03787	0.04908	0.873	0.126
0.80	1.724	flags	0.201	0.05087	0.08537	0.813	0.187
1.00	2.898	flags	0.252	0.06421	0.13516	0.744	0.256
0.40	0.141	passes	0.032	0.00256	0.00258	0.947	0.038

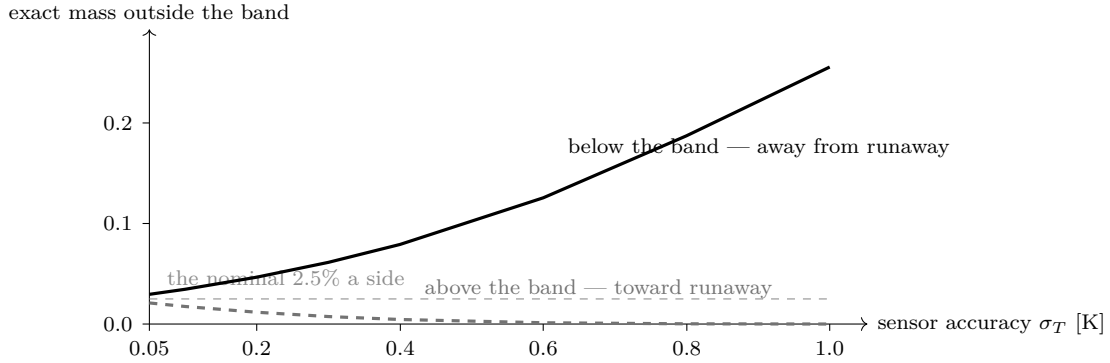


Figure 22.2: The exact posterior mass falling outside the nominal 95 percent band, split by side. Solid: below the band, away from runaway. Dashed: above the band, toward runaway. Each should be 2.5 percent. The mass above the band falls to nothing as the sensor is degraded; all of the failure is on the far side from the cliff.

the band’s own width measured in units of the distance left to the cliff. Sorted by κ , all nine points come out in increasing order of the curvature score, the sweep and the near-runaway point interleaved. The Laplace approximation is a local statement, and what makes it local enough is that the posterior’s spread does not reach the place where the physics changes character. A narrow band close to a cliff is fine. A wide band far from one is not.

A degenerate sampler is still a usable reference. The particle filter’s mean is within 0.19 of an exact standard deviation at all nine points and its width within 6 percent: at the finest sensor it gives 1.74967 against an exact 1.74987, and at the coarsest 1.66320 against 1.66395. It reaches that while being, as a sampler, in bad shape — at its worst only 1.75 percent of the 8000 particles are distinct after weighting, which is the degeneracy that Chapter 9 warned of and that the literature on high-dimensional filtering treats as disqualifying. Both things are true at once. The filter cannot be trusted to describe the shape of this posterior, and it can be trusted to locate its mean and width, because those summaries need far fewer effective samples than the

shape does. Which summary is being asked for decides whether a degenerate sample is usable.

The verdicts do not depend on the units. The whole study was re-run at ten times the heat, ten times the sensor noise and ten times the closure tolerance. Sixty-three continuous metrics agree to a relative 10^{-6} , and every verdict and every count is identical. The self-check is measuring the shape of the objective and not the scale of the numbers in it, which is what a check of this kind has to do to be portable between a rack and a campus.

22.5 What surprised

The gate is in about the right place, which was not guaranteed. A threshold of 0.25 on a curvature score is a convention, not a derivation. It could easily have fired two points early, costing an analyst the use of a perfectly good band, or two points late, which is worse. On this system it fires one point before coverage first drops below 0.94 and four points before the band becomes badly wrong. That is a single system and not a proof, and the honest statement is that the gate was calibrated on problems like this one and behaves on this one; a reader porting the check to a different kind of nonlinearity should re-grade it against an exact posterior, which is what this study is a template for.

Coverage is the wrong single number. The natural summary of a band's quality is the mass it holds. It hides the thing an operator needs, which is the direction of the error. Two bands both holding 87 percent, one missing its mass toward the cliff and one away from it, are not equally safe, and only the second is reportable without comment. Wherever a consequence has a dangerous direction, the tails should be reported separately.

The model that breaks the approximation is one row. There is no network here, no regime, no discrete state — one node, one balance, one closure, one parameter. The entire difficulty comes from the fact that $1/(G - \alpha)$ has a pole, and it is enough to turn a 95 percent band into a 74 percent band. The complexity that threatens a Gaussian summary is not the size of the model.

Principle 22.1. *A Laplace band is trustworthy when its own width is small against the distance to the nearest place the physics changes character, and the ratio of the two, not either alone, is what predicts it. Grade a band by the mass it holds on each side: a band can be badly wrong and still be safe, or nearly right and dangerous, depending on which tail it misses.*

22.6 Reproducing the run

The study is deterministic; the self-check uses seed 0 and the particle filter seed 1.

```
PYTHONPATH=src python docs/terra_graph_engine/case_studies/\
  level2_room_hall/when_laplace_lies/run.py
```

It writes `results.json`, which carries every fitted band, every self-check score, the exact posterior's moments and per-side tail masses at each point, the particle-filter reference and the ten-times-scale comparison. The chapter's numbers, two figures and table are reproduced by

```
cd docs/books/datacenter && python scripts/ch22_laplace.py
```

Notes and further reading

Thermal runaway from temperature-dependent leakage, and the pole that this chapter's model reduces it to, are Vassighi and Sachdev's [105]. The Laplace approximation and its use for posterior moments are Tierney and Kadane's [101]; its nested and integrated forms, which handle exactly the case where one parameter's posterior must be integrated rather than approximated, are Rue, Martino and Chopin's [89]. Measuring the nonlinearity of a fit by the curvature of its objective, which is what the self-check does, goes back to Bates and Watts [5]. The effective sample size is Kong, Liu and Wong's [51], and the degeneracy of particle filters in high dimension, which this chapter meets in a mild form and survives, is Snyder, Bengtsson, Bickel and Anderson's [94]. The ratio κ of a band's width to the distance to the pole, and the finding that the band's failure is one-sided and on the safe side, are the study's.

Chapter 23

The expensive chiller nobody sees

A chiller plant that is losing efficiency costs money every hour and announces itself to no one. Its power meter reads whatever the weather and the load ask of it, and both of those move more than the degradation does. This chapter is the case where the meter reads *down* by seventeen percent while the machine has lost twenty-one percent of its efficiency, and where a model with one fitted parameter per window recovers the loss and prices it.

It is also the chapter where the diagnosis has to argue with itself. The detection statistic comes out at fifty-nine standard errors, which is the kind of number that should make a reader suspicious rather than confident, and the study spends most of its effort establishing what that number does and does not measure.

The study is `level2_room_hall/cop_drift` in the repository, and every number below is read from its committed results by `scripts/ch23_cop_drift.py`.

23.1 The question

A facility has ten days of hourly plant power from the spring and ten days from the autumn. Between them the weather has cooled and the IT load has fallen. Has the plant degraded, by how much, and what is it costing?

The difficulty is that every quantity in the question moves at once. Chiller power depends on the load it is carrying and on the temperature of the water it rejects heat to, and it depends on both strongly and nonlinearly. Two windows of telemetry differ in the weather, the load, the staging, and — possibly — the machine. A comparison of means confounds all four.

23.2 The plant

Two water-cooled positive-displacement units of 100 kilowatts each, 28.43 tons apiece, which puts them in the smallest size bin the efficiency code treats. Each is anchored at the *least* efficient machine the code's prescriptive path allows for that size: a full-load coefficient of performance of 5.577 and a part-load value of 5.861. That choice is deliberate and conservative, and \$23.5 returns to it. The plant stages the second unit in at ninety percent of the first's capacity, and the chilled water leaves at 279.82 and returns at 285.37 kelvin.

The plant's law is a closure in the sense of Chapter 1: the electrical power a unit draws is a property of its load fraction and its condenser-water temperature, through three loss coefficients whose product with a scale factor sets the machine's losses. There is one free parameter, the *loss*

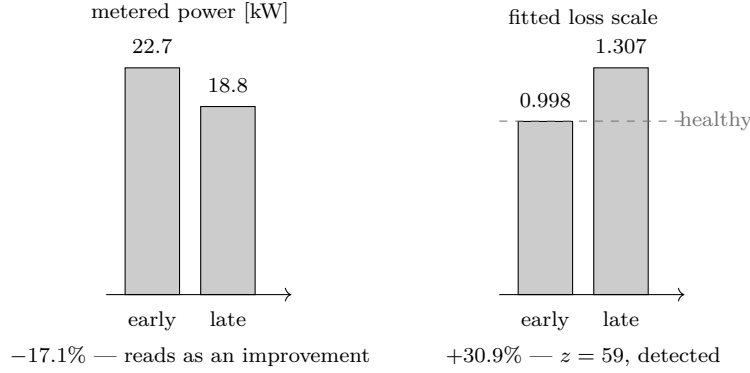


Figure 23.1: The same two windows of telemetry, read two ways. Left: mean metered power, which falls. Right: the loss scale fitted to each window against the plant’s own law, which rises. The dashed line is a healthy machine.

scale: the factor multiplying the three coefficients together. A healthy machine has a loss scale of one.

The early window is hot and heavily loaded: condenser water at 299.23 ± 4 kelvin, the plant at 0.65 ± 0.10 of capacity. The late window is milder and lighter: 293.23 ± 4 kelvin and 0.50 ± 0.10 . Each is 240 hourly readings with four percent relative meter noise. Between the windows the machine loses 21 percent of its mean efficiency, which the study places and the inference is not told.

23.3 Method

One parameter is fitted per window — the loss scale — to that window’s 240 power readings, by weighted least squares with relative weights, giving 239 degrees of freedom. The detection statistic is the signed difference of the two fitted scales in units of their combined standard error:

$$z = \frac{\hat{s}_{\text{late}} - \hat{s}_{\text{early}}}{\sqrt{\hat{\sigma}_{\text{late}}^2 + \hat{\sigma}_{\text{early}}^2}}, \quad (23.1)$$

with a verdict of *borderline* above two and *detected* above five.

That is the whole construction, and it is worth naming what it is doing. Chapter 12 treated a fault as a latent variable fitted against the physics rather than a threshold on a reading. Here the latent variable is the machine’s loss scale, the physics is the plant law with its load and temperature dependence, and the point of carrying the physics is that it *explains away* the weather and the load so that what is left is the machine.

23.4 Results

The meter has the sign wrong. Mean power falls from 22.689 to 18.813 kilowatts, 17.08 percent. Read on its own, that is a plant that has improved, and a dashboard that plots power against time will say so for as long as the seasons cooperate.

One parameter per window recovers the machine. The early window fits a loss scale of 0.99829 ± 0.00349 , which is 0.49 standard errors from healthy — the method finds nothing wrong where there is nothing wrong. The late window fits 1.30726 ± 0.00388 , which is 0.35 standard errors from the scale actually placed. The drift is 30.95 percent in the loss scale, and translated back into efficiency it is a fitted mean coefficient of performance falling from 6.949 to 5.487: 21.04 percent lost, against a placed 21.

The healthy plant cannot explain the late window. Take the early window's fitted plant and measure it against the late window's readings. The residual is 4031 watts root-mean-square, against 808 for the late window's own fit: a ratio of 4.99. And it is not noise — 3876 watts of it, ninety-six percent, is a signed under-prediction. The healthy machine is not merely a worse fit to the late data, it is wrong in one direction, which is the signature Chapter 4 taught to read.

The cost, with its caveat attached. The difference between the two fitted plants, evaluated at the late window's own operating hours, is 3.887 ± 0.066 kilowatts, which at twelve cents a kilowatt-hour is $\$4086 \pm 69$ a year. The study marks that figure *extrapolated* and says why: only 34.17 percent of the late window's hours lie inside the early window's operating box. The early fit is being asked about conditions it never saw. The number is the best available and it is not a measurement, and the distinction is Chapter 14's between a certified floor and an estimate.

23.5 What surprised

Fifty-nine standard errors is not the claim. A z of 59.18 invites the reading that the detection is overwhelming. It is not, and the study's central design decision is to say so. That z is computed from the meter's noise alone. It measures how precisely 240 readings pin one parameter, and with four percent noise and 239 degrees of freedom they pin it very precisely indeed. What it does not measure is whether the *plant law* is right. If the real machine's part-load curve has a different shape from the one fitted, the two windows sit at different load fractions and the fit will report a drift that is not there — and it will report it with the same tiny standard error.

So the study measures it. Fourteen alternative truths are built, each differing from the fitted law in one respect and each with zero degradation, and each is put through the same fit. Figure 23.2 shows what they report. A healthy machine whose part-load curve is a parabola reports +16.89 percent of drift at $z = +13.41$. A healthy plant that is one 200-kilowatt unit rather than two 100-kilowatt units reports +11.35 percent at +10.60. Both would pass any threshold on z .

The measured drift of 30.95 percent clears the largest of them by a factor of 1.83. *That* is the claim the design supports, and it is a factor of two, not a factor of fifty-nine. A reader who took the z at face value would have a false sense of the margin by more than an order of magnitude.

Where the model does not matter, and it is worth knowing which. Not every modeling choice is dangerous. The three chilled-water variants — the evaporator sensitivity divided by 1.7, divided by 3.1, and a constant-flow truth instead of a fixed entering temperature — move the fit by at most 0.05 percent. The result is not an artifact of how the evaporator side is modeled. It is sensitive to the part-load shape and the unit count, and those are the two things a facility should therefore establish from the nameplate rather than assume.

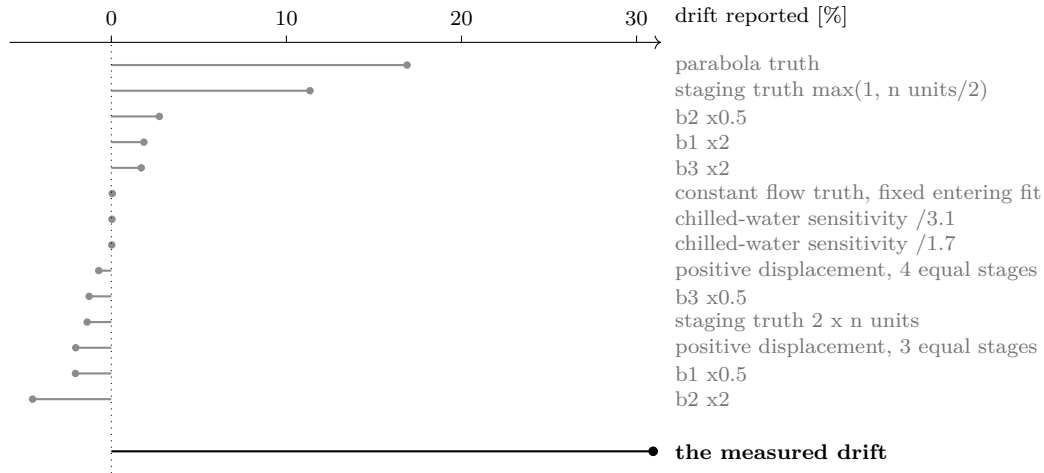


Figure 23.2: The drift reported by the same procedure on fourteen alternative machines, every one of them *healthy*: the truth differs from the fitted plant law in its loss ratios, its part-load shape, its evaporator sensitivity, its chilled-water model, its unloading or its unit count, and no degradation is placed. The heavy bar is the measured drift on the real case.

Table 23.1: The same procedure on progressively thinner evidence, and the thinnest case repeated over a thousand seeds. The verdict thresholds are $|z| > 2$ for borderline and $|z| > 5$ for detected.

case	hours	noise	efficiency lost	verdict
Easy	240	4%	21%	$z = 58.62$, detected
Moderate	96	6%	10%	$z = 10.27$, detected
Hard	48	8%	5%	$z = 1.28$, not enough evidence
the thinnest case over 1 000 seeds:				
borderline				79.2 percent of seeds
not enough evidence				17.9 percent of seeds
detected				2.9 percent of seeds
median $ z $				2.922

Detection weakens in the right order. Table 23.1 runs the same procedure on thinner evidence. Ten days, four percent noise and a 21 percent loss give $z = 58.6$. Four days, six percent noise and a 10 percent loss give 10.3, still detected. Two days, eight percent noise and a 5 percent loss give 1.28: not enough evidence, which is the correct answer rather than a failure. Repeating the thinnest case over a thousand seeds, 79.2 percent of them land borderline, 17.9 percent land at not enough evidence, and 2.9 percent detect — a median $|z|$ of 2.92. A method that reported *detected* on two days of eight-percent-noise telemetry after a five-percent loss would be the thing to distrust.

The verdicts survive the plant model. Forty-eight combinations of loss scale, staging rule, unit count, heat-sink floor and chilled-water model were scored against the same four cases. No verdict flips in any of them. The margin — how far the whole set of verdicts is from changing — falls from 0.989 to 0.869 at the worst corner, and what binds it throughout is not the detection but the thinnest case staying borderline. The fragile edge of this analysis is where it says *maybe*,

not where it says *yes*.

The conservative anchor cuts the right way. The plant was anchored at the least efficient machine the code allows. A reader might expect that to flatter the detection. It does the opposite: a less efficient machine has more loss to begin with, so a given fractional degradation is a smaller fractional change in the total power the meter sees. The anchor makes the problem harder, and it is the right default for a study whose conclusion is that the drift was found.

Principle 23.1. *A detection statistic computed from meter noise measures the meter, not the model. Before reporting it, run the same procedure on plausible alternative truths that are healthy, and report the margin over the largest drift they fabricate. Where a fitted difference is evaluated outside the conditions either fit saw, say that it is extrapolated and give the share of hours that lie inside.*

23.6 Reproducing the run

The study is deterministic at seeds 0, 100, 101, 102 and 0 through 999 for the thousand-seed repeat.

```
PYTHONPATH=src python docs/terra_graph_engine/case_studies/\
level2_room_hall/cop_drift/run.py
```

It writes `results.json`: both windows' fits, the held-out residuals, the cost with its extrapolation share, the fourteen alternative machines, the three thinner cases and the thousand-seed repeat, and the forty-eight-corner survival scan. The chapter's numbers, two figures and table are reproduced by

```
cd docs/books/datacenter && python scripts/ch23_cop_drift.py
```

Notes and further reading

Fitting one physical parameter per window and comparing the fits, rather than comparing the readings, is the model-based fault detection of Chapter 12 and of the building-systems literature reviewed by Katipamula and Brambley [46]. The plant law with three loss coefficients is the Gordon–Ng form [29]. The signed held-out residual as the signature of a wrong model rather than a noisy one is Chapter 4's. The practice of grading a detection statistic against the drift that alternative *healthy* truths fabricate, and of reporting the margin over the largest of them rather than the statistic itself, is the study's, and is the part of this chapter most worth carrying to another plant.

Chapter 24

When one explanation is not enough

Chapter 12 put competing explanations of a set of readings side by side and let the evidence rank them, with the Occam factor charging each hypothesis for the freedom it gave itself. Every example there had one thing wrong at a time. Plants do not oblige. This chapter is a cooling plant with two faults at once, where the best single explanation is plausible and incomplete, where the true pair of faults starts seventh of eighteen, and where two measurements chosen by the model itself move it to first.

It is also, deliberately, an unfair test. The telemetry that would confirm either fault directly is missing. The recovery model's water heat capacity is three percent away from the one the truth was generated with. And the two follow-up measurements, when they are taken, are wrong — one of them by three kilowatts out of twenty-four. The chapter is about whether a diagnosis survives that.

The study is `foundation_hvac/joint_fault_mismatch_diagnosis` in the repository, and every number below is read from its committed results by `scripts/ch24_joint_fault.py`.

24.1 The question

A chilled-water plant is carrying 880 kilowatts of load at 38 kilograms a second, and its chiller meter reads 181.1 kilowatts. Something in that set of numbers does not reconcile. An operator wants the explanation, and the explanations available are not all single.

Two faults are present. The return-temperature sensor reads 0.85 kelvin low — 284.018 kelvin against a true 284.868 — and the condenser is carrying an added heat-rejection penalty of 24 kilowatts. The chiller itself is healthy: its coefficient of performance is 5.6, its power meter is true, and nothing is bypassing.

That pairing is nasty for a specific reason. A return sensor reading low makes the water side look like it is carrying *less* heat than it is; a condenser penalty makes the machine draw *more* power than its load explains. Each partly conceals the other, and the combination looks, to a single-fault reading of the data, like a chiller that has simply lost efficiency.

24.2 The hypotheses

Eighteen hypotheses are carried. One is that nothing is wrong and the telemetry is noisy, which takes a prior of 0.25. Eleven are single faults: a degraded coefficient of performance, a condenser penalty, a biased return or supply sensor, a biased power or load meter, a pump drawing extra,

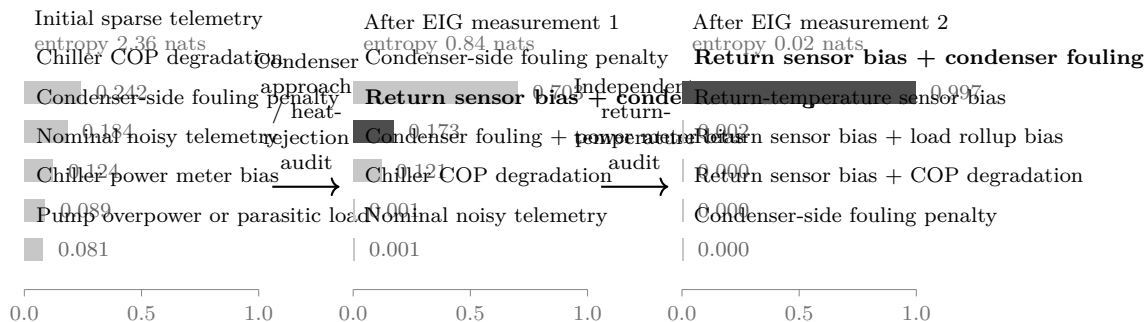


Figure 24.1: The posterior over the eighteen hypotheses at each phase, top five shown, with the true pair in black. It starts seventh, behind five single faults and nominal; the condenser audit lifts it to second; the return-temperature audit takes it to 0.997. The entropy below each panel is over the whole set.

a bypass, and so on. Six are *joint*: named pairs of the single faults, including the true one. The priors run downward in that order — nominal above single faults above pairs — which is the Occam factor of Chapter 12 made explicit in the prior rather than left to the evidence.

Each hypothesis is the plant’s balance and closure rows of Chapter 1 with one or two extra free variables attached, fitted against the available readings, and scored by its evidence times its prior. Nothing here is new machinery; what is new is that the set of candidates includes pairs.

24.3 Results

The single-fault baseline is plausible and wrong. Restricted to single faults, the ranking puts *chiller COP degradation* first at 0.275, condenser fouling second at 0.209, nominal third at 0.140, and a biased power meter fourth at 0.101. The recommended action is to inspect compressor efficiency and staging. The compressor is fine. An operator following that advice spends a maintenance visit on the one component that is working.

This is not a failure of the arithmetic. Given that exactly one thing is allowed to be wrong, a lost coefficient of performance genuinely is the best account of a plant drawing more power than its apparent load explains. The failure is in the hypothesis set.

Admitting pairs does not immediately help. With all eighteen hypotheses in play and only the initial sparse telemetry, the true pair ranks *seventh*, at 0.034. COP degradation still leads at 0.242, condenser fouling follows at 0.184, nominal at 0.124.

That is the Occam factor doing its job rather than failing. A pair of faults has two free amplitudes where a single fault has one, so it can fit anything a single fault can and more; the evidence integral charges it for that reach, and the prior charges it again. To come out ahead it must explain enough more to pay for both. On this data it cannot, because the readings that would separate the pair from its single-fault rivals have not been taken.

The posterior entropy is 2.355 nats over eighteen hypotheses, and the study marks the phase *low confidence*. It declines to recommend a repair. That refusal is the correct output and it is worth more than a confident wrong answer would be.

Table 24.1: The two follow-up measurements, each chosen by expected information gain over the leading eight hypotheses, and the state of the diagnosis after each. Both readings are imperfect: the condenser audit is off by three kilowatts and the return audit by four hundredths of a kelvin.

#	measurement	gain	noise	read	truth
1	Condenser approach / heat-rejection audit	0.511	4	21.000	24.000
2	Independent return-temperature audit	0.268	0.05	284.908	284.868
phase		entropy		the truth	
1	Initial sparse telemetry	2.3551		7 of 18, 0.0342	
2	After EIG measurement 1	0.8351		2 of 18, 0.1733	
3	After EIG measurement 2	0.0216		1 of 18, 0.9972	

The model chooses what to measure. Rather than guess, the diagnosis ranks candidate follow-up measurements by their expected information gain — the expected reduction in the posterior’s entropy, the construction of §11.7 — and takes the best.

The first is a condenser approach and heat-rejection audit, expected to be worth 0.511 nats. It reads 21.0 kilowatts of penalty against a true 24.0 — a measurement with a noise of 4 kilowatts, and it missed by three. That is enough. The posterior entropy falls from 2.355 to 0.835, the leading single fault becomes condenser fouling at 0.703, and the true pair rises from seventh to *second* at 0.173, with a second pair — condenser fouling plus a power-meter bias — third at 0.121. COP degradation, the single-fault baseline’s answer, collapses to 0.0009.

The second measurement is now the one that separates the three survivors: an independent return-temperature audit, worth 0.268 nats, testing whether the low return reading is real water or a biased sensor. It reads 284.908 kelvin against a true 284.868. After it, the true pair holds 0.997 of the posterior, the entropy is 0.022 nats, and the nearest rival — a return sensor bias alone — is at 0.002.

Over the three phases the true hypothesis gains 0.963 of posterior probability, from 0.034 to 0.997.

24.4 What surprised

Starting seventh is the system working. The instinct on seeing the truth ranked seventh is that the method has failed. It has not; it has correctly reported that the data available does not support a two-fault story. A diagnosis that put the true pair first on the initial telemetry would have been over-fitting, and would have put some *other* pair first on data where the truth was single. The measure of the method is not where it starts but that it refuses to act, names what to measure, and gets there in two readings.

The intermediate answer is wrong in an instructive way. After the first measurement the leading hypothesis is condenser fouling *alone*, at 0.703 — a confident, single, and incorrect answer. An operator who stopped there would fix a real fault and leave a biased sensor in place, and the plant would still not reconcile. The phase is not marked low confidence, because by its own lights it is not uncertain. The protection against stopping there is not the posterior’s width

but the fact that another measurement was still expected to be worth a quarter of a nat, and the discipline of taking it.

A mismatched model and imperfect readings did not break it. The recovery model uses a water heat capacity of 4.186 against the 4.05 the truth was generated with, a three percent error sitting directly in the water-side heat balance that both faults act on. The condenser audit missed by an eighth of the quantity it measured. The final posterior is still 0.997 on the correct pair. Diagnosis by ranked hypotheses is robust here in a way point estimation would not be, because a three percent bias in the physics shifts every hypothesis's fitted residual by roughly the same amount and largely cancels in the comparison. That is a property of the ratio, and it is the reason Chapter 12 ranks rather than estimates.

Principle 24.1. *Include joint faults in the hypothesis set and expect them to start low: a pair must explain enough more than a single fault to pay for its second unknown, and on sparse telemetry it usually cannot. When the posterior is flat, the output is not a repair but a measurement, chosen by expected information gain. Ranking hypotheses tolerates a biased model better than estimating a state does, because the bias largely cancels in the comparison.*

24.5 Reproducing the run

```
python docs/terra_graph_engine/case_studies/foundation_hvac/\
    joint_fault_mismatch_diagnosis/run.py
```

It writes `results.json` deterministically: the eighteen hypotheses with their priors, the single-fault baseline, the three posterior phases with their entropies, the expected-information-gain ranking at each phase, the measurements selected and the values they returned, and the truth held back for audit. The chapter's numbers, figure and table are reproduced by

```
cd docs/books/datacenter && python scripts/ch24_joint_fault.py
```

Notes and further reading

That a diagnosis may have to be a *set* of candidate explanations, and that multiple simultaneous faults are the hard case, is de Kleer and Williams's [18]; the building-systems review is Katipamula and Brambley's [46]. The evidence with its Occam factor, which is what charges a pair for its second unknown, is Chapter 12's and MacKay's [64]. Choosing the next measurement by expected reduction in posterior entropy is Lindley's [59] and is §11.7's. The observation that ranking tolerates a biased physics better than estimating does, because the bias largely cancels between hypotheses, is the study's.

Chapter 25

Telemetry you should not trust

Every chapter so far has taken the readings as given and asked what they imply. This one asks the prior question. A building's telemetry is a few dozen channels, each of which can drift, and a drifting sensor does not stop reporting — it reports a plausible number. The controls act on it, the dashboards show it, and nothing anywhere crosses a threshold.

The four corruptions in this chapter are all of that kind: each stays inside the normal operating band, and a threshold on the reading itself flags none of them. What catches all four is the question Chapter 4 taught to ask — not *is this reading unusual* but *is this reading consistent with what every other reading and the physics predict for it*.

The study is `level1_building/bad_sensor_trust` in the repository, and every number below is read from its committed results by `scripts/ch25_bad_sensor.py`.

25.1 The question

A two-room building of three racks a room carries fifteen sensors: rack temperatures, rack power meters, room supply temperatures, a building boundary temperature. One of them is wrong. Which, and does correcting it help?

Two things make the question harder than it looks. The first is that the building's real physics is not the model's: the truth is generated with perturbed rack loads, perturbed leakage, perturbed conductances and a perturbed boundary, and the recovery model knows none of that. Every sensor therefore disagrees with the model a little, and the corrupted one has to be found among that disagreement rather than against a clean baseline.

The second is that the corruptions are small on purpose. The largest is a building boundary temperature reading 0.80 kelvin high; the smallest is a room supply temperature 0.45 kelvin high. Neither leaves the band an alarm watches.

25.2 Four corruptions

- A *rack temperature* sensor reads 1 kelvin high, still inside the normal band. Its own noise is 0.12 kelvin.
- A *rack power meter* reports 10 watts of IT load that the thermal state does not support. Its noise is 1.2 watts.
- A *room supply temperature* drifts 0.45 kelvin high, below the alarm threshold. Its noise is 0.08 kelvin.

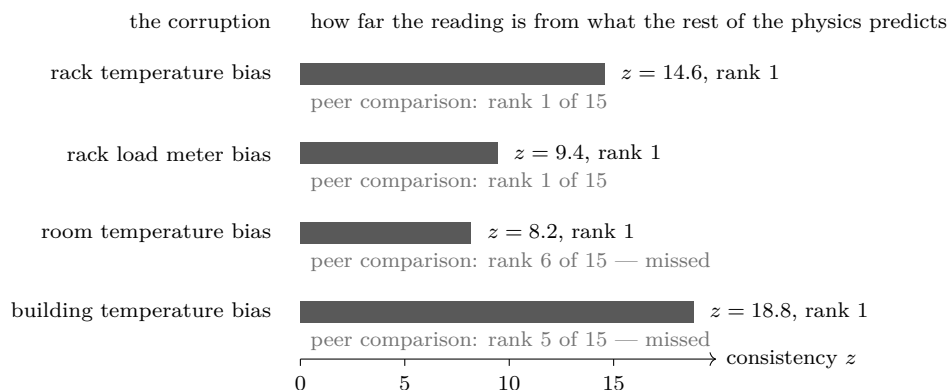


Figure 25.1: For each corruption, how far the corrupted reading is from what the rest of the physics predicts for it, and where the peer comparison ranks the same sensor among the fifteen. The physics ranks it first in all four; the peer comparison finds two.

- The *building boundary temperature* reads 0.80 kelvin high — enough to mislead the controls, not enough to trip anything. Its noise is 0.06 kelvin.

Each is run separately against the same building and the same fifteen sensors, and three routes are scored on each.

A threshold on the reading. The industry default: flag a channel when its value leaves a band.

Peer comparison. The better default: predict each sensor from its neighbours of the same kind — rack temperatures against other rack temperatures — and flag the one whose residual is largest in units of the spread. This is a real baseline, not a straw one, and it needs no physical model.

Physics consistency. Solve the building’s balance and closure rows of Chapter 1 with the sensor in question *withheld*, predict what it should read from everything else, and score the gap against the prediction’s own uncertainty. This is Chapter 4’s residual, computed one sensor at a time.

25.3 Results

The threshold finds nothing, in all four. No sensor is flagged by a band test in any scenario. That is the point of choosing corruptions this size, and it is what makes the case realistic: the corruptions that matter operationally are exactly the ones that stay in range, because the ones that leave it are already caught.

The physics ranks the corrupted sensor first, in all four. Table 25.1 gives the numbers. The consistency scores are 14.6, 9.5, 8.2 and 18.8 standard deviations; the weakest of the four is eight. In every case the corrupted channel is first of fifteen, and by a wide margin.

Table 25.1: The four corruptions. *Residual* is the gap between what the sensor read and what the physics predicts for it from the other fourteen; *z* scores that gap against the prediction’s uncertainty. The lower block gives the state cost with every sensor trusted against the cost after the suspect is corrected, and where a peer comparison ranked the same sensor.

corruption	placed	noise	residual	<i>z</i>	rank
rack temperature bias	+1.00	0.12	+1.748	14.56	1
rack load meter bias	+10.00	1.2	+11.334	9.45	1
room temperature bias	+0.45	0.08	+0.654	8.17	1
building temperature bias	+0.80	0.06	+1.129	18.82	1
corruption	state cost, trusted	corrected	peer rank		
rack temperature bias		199.5	93.4		1
rack load meter bias		156.8	112.2		1
room temperature bias		143.0	109.6	6 (missed)	
building temperature bias		274.9	97.8	5 (missed)	

Peer comparison finds two of four, and misses the two that matter most. On the rack temperature and the rack power meter, the peer baseline ranks the corrupted sensor first — there are five other racks to compare against, and the corrupted one stands out. On the room supply temperature it ranks the culprit *sixth*, and on the building boundary temperature *fifth*.

The reason is structural and worth stating. Peer comparison needs peers. A rack temperature has five; a room supply temperature has one; a building boundary temperature has none. The sensors with no peers are exactly the ones highest in the hierarchy, which are exactly the ones whose drift propagates furthest — a boundary temperature reading high biases every room and every rack beneath it. The method that works on the cheap sensors fails on the expensive ones.

The physics has no such gap, because a sensor’s peers, for its purposes, are every other sensor in the building. The building boundary temperature is predicted from the rooms and the racks through the conductances that join them, and it scores 18.8 — the highest of the four — precisely because so much sits downstream of it.

Correcting the suspect improves the state, in all four. The test that keeps this from being a ranking exercise. Solve the building with every sensor trusted, and measure the distance from the true state; then solve it again with the top suspect’s reading corrected to what the physics predicts, and measure again. The cost falls in every scenario: 199.5 to 93.4, 156.8 to 112.2, 143.0 to 109.6, and — the boundary sensor — 274.9 to 97.8. The corrupted sensor’s own error falls too, in the last case from 0.77 to 0.36 kelvin.

That the boundary case both scores highest and gains most from correction is one fact seen twice. A sensor with much downstream of it is easy to catch and expensive to leave alone.

25.4 What surprised

A wrong model still localizes the fault. The recovery model is wrong about the rack loads, the leakage, the conductances and the boundary, all at once. It nonetheless ranks the corrupted sensor first in every scenario at eight standard deviations or better. The reason is that a modeling error is spread across the whole graph, raising every sensor’s residual a little, while a corrupted sensor is a single channel disagreeing with the consensus of all the others. Those two

failures have different shapes, and the shape is what the ranking reads. Chapter 4 made that argument; here it is measured against a model that is wrong in four ways at once.

The correction is not the truth, and still helps. The physics predicts the boundary temperature to within 0.36 kelvin of the truth, against the 0.77 the corrupted sensor was reporting. It is not right. It is less wrong, and substituting it more than halves the state cost. An operator does not need the physics to be a better sensor than a good sensor; they need it to be a better sensor than a broken one, which is a much lower bar and the one that matters when a channel has drifted.

The method's cost is one solve per sensor. Nothing here needs a special algorithm. Withholding a reading and predicting it is the conditioning of Chapter 3, and fifteen of them is fifteen solves of a building that solves in milliseconds. The reason this is not standard practice is not that it is expensive.

Principle 25.1. *A sensor is suspect when the rest of the physics predicts a different value for it, not when its own value is unusual. Rank every channel that way and the corrupted one comes first even when the model is wrong in several places, because a model error lifts all the residuals and a bad sensor lifts one. Peer comparison degrades exactly where the hierarchy is thinnest — the boundary sensors, which have no peers and the most downstream of them.*

25.5 Reproducing the run

```
python docs/terra_graph_engine/case_studies/level1_building/\
    bad_sensor_trust/run.py
```

It writes `results.json`: the four scenarios, each with the full fifteen-sensor consistency ranking, the peer-comparison ranking, what a threshold would have flagged, and the state cost before and after correction. The chapter's numbers, figure and table are reproduced by

```
cd docs/books/datacenter && python scripts/ch25_bad_sensor.py
```

Notes and further reading

Scoring a reading against what the rest of a physical model predicts for it is the gross-error detection of data reconciliation, whose treatment for process plants is Mah, Stanley and Downing's [65]; the building-systems literature is reviewed by Katipamula and Brambley [46]. The distinction between a residual that indicts one channel and one that indicts the model, which is what lets a wrong model still localize a bad sensor, is Chapter 4's. That peer comparison degrades toward the top of a hierarchy, where sensors have no peers and the most depends on them, is the study's.

Chapter 26

Which sensor to install next

Every chapter so far has taken the instrument set as given. §11.7 gave the construction that does not: the value of a reading is the uncertainty it removes, and it can be computed *before* the reading is taken, because the model knows what each hypothesis would predict and how far apart those predictions are.

This chapter puts that construction to two questions a facility actually asks. The first is operational — a diagnosis is stuck between three explanations; which single reading should be taken next? The second is capital — there is budget for four permanent sensors in a new building; where do they go? In both cases there is an obvious answer that an experienced engineer would give, and in both cases the computed answer is different and better. In the second the obvious answer is worse than choosing at random.

Both studies live under `level1_building/` in the repository: `active_sensing` and `sensor_placement_optimization`. Every number below is read from their committed results by `scripts/ch26_which_sensor.py`.

26.1 Which reading to take now

A building of four zones, four racks a zone at 400 watts, cooled to 290-kelvin chilled water. The instruments are a temperature sensor in each zone’s air and one on the building — five channels, none of them inside a zone. That is a realistic starting point, because zone and building sensors come with the building and rack sensors do not.

Zone B is running warm. Three explanations are on the table: its cooling unit is derating, its racks are carrying an unmodeled load, or the whole plant has derated. The truth, which the diagnosis is not told, is that every rack in zone B carries an extra 250 watts.

The five readings in hand cannot separate the first two. The posterior is 0.460 on the cooling unit, 0.443 on the load, and 0.097 on the plant — an entropy of 0.944 nats over three hypotheses, which is close to the 1.10 of complete ignorance. Zone B’s air is warm under either story, and zone-B air is all anyone can see.

A portable sensor can be put on one rack. There are sixteen to choose from.

The ranking is not flat. Figure 26.1 gives the expected information gain of each. The best, a rack in zone B, is worth 0.743 nats. The worst, a rack in zone D, is worth 0.0044. The ratio is 169.

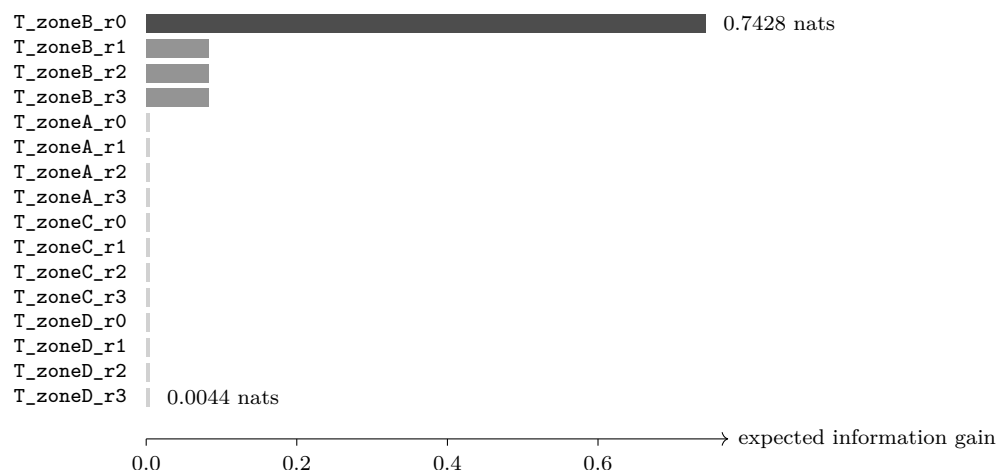


Figure 26.1: The sixteen candidate rack sensors, ranked by the information a reading from each is expected to remove. The best is worth 169 times the worst. The candidates fall into three flat tiers, and the tiers are the model’s structure rather than a property of the individual racks.

The reason is visible in what the hypotheses predict. For the best candidate, a derating cooling unit predicts 302.5 kelvin with a spread of 0.5, an unmodeled rack load predicts 319.5 with a spread of 6.3, and a plant derating predicts 301.6 with 0.2. Those are seventeen kelvin apart. For the worst candidate the three predictions are 301.423, 301.423 and 301.576 — indistinguishable at any sensor accuracy anyone would buy. A reading is worth what the hypotheses disagree about, not what it measures.

It is decisive, and the cheap alternative is not. Taking the best reading — 307.418 kelvin — moves the posterior to 0.9999999990 on the unmodeled load, 10^{-9} on the cooling unit and 10^{-24} on the plant. One reading, and the diagnosis is finished and correct.

Taking the worst reading — 301.599 kelvin — leaves the posterior at 0.461, 0.444, 0.095. It is the same uncertainty, having spent the same trip.

The tiers are structural. The sixteen candidates fall into three flat groups: one sensor alone, then the other three racks of zone B, then all twelve racks of the other zones. Within a group the gains are identical to the model’s tie tolerance. A reader tempted to ask *which* rack in zone B is best is asking a question the physics does not answer; what matters is which zone, and, inside zone B, whether the rack sits where the cooling unit’s derating and the load anomaly would show different temperatures. The ranking’s value is in the tiers, not in the order within them.

26.2 Which four to install

The second question is capital rather than operational. A building of three rooms, four racks each, is being instrumented. Sixteen fault terms are carried — one per rack, one per room, one for the building — each with a prior spread of 50 watts. Fifteen sensor positions are available and there is budget for four.

The positions are not equal, and not only in where they sit. A rack temperature sensor has

Table 26.1: Three placements of four sensors, and what each can say about a 250-watt fault placed afterwards. *Variance* is the fault terms’ total posterior variance in square watts, against 39 920 with no sensors at all; *covers* is whether the recovered interval contains the truth.

placement	the four sensors	variance	recovered [W]	covers
greedy	T_rk_0_0 T_rk_1_0	30 557	230.9 ± 13.8	yes
	T_rk_2_0 T_rk_0_1			
operator	T_room_0 T_room_1	37 450	1.5 ± 49.8	no
	T_room_2 T_rk_1_1			
random	T_rk_1_3 T_room_1	35 171	0.7 ± 49.9	no
	T_rk_2_0 T_room_2			
prior	no sensors	39 920	0.0 ± 50.0	no

an accuracy of 0.3 kelvin, a building sensor 0.5, and a room sensor 1.5 — room air is mixed and a single probe in it is a poor instrument. Those numbers are the study’s and they are realistic.

Three placements are compared. *Greedy* maximizes the variance removed, one sensor at a time, by the construction of §11.7. *Operator* is what an experienced engineer proposes: cover every room — a room sensor in each — and spend the fourth on a rack. *Random* draws four of the fifteen.

A 250-watt fault is then placed on one rack, *after* the placements are fixed, and each placement is asked to recover it.

Greedy buys rack sensors, one per room, then doubles up. Its picks are the rack sensors T_rk_0_0, T_rk_1_0, T_rk_2_0 and T_rk_0_1 — one in each room, then a second in room 0. It buys no room sensors at all. The first three picks are worth about 2 342 square watts each and the fourth 2 337, so the returns are nearly flat across the four; what is not flat is the gap to the alternatives, which after the first pick is 49 square watts, a factor of fifty.

Each pick is drawn from a large tie group — twelve candidates tie for the first, eight for the second — which is the same structural flatness §26.1 found. Which rack in a room is immaterial; that it is a rack and that it is in a room not yet covered is what the score is paying for.

The recovery separates them completely. Greedy recovers 230.9 ± 13.8 watts against a truth of 250, an interval of [204, 258] that contains it. The operator’s placement recovers 1.5 ± 49.9 — which is to say it recovers nothing, its interval [−96, 99] being the prior barely narrowed. Random recovers 0.7 ± 49.9 , the same.

In total fault variance: 39 920 square watts with no sensors, 37 450 with the operator’s four, 35 171 with random’s four, and 30 557 with greedy’s. Greedy removes 18.4 percent more of the remaining variance than the operator’s placement does and 13.1 percent more than random.

26.3 What surprised

The expert placement is worse than random. This is the finding worth carrying. The operator’s instinct — cover every room — is a good instinct about *coverage* and a bad one about *information*. A room sensor has five times a rack sensor’s noise and it sees only the sum of its four racks, so it can say that a room is warm and never which rack. Three of the operator’s four sensors are of that kind. Random, by drawing two rack sensors, accidentally did better.

The failure mode is not ignorance of the building. It is the substitution of a spatial heuristic — spread the sensors out — for the question actually being asked, which is what will be estimated from them. The two coincide often enough that the heuristic survives, and they come apart exactly when the instrument qualities differ, which is when it matters most.

Neither study’s answer needs the fault to exist yet. The greedy placement is computed from the model’s structure and the sensors’ noise alone. The 250-watt fault is placed afterwards, on a rack the placement did not know about. That is the property that makes this usable for capital planning: the value of a sensor is a function of the graph and the instrument, not of the fault that has not happened.

A hundredfold spread in value, over sensors that cost the same. The sixteen rack positions in the first study are physically identical channels on identical hardware. Their worth to the question being asked differs by a factor of 169. No procurement process that treats sensors as interchangeable can find that, and the computation that does find it costs one solve per candidate.

The ties are the useful output. Both studies produce large groups of exactly equivalent candidates. That is not a defect of the ranking; it is the most actionable thing in it. A recommendation of the form “any rack in zone B, and it does not matter which” survives contact with the fact that one of them is behind a locked cage and another has no spare port. A recommendation that named a single rack would have to be recomputed the moment it turned out to be inaccessible.

Principle 26.1. *The value of a reading is what the competing hypotheses disagree about at that location, divided by what the instrument can resolve, and it is computable before the sensor is bought. Rank the candidates and report the ties: the ranking’s content is which group a candidate falls in. Spatial coverage is not a proxy for information, and it fails hardest where the instruments differ in quality.*

26.4 Reproducing the runs

```
python docs/terra_graph_engine/case_studies/level1_building/\
    active_sensing/run.py
python docs/terra_graph_engine/case_studies/level1_building/\
    sensor_placement_optimization/run.py
```

The first writes the three hypotheses’ posteriors before and after each candidate reading, the full sixteen-candidate gain ranking with its tie groups, and what each hypothesis predicts at each candidate. The second writes the three placements, the greedy picks with the score and tie group at each step, and the recovered fault with its interval under each placement. The chapter’s numbers, figure and table are reproduced by

```
cd docs/books/datacenter && python scripts/ch26_which_sensor.py
```

Notes and further reading

Choosing an experiment by the expected reduction in the posterior's entropy is Lindley's [59], and the survey of Bayesian experimental design is Chaloner and Verdinelli's [14]. The variance-based form the greedy placement uses, and its submodularity — which is what makes greedy near-optimal rather than merely convenient — is Krause, Singh and Guestrin's [52]. The construction in the book's own terms is §11.7. That an experienced placement can fall behind a random one when the instruments differ in quality, and that the tie groups rather than the order are the actionable output, are the studies'.

Chapter 27

How much capacity can we actually use

A data center’s capacity is quoted as a number on a nameplate. The number that matters is a different one: the load at which something, somewhere, first stops the building — a breaker, a chiller, or one rack’s inlet temperature. This chapter is a building with 500 kilowatts installed that can safely use 250, where the thing that stops it is neither the electrical plant nor the cooling plant but a damper in one room, and where three of the four capital projects on the table would unstrand nothing at all.

The study is `level1_building/stranded_capacity`, and every number below is read from its committed results by `scripts/ch27_stranded.py`.

27.1 The question

An operator with 500 kilowatts of UPS nameplate and 234 kilowatts of IT load in the building wants to know how much more can be added. The finance department has a headroom number. It is $500 - 234$, scaled for efficiency: 266 kilowatts. On the strength of it, a room is being sold.

The question the physics answers is different: by what factor can the present load be scaled before *any* constraint in the building is violated, and which constraint is it? That is a single scalar — Chapter 13’s intervention, applied to every load at once — and everything else in the chapter follows from it.

27.2 The building

Three rooms of twelve racks. The electrical path is a 250-kilowatt UPS at 95 percent efficiency feeding three PDUs at 98 percent, rated 150, 105 and 150 kilowatts. The cooling plant is rated 350 kilowatts and delivers 316 at the design wet bulb of 294.15 kelvin, with chilled water at 290. Each rack’s inlet must stay below 310.15 kelvin.

One thing is not as designed. Room A’s dampers have degraded, so the airflow conductance at its racks is 550 rather than the design 900 watts per kelvin. Nothing about that is visible on any dashboard: the room is cooled, the racks are within limits, and the plant is not strained. Today’s load is 6.0, 7.0 and 6.5 kilowatts a rack in the three rooms, 234 kilowatts in all.

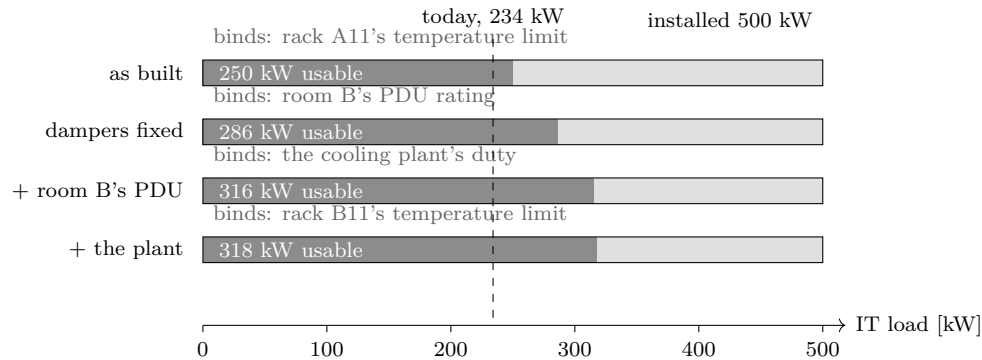


Figure 27.1: Usable IT load against the 500 kilowatts installed, as the binding constraint is removed one at a time. Each bar is labelled with what binds at that point. Fixing the dampers moves the limit from a rack in room A to room B's PDU; upgrading that PDU moves it to the plant; upgrading the plant moves it to a rack in room B, and there it stops.

27.3 Results

Half the building is stranded. Scaling every load together, the first constraint is violated at 1.0688 times the present load. Usable capacity is 250.1 kilowatts of an installed 500: 249.9 kilowatts, 49.98 percent, is stranded.

The binding constraint is T:A11 — the inlet temperature of one rack in room A, the room with the degraded dampers. The study verifies it by solving just below and just above the limit: at 0.999 of the critical scale the worst margin in the building is +0.0032 and the binding element is that rack; at 1.001 it is -0.0028 on the same rack. Nothing else is close.

When the building stops, the UPS still has 30.7 percent of its margin unused.

The dashboard is wrong by a factor of sixteen. The nameplate-minus-load headroom is 266 kilowatts. The true headroom — what can actually be added — is 16.1. The dashboard overstates it by 16.5 times.

That ratio is the chapter's operational point. The error is not a few percent of conservatism; it is an order of magnitude, and it points the wrong way. A building sold on 266 kilowatts of headroom will find the limit at 16.

Three of the four projects unstrand nothing. Table 27.1 prices each intervention applied on its own. Fixing room A's dampers is worth 36.4 kilowatts. Adding UPS capacity is worth 0.02. Upgrading room B's PDU is worth 0.000. Upgrading the cooling plant is worth 0.000.

The two capital projects — the plant and the PDU — add capacity to things that are not binding. Their return is exactly zero, and it is zero for a structural reason rather than a marginal one: the building is stopped by an air path in room A, and no amount of chiller or switchgear changes what that air path can carry.

But applied in order they are worth having. That is not an argument against them, and the ladder shows why. Fix the dampers and usable capacity rises to 286.5 kilowatts — and the binding element moves to room B's PDU. *Now* upgrade that PDU: 315.8 kilowatts, and the plant

Table 27.1: Each intervention applied alone, and then applied in the order the model recommends. The upper block is what a business case would compare; the lower is what actually happens, because each fix moves the binding constraint somewhere else.

applied alone	unstrands [kW]	usable [kW]	what binds after
fix the dampers in room A	36.367	286.473	room B's PDU rating
add UPS capacity	0.020	250.125	rack A11's temperature limit
upgrade the cooling plant	0.000	250.105	rack A11's temperature limit
upgrade room B's PDU	0.000	250.105	rack A11's temperature limit
applied in order			
+ fix the dampers in room A	36.368	286.473	room B's PDU rating
+ upgrade room B's PDU	29.353	315.826	the cooling plant's duty
+ upgrade the cooling plant	2.598	318.424	rack B11's temperature limit

binds. Now upgrade the plant: 318.4, and a rack in room B binds. Three interventions, 68.3 kilowatts unstranded, 27.3 percent more usable load, and the constraint moves three times.

Ranking interventions by what each is worth *alone* is therefore the wrong question asked in a defensible-looking way. Two of the four are worth nothing alone and a great deal in sequence. What the model provides that a spreadsheet cannot is the order, and the fact that the order changes what the next item is worth.

The last step is small, and says where to stop. The plant upgrade, third in the ladder, buys 2.6 kilowatts, because by then the limit has moved back to a rack temperature — this time in room B. The building's real ceiling is the air path at the racks, and the sequence has walked to it. A fourth project on the electrical or cooling plant would buy nothing again.

The answer does not move under perturbation. The degraded conductance is a modeled quantity and an operator will not know it exactly, so the study perturbs it by ten percent each way, and room B's PDU loading likewise. In all four perturbations the binding element is the same rack in room A. The stranded fraction moves between 47.0 and 53.3 percent. The number an operator would act on — *which* constraint binds — is stable; the number they would quote is stable to a few points.

27.4 What surprised

The constraint is invisible and cheap. Everything in this building that a capacity review would examine — the UPS, the PDUs, the chillers — is fine. The thing that halves the usable capacity is a damper. It costs almost nothing to fix and it is worth more than both capital projects put together. A review that works down a list of rated equipment cannot find it, because a damper has no rating to compare a load against; it is found only by solving the building and asking what binds.

Zero-return projects are not bad projects. It would be easy to read the ranking as an argument against the plant and PDU upgrades. The ladder says the opposite: in sequence they are worth 29.4 and 2.6 kilowatts. The lesson is about the evaluation, not the projects —

marginal value depends on what else has been done, and a portfolio of interventions evaluated independently will systematically misprice everything after the first.

Half the building, and the finance number said none of it. The gap between 266 and 16 kilowatts of headroom is not a modeling subtlety. Both numbers are defensible statements about a quantity called headroom; only one is about the building. The first differences two nameplates and the second solves the physics, and the whole of Part IV is the argument that the second is the one a decision needs.

Principle 27.1. *Usable capacity is the scale factor at which the first constraint binds, not a difference of nameplates, and the two can differ by an order of magnitude. Report which element binds, because that is what the intervention has to target, and price interventions in sequence rather than independently: each one moves the binding element, and the value of the next depends on where it moved to.*

27.5 Reproducing the run

```
python docs/terra_graph_engine/case_studies/level1_building/\
stranded_capacity/run.py
```

It writes `results.json`: the building's fixture, the critical scale factor and binding element with its verification just either side of the limit, the headroom comparison, each intervention priced alone, the ladder in sequence, and the four robustness perturbations. The chapter's numbers, figure and table are reproduced by

```
cd docs/books/datacenter && python scripts/ch27_stranded.py
```

Notes and further reading

Scaling every input together until a constraint binds is the loading parameter of continuation analysis, and the identification of the binding element with it is standard there. The reading of an intervention as a modification of the model rather than a conditioning on it, which is what lets a damper fix and a PDU upgrade be compared on the same footing, is Chapter 13's. That stranded capacity in real facilities is dominated by distribution and airflow rather than by plant, and that nameplate headroom overstates it, is reported across the industry literature; the contribution here is to compute which element binds and to price the interventions in the order that the binding element moves.

Chapter 28

What the graph is worth

Part III argued that the graph is not merely a way of drawing a model but the thing that makes it cheap to solve, and Chapter 18 measured the elimination width that makes the argument concrete. This chapter puts a number on the argument for a building, by solving the same facility two ways — once exploiting its block-and-interface structure and once ignoring it — from eight racks to a thousand and twenty-four.

It also corrects an earlier version of itself, and the correction is the more useful half. The first run of this study reported that structure bought a *scaling* advantage: near-linear against near-cubic, a factor that grew without limit. Sizing each network to its own load, as Chapter 1 requires and Chapter 4 checks, turned that into a bounded constant factor of twenty-seven. The drama was an artifact of unsized networks. What survives is smaller, true, and still worth having.

The study is `level1_building/graph_structure_scaling`, and every number below is read from its committed results by `scripts/ch28_structure.py`.

28.1 The question

A building's thermal model is a tree: racks inside rooms inside a building, each rack coupled to its room and each room to the building, and no rack coupled directly to any other. A solver that knows that can eliminate each rack's interior independently and solve only for what the racks share; a solver that does not know it factors one dense matrix over every unknown at once.

Both give the same answer. The question is what the first is worth, and — the part that turns out to matter — whether what it is worth grows with the building or settles at a constant.

28.2 The system

Four rooms, with the racks per room swept from two to two hundred and fifty-six: eight racks to 1 024, and 34 unknowns to 3 082. Each rack contributes three unknowns and one interface variable; each room two and two; the building two and one. Chilled water at 290 kelvin, a leakage of 0.1 watts per kelvin, a reference of 300.

Every network is sized for its own load. The rack power rises with the sweep, from 33.5 watts at the smallest size to 541.5 at the largest, and the conductances are set from the design rule — a rack at a twelve-kelvin rise, a three-kelvin approach across the room and building links — at every size separately. That sentence is the correction this chapter is built on, and §28.4 says what it replaced.

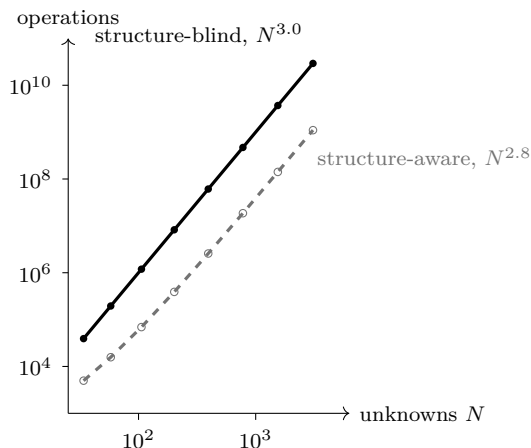


Figure 28.1: Operations for one solve, against the number of unknowns, both axes logarithmic. Solid: a dense factorization over every unknown at once. Dashed: eliminate each rack’s and room’s interior block, then solve on the interface. The gap widens and then stops widening.

Table 28.1: The same building solved two ways. *Interface* is the number of unknowns shared between blocks, *blocks* the number of independently eliminable interiors. The operation counts are for one solve; the ratio is bounded above by 27.

racks	N	interface	blocks	structure-blind	structure-aware	ratio
8	34	17	9	3.93×10^4	4.97×10^3	7.9
16	58	25	17	1.95×10^5	1.57×10^4	12.4
32	106	41	33	1.19×10^6	6.92×10^4	17.2
64	202	73	65	8.24×10^6	3.90×10^5	21.2
128	394	137	129	6.12×10^7	2.57×10^6	23.8
256	778	265	257	4.71×10^8	1.86×10^7	25.3
512	1546	521	513	3.70×10^9	1.41×10^8	26.1
1024	3082	1033	1025	2.93×10^{10}	1.10×10^9	26.6

28.3 Results

The two routes give the same answer. At every size, every unknown agrees to a relative 10^{-11} . Every solve is physical: at the largest size the racks sit between 292.7 and 306.2 kelvin against a limit of 320, and the heat balance closes to 5×10^{-15} . Newton converges in one iteration by either route, because the assembled network is linear.

That is the precondition for the whole comparison. A faster route that gave a different answer would be a different model.

The structure-aware route costs a bounded fraction. Table 28.1 gives the counts. At eight racks the blocked route costs 4974 operations against the dense route’s 39304: a factor of 7.9. At 1024 racks it is 1.10×10^9 against 2.93×10^{10} : a factor of 26.6.

The ratio rises and flattens: 7.9, 12.4, 17.2, 21.2, 23.8, 25.3, 26.1, 26.6 — converging on a bound of 27. Fitted over the sweep, the dense route scales as $N^{3.00}$, which is what a dense factorization does, and the blocked route as $N^{2.76}$. Those two exponents are close, and their closeness is the finding.

Why it is bounded, and when it would not be. The interface is 1 033 unknowns of 3 082 at the largest size: a third, and it stays a third as the building grows, because every rack added brings three unknowns and one interface variable with it. A block-and-interface solve costs roughly the cube of the interface plus the blocks' own work, so if the interface is a fixed fraction f of the unknowns the saving tends to $1/f^3$ — here 27, which is exactly the bound the study reports.

The saving becomes unbounded only when the interface is a *shrinking* fraction, which is what happens when a system grows by adding depth rather than width — more levels of hierarchy, more rooms per building rather than more racks per room. Chapter 17 is about the first case and this chapter's sweep is the second, and the difference between them is the difference between a constant factor and a scaling law.

28.4 What surprised

The exciting version of this result was an artifact. An earlier run of this study held the conductances fixed — 10 watts per kelvin at the racks, 50 at the rooms, 100 at the building — at every size in the sweep. As the racks per room grew, the same conductances had to carry more and more heat, and the solved networks got hotter: the screening pass recorded a hottest rack of 6 134 kelvin and a coldest of $-9\,876$, which is to say that at the larger sizes the model had gone past thermal runaway and was solving an equation with no physical solution.

On those networks the measured exponents were 0.73 for the structure-aware route and 2.2 for the dense one, and the structure-aware route was eleven to twenty-four times faster at 1 024 racks with the gap still widening. It made a much better story. It was a story about badly conditioned nonsense.

Sizing each network to its own load — the design rule of Chapter 1, applied before any timing — produced the bounded factor of twenty-seven reported above. Nothing about the solver changed. The published figures were superseded and the reason is recorded in the study's own results file, which is why this chapter can state it.

The check that would have caught it is the one the book already had. A hottest rack of 6 134 kelvin is not a subtle symptom. Chapter 4 says to check that a solved state is a physical state before reading anything off it, and the check is two comparisons against a limit. It was not run on the scaling sweep because the sweep was about *timing*, and timing feels like a question about the solver rather than about the model. It is not: a solver's cost depends on the conditioning of what it is given, and an unphysical network is badly conditioned in a way that flatters block elimination.

Operations are not wall-clock, and the study says which it measured. Everything above is an operation count, computed from the structure. The study's own verdict on the explicit block-and-interface implementation is that it is *overhead-bound* — it agrees to round-off and is slower than a good sparse factorization at these sizes, because a sparse solver's ordering heuristic already finds most of the same structure without the bookkeeping. The structural saving is real and a naive explicit implementation does not collect it. Where it does get collected is in the things a monolithic factorization cannot offer at all: reuse across a what-if sweep, a marginal covariance on one block, an incremental re-solve after a local change — which are Chapters 11 and 17's subject, not this chapter's.

Principle 28.1. *Exploiting a block-and-interface structure saves a factor that tends to the cube of the unknowns-to-interface ratio, and that ratio is a property of how the system grows: adding width keeps it fixed and buys a constant, adding depth shrinks it and buys a scaling law. Before timing anything, check that every network in the sweep is sized for its own load — an unphysical network is badly conditioned, and badly conditioned problems flatter structured solvers.*

28.5 Reproducing the run

```
PYTHONPATH=src python docs/terra_graph_engine/case_studies/\
  level1_building/graph_structure_scaling/run.py
```

It writes `results.json`: the eight sizes with their unknown, interface and block counts, the operation counts for both routes, the agreement between them, the physical checks at every size, and the record of the superseded run with the conductances that caused it. The chapter's numbers, figure and table are reproduced by

```
cd docs/books/datacenter && python scripts/ch28_structure.py
```

Notes and further reading

Eliminating independent interiors and solving on the interface is substructuring [33] and nested dissection [27], and its cost model in the book's own terms is Chapter 18's: the boundary dimension is what everything is paid in. That a sparse direct solver's ordering heuristic already recovers most of the same structure, so that an explicit implementation is overhead-bound at these sizes, is Chapter 17's observation and the study's measurement. The record of the superseded run, including the conductances that produced it and the temperatures that should have flagged it, is kept in the study's results file; the practice of keeping it there rather than deleting it is the repository's.

Chapter 29

Same heatwave, four resolutions

Chapter 17 showed that a facility can be modeled at several levels at once and that the levels agree, because the messages compose. This chapter asks the operational question that follows. Given one real event, what can an operator *do* at each level, what does it cost, and what does it miss?

The event is not constructed. It is ninety-six hours of the annual maximum heatwave over Santa Clara in October 2023, from reanalysis weather and the grid’s own load, and it drives one modeled facility four times. The four runs differ only in the resolution at which the telemetry is read and the action is taken. They produce four different decisions, and the worst of them is unsafe while the most expensive is not the safest.

The study is `level3_row_pod/four_resolutions`, and every number below is read from its committed results by `scripts/ch29_resolutions.py`.

29.1 The event and the facility

The weather window is the annual-maximum heatwave of 2023 at Santa Clara, ninety-six hours, peaking at a dry bulb of 36.7 degrees Celsius. The grid’s load over the window runs from 20 404 to 44 143 megawatts, and the facility’s own electricity price follows it. The rack inlet limit is 36.85 degrees.

The facility is two halls of three rows of five racks — thirty racks at 4.29 kilowatts — and four things about it are not nominal. Hall B’s room airflow is derated to 0.85. Row B3’s containment mixing is 0.45 and its rack conductance is derated to 0.60. Rack B3_r5 carries 1.7 times its neighbours’ load. And rack B3_r4’s temperature sensor reads 1.5 kelvin high.

Those four compound. At the peak, exactly one rack in the facility actually exceeds the limit: B3_r5. The telemetry reports two: B3_r5, which is real, and B3_r4, which is the biased sensor. Any resolution that cannot tell them apart will act on both.

29.2 What each resolution can see

- *L1, the building.* One number: the facility’s rack-mean temperature. It peaks at 33.15 degrees — comfortably under the limit. The violation is invisible.
- *L2, the hall.* The worst reported rack in each hall. It peaks at 39.12 degrees. The violation is seen; it can be localized to a hall, one of two.

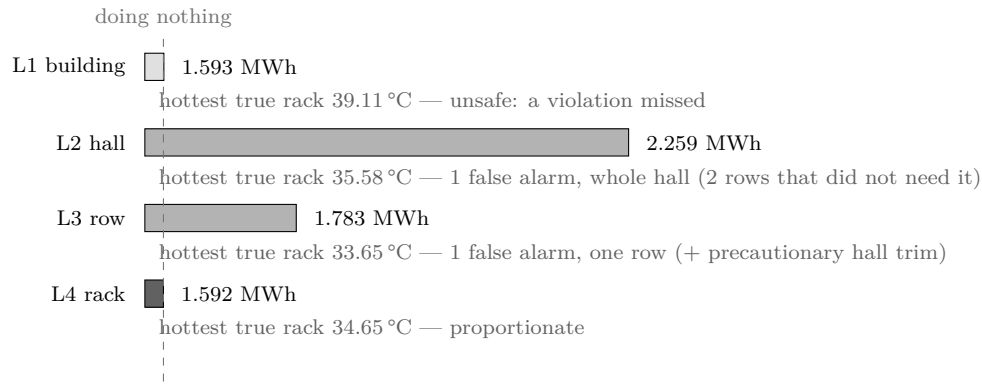


Figure 29.1: Cooling energy over the ninety-six hours under the action each resolution is capable of taking, with the hottest rack the facility actually reaches beneath it. The dashed line is the energy of doing nothing. The hall-level action costs forty-two percent more than the rack-level one and leaves the facility hotter.

- *L3, the row.* The worst reported rack in each row. Same peak, localized to a row, one of six.
- *L4, the rack.* Every rack, reconciled against the physics. Same peak, localized to a rack — and, because the reconciliation predicts each reading from the others, the sensor’s validity is established too.

The four see the same event through progressively finer cuts of the same graph. Nothing is added between them except resolution.

29.3 What each resolution does

L1 does nothing, and that is unsafe. The building mean reads under the limit, so nothing is automated. The hottest rack in the facility reaches 39.11 degrees, two and a quarter above its limit, and no one knows. One true violation missed.

L2 over-cools an entire hall. Hall B reports a hot rack and the only actuator at this resolution is the hall’s supply setpoint, so it is dropped by about 3.5 kelvin for the event. It works: the hottest true rack comes down to 35.58 degrees, under the limit. It costs 2.259 megawatt-hours against 1.591 for doing nothing, and two of the three rows it cooled did not need it. It also responds to the biased sensor, because at hall resolution there is no way to tell that B3_r4’s reading is not real.

L3 fixes the row, then hedges. Row B3 is identified as binding, and the action is to raise that row’s cold-aisle airflow to nominal. Much cheaper: 1.783 megawatt-hours. The hottest true rack falls to 33.65 degrees, the lowest of the four — because on top of the airflow fix, the still-unexplained B3_r4 reading forces a precautionary hall trim. One false alarm, and the hedge is what it costs.

L4 acts on one rack’s worth of airflow and rejects the alarm. Rack B3_r5 is identified as the only true binding asset, and B3_r4’s reading is rejected as a sensor bias — the physics

Table 29.1: The four resolutions on one event. *Peak seen* is the highest temperature the level’s telemetry reports; *hottest true* is what the facility actually reaches under that level’s action. The lower block gives the cooling energy and its excess over taking no action at all.

level	what it can localize	peak seen	hottest true	missed	false
L1 building	nothing	33.15	39.11	1	0
L2 hall	hall	39.12	35.58	0	1
L3 row	row	39.12	33.65	0	1
L4 rack	rack + sensor validity	39.12	34.65	0	0
level	action	energy [MWh]		against nothing	
L1 building	none	1.5928		+0.0000	
L2 hall	whole hall (2 rows that did not need it)	2.2590		+0.6681	
L3 row	one row (+ precautionary hall trim)	1.7826		+0.1910	
L4 rack	one row, sized to one rack	1.5922		+0.0000	

predicts what that rack should read from its neighbours, and it does not read that. The action is Row B3’s dampers to full, sized to protect B3_r5, with a blanking-panel reseal flagged to maintenance rather than automated. The hottest true rack is 34.65 degrees, under the limit. No violation missed, no false alarm.

It costs 1.5922 megawatt-hours. Doing nothing at all costs 1.5922. To four decimal places, acting correctly on this event is free.

29.4 What surprised

The expensive action is not the safe one, and the safe one is not free of cost — except that it is. The natural expectation is a trade: finer resolution costs modeling effort and buys safety, and broader action costs energy and buys safety too. The measurement does not line up that way. L2 spends 0.67 megawatt-hours more than L4 and ends up with a *hotter* facility, 35.58 against 34.65, because it applies a blunt instrument to the wrong place: lowering a whole hall’s supply temperature cools thirteen racks that were fine and only indirectly helps the one that was not, whereas opening one row’s dampers puts air exactly where the heat is.

The false alarm is a resolution failure, not a sensor failure. Every level has the same biased reading. Only L4 rejects it, and not because it has a better sensor — it has the same fifteen channels — but because at rack resolution the model can predict what B3_r4 should read from everything around it and compare. That is Chapter 25’s construction, and here it is worth about a third of a megawatt-hour of precautionary cooling. The cost of a bad sensor is paid by whoever cannot localize it.

L1 is not a worse model, it is a model with no actuator. The building-mean view is correct about the building mean. It reports 33.15 degrees and the building mean is 33.15 degrees. What it lacks is any quantity an operator can act on, so its recommendation is necessarily “nothing,” and the failure is not in its arithmetic but in the match between its resolution and the decision being asked of it. Chapter 17 said a level of description is a choice about what to carry; this is the operational form of that statement, and the cost of carrying too little is an undetected violation rather than an inaccurate number.

The ordering survives the plant model. The four policies were re-scored over 192 corners of the cooling plant — loss scale, staging rule, unit count, heat-sink floor, chilled-water model, load share. No conclusion flips in any of them. The margin falls from 0.120 at the registered corner to 0.061 at the worst, and the study’s two structural invariants — that the rack-level duty never exceeds the building-level duty at any step, and that its energy never exceeds the building level’s at any corner — hold throughout.

Principle 29.1. *The resolution at which a facility is modeled determines which actions exist, not merely how accurately the state is reported. A level that can detect a violation but not localize it must act broadly, which costs energy and responds to bad sensors it cannot identify; a level that can localize acts narrowly and can reject them. Choose the resolution from the actuators available, not from the telemetry.*

29.5 Reproducing the run

```
PYTHONPATH=src python docs/terra_graph_engine/case_studies/\
  level3_row_pod/four_resolutions/run.py
```

It writes `results.json`: the weather window with its source file and coordinates, the facility with its four injected asymmetries, the per-rack true and reported peaks, what each of the four resolutions can see and do, the cooling energy and outcome of each policy against a no-action baseline computed at the same level, and the 192-corner survival scan with its invariants. The chapter’s numbers, figure and table are reproduced by

```
cd docs/books/datacenter && python scripts/ch29_resolutions.py
```

Notes and further reading

That the levels of a hierarchy agree and compose is Chapter 17’s, and that a control acts at a port — which is what makes the available actuator a property of the resolution — is §17.5’s. Rejecting a reading by predicting it from the rest of the physics is Chapter 25’s. The finding that the broader action is both more expensive and less effective, and that the correct action on this event is free to four decimal places, is the study’s.

Appendix A

Notation

This appendix collects the book’s notation. Section A.1 states the conventions that hold throughout. Section A.2 lists the symbols by subject, each with its meaning and the place that introduces it. Section A.3 lists the letters that carry more than one meaning, and where each meaning applies. A symbol used in only one example, one proof or one closure is defined where it is used and is not listed.

A.1 Conventions

Type. Scalars are italic: z_k , σ , G . Vectors are bold lowercase, $\mathbf{z}$, $\mathbf{h}$, and matrices bold capitals, $\mathbf{J}$, $\mathbf{K}$; Greek vectors and matrices are bold as well, $\boldsymbol{\mu}$, $\boldsymbol{\Sigma}$, $\boldsymbol{\Lambda}$. A vector is a column, $\mathbf{z}^\top$ is its transpose, and $(\mathbf{a}; \mathbf{b})$ stacks two columns into one. $\mathbf{I}$ is the identity, $\mathbf{0}$ and $\mathbf{1}$ are the vectors of zeros and ones, and $\mathbf{e}_k$ is the k th unit vector. Calligraphic capitals are sets or objects built from sets: $\mathcal{N}$, $\mathcal{E}$, the manifold $\mathcal{M}$, the regime $\mathcal{R}_b$. $\text{diag}(\mathbf{w})$ is the diagonal matrix with $\mathbf{w}$ on its diagonal, and tr , $\det$, $\mathbb{E}$, Var and Cov are the trace, determinant, expectation, variance and covariance.

The unknowns and the rows. The unknowns of a model are stacked into one vector $\mathbf{z} \in \mathbb{R}^n$, flows first and potentials after: $\mathbf{z} = (\mathbf{q}; \mathbf{T})$ for the processor heat path of Example 1.1, and feeder flows before bus angles for the DC triangle of Example 1.2. When a later chapter frees an input of an example, the input is appended to the example’s $\mathbf{z}$, so the order a reader has learned is never changed. Flows first is an order for listing, not for elimination; Chapter 5 chooses elimination orders on other grounds. The residual $\mathbf{F}(\mathbf{z}) \in \mathbb{R}^m$ lists its rows in the order of §1.5: balances, edge closures, storage relations, freestanding closures, and boundary-condition rows. In an example the balance rows come first and the closure rows after, and the text says which is which.

Inputs and solved variables. The inputs $\mathbf{u}$ are the quantities a modeler places priors on; the solved variables $\mathbf{x}$ are the ones the physics then determines, through the solve map $\mathbf{x} = X(\mathbf{u})$ (§4.1). When the physics is linear the whole state is a linear image of the inputs, $\mathbf{z} = \mathbf{S}\mathbf{u}$ (§3.4).

Widths and weights. Every factor has a width σ , in the units of its residual, and a weight $w = 1/\sigma^2$; $\boldsymbol{\Omega}$ is the diagonal matrix of the weights of all factors (§6.1). A residual divided by its width is *standardized* (§3.3.1).

Gaussians. $\mathcal{N}(\boldsymbol{\mu}, \boldsymbol{\Sigma})$ is the Gaussian with mean $\boldsymbol{\mu}$ and covariance $\boldsymbol{\Sigma}$, and $\mathcal{N}(\mathbf{z}; \boldsymbol{\mu}, \boldsymbol{\Sigma})$ is its density at $\mathbf{z}$. The information form has precision $\boldsymbol{\Lambda} = \boldsymbol{\Sigma}^{-1}$ and information vector $\boldsymbol{\eta} = \boldsymbol{\Lambda}\boldsymbol{\mu}$ (equations (B.1) and (B.2)); a density written with $(\boldsymbol{\eta}, \boldsymbol{\Lambda})$ in place of $(\boldsymbol{\mu}, \boldsymbol{\Sigma})$ is marked as such where it appears. A covariance may be singular (Definition B.1).

Decorations. A prime marks the result of conditioning on readings: $\boldsymbol{\mu}'$ and $\boldsymbol{\Sigma}'$ are a posterior mean and covariance, and $\boldsymbol{\Sigma}''$ follows a second reading. A star marks a mode: $\mathbf{z}^*$ is the most probable state (§6.2) and $\mathbf{z}_a^*$ the mode of branch a . A bar marks either an imposed value, $\bar{z}_k$, or a sample mean, $\bar{G}_N$. In Chapter 16 a superscript counts time steps, $\mathbf{x}^n$, and the subscript $n+1 \mid n$ marks a prediction from the readings up to step n . Chapters 13 and 15 use the prime for other purposes, listed in Table A.7.

Drawings. In a factor graph, circles are variables and squares are factors; a dark square is a prior and an open square is a sensor (Figure 3.1).

Local symbols. The coolant loop of Example 1.3, the entries of Appendix D (§D.1) and the case studies of Part VI define symbols of their own where they use them. The case studies keep the book's symbols where the meaning is the same.

A.2 Symbols

Tables A.1 to A.6 give the symbols by subject, in the order the book introduces the subjects. The last column names the first place a symbol is defined; many are used throughout.

Table A.1: Graphs, sets and indices.

symbol	meaning	introduced
$\mathcal{N}, \mathcal{E}, \mathcal{D}$	nodes, edges, and conservation domains of a physical graph	§1.2
n, e, d	a node, an edge, a domain	equation (1.1)
$\mathcal{E}(n)$	the edges incident on node n	equation (1.1)
$A_{n,e}, \mathbf{A}$	incidence: +1 or −1 by the orientation of edge e at node n , 0 otherwise; one row per inside node	§1.2.3
$\mathbf{A}_b$	the incidence rows of the reservoirs	Example 1.1
reservoir, port	a node whose condition is imposed; a flow and potential pair at a boundary	§1.4, Table 1.3
$S, \partial S$	a set of inside nodes; the edges with one end in it	Proposition 1.1, equation (17.2)
N, E, S, Θ, C, R	counts of inside nodes, edge channels, storages, freed parameters, freestanding closures and boundary rows	Proposition 1.2
$\varphi_f, \mathbf{z}_f$	a factor and its scope, the variables it reads	§2.5
$\text{pa}(i)$	the parents of variable i in a directed graph	equation (2.1)
$x_1 \perp x_3 \mid x_2$	x_1 and x_3 are independent given x_2	equation (5.1)
A, B, S	sets of variables; S separates A from B	Definition 5.1
$\mathcal{C}$	the set of cut edges	Proposition 5.3
width, treewidth	the largest scope an elimination order creates, less one; its minimum over orders	Definition 5.2

Table A.1, continued

symbol	meaning	introduced
R_A	the variables of region A	§5.7
r, I_r, S	a region, its interior variables, the port set	§8.4
n_r, k_r, w_r	the interior variables, ports and elimination width of region r	§18.1

Table A.2: The physical model.

symbol	meaning	introduced
$X_{n,d}$	the extensive state of domain d at node n	equation (1.1)
$P_{d,e}$	the flow of domain d along edge e ; written Q for heat and F for DC power in the examples	equation (1.1)
$G_{n,d}, L_{n,d}$	a source and a loss at a node	equation (1.1)
$r(\mathbf{z}_{\text{loc}}; \theta) = 0, \theta$	a closure in residual form; its parameters	§1.3
$\mathbf{z} \in \mathbb{R}^n$	the unknowns, flows first	§1.5
$\bar{z}_k$	a value imposed at a reservoir	§1.5
$\mathbf{F}(\mathbf{z}) = \mathbf{0}, m$	the residual system; its number of rows	equation (1.7)
$\mathbf{J} = \partial \mathbf{F} / \partial \mathbf{z}$	the Jacobian	§1.5
$\mathbf{q}, \mathbf{T}, \mathbf{s}$	the heat flows, the node temperatures, and the sources at the inside nodes	Example 1.1
k, hA, T_a	a conductance; a convection coefficient times an area; the inlet-air temperature	Example 1.1
$\mathbf{K}$	the diagonal matrix of conductances or susceptances	equation (1.13)
$\mathbf{F}, \theta, B$	the feeder flows and bus angles of the DC triangle; a susceptance	Example 1.2
C	a heat capacity, in a storage row $E = C T$	§1.5, equation (16.3)
$\mathbf{u}, \mathbf{x}$	inputs; solved variables	§4.1
$X(\mathbf{u})$	the solve map from inputs to solved variables	equation (4.1)
$\mathcal{M}$	the constraint manifold, the states that satisfy the physics	equation (4.1)
$\mathbf{J}_x, \mathbf{J}_u$	the Jacobian's blocks for solved variables and for inputs	§4.1
$\mathbf{S}$	the linear map from inputs to unknowns, $\mathbf{z} = \mathbf{S}\mathbf{u}$	§3.4
$\boldsymbol{\lambda}$	the adjoint vector	§14.2
$\mathbf{F}(\mathbf{z}, \dot{\mathbf{z}}, t) = \mathbf{0}$	the differential-algebraic system	equation (16.2)

Table A.3: Probability and factors.

symbol	meaning	introduced
$p(\mathbf{z}), p(\mathbf{z}_1 \mathbf{z}_2)$	a density; a conditional density	§3.1
$\mathbb{P}, \mathbb{E}$	probability; expectation	Chapter 3
Z	the normalizer of a density	§3.1
$\mathcal{N}(\mu, \sigma^2)$	the Gaussian with mean μ and variance σ^2	equation (3.1)
π_j, μ_j, σ_j	a prior factor on z_j ; its mean and width	§3.2
φ_k, σ_k	a physics factor; its width	equation (3.3)

Table A.3, continued

symbol	meaning	introduced
y_i, z_{o_i}	a reading; the variable it observes	equation (3.5)
ν_i, σ_i	a sensor's noise; its accuracy, σ_y for a single reading	equation (3.5)
ℓ_i	the likelihood factor of reading i	equation (3.5)
a, q	the availability of a component, 0 or 1; its failure rate	equation (3.6)
$p(\mathbf{z} \mid \mathbf{y})$	the posterior	equation (3.7)
$\mathbf{y}, \mathbf{H}, \mathbf{R}$	the stacked readings, the sensor matrix, the noise covariance: $\mathbf{y} = \mathbf{H}\mathbf{z} + \boldsymbol{\nu}$	Proposition 3.2
$\mathbf{h}$	the sensor vector of one reading, $y = \mathbf{h}^\top \mathbf{z} + \nu$	Proposition 3.1
$\chi^2, m_g - n$	the misfit; its degrees of freedom	Proposition 12.1
Z_a, C_a	the evidence of branch a ; its objective	equations (7.1) and (7.2)
$\mathcal{R}_b, p_b(\mathbf{y})$	the region of input space where branch b holds; the branch's predictive density of the readings	Proposition 7.2
$\text{KL}(q \parallel p)$	the Kullback–Leibler divergence	Proposition 9.2, equation (B.12)
L, S, k	the number of components that can fail; a failure set; its size	§15.1
$\mathbb{P}(S), q_i$	the prior of a failure set; the failure probability of component i	§15.1, equation (15.1)

Table A.4: Linear-Gaussian inference.

symbol	meaning	introduced
$\boldsymbol{\mu}, \boldsymbol{\Sigma}$	a mean and a covariance	Proposition 3.1
$\boldsymbol{\Lambda} = \boldsymbol{\Sigma}^{-1}, \boldsymbol{\eta} = \boldsymbol{\Lambda}\boldsymbol{\mu}$	the precision; the information vector	Proposition 3.2
$\boldsymbol{\mu}', \boldsymbol{\Sigma}', \boldsymbol{\Lambda}', \boldsymbol{\eta}'$	the same after conditioning on readings	equations (3.9) and (3.10)
e, s	the innovation $y - \mathbf{h}^\top \boldsymbol{\mu}$; its predicted variance. Indexed e_i, s_i by reading and e_n, s_n by time step	Proposition 3.1
$\mathbf{k}, \mathbf{s}$	the gain of one reading; the vector $\boldsymbol{\Sigma}\mathbf{h}$	equation (11.1)
$\mathbf{S}, \mathbf{K}$	the innovation covariance $\mathbf{H}\boldsymbol{\Sigma}\mathbf{H}^\top + \mathbf{R}$ of several readings; their gain	equation (B.6)
$w, \boldsymbol{\Omega}$	a factor's weight $1/\sigma^2$; the diagonal matrix of weights	§6.1
$\mathbf{g}(\mathbf{z}), m_g, \mathbf{J}_g$	every residual stacked, physics, prior and sensor; its length; its Jacobian	equation (6.3)
$C(\mathbf{z})$	the cost, $\frac{1}{2}\mathbf{g}^\top \boldsymbol{\Omega} \mathbf{g}$, the negative log posterior up to a constant	equation (6.4)
$\mathbf{z}^*$	the most probable state	§6.2
δ	a Gauss–Newton step	equation (6.6)
$\nabla^2 C$	the Hessian of the cost	equation (6.7)
$\mathbf{L}$	the Cholesky factor, $\boldsymbol{\Lambda} = \mathbf{L}\mathbf{L}^\top$	§6.3
$\boldsymbol{\xi}$	a vector of independent standard normals	Proposition 6.4
$\mathbf{M}/\mathbf{D}$	the Schur complement of the block $\mathbf{D}$ in $\mathbf{M}$	Lemma B.4
$m_{x \rightarrow f}, m_{f \rightarrow x}$	sum-product messages	equations (8.1) and (8.2)
$\mathbf{S}_r, \mathbf{h}_r$	the precision and information of region r 's message on the ports	equation (8.5)
$\mathbf{X}$	the sensitivity of a region's interior to its ports	equation (8.6)
EIG	the expected information gain of a reading	equation (12.2)

Table A.4, continued

symbol	meaning	introduced
F , Q , w	the transition matrix, process-noise covariance and process noise of a linear dynamic model	Proposition 16.3

Table A.5: Time.

symbol	meaning	introduced
$t, t_n, \Delta t$	time; the n th time point; the step	§16.2
$X^n, \mathbf{z}^{n+1}$	a superscript counts time steps	equation (16.4)
$\mu_{n+1 n}, \Sigma_{n+1 n}$	the prediction of step $n + 1$ from readings to step n	equation (16.6)
$\log Z$	the evidence of a record of readings in time	equation (16.8)

Table A.6: Consequences and attribution.

symbol	meaning	introduced
$G(\mathbf{u})$	a scalar consequence of the physics as a function of the inputs	equation (10.1), §14.1
$C(S)$	the consequence of failure set S	§15.1
S_i	the first-order Sobol index of input i	§14.3
$L(\mathbf{u}), \mathbf{s}_j$	a cutting-plane surrogate below G ; a subgradient of G at census point j	equation (14.3), Proposition 14.2
PTDF, LODF	power-transfer and line-outage distribution factors	equation (15.2)

A.3 Letters with more than one meaning

A book that spans physics, probability and computation runs out of letters. Table A.7 lists the letters that carry different meanings in different places, with the scope of each meaning. Within a chapter a letter has one meaning unless the chapter says otherwise.

Table A.7: Letters with more than one meaning, and the scope of each.

letter	meanings and where they apply
$A, \mathbf{A}$	the incidence (Chapter 1 on); a generic matrix in lemmas and in Appendix B; sets or regions A, B (Chapters 5, 8, 13, 15); the area in hA
C	a heat capacity; a count in Proposition 1.2; the cost $C(\mathbf{z})$ of Chapter 6; the consequence $C(S)$ of Chapter 15; the census size in Chapter 14; the compression C_r of Chapter 18
$e, \mathbf{e}_k$	an edge (Chapter 1); the innovation (Chapters 3, 11, 16); the unit vector $\mathbf{e}_k$
$F, \mathbf{F}$	the residual $\mathbf{F}(\mathbf{z})$ throughout; the feeder flows F_e and $\mathbf{F}$ of DC networks; the transition matrix $\mathbf{F}$ of Proposition 16.3
$G, \mathbf{G}$	a source at a node, including the chain's heat source G in every chapter that uses the chain; the consequence $G(\mathbf{u})$ of Chapters 10 and 14 and the case studies; the laminar conductances $\mathbf{G}$ of Example 1.3; the blocks $\mathbf{G}_x, \mathbf{G}_u$ of Chapter 13
$\mathbf{g}$	the stacked residual of every factor, Chapter 6 on

Table A.7, continued

letter	meanings and where they apply
$h, \mathbf{h}$	the sensor vector $\mathbf{h}$ (Chapter 3 on); the convection coefficient in hA ; the region information $\mathbf{h}_r$ (Chapter 8); enthalpy in Appendix D; a step size in Chapters 10 and 14
$H, \mathbf{H}$	the sensor matrix; the Fisher information in Chapter 12; the entropy $H[p]$ of equation (B.11)
$J, \mathbf{J}$	the Jacobian throughout; a slope jump in Chapters 10 and 14; an interdiction objective $J(A)$ in Chapter 15
K, k	the conductance matrix $\mathbf{K}$ and a conductance k ; the gain $\mathbf{k}$ of one reading and $\mathbf{K}$ of several; the size k of a failure set (Chapter 15); the ports k_r of a region (Chapters 8 and 18); the number of inputs K in the case studies
$L, \mathbf{L}$	a loss at a node; the Cholesky factor $\mathbf{L}$; the number of components L (Chapter 15); the surrogate $L(\mathbf{u})$ (Chapter 14)
$P, \mathbf{P}$	a flow $P_{d,e}$; a bus injection; a projector
Q, q	a heat flow; the process noise $\mathbf{Q}$ (Chapter 16); the shed load Q of Chapter 15; a failure rate q ; the flows $\mathbf{q}$; a variational density q (Chapter 9); a nodal source q_n (Chapter 17)
R, r	the noise covariance $\mathbf{R}$; a count in Proposition 1.2; a residual r ; a region r (Chapter 8 on)
$S, \mathbf{S}, s$	a set of nodes (Chapter 1), of variables (Chapter 5), of ports (Chapter 8) or of failed components (Chapter 15); the map $\mathbf{z} = \mathbf{S}\mathbf{u}$; the innovation covariance $\mathbf{S}$ and variance s ; the region message $\mathbf{S}_r$; the Sobol index S_i (Chapter 14); the sources $\mathbf{s}$ of Chapter 1; the vector $\mathbf{s} = \mathbf{\Sigma}\mathbf{h}$ (Chapter 11); a subgradient $\mathbf{s}_j$ (Chapter 14)
$T, \mathbf{T}$	a temperature; the transpose
w	a weight $1/\sigma^2$; the width of an elimination order and w_r of a region; process noise $\mathbf{w}$ (Chapter 16); a scenario weight w_s (Chapter 15)
X, x	the extensive state $X_{n,d}$; the solve map $X(\mathbf{u})$; the variables X_i and scopes X_f of a generic graphical model in Chapter 2; the interior sensitivity $\mathbf{X}$ (Chapter 8); the solved variables $\mathbf{x}$, and the state $\mathbf{x}^n$ of Chapter 16
Z	a normalizer; the evidence Z_a of a branch or hypothesis
θ	the parameters of a closure; the bus angles of a DC network
ν	a sensor's noise
φ	a factor; a potential φ_i at a port (Chapters 5 and 17)
$\lambda, \rho, \varepsilon$	each is defined where it is used: λ the adjoint (Chapter 14), an eigenvalue, a scalar precision; ρ a correlation, a relative width, a spectral radius; ε a noise, a discarded weight (Proposition 9.3)
prime	a posterior (Chapters 3 and 11, Appendix B); a replaced mechanism or the intervened world (Definition 13.1); the post-outage flow F'_e and the reduced susceptance $\mathbf{B}'$ (Proposition 15.2)

Appendix B

Gaussian identities

This appendix collects the facts about Gaussian distributions that the book uses, each with a short proof. Most chapters need only a few of them, and the table in §B.8 says which chapter uses which. Where a chapter already proves an identity in the form it needs, the appendix states the identity and points to that proof. Every identity is checked numerically, on randomly drawn matrices, by the script `appB_gaussian_identities.py` in the book's `scripts` directory.

Throughout, $\mathbf{z} \in \mathbb{R}^n$, a covariance $\mathbf{\Sigma}$ is symmetric positive semidefinite, and a precision $\mathbf{\Lambda}$ is symmetric positive definite. Bold capitals are matrices, $\mathbf{I}$ is the identity, and `tr` and `det` are the trace and the determinant.

B.1 The two forms of a Gaussian

A Gaussian with mean $\boldsymbol{\mu}$ and positive definite covariance $\mathbf{\Sigma}$ has the density

$$\mathcal{N}(\mathbf{z}; \boldsymbol{\mu}, \mathbf{\Sigma}) = (2\pi)^{-n/2} (\det \mathbf{\Sigma})^{-1/2} \exp(-\tfrac{1}{2}(\mathbf{z} - \boldsymbol{\mu})^\top \mathbf{\Sigma}^{-1}(\mathbf{z} - \boldsymbol{\mu})). \quad (\text{B.1})$$

This is the *moment form*. Expanding the quadratic with $\mathbf{\Lambda} = \mathbf{\Sigma}^{-1}$ and $\boldsymbol{\eta} = \mathbf{\Lambda}\boldsymbol{\mu}$ gives the *information form* of Chapter 6,

$$\mathcal{N}(\mathbf{z}; \boldsymbol{\mu}, \mathbf{\Sigma}) = \exp(-\tfrac{1}{2}\mathbf{z}^\top \mathbf{\Lambda} \mathbf{z} + \boldsymbol{\eta}^\top \mathbf{z} - \kappa), \quad \kappa = \tfrac{1}{2}\boldsymbol{\eta}^\top \mathbf{\Lambda}^{-1} \boldsymbol{\eta} + \tfrac{n}{2} \log 2\pi - \tfrac{1}{2} \log \det \mathbf{\Lambda}. \quad (\text{B.2})$$

The two carry the same information. The moment form makes marginals and predictions easy, and the information form makes products and conditioning easy, which is the division of labour §B.3 makes precise.

Lemma B.1 (The Gaussian integral). *For $\mathbf{\Lambda}$ positive definite and any $\boldsymbol{\eta}$,*

$$\int_{\mathbb{R}^n} \exp(-\tfrac{1}{2}\mathbf{z}^\top \mathbf{\Lambda} \mathbf{z} + \boldsymbol{\eta}^\top \mathbf{z}) \, d\mathbf{z} = (2\pi)^{n/2} (\det \mathbf{\Lambda})^{-1/2} \exp(\tfrac{1}{2}\boldsymbol{\eta}^\top \mathbf{\Lambda}^{-1} \boldsymbol{\eta}).$$

Proof. Complete the square: with $\mathbf{m} = \mathbf{\Lambda}^{-1}\boldsymbol{\eta}$ the exponent is $-\tfrac{1}{2}(\mathbf{z} - \mathbf{m})^\top \mathbf{\Lambda}(\mathbf{z} - \mathbf{m}) + \tfrac{1}{2}\boldsymbol{\eta}^\top \mathbf{\Lambda}^{-1} \boldsymbol{\eta}$. Factor $\mathbf{\Lambda} = \mathbf{L}\mathbf{L}^\top$ by Cholesky and substitute $\mathbf{w} = \mathbf{L}^\top(\mathbf{z} - \mathbf{m})$, so that $d\mathbf{z} = d\mathbf{w}/\det \mathbf{L}$ and the quadratic becomes $\mathbf{w}^\top \mathbf{w}$. The integral of $\exp(-\tfrac{1}{2}\mathbf{w}^\top \mathbf{w})$ is a product of n one-dimensional integrals, each $\sqrt{2\pi}$, and $\det \mathbf{L} = (\det \mathbf{\Lambda})^{1/2}$. $\square$

The lemma is what normalizes equations (B.1) and (B.2), and it has a corollary used on almost every page of Part III: *a density whose logarithm is $-\tfrac{1}{2}\mathbf{z}^\top \mathbf{\Lambda} \mathbf{z} + \boldsymbol{\eta}^\top \mathbf{z}$ plus a constant is the*

Gaussian with precision $\mathbf{\Lambda}$ and mean $\mathbf{\Lambda}^{-1}\boldsymbol{\eta}$. To find a posterior, collect the quadratic and linear terms of its logarithm and read the two off.

A Gaussian need not have a density. When the physics is exact, as in the examples of Chapter 3, the unknown vector is a linear function of a few inputs, $\mathbf{z} = \mathbf{S}\mathbf{u}$, and its covariance $\mathbf{S}\boldsymbol{\Sigma}_u\mathbf{S}^\top$ is singular. The general definition goes through the moment generating function.

Definition B.1 (Gaussian vector). A random vector $\mathbf{z}$ is Gaussian with mean $\boldsymbol{\mu}$ and covariance $\boldsymbol{\Sigma}$, written $\mathbf{z} \sim \mathcal{N}(\boldsymbol{\mu}, \boldsymbol{\Sigma})$, if $\mathbb{E}[\exp(\mathbf{t}^\top \mathbf{z})] = \exp(\mathbf{t}^\top \boldsymbol{\mu} + \frac{1}{2} \mathbf{t}^\top \boldsymbol{\Sigma} \mathbf{t})$ for every $\mathbf{t} \in \mathbb{R}^n$. It has the density (B.1) exactly when $\boldsymbol{\Sigma}$ is positive definite.

For a positive definite $\boldsymbol{\Sigma}$ the definition agrees with the density: multiplying equation (B.2) by $\exp(\mathbf{t}^\top \mathbf{z})$ and integrating by Lemma B.1, with $\boldsymbol{\eta}$ replaced by $\boldsymbol{\eta} + \mathbf{t}$, gives the stated function. A moment generating function that is finite everywhere determines its distribution, so the definition names each Gaussian exactly once.

Lemma B.2 (Affine maps). If $\mathbf{z} \sim \mathcal{N}(\boldsymbol{\mu}, \boldsymbol{\Sigma})$ and $\mathbf{w} = \mathbf{A}\mathbf{z} + \mathbf{b}$ for an $m \times n$ matrix $\mathbf{A}$, then $\mathbf{w} \sim \mathcal{N}(\mathbf{A}\boldsymbol{\mu} + \mathbf{b}, \mathbf{A}\boldsymbol{\Sigma}\mathbf{A}^\top)$. In particular every block of a Gaussian vector is Gaussian, with the corresponding blocks of $\boldsymbol{\mu}$ and $\boldsymbol{\Sigma}$.

Proof. $\mathbb{E}[\exp(\mathbf{s}^\top \mathbf{w})] = \exp(\mathbf{s}^\top \mathbf{b}) \mathbb{E}[\exp((\mathbf{A}^\top \mathbf{s})^\top \mathbf{z})] = \exp(\mathbf{s}^\top (\mathbf{A}\boldsymbol{\mu} + \mathbf{b}) + \frac{1}{2} \mathbf{s}^\top \mathbf{A}\boldsymbol{\Sigma}\mathbf{A}^\top \mathbf{s})$. A block is the map $\mathbf{A} = \begin{pmatrix} \mathbf{0} & \mathbf{I} \end{pmatrix}$. $\square$

Lemma B.3 (Uncorrelated blocks are independent). If $(\mathbf{a}, \mathbf{b})$ is Gaussian and $\text{Cov}(\mathbf{a}, \mathbf{b}) = \mathbf{0}$, then $\mathbf{a}$ and $\mathbf{b}$ are independent.

Proof. With a zero cross-covariance the joint moment generating function is

$$\mathbb{E}[\exp(\mathbf{s}^\top \mathbf{a} + \mathbf{t}^\top \mathbf{b})] = \exp(\mathbf{s}^\top \boldsymbol{\mu}_a + \frac{1}{2} \mathbf{s}^\top \boldsymbol{\Sigma}_{aa} \mathbf{s}) \exp(\mathbf{t}^\top \boldsymbol{\mu}_b + \frac{1}{2} \mathbf{t}^\top \boldsymbol{\Sigma}_{bb} \mathbf{t}),$$

the product of the two marginal ones, which is the moment generating function of an independent pair. $\square$

B.2 Block matrices

Partition a square matrix as $\mathbf{M} = \begin{pmatrix} \mathbf{A} & \mathbf{B} \\ \mathbf{C} & \mathbf{D} \end{pmatrix}$. When $\mathbf{D}$ is invertible, the *Schur complement* of $\mathbf{D}$ in $\mathbf{M}$ is $\mathbf{M}/\mathbf{D} = \mathbf{A} - \mathbf{B}\mathbf{D}^{-1}\mathbf{C}$, and when $\mathbf{A}$ is invertible, the Schur complement of $\mathbf{A}$ is $\mathbf{M}/\mathbf{A} = \mathbf{D} - \mathbf{C}\mathbf{A}^{-1}\mathbf{B}$.

Lemma B.4 (Block factorization). If $\mathbf{D}$ is invertible,

$$\mathbf{M} = \begin{pmatrix} \mathbf{I} & \mathbf{B}\mathbf{D}^{-1} \\ \mathbf{0} & \mathbf{I} \end{pmatrix} \begin{pmatrix} \mathbf{M}/\mathbf{D} & \mathbf{0} \\ \mathbf{0} & \mathbf{D} \end{pmatrix} \begin{pmatrix} \mathbf{I} & \mathbf{0} \\ \mathbf{D}^{-1}\mathbf{C} & \mathbf{I} \end{pmatrix},$$

so $\det \mathbf{M} = \det(\mathbf{M}/\mathbf{D}) \det \mathbf{D}$, and when $\mathbf{M}/\mathbf{D}$ is invertible,

$$\mathbf{M}^{-1} = \begin{pmatrix} (\mathbf{M}/\mathbf{D})^{-1} & -(\mathbf{M}/\mathbf{D})^{-1}\mathbf{B}\mathbf{D}^{-1} \\ -\mathbf{D}^{-1}\mathbf{C}(\mathbf{M}/\mathbf{D})^{-1} & \mathbf{D}^{-1} + \mathbf{D}^{-1}\mathbf{C}(\mathbf{M}/\mathbf{D})^{-1}\mathbf{B}\mathbf{D}^{-1} \end{pmatrix}.$$

The same holds with the roles of the blocks exchanged: if $\mathbf{A}$ is invertible, $\det \mathbf{M} = \det \mathbf{A} \det(\mathbf{M}/\mathbf{A})$ and the lower right block of $\mathbf{M}^{-1}$ is $(\mathbf{M}/\mathbf{A})^{-1}$.

Proof. Multiplying the last two factors gives $\begin{pmatrix} \mathbf{M}/\mathbf{D} & \mathbf{0} \\ \mathbf{C} & \mathbf{D} \end{pmatrix}$, and the first factor adds $\mathbf{B}\mathbf{D}^{-1}$ times the second row to the first, restoring $\mathbf{A} = \mathbf{M}/\mathbf{D} + \mathbf{B}\mathbf{D}^{-1}\mathbf{C}$ and $\mathbf{B}$. The outer factors are triangular with unit diagonal, so their determinants are one and their inverses change the sign of the off-diagonal block. Inverting the product in reverse order gives $\mathbf{M}^{-1}$ as stated. The exchanged version is the same argument with the factorization pivoting on $\mathbf{A}$. $\square$

Two identities follow from computing one block of $\mathbf{M}^{-1}$ in two ways. They are the algebra behind every rank-one update in the book.

Lemma B.5 (Woodbury and the determinant lemma). *Let $\mathbf{A}$ ($n \times n$) and $\mathbf{W}$ ($k \times k$) be invertible, and $\mathbf{U}$ ($n \times k$) and $\mathbf{V}$ ($k \times n$) arbitrary. If $\mathbf{W}^{-1} + \mathbf{V}\mathbf{A}^{-1}\mathbf{U}$ is invertible, then*

$$(\mathbf{A} + \mathbf{U}\mathbf{W}\mathbf{V})^{-1} = \mathbf{A}^{-1} - \mathbf{A}^{-1}\mathbf{U}(\mathbf{W}^{-1} + \mathbf{V}\mathbf{A}^{-1}\mathbf{U})^{-1}\mathbf{V}\mathbf{A}^{-1}, \quad (\text{B.3})$$

$$\det(\mathbf{A} + \mathbf{U}\mathbf{W}\mathbf{V}) = \det \mathbf{A} \det \mathbf{W} \det(\mathbf{W}^{-1} + \mathbf{V}\mathbf{A}^{-1}\mathbf{U}). \quad (\text{B.4})$$

For a rank-one change, $\mathbf{U} = \mathbf{h}$, $\mathbf{V} = \mathbf{h}^\top$ and $\mathbf{W} = w$, these read

$$(\mathbf{A} + w\mathbf{h}\mathbf{h}^\top)^{-1} = \mathbf{A}^{-1} - \frac{w\mathbf{A}^{-1}\mathbf{h}\mathbf{h}^\top\mathbf{A}^{-1}}{1 + w\mathbf{h}^\top\mathbf{A}^{-1}\mathbf{h}}, \quad \det(\mathbf{A} + w\mathbf{h}\mathbf{h}^\top) = \det \mathbf{A} (1 + w\mathbf{h}^\top\mathbf{A}^{-1}\mathbf{h}),$$

the Sherman–Morrison formula and the matrix determinant lemma.

Proof. Apply Lemma B.4 to $\mathbf{M} = \begin{pmatrix} \mathbf{A} & \mathbf{U} \\ -\mathbf{V} & \mathbf{W}^{-1} \end{pmatrix}$. Pivoting on the lower right block, $\mathbf{M}/\mathbf{W}^{-1} = \mathbf{A} + \mathbf{U}\mathbf{W}\mathbf{V}$, so the upper left block of $\mathbf{M}^{-1}$ is $(\mathbf{A} + \mathbf{U}\mathbf{W}\mathbf{V})^{-1}$ and $\det \mathbf{M} = \det(\mathbf{A} + \mathbf{U}\mathbf{W}\mathbf{V}) \det \mathbf{W}^{-1}$. Pivoting on the upper left block, $\mathbf{M}/\mathbf{A} = \mathbf{W}^{-1} + \mathbf{V}\mathbf{A}^{-1}\mathbf{U}$, so $\det \mathbf{M} = \det \mathbf{A} \det(\mathbf{W}^{-1} + \mathbf{V}\mathbf{A}^{-1}\mathbf{U})$, and the upper left block of $\mathbf{M}^{-1}$, computed from that factorization, is the right side of equation (B.3). Equating the two expressions for each quantity gives both identities. $\square$

Lemma B.6 (Push-through). *For $\mathbf{\Lambda}$ and $\mathbf{R}$ positive definite and any $\mathbf{H}$,*

$$(\mathbf{\Lambda} + \mathbf{H}^\top\mathbf{R}^{-1}\mathbf{H})^{-1}\mathbf{H}^\top\mathbf{R}^{-1} = \mathbf{\Lambda}^{-1}\mathbf{H}^\top(\mathbf{R} + \mathbf{H}\mathbf{\Lambda}^{-1}\mathbf{H}^\top)^{-1}.$$

Proof. $(\mathbf{\Lambda} + \mathbf{H}^\top\mathbf{R}^{-1}\mathbf{H})\mathbf{\Lambda}^{-1}\mathbf{H}^\top = \mathbf{H}^\top + \mathbf{H}^\top\mathbf{R}^{-1}\mathbf{H}\mathbf{\Lambda}^{-1}\mathbf{H}^\top = \mathbf{H}^\top\mathbf{R}^{-1}(\mathbf{R} + \mathbf{H}\mathbf{\Lambda}^{-1}\mathbf{H}^\top)$. Multiply on the left by the inverse of the first factor and on the right by the inverse of the last. $\square$

B.3 Marginals and conditionals

Partition $\mathbf{z} = (\mathbf{x}, \mathbf{u})$, and partition $\boldsymbol{\mu}$, $\boldsymbol{\Sigma}$, $\boldsymbol{\eta}$ and $\mathbf{\Lambda}$ to match. Chapter 6 proved the information-form results: the marginal of $\mathbf{u}$ has the Schur complement $\boldsymbol{\Lambda}_{uu} - \boldsymbol{\Lambda}_{ux}\boldsymbol{\Lambda}_{xx}^{-1}\boldsymbol{\Lambda}_{xu}$ as its precision (Proposition 6.3), and conditioning on $\mathbf{x}$ keeps the block $\boldsymbol{\Lambda}_{uu}$ and shifts the information vector (Proposition 6.5). The moment form is the mirror image.

Proposition B.1 (Marginal and conditional, moment form). *Let $\mathbf{z} = (\mathbf{x}, \mathbf{u}) \sim \mathcal{N}(\boldsymbol{\mu}, \boldsymbol{\Sigma})$ with $\boldsymbol{\Sigma}_{xx}$ positive definite. The marginal of $\mathbf{u}$ is $\mathcal{N}(\boldsymbol{\mu}_u, \boldsymbol{\Sigma}_{uu})$, and the conditional of $\mathbf{u}$ given $\mathbf{x}$ is*

$$\mathbf{u} \mid \mathbf{x} \sim \mathcal{N}(\boldsymbol{\mu}_u + \boldsymbol{\Sigma}_{ux}\boldsymbol{\Sigma}_{xx}^{-1}(\mathbf{x} - \boldsymbol{\mu}_x), \boldsymbol{\Sigma}_{uu} - \boldsymbol{\Sigma}_{ux}\boldsymbol{\Sigma}_{xx}^{-1}\boldsymbol{\Sigma}_{xu}). \quad (\text{B.5})$$

Proof. The marginal is Lemma B.2. For the conditional, let $\mathbf{e} = \mathbf{u} - \boldsymbol{\mu}_u - \boldsymbol{\Sigma}_{ux}\boldsymbol{\Sigma}_{xx}^{-1}(\mathbf{x} - \boldsymbol{\mu}_x)$. The pair $(\mathbf{e}, \mathbf{x})$ is an affine map of $\mathbf{z}$, hence Gaussian, and $\text{Cov}(\mathbf{e}, \mathbf{x}) = \boldsymbol{\Sigma}_{ux} - \boldsymbol{\Sigma}_{ux}\boldsymbol{\Sigma}_{xx}^{-1}\boldsymbol{\Sigma}_{xx} = \mathbf{0}$, so by Lemma B.3 $\mathbf{e}$ is independent of $\mathbf{x}$. It has mean zero and covariance $\boldsymbol{\Sigma}_{uu} - 2\boldsymbol{\Sigma}_{ux}\boldsymbol{\Sigma}_{xx}^{-1}\boldsymbol{\Sigma}_{xu} + \boldsymbol{\Sigma}_{ux}\boldsymbol{\Sigma}_{xx}^{-1}\boldsymbol{\Sigma}_{xx}\boldsymbol{\Sigma}_{xx}^{-1}\boldsymbol{\Sigma}_{xu} = \boldsymbol{\Sigma}_{uu} - \boldsymbol{\Sigma}_{ux}\boldsymbol{\Sigma}_{xx}^{-1}\boldsymbol{\Sigma}_{xu}$. Given $\mathbf{x}$, therefore, $\mathbf{u}$ is a fixed vector plus the independent Gaussian $\mathbf{e}$, which is equation (B.5). $\square$

Table B.1: Marginalizing and conditioning in the two forms. What is a selection of blocks in one form is a Schur complement in the other.

	moment form $(\boldsymbol{\mu}, \boldsymbol{\Sigma})$	information form $(\boldsymbol{\eta}, \boldsymbol{\Lambda})$
marginal of $\mathbf{u}$	$\boldsymbol{\mu}_u, \boldsymbol{\Sigma}_{uu}$	$\boldsymbol{\eta}_u - \boldsymbol{\Lambda}_{ux} \boldsymbol{\Lambda}_{xx}^{-1} \boldsymbol{\eta}_x, \boldsymbol{\Lambda}_{uu} - \boldsymbol{\Lambda}_{ux} \boldsymbol{\Lambda}_{xx}^{-1} \boldsymbol{\Lambda}_{xu}$
conditional on $\mathbf{x}$	$\boldsymbol{\mu}_u + \boldsymbol{\Sigma}_{ux} \boldsymbol{\Sigma}_{xx}^{-1} (\mathbf{x} - \boldsymbol{\mu}_x), \boldsymbol{\Sigma}_{uu} - \boldsymbol{\Sigma}_{ux} \boldsymbol{\Sigma}_{xx}^{-1} \boldsymbol{\Sigma}_{xu}$	$\boldsymbol{\eta}_u - \boldsymbol{\Lambda}_{ux} \mathbf{x}, \boldsymbol{\Lambda}_{uu}$

The proof never inverts $\boldsymbol{\Sigma}$ or $\boldsymbol{\Sigma}_{uu}$, so the proposition holds for any covariance whose conditioning block $\boldsymbol{\Sigma}_{xx}$ is positive definite. When $\boldsymbol{\Sigma}$ itself is positive definite the two forms agree through Lemma B.4. The upper left block of $\boldsymbol{\Sigma}^{-1}$, ordered as $(\mathbf{u}, \mathbf{x})$, is $\boldsymbol{\Lambda}_{uu} = (\boldsymbol{\Sigma}_{uu} - \boldsymbol{\Sigma}_{ux} \boldsymbol{\Sigma}_{xx}^{-1} \boldsymbol{\Sigma}_{xu})^{-1}$, the inverse of the conditional covariance, as Proposition 6.5 requires. Symmetrically, $\boldsymbol{\Sigma}_{uu}$ is the inverse of the Schur complement of $\boldsymbol{\Lambda}_{xx}$, as Proposition 6.3 requires. Table B.1 sets the four results side by side.

B.4 Products and linear-Gaussian models

Proposition B.2 (Products of Gaussians). *As functions of $\mathbf{z}$, $\prod_i \mathcal{N}(\mathbf{z}; \boldsymbol{\mu}_i, \boldsymbol{\Sigma}_i)$ is proportional to the Gaussian with precision $\boldsymbol{\Lambda} = \sum_i \boldsymbol{\Sigma}_i^{-1}$ and information vector $\boldsymbol{\eta} = \sum_i \boldsymbol{\Sigma}_i^{-1} \boldsymbol{\mu}_i$. For two factors the constant of proportionality is*

$$\int \mathcal{N}(\mathbf{z}; \boldsymbol{\mu}_1, \boldsymbol{\Sigma}_1) \mathcal{N}(\mathbf{z}; \boldsymbol{\mu}_2, \boldsymbol{\Sigma}_2) d\mathbf{z} = \mathcal{N}(\boldsymbol{\mu}_1; \boldsymbol{\mu}_2, \boldsymbol{\Sigma}_1 + \boldsymbol{\Sigma}_2).$$

Proof. In information form the exponents add, and the corollary of Lemma B.1 reads off the product. For the constant, let $\mathbf{z} \sim \mathcal{N}(\boldsymbol{\mu}_2, \boldsymbol{\Sigma}_2)$ and $\mathbf{y} = \mathbf{z} + \boldsymbol{\nu}$ with an independent $\boldsymbol{\nu} \sim \mathcal{N}(\mathbf{0}, \boldsymbol{\Sigma}_1)$. The density of $\mathbf{y}$ at $\boldsymbol{\mu}_1$ is $\int \mathcal{N}(\mathbf{z}; \boldsymbol{\mu}_2, \boldsymbol{\Sigma}_2) \mathcal{N}(\boldsymbol{\mu}_1; \mathbf{z}, \boldsymbol{\Sigma}_1) d\mathbf{z}$, which is the integral above, since $\mathcal{N}(\boldsymbol{\mu}_1; \mathbf{z}, \boldsymbol{\Sigma}_1) = \mathcal{N}(\mathbf{z}; \boldsymbol{\mu}_1, \boldsymbol{\Sigma}_1)$. By Lemma B.2 $\mathbf{y} \sim \mathcal{N}(\boldsymbol{\mu}_2, \boldsymbol{\Sigma}_1 + \boldsymbol{\Sigma}_2)$. $\square$

The product rule is the one sentence Chapter 6 builds on: every factor adds its precision and its information vector.

Proposition B.3 (The linear-Gaussian model). *Let $\mathbf{z} \sim \mathcal{N}(\boldsymbol{\mu}, \boldsymbol{\Sigma})$, with $\boldsymbol{\Sigma}$ positive semidefinite, and let $\mathbf{y} = \mathbf{H}\mathbf{z} + \mathbf{c} + \boldsymbol{\nu}$ with $\boldsymbol{\nu} \sim \mathcal{N}(\mathbf{0}, \mathbf{R})$ independent of $\mathbf{z}$ and $\mathbf{R}$ positive definite. Write $\mathbf{S} = \mathbf{H}\boldsymbol{\Sigma}\mathbf{H}^\top + \mathbf{R}$ and $\mathbf{K} = \boldsymbol{\Sigma}\mathbf{H}^\top\mathbf{S}^{-1}$, the covariance of the innovation $\mathbf{y} - \mathbf{H}\boldsymbol{\mu} - \mathbf{c}$ and the gain. (This $\mathbf{S}$ is not the map $\mathbf{z} = \mathbf{S}\mathbf{u}$ of §B.1.) Then:*

1. the pair $(\mathbf{z}, \mathbf{y})$ is Gaussian with cross-covariance $\text{Cov}(\mathbf{z}, \mathbf{y}) = \boldsymbol{\Sigma}\mathbf{H}^\top$;
2. the predictive distribution of the reading is $\mathbf{y} \sim \mathcal{N}(\mathbf{H}\boldsymbol{\mu} + \mathbf{c}, \mathbf{S})$;
3. the posterior is

$$\mathbf{z} \mid \mathbf{y} \sim \mathcal{N}(\boldsymbol{\mu} + \mathbf{K}(\mathbf{y} - \mathbf{H}\boldsymbol{\mu} - \mathbf{c}), \boldsymbol{\Sigma} - \mathbf{K}\mathbf{H}\boldsymbol{\Sigma}); \quad (\text{B.6})$$

4. if $\boldsymbol{\Sigma}$ is positive definite, the posterior has precision $\boldsymbol{\Lambda} + \mathbf{H}^\top\mathbf{R}^{-1}\mathbf{H}$ and information vector $\boldsymbol{\eta} + \mathbf{H}^\top\mathbf{R}^{-1}(\mathbf{y} - \mathbf{c})$, with $\boldsymbol{\Lambda} = \boldsymbol{\Sigma}^{-1}$ and $\boldsymbol{\eta} = \boldsymbol{\Lambda}\boldsymbol{\mu}$.

Proof. The pair $(\mathbf{z}, \boldsymbol{\nu})$ is Gaussian with block diagonal covariance, and $(\mathbf{z}, \mathbf{y})$ is an affine map of it, so items 1 and 2 follow from Lemma B.2; the cross-covariance is $\mathbb{E}[(\mathbf{z} - \boldsymbol{\mu})(\mathbf{H}(\mathbf{z} - \boldsymbol{\mu}) + \boldsymbol{\nu})^\top] = \boldsymbol{\Sigma}\mathbf{H}^\top$. Item 3 is Proposition B.1 with $\mathbf{x} = \mathbf{y}$ and $\mathbf{u} = \mathbf{z}$, whose conditioning block is $\mathbf{S}$, positive definite because $\mathbf{R}$ is. For item 4, the posterior precision claimed inverts to the posterior covariance of item 3 by equation (B.3) with $\mathbf{A} = \boldsymbol{\Lambda}$, $\mathbf{U} = \mathbf{H}^\top$, $\mathbf{W} = \mathbf{R}^{-1}$ and $\mathbf{V} = \mathbf{H}$:

$(\mathbf{\Lambda} + \mathbf{H}^\top \mathbf{R}^{-1} \mathbf{H})^{-1} = \mathbf{\Sigma} - \mathbf{\Sigma} \mathbf{H}^\top \mathbf{S}^{-1} \mathbf{H} \mathbf{\Sigma} = \mathbf{\Sigma} - \mathbf{K} \mathbf{H} \mathbf{\Sigma}$. The mean is that covariance times the claimed information vector. Its first part is $(\mathbf{\Sigma} - \mathbf{K} \mathbf{H} \mathbf{\Sigma}) \mathbf{\Lambda} \boldsymbol{\mu} = \boldsymbol{\mu} - \mathbf{K} \mathbf{H} \boldsymbol{\mu}$, and by Lemma B.6 its second part is $(\mathbf{\Lambda} + \mathbf{H}^\top \mathbf{R}^{-1} \mathbf{H})^{-1} \mathbf{H}^\top \mathbf{R}^{-1} (\mathbf{y} - \mathbf{c}) = \mathbf{K} (\mathbf{y} - \mathbf{c})$. Their sum is the mean of item 3. $\square$

With one reading, $\mathbf{H} = \mathbf{h}^\top$ and $\mathbf{R} = \sigma^2$, item 3 is Proposition 3.1 and Proposition 11.1, and item 4 is Proposition 3.2. The proof here conditions the joint distribution rather than completing a square, so it never inverts $\mathbf{\Sigma}$: the one-reading formulas hold for a singular covariance such as the rank-two $\mathbf{\Sigma}_z$ of §3.4, exactly and not only as a limit.

B.5 Rank-one changes

A reading of $\mathbf{h}^\top \mathbf{z}$ with weight $w = 1/\sigma^2$ changes the precision by the rank-one term $w \mathbf{h} \mathbf{h}^\top$. With $\mathbf{s} = \mathbf{\Sigma} \mathbf{h}$, Lemma B.5 gives the new covariance and determinant at the cost of one solve:

$$\mathbf{\Sigma}' = \mathbf{\Sigma} - \frac{w \mathbf{s} \mathbf{s}^\top}{1 + w \mathbf{h}^\top \mathbf{s}}, \quad \det \mathbf{\Lambda}' = \det \mathbf{\Lambda} (1 + w \mathbf{h}^\top \mathbf{s}). \quad (\text{B.7})$$

A reading can also be removed, which is how a leave-one-out residual or a rejected meter is computed without refactoring. Removing it subtracts the same term, $\mathbf{\Lambda} = \mathbf{\Lambda}' - w \mathbf{h} \mathbf{h}^\top$, and with $\mathbf{s}' = \mathbf{\Sigma}' \mathbf{h}$ equation (B.3) with $\mathbf{W} = -w$ gives

$$\mathbf{\Sigma} = \mathbf{\Sigma}' + \frac{w \mathbf{s}' \mathbf{s}'^\top}{1 - w \mathbf{h}^\top \mathbf{s}'}, \quad (\text{B.8})$$

valid exactly when $1 - w \mathbf{h}^\top \mathbf{s}' > 0$, which is the condition that the reduced precision stays positive definite. The determinant identity gives what a reading is worth before it is taken, measured in information rather than variance. With the entropy of equation (B.11) below, the entropy of $\mathbf{z}$ falls by

$$\frac{1}{2} \log \det \mathbf{\Sigma} - \frac{1}{2} \log \det \mathbf{\Sigma}' = \frac{1}{2} \log(1 + \mathbf{h}^\top \mathbf{\Sigma} \mathbf{h} / \sigma^2), \quad (\text{B.9})$$

the mutual information between $\mathbf{z}$ and the reading. It depends on the reading only through the ratio of the variance it predicts, $\mathbf{h}^\top \mathbf{\Sigma} \mathbf{h}$, to its noise, and it is the information counterpart of the variance reduction of equation (11.3).

B.6 Integrals, quadratic forms and divergences

Proposition B.4 (The evidence of a quadratic objective). *If $C(\mathbf{z}) = C^* + \frac{1}{2}(\mathbf{z} - \mathbf{z}^*)^\top \mathbf{\Lambda}(\mathbf{z} - \mathbf{z}^*)$ with $\mathbf{\Lambda}$ positive definite, then $\int \exp(-C(\mathbf{z})) d\mathbf{z} = \exp(-C^*) (2\pi)^{n/2} (\det \mathbf{\Lambda})^{-1/2}$.*

Proof. Lemma B.1, with the square already completed. $\square$

For a linear-Gaussian model the negative log posterior of equation (6.4) is exactly such a quadratic. The joint density of the unknowns and the readings is $\exp(-C)$ times the normalizing constants of the factors, so the evidence is $\exp(-C(\mathbf{z}^*))$, times $(2\pi)^{n/2} (\det \mathbf{\Lambda})^{-1/2}$, times those constants. Its logarithm is equation (7.2) of Chapter 7, whose constant collects $\frac{n}{2} \log 2\pi$ and the logarithms of the factors' normalizers.

Proposition B.5 (Quadratic forms and the chi-squared law). *Let $\mathbf{z}$ have mean $\boldsymbol{\mu}$ and covariance $\boldsymbol{\Sigma}$. For any symmetric $\mathbf{A}$ and any $\mathbf{m}$,*

$$\mathbb{E}[(\mathbf{z} - \mathbf{m})^\top \mathbf{A}(\mathbf{z} - \mathbf{m})] = \text{tr}(\mathbf{A}\boldsymbol{\Sigma}) + (\boldsymbol{\mu} - \mathbf{m})^\top \mathbf{A}(\boldsymbol{\mu} - \mathbf{m}). \quad (\text{B.10})$$

If $\boldsymbol{\epsilon} \sim \mathcal{N}(\mathbf{0}, \mathbf{I}_m)$ and $\mathbf{P}$ is a symmetric idempotent matrix of rank r , then $\boldsymbol{\epsilon}^\top \mathbf{P} \boldsymbol{\epsilon}$ is chi-squared with r degrees of freedom, with mean r and variance $2r$.

Proof. Write $\mathbf{z} - \mathbf{m} = (\mathbf{z} - \boldsymbol{\mu}) + (\boldsymbol{\mu} - \mathbf{m})$. The cross term has zero mean, and $\mathbb{E}[(\mathbf{z} - \boldsymbol{\mu})^\top \mathbf{A}(\mathbf{z} - \boldsymbol{\mu})] = \text{tr}(\mathbf{A} \mathbb{E}[(\mathbf{z} - \boldsymbol{\mu})(\mathbf{z} - \boldsymbol{\mu})^\top]) = \text{tr}(\mathbf{A}\boldsymbol{\Sigma})$, since a scalar equals its trace and the trace is invariant under cyclic permutation. For the second part, a symmetric idempotent matrix has eigenvalues zero and one, so $\mathbf{P} = \mathbf{Q}\mathbf{D}\mathbf{Q}^\top$ with $\mathbf{Q}$ orthogonal and $\mathbf{D}$ diagonal with r ones. By Lemma B.2, $\boldsymbol{\delta} = \mathbf{Q}^\top \boldsymbol{\epsilon}$ is again standard Gaussian, and $\boldsymbol{\epsilon}^\top \mathbf{P} \boldsymbol{\epsilon} = \sum_{i \leq r} \delta_i^2$, a sum of r independent squared standard normals. Each has mean one and, since $\mathbb{E}[\delta_i^4] = 3$, variance two. $\square$

The second part is the last step of Proposition 4.2 and of Proposition 12.1. There the matrix is the projector $\mathbf{I} - \mathbf{P}$ onto the complement of the column space of the standardized Jacobian, of rank $m - n$.

The *entropy* of a density is $H[p] = -\mathbb{E}_p[\log p]$, and the *Kullback–Leibler divergence* of q from p is $\text{KL}(q \parallel p) = \mathbb{E}_q[\log q - \log p]$, which is non-negative and zero only when $q = p$.

Proposition B.6 (Entropy and divergence of Gaussians). *For $\boldsymbol{\Sigma}$ positive definite,*

$$H[\mathcal{N}(\boldsymbol{\mu}, \boldsymbol{\Sigma})] = \frac{1}{2} \log \det(2\pi e \boldsymbol{\Sigma}), \quad (\text{B.11})$$

and for two Gaussians $\mathcal{N}_0 = \mathcal{N}(\boldsymbol{\mu}_0, \boldsymbol{\Sigma}_0)$ and $\mathcal{N}_1 = \mathcal{N}(\boldsymbol{\mu}_1, \boldsymbol{\Sigma}_1)$ on $\mathbb{R}^n$,

$$\text{KL}(\mathcal{N}_0 \parallel \mathcal{N}_1) = \frac{1}{2} \left[\text{tr}(\boldsymbol{\Sigma}_1^{-1} \boldsymbol{\Sigma}_0) + (\boldsymbol{\mu}_1 - \boldsymbol{\mu}_0)^\top \boldsymbol{\Sigma}_1^{-1} (\boldsymbol{\mu}_1 - \boldsymbol{\mu}_0) - n + \log \det \boldsymbol{\Sigma}_1 - \log \det \boldsymbol{\Sigma}_0 \right]. \quad (\text{B.12})$$

Proof. From equation (B.1), $-\log \mathcal{N}_1(\mathbf{z}) = \frac{n}{2} \log 2\pi + \frac{1}{2} \log \det \boldsymbol{\Sigma}_1 + \frac{1}{2} (\mathbf{z} - \boldsymbol{\mu}_1)^\top \boldsymbol{\Sigma}_1^{-1} (\mathbf{z} - \boldsymbol{\mu}_1)$. Its expectation under $\mathcal{N}_0$ is, by equation (B.10), $\frac{n}{2} \log 2\pi + \frac{1}{2} \log \det \boldsymbol{\Sigma}_1 + \frac{1}{2} \text{tr}(\boldsymbol{\Sigma}_1^{-1} \boldsymbol{\Sigma}_0) + \frac{1}{2} (\boldsymbol{\mu}_0 - \boldsymbol{\mu}_1)^\top \boldsymbol{\Sigma}_1^{-1} (\boldsymbol{\mu}_0 - \boldsymbol{\mu}_1)$. With $\mathcal{N}_1 = \mathcal{N}_0$ the trace is n , which gives the entropy, $\frac{n}{2} \log 2\pi + \frac{1}{2} \log \det \boldsymbol{\Sigma}_0 + \frac{n}{2}$. The divergence is the second expectation minus the entropy of $\mathcal{N}_0$. $\square$

Proposition 9.2 minimizes equation (B.12) with $\mathcal{N}_1$ the posterior, over $\mathcal{N}_0$ a product of independent Gaussians. The terms that depend on $\mathcal{N}_0$ are $\text{tr}(\boldsymbol{\Lambda} \boldsymbol{\Sigma}_0) + (\boldsymbol{\mu} - \boldsymbol{\mu}_0)^\top \boldsymbol{\Lambda} (\boldsymbol{\mu} - \boldsymbol{\mu}_0) - \log \det \boldsymbol{\Sigma}_0$, and with a diagonal $\boldsymbol{\Sigma}_0$ the trace keeps only the diagonal of $\boldsymbol{\Lambda}$.

B.7 The Laplace approximation

Let a posterior be $p(\mathbf{z} \mid \mathbf{y}) \propto \exp(-C(\mathbf{z}))$ with C twice differentiable, a minimum at $\mathbf{z}^*$, and a positive definite Hessian $\nabla^2 C^* = \nabla^2 C(\mathbf{z}^*)$ there. Because the gradient vanishes at the minimum, Taylor's theorem gives $C(\mathbf{z}) = C(\mathbf{z}^*) + \frac{1}{2} (\mathbf{z} - \mathbf{z}^*)^\top \nabla^2 C^* (\mathbf{z} - \mathbf{z}^*) + O(\|\mathbf{z} - \mathbf{z}^*\|^3)$. Dropping the cubic remainder and applying the corollary of Lemma B.1 and Proposition B.4 gives the *Laplace approximation* to the posterior and to the evidence,

$$p(\mathbf{z} \mid \mathbf{y}) \approx \mathcal{N}(\mathbf{z}^*, (\nabla^2 C^*)^{-1}), \quad \log \int \exp(-C) d\mathbf{z} \approx -C(\mathbf{z}^*) + \frac{n}{2} \log 2\pi - \frac{1}{2} \log \det \nabla^2 C^*. \quad (\text{B.13})$$

Table B.2: The identities of this appendix and where the book uses them.

identity	used in
Gaussian integral, reading a Gaussian off its exponent (Lemma B.1)	every posterior of Chapters 3 to 9; evidence, equation (7.2)
affine maps, singular covariances (Definition B.1, Lemma B.2)	$\mathbf{z} = \mathbf{S}\mathbf{u}$ in §3.4; sampling, Proposition 6.4; misfit law
block factorization, Schur complement (Lemma B.4)	marginalization and region messages, Chapters 6 and 8
Woodbury, Sherman–Morrison, determinant lemma (Lemma B.5)	Propositions 3.1 and 11.1; sequential updates, Chapter 11
moment-form conditional (Proposition B.1)	conditioning a joint prediction on a reading; virtual sensors
product rule (Proposition B.2)	information form, Proposition 3.2; Exercise 6.1
linear-Gaussian model (Proposition B.3)	predictive checks and innovations, Chapters 11 and 12; one reading with a singular prior
rank-one update, downdate, information gain (§B.5)	the value of a reading, equation (11.3); removing a meter
quadratic forms, chi-squared (Proposition B.5)	the misfit law, Propositions 4.2 and 12.1
entropy and divergence (Proposition B.6)	mean field, Proposition 9.2
Laplace approximation, Gauss–Newton Hessian (§B.7)	equation (6.9); branch evidence, Chapter 7

Both are exact when C is quadratic. Otherwise their accuracy depends on how much of the posterior’s mass lies where the cubic remainder is not small against the quadratic, which shrinks as the posterior concentrates [101].

The book’s objective has the least-squares form $C = \frac{1}{2}\mathbf{g}^T\mathbf{\Omega}\mathbf{g}$ of equation (6.4), with $\mathbf{\Omega} = \text{diag}(w_k)$. Differentiating twice,

$$\nabla C = \mathbf{J}_g^T\mathbf{\Omega}\mathbf{g}, \quad \nabla^2 C = \mathbf{J}_g^T\mathbf{\Omega}\mathbf{J}_g + \sum_k w_k g_k \nabla^2 g_k. \quad (\text{B.14})$$

The first term is the Gauss–Newton matrix $\mathbf{\Lambda} = \mathbf{J}_g^T\mathbf{\Omega}\mathbf{J}_g$ that the book’s solver assembles and that equation (6.9) uses; the second is dropped. For row k the dropped term is smaller than the kept one by roughly the factor $|g_k| \|\nabla^2 g_k\| / \|\nabla g_k\|^2$: the row’s residual at the mode times its curvature, over its squared slope. It vanishes for linear rows. It is small for rows that are nearly satisfied at the mode, such as physics rows held to a small width, and for readings that the posterior fits to within their noise, and §6.2.1 discusses when that fails. The Gauss–Newton matrix is also positive semidefinite by construction, which the full Hessian need not be away from the mode.

B.8 Where the book uses each identity

Table B.2 lists, for each result of this appendix, the places in the book that rely on it.

Appendix C

From the book to the engine

The constructions of this book are implemented in TERRA, a domain-independent engine for multi-conservation graphs, written by the author. Nothing in Chapters 1 to 18 depends on it: their scripts import no module of the engine and run on a numerical library alone. The case studies of Part VI were run with it. This appendix says what the engine is, shows a model written in it, maps each construction of the book to the module that implements it, and says what the case studies used and how to rerun them.

C.1 What TERRA is

TERRA is the Python package `terra_graph_engine`. It needs Python 3.11 or later, NumPy, SciPy and Jinja2. It has two layers.

The *engine* knows nothing of any domain. It holds the objects of Part I: nodes with roles, edges with one channel per conserved quantity, closures, boundary conditions, and the compiled residual system with its sparse Jacobian. It solves that system by Newton’s method in steady state and by a BDF integrator in time. On the same rows it builds the probabilistic model of Parts II and III, together with counterfactual branching and hierarchical decomposition.

The *plugins* carry what is specific to one domain or one method. There are foundation plugins for substance physics and electrical quantities, and domain plugins for power flow, transmission grids, HVAC, batteries and data centers. There are also method plugins for reliability enumeration and for the census and its surrogate. A plugin supplies closures, factories that build standard networks, and algorithms that sit on top of the engine. Some plugin algorithms, such as the DC dispatch linear programs of the power-flow plugin, solve their own problems directly and never call the engine’s Newton solver.

The objects a reader meets first are these.

- **Model** is the builder. Nodes, edges, closures and initial values are added to it, and `build()` compiles it.
- **CompiledModel** is the frozen result: a registry of unknowns, the residual rows of Chapter 2, and their Jacobian.
- `tge.solve` solves a compiled model in steady state, by Newton’s method with a backtracking line search. `tge.simulate` integrates it in time.
- **InferenceModel** views a compiled model as the Gaussian factor graph of Chapter 3. Its physics rows are weighted by a physics width, `physics_sigma`, which is the soft-constraint width of Chapter 4. `observe` attaches a sensor, `prior` a belief, and `add_latent_fault` an

additive unknown source on a balance.

- `infer` returns a `Posterior`: the MAP state by Gauss–Newton weighted least squares, and the Laplace covariance from the information matrix, as in Chapter 6.

A prior is either a datum or a regularizer. A datum is a belief whose error is a draw at its stated spread, such as a forecast. A regularizer is a broad prior that only keeps an unknown identifiable. Both act the same way in the solve. The adequacy test of Chapter 12 counts only data, for the reason Chapter 12 gives.

C.2 A model in a dozen lines

The smallest model with physics and redundancy has one closure, $y = 2x$, three readings of x , and nothing observed about y except a broad regularizing prior.

```
import terra_graph_engine as tge
from terra_graph_engine import Model, NodeRole, PropertyClosure
from terra_graph_engine.inference import InferenceModel, infer, goodness_of_fit

m = Model()
m.add_node("n", role=NodeRole.RESERVOIR)
m.add_closure(PropertyClosure(out="y", inputs=["x"], f=lambda x: 2.0 * x,
                              analytic_jacobian=lambda x: {"x": 2.0}))

m.set_initial("x", 10.0)
m.set_initial("y", 20.0)
cm = m.build()

im = InferenceModel(cm, physics_sigma=1e-3)
for reading in (11.0, 9.0, 10.5):
    im.observe("x", reading, noise=1.0)
im.prior("y", mean=20.0, std=50.0, regularizer=True)
post = infer(im)
fit = goodness_of_fit(im, post)
```

The posterior gives $x = 10.167 \pm 0.577$, which is the mean of the three readings with spread $1/\sqrt{3}$. It gives $y = 20.333 \pm 1.154$, carried through the closure with twice the spread. The closure's row has put y on the same footing as x with no reading of y ; this is the virtual sensor of Chapter 12. The misfit is 2.167 on 2 degrees of freedom, a p-value of 0.338. The count is one physics row plus three readings less two unknowns. The regularizing prior on y counts in neither the misfit nor the degrees of freedom.

C.3 Where each construction lives

Tables C.1 and C.2 map the chapters of Parts I to V to the modules that implement them. Engine modules are named relative to the package, and plugin modules by plugin. Where a chapter's construction has no module, its script carries it out directly.

Table C.1: Parts I to III: the constructions and the modules that implement them.

ch.	construction	modules
1	nodes and roles, edges and channels, boundary conditions, sources, losses, storage; conserved domains; closure patterns	<code>model/ (node, edge, boundary, model); domains/; closure/ (carrier flow, gradient flow, property, piecewise)</code>
2	incidence, the registry of unknowns, residual rows, the Jacobian, the Newton solve	<code>topology/graph; variables/registry; model/compiled_model; assembly/residual, assembly/jacobian; numerics/solver/newton; entry (solve)</code>
3	sensors, priors, latent faults on a balance	<code>inference/model (InferenceModel); inference/factors; model/compiled_model (with_latent_fault)</code>
4	physics as soft rows of a set width; bounds on a posterior	<code>inference/model (physics_sigma); inference/map_solve; inference/constrained</code>
5	separators and elimination on the information matrix	<code>inference/gaussian_bp; hierarchy/coordinator</code>
6	MAP by weighted least squares; the Laplace posterior	<code>inference/map_solve; inference/result (Posterior)</code>
7	hybrid states and branch mixtures; checks and corrections of the Laplace posterior	<code>closure/patterns/piecewise, numerics/regimes; inference/validity, inference/laplace_is, inference/particle, inference/escalation; plugin uncertainty (mixture)</code>
8	Schur complements over an interface; elimination orders	<code>inference/gaussian_bp; hierarchy/coordinator</code>
9	sampling corrections; iteration between regions	<code>inference/particle, inference/laplace_is; hierarchy/coupling, hierarchy/ports</code>
10	forward sampling through the physics; batched and swept solves	<code>inference/propagate; assembly/batch (solve_batch); inference/map_batch; numerics/sweep</code>
11	rank-one conditioning on new readings; particle filtering; the value of a reading	<code>inference/incremental; inference/particle; inference/online_identify; inference/experiment_design</code>

C.4 The case studies

Table C.3 lists, for each chapter of Part VI, what the study used and what one engine solve is in it. Three studies run the engine's own solver or inference, and three run plugin algorithms whose inner problem is a linear program or a linear network flow. The chapters count cost in engine solves in both cases, and each says which kind it counts.

Each study lives in its own directory under `docs/terra_graph_engine/case_studies/` in the repository that accompanies the book. It is run from the repository root with the package source on the Python path,

```
PYTHONPATH=src python \
docs/terra_graph_engine/case_studies/<group>/<study>/run.py
```

and it writes a results file next to its script. The book's script for the chapter reads that file and runs no physics:

```
cd docs/book
python scripts/ch25_bad_data.py
```

Table C.2: Parts IV and V: the constructions and the modules that implement them.

ch.	construction	modules
12	the misfit law, studentized residuals, fault hypotheses by evidence, identifiability, virtual sensors	<code>inference/goodness_of_fit</code> ; <code>inference/model_comparison</code> ; <code>inference/identifiability</code> ; <code>inference/queries</code> (<code>locate_faults</code>)
13	interventions on the model; stacked branches and their aggregation	<code>counterfactual/</code> (<code>perturbation</code> , <code>branch</code> , <code>reduce</code>)
14	sensitivities at a solution; the census of values and gradients, supporting planes, the certificate, the questions answered from it	<code>numerics/sensitivity</code> ; <code>assembly/input_jacobian</code> ; <code>plugin</code> <code>uncertainty</code> (<code>evaluator</code> , <code>pieces</code> , <code>queries</code> , <code>attribution</code> , <code>control_variate</code> , <code>sampling</code>)
15	component reliability, common cause, probability-ordered enumeration with certified bounds, interdiction	<code>plugin reliability</code> (<code>component_reliability</code> , <code>common_cause</code> , <code>enumeration</code> , <code>interdiction</code> , <code>risk</code> , <code>screening</code> , <code>rare_event</code>)
16	time integration and events; linearization, observers and model-predictive control	<code>entry</code> (<code>simulate</code>); <code>numerics/integrator/</code> ; <code>assembly/dynamic</code> ; <code>numerics/linearize</code> , <code>numerics/observer</code> , <code>numerics/mpc</code> ; <code>controls/</code> ; <code>inference/forecast</code>
17	subsystems with ports, interface coupling, Schur-complement coordination, composition	<code>hierarchy/</code> (<code>subsystem</code> , <code>ports</code> , <code>coupling</code> , <code>coordinator</code> , <code>compose</code>)
18	region messages, separator values and compression, region trees, certified boxing, boundary equivalents	<code>plugin reliability</code> (<code>local_global</code> , <code>compressibility</code> , <code>region_tree</code> , <code>boxing</code> , <code>environment_k</code> , <code>regional_contingency</code> , <code>thermal_adapter</code>); <code>plugin</code> <code>power_flow</code> (<code>regional_dc</code> , <code>partitioning</code>)

Table C.3: The case studies of Part VI: the engine and plugin pieces each used, and what one engine solve is.

ch.	engine and plugins	one engine solve
20	<code>plugin hvac</code> (<code>thermal_network</code> , <code>hall_chain</code>); <code>plugin reliability</code> (<code>thermal_adapter</code> , <code>environment_k</code>)	a linear thermal network flow under a fixed duty re-share
21	<code>plugin datacenter</code> (room and rack primitives); engine: <code>infer</code> , <code>infer_particle</code>	a linear thermal solve of the two-rack room
22	engine: <code>Model</code> , <code>solve</code> , <code>infer</code> , <code>infer_particle</code>	a Newton solve of the one-node leakage model
23	<code>plugin datacenter</code> (<code>chiller_bank</code> , <code>cooling_plant</code>); <code>plugin uncertainty</code>	one weighted least-squares fit of the staged plant law to a window of readings
24	<code>plugin datacenter</code> (<code>cooling_plant</code> , <code>cooling_plant_id</code>); engine: <code>evidence</code> , <code>expected_information_gain</code>	one fit of the plant's rows under one hypothesis
25	<code>plugin datacenter</code> (building, room and rack primitives); engine: <code>infer</code> , <code>goodness_of_fit</code> , <code>sensor_consistency</code>	a linear thermal solve of the building with one reading withheld

Each chapter's last section gives its exact commands, its run time, and the tests that pin its committed results. The engine and its plugins carry their own test suite, under `tests/terra_graph_engine` and `tests/plugins`.

Appendix D

A catalogue of closures

Table 1.2 named four closure patterns. This appendix fills them in. It gathers the closures of the domains this book touches, thermal, fluid, moist air, electrical, storage and plant equipment, and gives each one in the same short form. Some are implemented in the plugins of TERRA, and the entry names the class or function; the forms given are the ones the code implements. Others are standard relations the plugins do not yet carry, and the entry cites a textbook. Either way the entry says what a modeler needs before writing the relation into a graph.

D.1 How to read an entry

Each entry gives the relation in residual form, zero when the relation holds, and then eight short fields.

- *Pattern*: carrier, gradient, property or piecewise, as in Table 1.2, or a custom closure when none fits.
- *Unknowns*: the variables the closure reads. Any of them can be an unknown; which ones are is a property of the question (Principle 1.2).
- *Parameters*: constants fixed when the closure is built, with units.
- *Jacobian*: the partial derivatives of the residual, analytic or by finite differences.
- *Kinks*: where the relation, or its derivative, is not smooth. A kink is where Newton's method, the Laplace approximation and the certificates of Chapter 14 need care (§14.5).
- *Shape*: whether the relation is monotone, linear, convex or none of these, in the variables that matter. Convexity is what the supporting planes of Proposition 14.2 need, and monotonicity is what the floors of Proposition 14.4 need.
- *Prior*: the parameter a study usually leaves uncertain, and why. This is a modeling judgment, not a property of the code.
- *Source*: the plugin and class that implements it, or the reference for a textbook relation.

Three kinds of physics look like closures and are not. A *storage relation* is the accumulation term of a balance, dX/dt , and belongs to the node (Chapter 16). A *pin* fixes a variable at a setpoint and is a one-variable row. And an *outer loop* changes the model between solves, as a generator that hits its reactive limit does. The entries say when a relation is one of these.

Table D.1 indexes the entries.

Table D.1: The closures of this appendix: pattern, whether the relation kinks, its shape, and where it comes from (P: a plugin of TERRA; T: a textbook relation).

closure	pattern	kinks	shape	src
<i>Thermal</i>				
conductance, $Q = UA\Delta T$	gradient	no	linear	P
series conduction	gradient	no	linear	P
convection with a correlation	gradient	yes	monotone in ΔT	T
radiation between two surfaces	custom	no	monotone, not convex	P
counterflow exchanger, fixed rates	custom	no	linear in T	P
counterflow exchanger, variable rates	custom	yes	not evident	P
cooling tower	gradient	yes	non-decreasing	P
waterside economizer	property	yes	non-decreasing	P
enthalpy carried by mass; throttle	carrier;	no	bilinear; linear	P
	custom			
temperature-dependent load	property	no	linear	P
<i>Fluid</i>				
quadratic resistance; damper	gradient	yes	increasing, odd	P
pipe friction (Darcy–Weisbach)	gradient	yes	increasing	T
laminar pipe (Hagen–Poiseuille)	gradient	no	linear	T
fan or pump curve	gradient	yes	decreasing in flow	P
fan and pump power	property	no	convex (cubic)	P
valve with a loss coefficient	gradient	yes	increasing in flow	T
check valve	piecewise	yes	monotone	T
isothermal gas pipe	gradient	yes	increasing	T
ideal-gas mass flow	property	no	linear	P
mixing of two streams	property	no	bilinear	P
<i>Moist air</i>				
humidity ratio and moist-air enthalpy	property	no	monotone	P
coil condensation	property	yes	non-decreasing	P
moisture carried by mass	carrier	no	bilinear	P
<i>Electrical</i>				
DC branch	gradient	no	linear	P
AC branch in polar form	custom	no	trigonometric	P
transformer with a tap	custom	no	trigonometric	P
slack and voltage-controlled buses	pin	—	—	P
reactive limits of a generator	outer loop	yes	—	P
transformer loss	property	no	convex	P
UPS loss	property	no	convex	P
PDU loss	property	no	linear	P
fixed share of a flow	custom	no	linear	P
generator fuel curve	property	gated	affine	P
<i>Storage and electrochemistry</i>				
battery energy with efficiencies	storage	no	linear	P
signed power port	property	yes	piecewise linear	P
equivalent-circuit battery	property	no	monotone in charge	T
state of health	storage	no	linear	P
<i>Plant equipment</i>				
chiller power from load	property	yes	increasing	P
chiller staging	piecewise	yes	—	P
thermal storage mode	piecewise	yes	—	P

D.2 The four patterns in the engine

Carrier flow. $r = P - q\varepsilon$, the flow of one quantity carried by the flow q of another at intensity ε . *Jacobian*: analytic, $\{P : 1, q : -\varepsilon, \varepsilon : -q\}$. *Shape*: bilinear, so not convex in q and ε together; a census over both needs the conditions of §14.7. *Source*: engine, **CarrierFlow**.

Gradient flow. $r = P - g(\phi_i, \phi_j; \theta)$, with g any function of the two potentials. *Jacobian*: analytic if the modeler supplies it, otherwise a central difference with step $10^{-6} \max(1, |\phi|)$. *Kinks*: not detected; whatever g has. *Source*: engine, **GradientFlow**.

Property. $r = y - f(x_1, \dots, x_k)$, a relation among variables at one place. *Jacobian*: analytic if supplied, otherwise a central difference. When the Jacobian is differenced the engine probes for a kink at every evaluation: it compares the second difference with the first, and warns when their ratio exceeds 0.1. *Source*: engine, **PropertyClosure**.

Piecewise. $r = y - f_b(x)$ on the active branch b . Each branch may carry a guard, a margin that is non-negative where the branch is admissible. The engine solves with the branches frozen, then asks each closure which branch its guards now prefer. The current branch stays while it is admissible, and otherwise the first admissible branch in construction order is taken, so overlapping guards give hysteresis. The loop repeats at most eight times, and a closure that flips more than three times is relaxed and reported as a failure to converge. This is the regime loop of §7.3; the probabilistic model instead weighs the branches (Proposition 7.2). *Source*: engine, **PiecewiseClosure**, and **numerics/regimes**.

D.3 Thermal

Conductance.

$$r = Q - UA(T_h - T_c).$$

Pattern: gradient. *Unknowns*: Q, T_h, T_c . *Parameters*: UA [W/K]. *Jacobian*: analytic, constant. *Shape*: linear. *Prior*: UA , which is seldom known well at the start and drifts as surfaces foul. *Source*: **thermo**, **sensible_heat**; it is equation (1.5).

Series conduction.

$$r = Q - \frac{T_h - T_c}{\sum_i R_i}.$$

Pattern: gradient. *Parameters*: layer resistances R_i [K/W]. *Jacobian*: analytic, constant, $\mp 1/\sum_i R_i$ on the temperatures. *Shape*: linear. *Prior*: the least known layer, often a contact resistance; the sum is identifiable, the layers separately are not (§12.7). *Source*: **thermo**, **SeriesConduction**.

Convection with a correlation.

$$r = Q - hA(T_s - T_\infty), \quad h = \frac{k}{L} C \text{Re}^m \text{Pr}^n.$$

Pattern: gradient. *Unknowns*: Q, T_s, T_∞ , and the velocity inside Re when it is solved for. *Parameters*: A , the length L , the fluid properties, and the correlation constants C, m, n . *Kinks*:

where the correlation changes, at the laminar-to-turbulent transition, C , m and n jump. *Shape*: linear in the temperature difference at fixed velocity, increasing and concave in velocity. *Prior*: C , since empirical correlations carry errors that can reach about twenty-five percent [7]. *Source*: textbook [7].

Radiation between two surfaces.

$$r_i = q_i - k (T_i^4 - T_j^4) - G_i (T_i - T_{\text{amb}}), \quad r_j = q_j + k (T_i^4 - T_j^4) - G_j (T_j - T_{\text{amb}}).$$

Pattern: custom, two residuals from one closure. *Unknowns*: q_i, q_j, T_i, T_j . *Parameters*: $k = \sigma \epsilon A$ with view factor [W/K⁴], and ambient conductances G_i, G_j [W/K]. *Jacobian*: analytic, $4kT^3$ on each temperature. *Shape*: increasing in the hotter temperature, not convex over both. *Prior*: the emissivity inside k , which depends on the surface's condition. *Source*: `thermo`, `RadiativeCouple2Node`; the law is in [7].

Counterflow exchanger, fixed capacity rates.

$$r = Q - \epsilon C_{\min} (T_{h,\text{in}} - T_{c,\text{in}}), \quad \epsilon = \frac{1 - e}{1 - C_r e}, \quad e = \exp[-\text{NTU}(1 - C_r)],$$

with $\text{NTU} = UA/C_{\min}$, $C_r = C_{\min}/C_{\max}$, and $\epsilon = \text{NTU}/(1 + \text{NTU})$ when $C_r = 1$. *Pattern*: custom. *Parameters*: UA, C_h, C_c [W/K], so ϵ is fixed when the closure is built. *Jacobian*: analytic, constant, $\mp \epsilon C_{\min}$. *Shape*: linear in the inlet temperatures; the product $\epsilon C_{\min}$ increases with UA . *Prior*: UA , for fouling. *Source*: `thermo`, `HeatExchangerEpsNTU`; the effectiveness relation is in [47].

Counterflow exchanger, variable capacity rates. The same residual with C_h and C_c as unknowns, so the exchanger responds to its flows. *Jacobian*: analytic in the temperatures; the capacity entries are differenced inside the closure. *Kinks*: at $C_h = C_c$, where $C_{\min}$ and $C_{\max}$ swap and the effectiveness formula changes. The closure refuses a capacity rate at or below a floor. *Shape*: not evident from the relation. *Source*: `thermo`, `HeatExchangerEpsNTUVariable`.

Cooling tower.

$$r = Q - \epsilon_{\text{eff}}(a) C_{cw} \max(0, T_{cw} - T_{wb}), \quad \epsilon_{\text{eff}}(a) = \epsilon_d \min(1, \max(0, a)),$$

with a the air-flow ratio when it is modeled, and $\epsilon_{\text{eff}} = \epsilon_d$ when it is not. *Pattern*: gradient. *Unknowns*: Q , the water temperature to the tower T_{cw} , the wet-bulb temperature T_{wb} , and a . *Parameters*: C_{cw} [W/K], design effectiveness $\epsilon_d \in [0, 1]$. *Kinks*: at $T_{cw} = T_{wb}$, $a = 0$ and $a = 1$. *Shape*: non-decreasing in both the approach and the air flow. *Prior*: ϵ_d , which is a fit to a manufacturer's curve. *Source*: `thermo`, `CoolingTowerEffectiveness`.

Waterside economizer.

$$r = Q - k \max(0, T_{chw,r} - T_{cw,s}), \quad k = \epsilon C_{\min}.$$

Pattern: property. *Kinks*: at the crossover $T_{chw,r} = T_{cw,s}$, below which the economizer does nothing and the Jacobian is zero. *Shape*: non-decreasing and convex in the temperature difference. *Source*: `datacenter`, condenser loop.

Enthalpy carried by mass; throttle.

$$r = P - \dot{m} h, \quad r = h_{\text{out}} - h_{\text{in}}.$$

Pattern: carrier; custom. *Shape:* bilinear; linear. The throttle is exact: an adiabatic valve conserves enthalpy. *Source:* `thermo`, `enthalpy_advection` and `Throttle`; the duct heater, `make_duct_heater`, is two carrier edges around a node with a source and a loss.

Temperature-dependent load.

$$r = P - P_{\text{base}} - \alpha (T - T_{\text{ref}}).$$

Pattern: property. *Parameters:* α [W/K], T_{ref} [K]; P_{base} may be a schedule. *Shape:* linear. *Prior:* α , a calibrated fan-and-leakage slope. *Source:* `datacenter`, rack load.

D.4 Fluid**Quadratic resistance; damper.**

$$r = (p_i - p_j) - k \dot{m} |\dot{m}| - \epsilon \dot{m}, \quad k(\theta) = k_{\text{open}} / \max(\theta, \theta_{\text{min}})^2.$$

Pattern: gradient. *Unknowns:* $\dot{m}$, p_i , p_j , and the damper position θ . *Parameters:* k [Pa/(kg/s)²]; an optional linear term ϵ . *Jacobian:* analytic, $-2k|\dot{m}| - \epsilon$ in $\dot{m}$, which is zero at no flow unless $\epsilon > 0$; that is what the linear term is for. *Kinks:* the second derivative jumps at $\dot{m} = 0$; the damper kinks at θ_{min} . *Shape:* increasing and odd in $\dot{m}$. *Prior:* k , which is set by fittings nobody measured. *Source:* `thermo`, `FlowResistance` and `DamperResistance`.

Pipe friction.

$$r = (p_i - p_j) - f(\text{Re}, e/D) \frac{L}{D} \frac{\rho v^2}{2}, \quad f = 64/\text{Re} \text{ (laminar)}, \text{ Colebrook (turbulent)}.$$

Pattern: gradient. *Parameters:* length L , diameter D , roughness e , density ρ , viscosity. *Kinks:* at the transition near $\text{Re} \approx 2300$ the friction factor jumps; a smooth blend is the usual remedy. *Shape:* increasing in flow; between linear (laminar) and quadratic (fully rough). *Prior:* the roughness e , which grows with age. *Source:* textbook [109].

Laminar pipe.

$$r = \dot{V} - \frac{\pi D^4}{128 \mu L} (p_i - p_j).$$

Pattern: gradient. *Shape:* linear, the fluid analogue of a conductance. *Prior:* the viscosity μ , through its temperature dependence. *Source:* textbook [109].

Fan or pump curve.

$$r = (p_i - p_j) - (h_0 s^2 - h_2 \dot{m} |\dot{m}|),$$

with p_i and p_j the pressures at the edge's two ends in the plugin's orientation, so that the curve's head is the pressure difference along the edge. *Pattern:* gradient. *Unknowns:* $\dot{m}$, the two pressures, and the speed ratio s . *Parameters:* shutoff head h_0 [Pa], curvature h_2 [Pa/(kg/s)²]. *Jacobian:* analytic, $+2h_2|\dot{m}|$ in $\dot{m}$ and $-2h_0s$ in s . *Kinks:* C^1 at no flow. *Shape:* head decreasing in flow and increasing in speed squared, the affinity laws at fixed curve shape. *Prior:* h_0 and h_2 , which wear moves. *Source:* `thermo`, `FanCurve`.

Fan and pump power.

$$r = P - P_{\text{rated}} (\dot{m}/\dot{m}_{\text{rated}})^3 \quad \text{or} \quad r = P - P_{\text{nom}} u^3.$$

Pattern: property. *Shape:* convex and increasing, the cube law of the affinity relations. *Prior:* the rated power, since the cube law holds only near the design point. *Source:* `thermo`, `pump_work`; `hvac`, fan power.

Valve with a loss coefficient.

$$r = (p_i - p_j) - K(\theta) \frac{\rho v^2}{2}.$$

Pattern: gradient. *Unknowns:* the flow, the pressures, the stem position θ . *Parameters:* the characteristic $K(\theta)$, linear or equal-percentage in the opening. *Kinks:* at full closure, where $K \rightarrow \infty$; a floor on the opening keeps the residual finite. *Shape:* increasing in flow, decreasing in opening. *Source:* textbook [109]; the damper above is the same relation with $K \propto 1/\theta^2$.

Check valve. Two branches: open, $r = (p_i - p_j) - k \dot{m} |\dot{m}|$ with guard $\dot{m} \geq 0$; closed, $r = \dot{m}$ with guard $p_j - p_i \geq 0$. *Pattern:* piecewise. *Kinks:* the branch switch is the whole point. *Shape:* monotone. The regime loop settles it in one or two passes; the probabilistic model weighs the two branches when the pressure difference is uncertain (§7.2). *Source:* textbook; any valve in [109] with a one-way guard.

Isothermal gas pipe.

$$r = (p_i^2 - p_j^2) - K \dot{m} |\dot{m}|.$$

Pattern: gradient, with the square of pressure as the potential. *Parameters:* K , from length, diameter, friction factor, temperature and the gas constant. *Kinks:* C^1 at no flow. *Shape:* increasing in flow. The squared potential makes the relation linear in p^2 for a fixed flow, which is why gas networks are usually solved in p^2 . *Prior:* the friction factor inside K . *Source:* textbook [109].

Ideal-gas mass flow.

$$r = \dot{m} - \frac{p}{RT} \dot{V}.$$

Pattern: property, with the density fixed when the closure is built. *Shape:* linear in $\dot{V}$. *Prior:* the volume flow, which the code's own documentation suggests pinning or giving a prior. *Source:* `thermo`, `ideal_gas_mass_flow`.

Mixing of two streams.

$$r = T_{\text{mix}} - f T_{oa} - (1 - f) T_{ra}, \quad r = \dot{m}_{oa} - f \dot{m}_{\text{supply}}.$$

Pattern: property. *Shape:* bilinear in the fraction f and the temperatures. *Prior:* f , the outdoor-air fraction, which dampers set and few sensors report; a carbon-dioxide balance on the zone, $G = (\dot{m}_{oa}/\rho)(C_{\text{zone}} - C_{oa})$, makes it identifiable. *Source:* `hvac`, mixed-air closures.

D.5 Moist air

Humidity ratio and moist-air enthalpy.

$$W = 0.62198 \frac{p_w}{p - p_w}, \quad h = 1006 t + W (2.501 \times 10^6 + 1860 t),$$

with t in degrees Celsius and the saturation pressure from the Magnus form

$$p_{ws} = 0.61094 \exp \left[\frac{17.625 t}{t + 243.04} \right] \text{ kPa.}$$

Pattern: property, when written as closures. *Shape:* increasing in p_w and in t . *Source:* **thermo**, the functions of **psychro**, which the plugins call inside other closures; the relations are in [4].

Coil condensation.

$$r = \dot{m}_{\text{cond}} - \dot{m}_{\text{air}} (1 - \text{BF}) \max(0, W_{\text{zone}} - W_{\text{adp}}),$$

with W_{adp} the saturated humidity ratio at the coil's apparatus dew point, the chilled-water temperature plus an approach. The latent duty is $\dot{m}_{\text{cond}}$ times the heat of vaporization. *Pattern:* property. *Parameters:* bypass factor BF, approach [K]. *Jacobian:* differenced. *Kinks:* at $W_{\text{zone}} = W_{\text{adp}}$, where the coil starts to condense. *Shape:* non-decreasing in the zone's humidity. *Prior:* the bypass factor. *Source:* **datacenter**, the CRAH zone.

Moisture carried by mass.

$$r = \dot{m}_w - \dot{m} W.$$

Pattern: carrier. *Source:* **thermo**, **moisture_advection**.

D.6 Electrical

DC branch.

$$r = F - b (\theta_i - \theta_j), \quad b = 1/X.$$

Pattern: gradient. *Parameters:* the susceptance b [p.u.]. *Jacobian:* analytic, $\mp b$. *Shape:* linear. *Prior:* b for a line whose impedance is in doubt; more often none, since the DC model's error is structural. *Source:* **electrical**, **dc_branch**; the approximation is [97].

AC branch in polar form. With $\delta = \theta_i - \theta_j$, series admittance $G + jB = 1/(R + jX)$, half line charging B_{sh} and tap t , the four end flows are

$$\begin{aligned} P_{\text{from}} &= V_i^2 G / t^2 - V_i V_j (G \cos \delta + B \sin \delta) / t, \\ Q_{\text{from}} &= -V_i^2 (B + B_{sh}) / t^2 - V_i V_j (G \sin \delta - B \cos \delta) / t, \\ P_{\text{to}} &= V_j^2 G - V_i V_j (G \cos \delta - B \sin \delta) / t, \\ Q_{\text{to}} &= -V_j^2 (B + B_{sh}) + V_i V_j (G \sin \delta + B \cos \delta) / t, \end{aligned}$$

and each closure is $r = F - (1 + f) F(V, \theta)$ for its flow. *Pattern:* custom. *Unknowns:* the flow, both voltages and angles, and an optional latent admittance shift f . *Jacobian:* analytic; every partial is scaled by $1 + f$, and $\partial r / \partial f = -F$. *Shape:* trigonometric, neither monotone nor convex. *Prior:* f , a latent fault of the kind of Chapter 3, zero-mean with a small width. *Source:* **electrical**, **ACBranchPolar**; the equations are in [110]. Each line meets its two buses through a midpoint node that absorbs the loss $P_{\text{from}} + P_{\text{to}}$.

Transformer with a tap. The AC branch with $t \neq 1$. It carries no latent fault in the current plugin. *Source:* `electrical`, `transformer_polar`; `power_flow`, `attach_ac_line` with a tap.

Slack and voltage-controlled buses. These are pins, not closures: $r = \theta - 0$ and $r = V - V_{\text{set}}$ at the slack, $r = V - V_{\text{set}}$ at a voltage-controlled bus. The generator's injections are free flows from a reservoir, closed by the bus balances alone. A pinned variable stays in the list of unknowns, so a study can observe it or put a prior on it. *Source:* `electrical`, `bus_residuals`; `power_flow`, `attach_bus`.

Reactive limits of a generator. An outer loop, not a closure. After a solve, a voltage-controlled bus whose generator exceeds its reactive band is rewritten as a load bus with the reactive output held at the violated limit, and the model is solved once more. There is one such pass, and no return to voltage control. *Kinks:* the switch is a kink in every quantity downstream. *Source:* `power_flow`, `solve_with_q_limits`.

Transformer loss.

$$r = L - L_0 - L_{cu} \frac{(\sum g)^2}{S^2}.$$

Pattern: property. *Parameters:* no-load loss L_0 , copper loss at rating L_{cu} , rating S [kW]. *Shape:* convex in the load $\sum g$. *Prior:* L_{cu} , a calibrated coefficient. *Source:* `facility`, `TransformerLoss`.

UPS loss.

$$r = L - \ell_f \sum g - \ell_q \frac{(\sum g)^2}{S} - L_0.$$

Pattern: property. *Shape:* convex. *Prior:* the coefficients ℓ_f , ℓ_q , calibrated to an efficiency curve. *Source:* `facility`, `UpsLoss`.

PDU loss.

$$r = L - L_0 - p \sum g.$$

Pattern: property. *Shape:* linear. *Source:* `facility`, `PduLoss`.

Fixed share of a flow.

$$r = s_{\text{ref}} F - s_F F_{\text{ref}}.$$

Pattern: custom. *Shape:* linear. Written without dividing by s_{ref} , so the residual is well defined for any share. *Source:* `facility`, `SplitShare`.

Generator fuel curve.

$$r = \dot{V}_{\text{fuel}} - (a + b\lambda)g,$$

with λ the load fraction and $g \in \{0, 1\}$ the run state. *Pattern:* property. *Shape:* affine and non-decreasing in λ . *Kinks:* the start and stop are held outside the solver: g is set per segment by a switching driver, so each solve sees a smooth relation. *Source:* `facility`, `GensetFuelCurve`.

D.7 Storage and electrochemistry

Battery energy with efficiencies.

$$\frac{dE}{dt} = \eta_c P_c - P_d / \eta_d, \quad L = (1 - \eta_c) P_c + (1 / \eta_d - 1) P_d, \quad \text{SoC} = E / E_{\text{cap}}.$$

Pattern: a storage node for the energy, with property closures for the loss and the state of charge.

Parameters: the efficiencies η_c , η_d , and the capacity. *Shape:* linear. A steady solve must pin the energy or the state of charge, since a storage node in steady state has no row of its own (§16.1).

Prior: the efficiencies. *Source:* `battery_storage`, `attach_battery_pack`. The plugin's pack is this bookkeeping model; it has no voltage curve and no internal resistance.

Signed power port.

$$P_c = \max(-s, 0), \quad P_d = \max(s, 0).$$

Pattern: property. *Kinks:* at $s = 0$. The kink is harmless only because the setpoint s is pinned and never a Newton unknown; if a study makes s uncertain, this closure is where the Laplace approximation fails. *Source:* `battery_storage`, power port.

Equivalent-circuit battery.

$$r = V - \text{OCV}(\text{SoC}) + R_0 I,$$

with further resistor–capacitor pairs for the slow voltage response. *Pattern:* property. *Unknowns:* terminal voltage, current, state of charge. *Parameters:* the open-circuit voltage curve, the series resistance R_0 . *Shape:* OCV increasing in the state of charge, flat in the middle of the range, which makes the state of charge weakly identifiable from voltage there. *Prior:* R_0 and the capacity, both of which age. *Source:* textbook [82]; not in the plugin.

State of health.

$$\frac{dD}{dt} = \dot{a}, \quad \text{SoH} = \text{SoH}_0 - D, \quad C_{\text{eff}} = C_{\text{nom}} \text{SoH},$$

with an aging rate $\dot{a}$ from throughput or from an Arrhenius calendar law,

$$\dot{a} = \dot{a}_{\text{ref}} \exp \left[\frac{E_a}{R} \left(\frac{1}{T_{\text{ref}}} - \frac{1}{T} \right) \right].$$

Pattern: a storage node for the accumulated damage D , with property closures. *Shape:* linear in D ; the capacity relation is bilinear. *Prior:* the reference rate $\dot{a}_{\text{ref}}$, the least known number in battery aging. *Source:* `battery_storage`, `attach_soh_evolution`.

D.8 Plant equipment

Chiller power from load.

$$r = P - \frac{Q}{\text{COP}}, \quad \text{COP} = \max(\text{COP}_{\text{min}}, \text{COP}_{\text{pk}} - c(x - x_{\text{opt}})^2),$$

with x the load per running unit as a fraction of one unit's capacity, and $P = 0$ at no load. *Pattern*: property. *Jacobian*: differenced. *Kinks*: at zero load, at the COP floor, and wherever the stage count changes, since the stage enters through rounding. *Shape*: increasing in load at fixed stage for the default curve. A condenser-loop variant also derates the COP linearly with the condenser-water temperature. *Prior*: the peak COP and the curvature, fitted to a part-load curve. *Source*: `datacenter`, `ChillerBankPowerClosure` and the condenser loop.

Chiller staging. A piecewise closure with one branch per stage, $r = \text{stage} - k$. Stage k is admissible between $(k-1)$ units at their stage-down fraction and k units at their stage-up fraction, 0.70 and 0.90 of capacity by default. *Kinks*: every stage change. *Shape*: the admissible bands of neighbouring stages overlap, and since the current stage is kept while admissible, the overlap is a deadband that stops the plant from cycling. *Source*: `datacenter`, `ChillerBankStageClosure`.

Thermal storage mode. A piecewise closure with branches charge, hold and discharge, $r = \text{mode} - m$ with $m \in \{+1, 0, -1\}$. Guards combine the plant load with the tank's state of charge: charge below a load threshold while the tank is not full, discharge above another while it is not empty, hold otherwise. *Kinks*: every mode change. *Source*: `datacenter`, `TesModeClosure`.

Bibliography

- [1] Ali Abur and Antonio Gomez Exposito. *Power System State Estimation: Theory and Implementation*. Marcel Dekker, 2004.
- [2] Athanasios C. Antoulas. *Approximation of Large-Scale Dynamical Systems*. SIAM, Philadelphia, 2005.
- [3] Stefan Arnborg, Derek G. Corneil, and Andrzej Proskurowski. Complexity of finding embeddings in a k -tree. *SIAM Journal on Algebraic and Discrete Methods*, 8(2):277–284, 1987.
- [4] ASHRAE. *ASHRAE Handbook—Fundamentals*. ASHRAE, Atlanta, 2021.
- [5] Douglas M. Bates and Donald G. Watts. Relative curvature measures of nonlinearity. *Journal of the Royal Statistical Society, Series B*, 42(1):1–16, 1980. doi: 10.1111/j.2517-6161.1980.tb01094.x.
- [6] Albert Benveniste, Benoît Caillaud, and Mathias Malandain. The mathematical foundations of physical systems modeling languages. *Annual Reviews in Control*, 50:72–118, 2020.
- [7] Theodore L. Bergman, Adrienne S. Lavine, Frank P. Incropera, and David P. DeWitt. *Fundamentals of Heat and Mass Transfer*. Wiley, 7th edition, 2011.
- [8] Julian Besag. Spatial interaction and the statistical analysis of lattice systems. *Journal of the Royal Statistical Society: Series B (Methodological)*, 36(2):192–236, 1974.
- [9] Roy Billinton and Ronald N. Allan. *Reliability Evaluation of Power Systems*. Plenum Press, New York, 2nd edition, 1996.
- [10] Christopher M. Bishop. *Pattern Recognition and Machine Learning*. Springer, 2006.
- [11] José Luis Blanco-Claraco, Antonio Leanza, and Giulio Reina. A general framework for modeling and dynamic simulation of multibody systems using factor graphs. *Nonlinear Dynamics*, 105(3):2031–2053, 2021.
- [12] Stephen Boyd and Lieven Vandenberghe. *Convex Optimization*. Cambridge University Press, 2004.
- [13] K. E. Brenan, S. L. Campbell, and L. R. Petzold. *Numerical Solution of Initial-Value Problems in Differential-Algebraic Equations*. SIAM, 1996.
- [14] Kathryn Chaloner and Isabella Verdinelli. Bayesian experimental design: A review. *Statistical Science*, 10(3):273–304, 1995.

- [15] Phani Chavali and Arye Nehorai. Distributed power system state estimation using factor graphs. *IEEE Transactions on Signal Processing*, 63(11):2864–2876, 2015.
- [16] Roy R. Craig and Mervyn C. C. Bampton. Coupling of substructures for dynamic analyses. *AIAA Journal*, 6(7):1313–1319, 1968.
- [17] Timothy A. Davis. *Direct Methods for Sparse Linear Systems*. SIAM, 2006.
- [18] Johan de Kleer and Brian C. Williams. Diagnosing multiple faults. *Artificial Intelligence*, 32(1):97–130, 1987. doi: 10.1016/0004-3702(87)90063-4.
- [19] Frank Dellaert and Michael Kaess. Factor graphs for robot perception. *Foundations and Trends in Robotics*, 6(1–2):1–139, 2017.
- [20] Florian Dörfler and Francesco Bullo. Kron reduction of graphs with applications to electrical networks. *IEEE Transactions on Circuits and Systems I: Regular Papers*, 60(1):150–163, 2013.
- [21] Iain S. Duff, Albert M. Erisman, and John K. Reid. *Direct Methods for Sparse Matrices*. Oxford University Press, 2nd edition, 2017.
- [22] A. L. Dulmage and N. S. Mendelsohn. Coverings of bipartite graphs. *Canadian Journal of Mathematics*, 10:517–534, 1958.
- [23] A. M. Erisman and W. F. Tinney. On computing certain elements of the inverse of a sparse matrix. *Communications of the ACM*, 18(3):177–179, 1975.
- [24] Lawrence C. Evans and Ronald F. Gariepy. *Measure Theory and Fine Properties of Functions*. CRC Press, 1992.
- [25] Herbert Federer. *Geometric Measure Theory*. Springer, 1969.
- [26] Miroslav Fiedler. Algebraic connectivity of graphs. *Czechoslovak Mathematical Journal*, 23(2):298–305, 1973.
- [27] Alan George. Nested dissection of a regular finite element mesh. *SIAM Journal on Numerical Analysis*, 10(2):345–363, 1973.
- [28] Claudio Gomes, Casper Thule, David Broman, Peter Gorm Larsen, and Hans Vangheluwe. Co-simulation: A survey. *ACM Computing Surveys*, 51(3):1–33, 2018.
- [29] J. M. Gordon and K. C. Ng. Predictive and diagnostic aspects of a universal thermodynamic model for chillers. *International Journal of Heat and Mass Transfer*, 38(5):807–818, 1995. doi: 10.1016/0017-9310(94)00208-D.
- [30] N. J. Gordon, D. J. Salmond, and A. F. M. Smith. Novel approach to nonlinear/non-Gaussian Bayesian state estimation. *IEE Proceedings F: Radar and Signal Processing*, 140(2):107–113, 1993.
- [31] Teoman Guler, George Gross, and Minghai Liu. Generalized line outage distribution factors. *IEEE Transactions on Power Systems*, 22(2):879–881, 2007.

- [32] Kjell Gustafsson, Michael Lundh, and Gustaf Söderlind. A PI stepsize control for the numerical solution of ordinary differential equations. *BIT Numerical Mathematics*, 28(2):270–287, 1988.
- [33] Robert J. Guyan. Reduction of stiffness and mass matrices. *AIAA Journal*, 3(2):380, 1965.
- [34] William W. Hager. Updating the inverse of a matrix. *SIAM Review*, 31(2):221–239, 1989.
- [35] Ernst Hairer and Gerhard Wanner. *Solving Ordinary Differential Equations II: Stiff and Differential-Algebraic Problems*. Springer, 2nd edition, 1996.
- [36] Qing Han, Ronald T. Eguchi, Sharad Mehrotra, and Nalini Venkatasubramanian. Enabling state estimation for fault identification in water distribution systems under large disasters. In *Proceedings of the 37th IEEE Symposium on Reliable Distributed Systems*, pages 161–170, 2018.
- [37] Nicholas J. Higham. *Accuracy and Stability of Numerical Algorithms*. SIAM, 2nd edition, 2002.
- [38] IEEE Power and Energy Society. IEEE standard for calculating the current-temperature relationship of bare overhead conductors. Technical Report IEEE Std 738-2012, IEEE, 2013.
- [39] Paul Irofti, Luis Romero-Ben, Florin Stoican, and Vicenç Puig. Factor graph optimization for leak localization in water distribution networks. arXiv:2509.10982, 2025.
- [40] Simon J. Julier and Jeffrey K. Uhlmann. A non-divergent estimation algorithm in the presence of unknown correlations. In *Proceedings of the American Control Conference*, volume 4, pages 2369–2373, 1997.
- [41] Jari Kaipio and Erkki Somersalo. *Statistical and Computational Inverse Problems*. Springer, 2005.
- [42] R. E. Kalman. A new approach to linear filtering and prediction problems. *Journal of Basic Engineering*, 82(1):35–45, 1960.
- [43] Dean C. Karnopp and Ronald C. Rosenberg. *Analysis and Simulation of Multiport Systems: The Bond Graph Approach to Physical System Dynamics*. MIT Press, Cambridge, MA, 1968.
- [44] George Karypis and Vipin Kumar. A fast and high quality multilevel scheme for partitioning irregular graphs. *SIAM Journal on Scientific Computing*, 20(1):359–392, 1998.
- [45] Robert E. Kass and Adrian E. Raftery. Bayes factors. *Journal of the American Statistical Association*, 90(430):773–795, 1995.
- [46] Srinivas Katipamula and Michael R. Brambley. Methods for fault detection, diagnostics, and prognostics for building systems — a review, Part I. *HVAC&R Research*, 11(1):3–25, 2005. doi: 10.1080/10789669.2005.10391123.
- [47] William M. Kays and Alexander L. London. *Compact Heat Exchangers*. McGraw-Hill, 3rd edition, 1984.

- [48] J. E. Kelley. The cutting-plane method for solving convex programs. *Journal of the Society for Industrial and Applied Mathematics*, 8(4):703–712, 1960.
- [49] Brian W. Kernighan and Shen Lin. An efficient heuristic procedure for partitioning graphs. *Bell System Technical Journal*, 49(2):291–307, 1970.
- [50] Daphne Koller and Nir Friedman. *Probabilistic Graphical Models: Principles and Techniques*. MIT Press, 2009.
- [51] Augustine Kong, Jun S. Liu, and Wing Hung Wong. Sequential imputations and Bayesian missing data problems. *Journal of the American Statistical Association*, 89(425):278–288, 1994. doi: 10.1080/01621459.1994.10476469.
- [52] Andreas Krause, Ajit Singh, and Carlos Guestrin. Near-optimal sensor placements in Gaussian processes: theory, efficient algorithms and empirical studies. *Journal of Machine Learning Research*, 9:235–284, 2008.
- [53] Gabriel Kron. *Tensor Analysis of Networks*. Wiley, New York, 1939.
- [54] Frank R. Kschischang, Brendan J. Frey, and Hans-Andrea Loeliger. Factor graphs and the sum-product algorithm. *IEEE Transactions on Information Theory*, 47(2):498–519, 2001.
- [55] Steffen L. Lauritzen. Propagation of probabilities, means, and variances in mixed graphical association models. *Journal of the American Statistical Association*, 87(420):1098–1108, 1992.
- [56] Steffen L. Lauritzen. *Graphical Models*. Oxford University Press, 1996.
- [57] Steffen L. Lauritzen and David J. Spiegelhalter. Local computations with probabilities on graphical structures and their application to expert systems. *Journal of the Royal Statistical Society: Series B (Methodological)*, 50(2):157–224, 1988.
- [58] Steffen L. Lauritzen and Nanny Wermuth. Graphical models for associations between variables, some of which are qualitative and some quantitative. *Annals of Statistics*, 17(1): 31–57, 1989.
- [59] Dennis V. Lindley. On a measure of the information provided by an experiment. *Annals of Mathematical Statistics*, 27(4):986–1005, 1956.
- [60] Richard J. Lipton and Robert Endre Tarjan. A separator theorem for planar graphs. *SIAM Journal on Applied Mathematics*, 36(2):177–189, 1979.
- [61] Jun S. Liu and Rong Chen. Sequential Monte Carlo methods for dynamic systems. *Journal of the American Statistical Association*, 93(443):1032–1044, 1998. doi: 10.1080/01621459.1998.10473765.
- [62] C. H. Lo, Y. K. Wong, and A. B. Rad. Bond graph based Bayesian network for fault diagnosis. *Applied Soft Computing*, 11(1):1208–1212, 2011.
- [63] Hans-Andrea Loeliger. An introduction to factor graphs. *IEEE Signal Processing Magazine*, 21(1):28–41, 2004.

- [64] David J. C. MacKay. *Information Theory, Inference, and Learning Algorithms*. Cambridge University Press, 2003.
- [65] Richard S. H. Mah, Gregory M. Stanley, and Dennis M. Downing. Reconciliation and rectification of process flow and inventory data. *Industrial & Engineering Chemistry Process Design and Development*, 15(1):175–183, 1976.
- [66] Dmitry M. Malioutov, Jason K. Johnson, and Alan S. Willsky. Walk-sums and belief propagation in Gaussian graphical models. *Journal of Machine Learning Research*, 7: 2031–2064, 2006.
- [67] Albert W. Marshall and Ingram Olkin. A multivariate exponential distribution. *Journal of the American Statistical Association*, 62(317):30–44, 1967.
- [68] Geoffrey McLachlan and David Peel. *Finite Mixture Models*. Wiley Series in Probability and Statistics. Wiley, New York, 2000. doi: 10.1002/0471721182.
- [69] Mihajlo D. Mesarović, D. Macko, and Yasuhiko Takahara. *Theory of Hierarchical, Multilevel, Systems*. Academic Press, New York, 1970.
- [70] Gary L. Miller, Shang-Hua Teng, William Thurston, and Stephen A. Vavasis. Geometric separators for finite-element meshes. *SIAM Journal on Scientific Computing*, 19(2):364–386, 1998.
- [71] Thomas P. Minka. Expectation propagation for approximate Bayesian inference. In *Proceedings of the 17th Conference on Uncertainty in Artificial Intelligence*, pages 362–369, 2001.
- [72] Modelica Association. Modelica: A unified object-oriented language for systems modeling. language specification, version 3.6. <https://specification.modelica.org>, 2023.
- [73] Alcir Monticelli. *State Estimation in Electric Power Systems: A Generalized Approach*. Kluwer Academic, Boston, 1999.
- [74] Justin Moore, Jeffrey S. Chase, and Parthasarathy Ranganathan. Weatherman: Automated, online and predictive thermal mapping and management for data centers. In *Proceedings of the 3rd IEEE International Conference on Autonomic Computing (ICAC)*, pages 155–164, Dublin, Ireland, 2006.
- [75] Jorge Nocedal and Stephen J. Wright. *Numerical Optimization*. Springer, 2nd edition, 2006.
- [76] George Oster, Alan Perelson, and Aharon Katchalsky. Network thermodynamics. *Nature*, 234:393–399, 1971.
- [77] Art B. Owen. Sobol’ indices and Shapley value. *SIAM/ASA Journal on Uncertainty Quantification*, 2(1):245–251, 2014.
- [78] Constantinos C. Pantelides. The consistent initialization of differential-algebraic systems. *SIAM Journal on Scientific and Statistical Computing*, 9(2):213–231, 1988.

- [79] Henry M. Paynter. *Analysis and Design of Engineering Systems*. MIT Press, Cambridge, MA, 1961.
- [80] Judea Pearl. *Causality: Models, Reasoning, and Inference*. Cambridge University Press, 2nd edition, 2009.
- [81] Jonas Peters, Dominik Janzing, and Bernhard Schölkopf. *Elements of Causal Inference: Foundations and Learning Algorithms*. MIT Press, 2017.
- [82] Gregory L. Plett. *Battery Management Systems, Volume I: Battery Modeling*. Artech House, 2015.
- [83] Alex Pothén, Horst D. Simon, and Kang-Pu Liou. Partitioning sparse matrices with eigenvectors of graphs. *SIAM Journal on Matrix Analysis and Applications*, 11(3):430–452, 1990.
- [84] H. E. Rauch, F. Tung, and C. T. Striebel. Maximum likelihood estimates of linear dynamic systems. *AIAA Journal*, 3(8):1445–1450, 1965.
- [85] Christian P. Robert and George Casella. *Monte Carlo Statistical Methods*. Springer, 2nd edition, 2004.
- [86] R. Tyrrell Rockafellar and Stanislav Uryasev. Optimization of conditional value-at-risk. *Journal of Risk*, 2(3):21–41, 2000.
- [87] Donald J. Rose, R. Endre Tarjan, and George S. Lueker. Algorithmic aspects of vertex elimination on graphs. *SIAM Journal on Computing*, 5(2):266–283, 1976.
- [88] Håvard Rue and Leonhard Held. *Gaussian Markov Random Fields: Theory and Applications*. Chapman and Hall/CRC, 2005.
- [89] Håvard Rue, Sara Martino, and Nicolas Chopin. Approximate Bayesian inference for latent Gaussian models by using integrated nested Laplace approximations. *Journal of the Royal Statistical Society, Series B*, 71(2):319–392, 2009. doi: 10.1111/j.1467-9868.2008.00700.x.
- [90] Andrea Saltelli. Making best use of model evaluations to compute sensitivity indices. *Computer Physics Communications*, 145(2):280–297, 2002.
- [91] Simo Särkkä and Lennart Svensson. *Bayesian Filtering and Smoothing*. Cambridge University Press, 2nd edition, 2023.
- [92] Fred C. Schweppe and J. Wildes. Power system static-state estimation, part I: Exact model. *IEEE Transactions on Power Apparatus and Systems*, PAS-89(1):120–125, 1970.
- [93] Ori Shental, Paul H. Siegel, Jack K. Wolf, Danny Bickson, and Danny Dolev. Gaussian belief propagation solver for systems of linear equations. In *Proceedings of the IEEE International Symposium on Information Theory*, pages 1863–1867, 2008.
- [94] Chris Snyder, Thomas Bengtsson, Peter Bickel, and Jeffrey Anderson. Obstacles to high-dimensional particle filtering. *Monthly Weather Review*, 136(12):4629–4640, 2008. doi: 10.1175/2008MWR2529.1.

- [95] Ilya M. Sobol'. Global sensitivity indices for nonlinear mathematical models and their Monte Carlo estimates. *Mathematics and Computers in Simulation*, 55(1–3):271–280, 2001.
- [96] Eunhye Song, Barry L. Nelson, and Jeremy Staum. Shapley effects for global sensitivity analysis: Theory and computation. *SIAM/ASA Journal on Uncertainty Quantification*, 4(1):1060–1083, 2016.
- [97] Brian Stott, Jorge Jardim, and Ongun Alsac. DC power flow revisited. *IEEE Transactions on Power Systems*, 24(3):1290–1300, 2009.
- [98] Andrew M. Stuart. Inverse problems: A Bayesian perspective. *Acta Numerica*, 19:451–559, 2010.
- [99] Kaarthik Sundar, Carleton Coffrin, Harsha Nagarajan, and Russell Bent. Probabilistic N-k failure-identification for power systems. *Networks*, 71(3):302–321, 2018.
- [100] Kaarthik Sundar, Andrew Mastin, Manuel Garcia, Russell Bent, and Jean-Paul Watson. Exact and heuristic approaches for the stochastic N - k interdiction in power grids. arXiv:2402.00217, 2024.
- [101] Luke Tierney and Joseph B. Kadane. Accurate approximations for posterior moments and marginal densities. *Journal of the American Statistical Association*, 81(393):82–86, 1986.
- [102] William F. Tinney and John W. Walker. Direct solutions of sparse network equations by optimally ordered triangular factorization. *Proceedings of the IEEE*, 55(11):1801–1809, 1967.
- [103] Andrea Toselli and Olof Widlund. *Domain Decomposition Methods: Algorithms and Theory*. Springer, 2005.
- [104] Arjan J. van der Schaft and Bernhard M. Maschke. Port-Hamiltonian systems on graphs. *SIAM Journal on Control and Optimization*, 51(2):906–937, 2013.
- [105] Arman Vassighi and Manoj Sachdev. Thermal runaway in integrated circuits. *IEEE Transactions on Device and Materials Reliability*, 6(2):300–305, 2006. doi: 10.1109/TDMR.2006.876577.
- [106] Martin J. Wainwright and Michael I. Jordan. Graphical models, exponential families, and variational inference. *Foundations and Trends in Machine Learning*, 1(1–2):1–305, 2008.
- [107] J. B. Ward. Equivalent circuits for power-flow studies. *Transactions of the American Institute of Electrical Engineers*, 68(1):373–382, 1949.
- [108] Yair Weiss and William T. Freeman. Correctness of belief propagation in Gaussian graphical models of arbitrary topology. *Neural Computation*, 13(10):2173–2200, 2001.
- [109] Frank M. White. *Fluid Mechanics*. McGraw-Hill Education, 8th edition, 2016.
- [110] Allen J. Wood, Bruce F. Wollenberg, and Gerald B. Sheblé. *Power Generation, Operation, and Control*. Wiley, 3rd edition, 2013.
- [111] Mihalis Yannakakis. Computing the minimum fill-in is NP-complete. *SIAM Journal on Algebraic and Discrete Methods*, 2(1):77–79, 1981.